


Overview of Monitoring Requirements for Lead/Copper* (Medium and Small Systems)

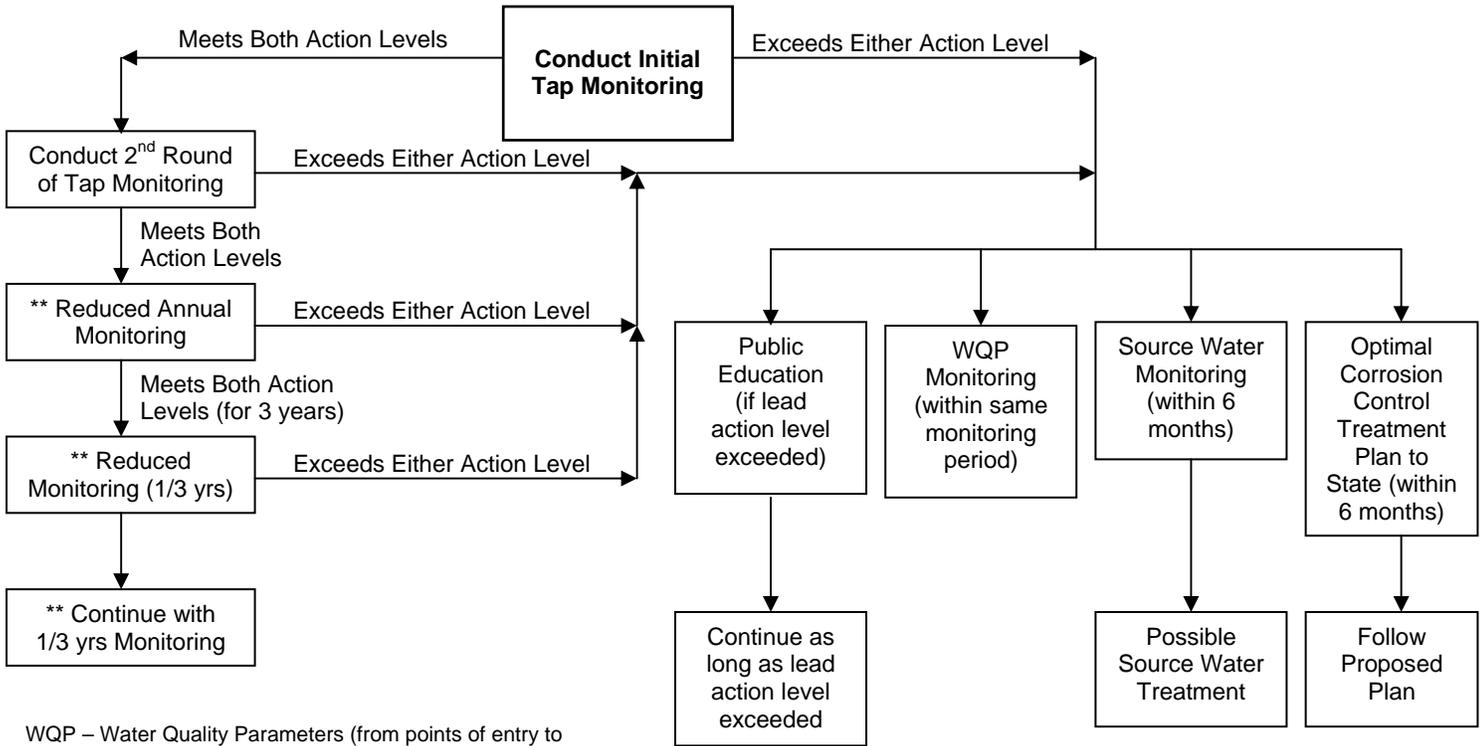

WQP – Water Quality Parameters (from points of entry to distribution system and from points in distribution system)

* Supplies should contact their MDNRE district office for further details about specific requirements under each phase of the regulations.

** Must be done during June, July, August, or September.