


# Residential Water Sampling Results - Copper

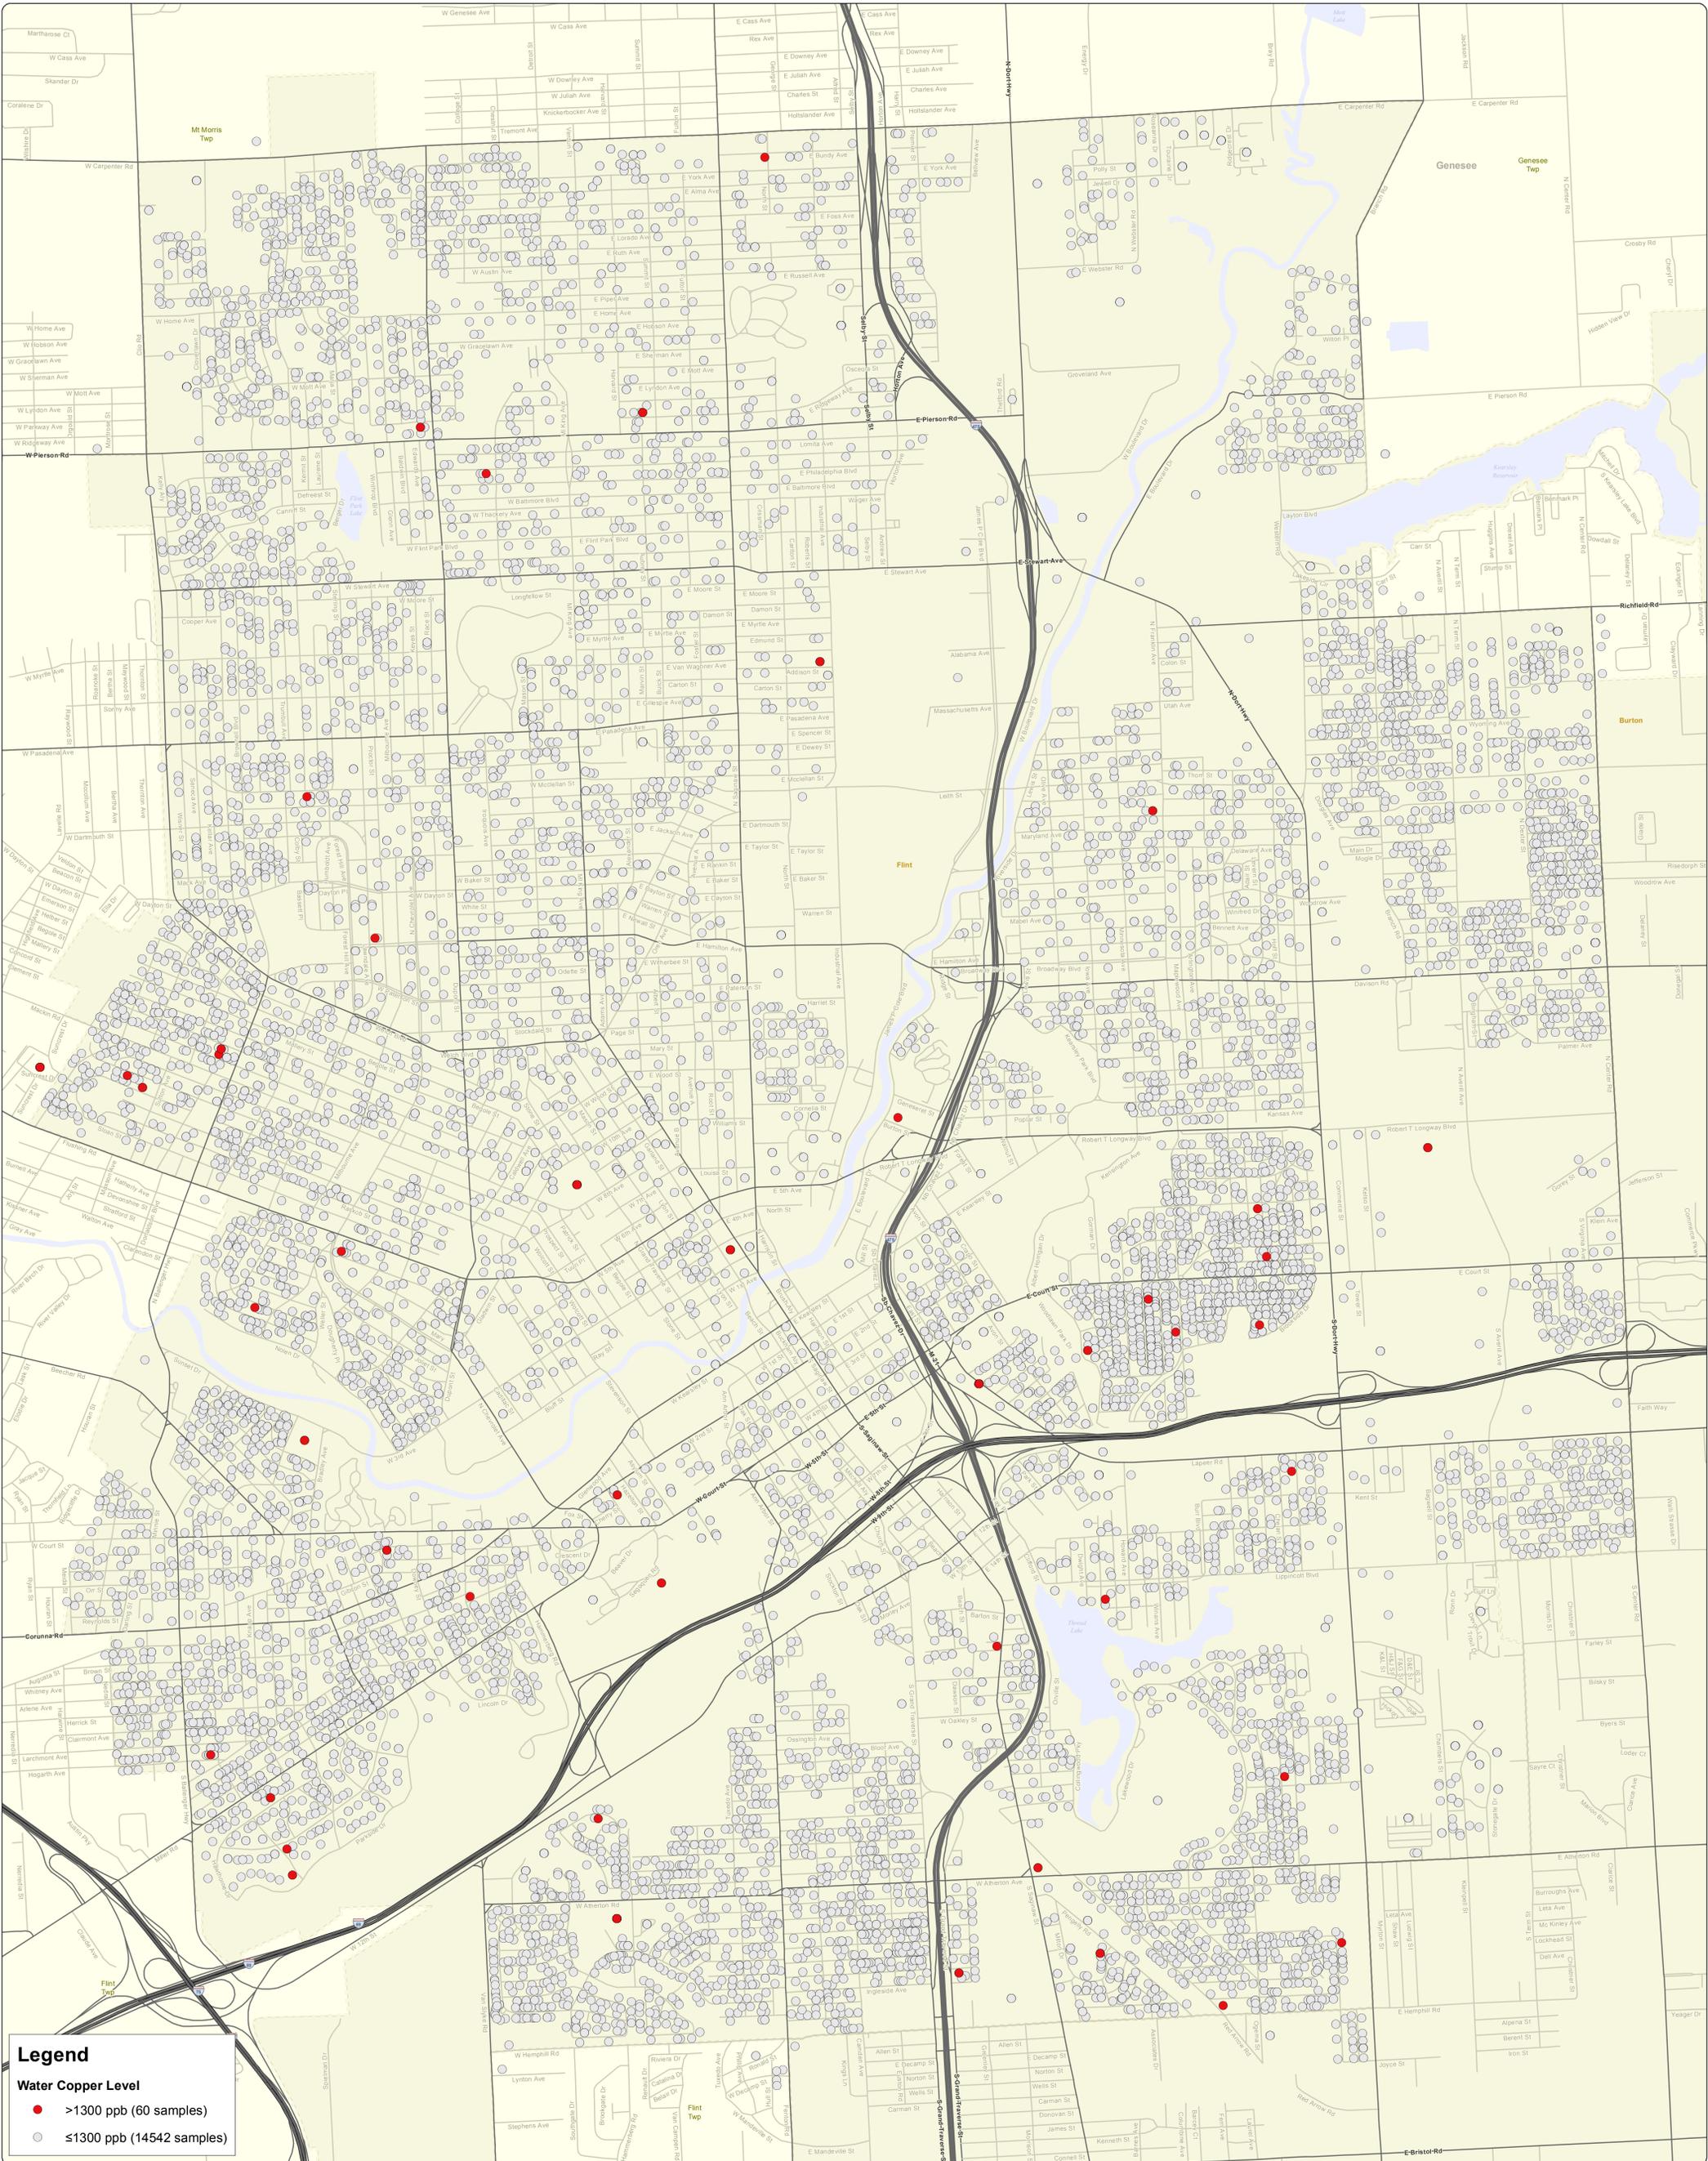

**Legend**

**Water Copper Level**

- >1300 ppb (60 samples)
- ≤1300 ppb (14542 samples)



Michigan State Police  
Emergency Management and  
Homeland Security Division

Miles 0 0.75 1.5

This information is being provided by the City of Flint, Michigan State Police, Emergency Management and Homeland Security Division (MSP/EMHSD). The MSP/EMHSD assumes no responsibility for the completeness or accuracy of the data displayed on the map. Data layers were compiled from various sources and are not to be construed as a "legal description".



Author: msp-seocgis@michigan.gov, (A111)  
Created: 11:38 AM, 10 Mar 16