


Residential Water Sampling Results - Lead

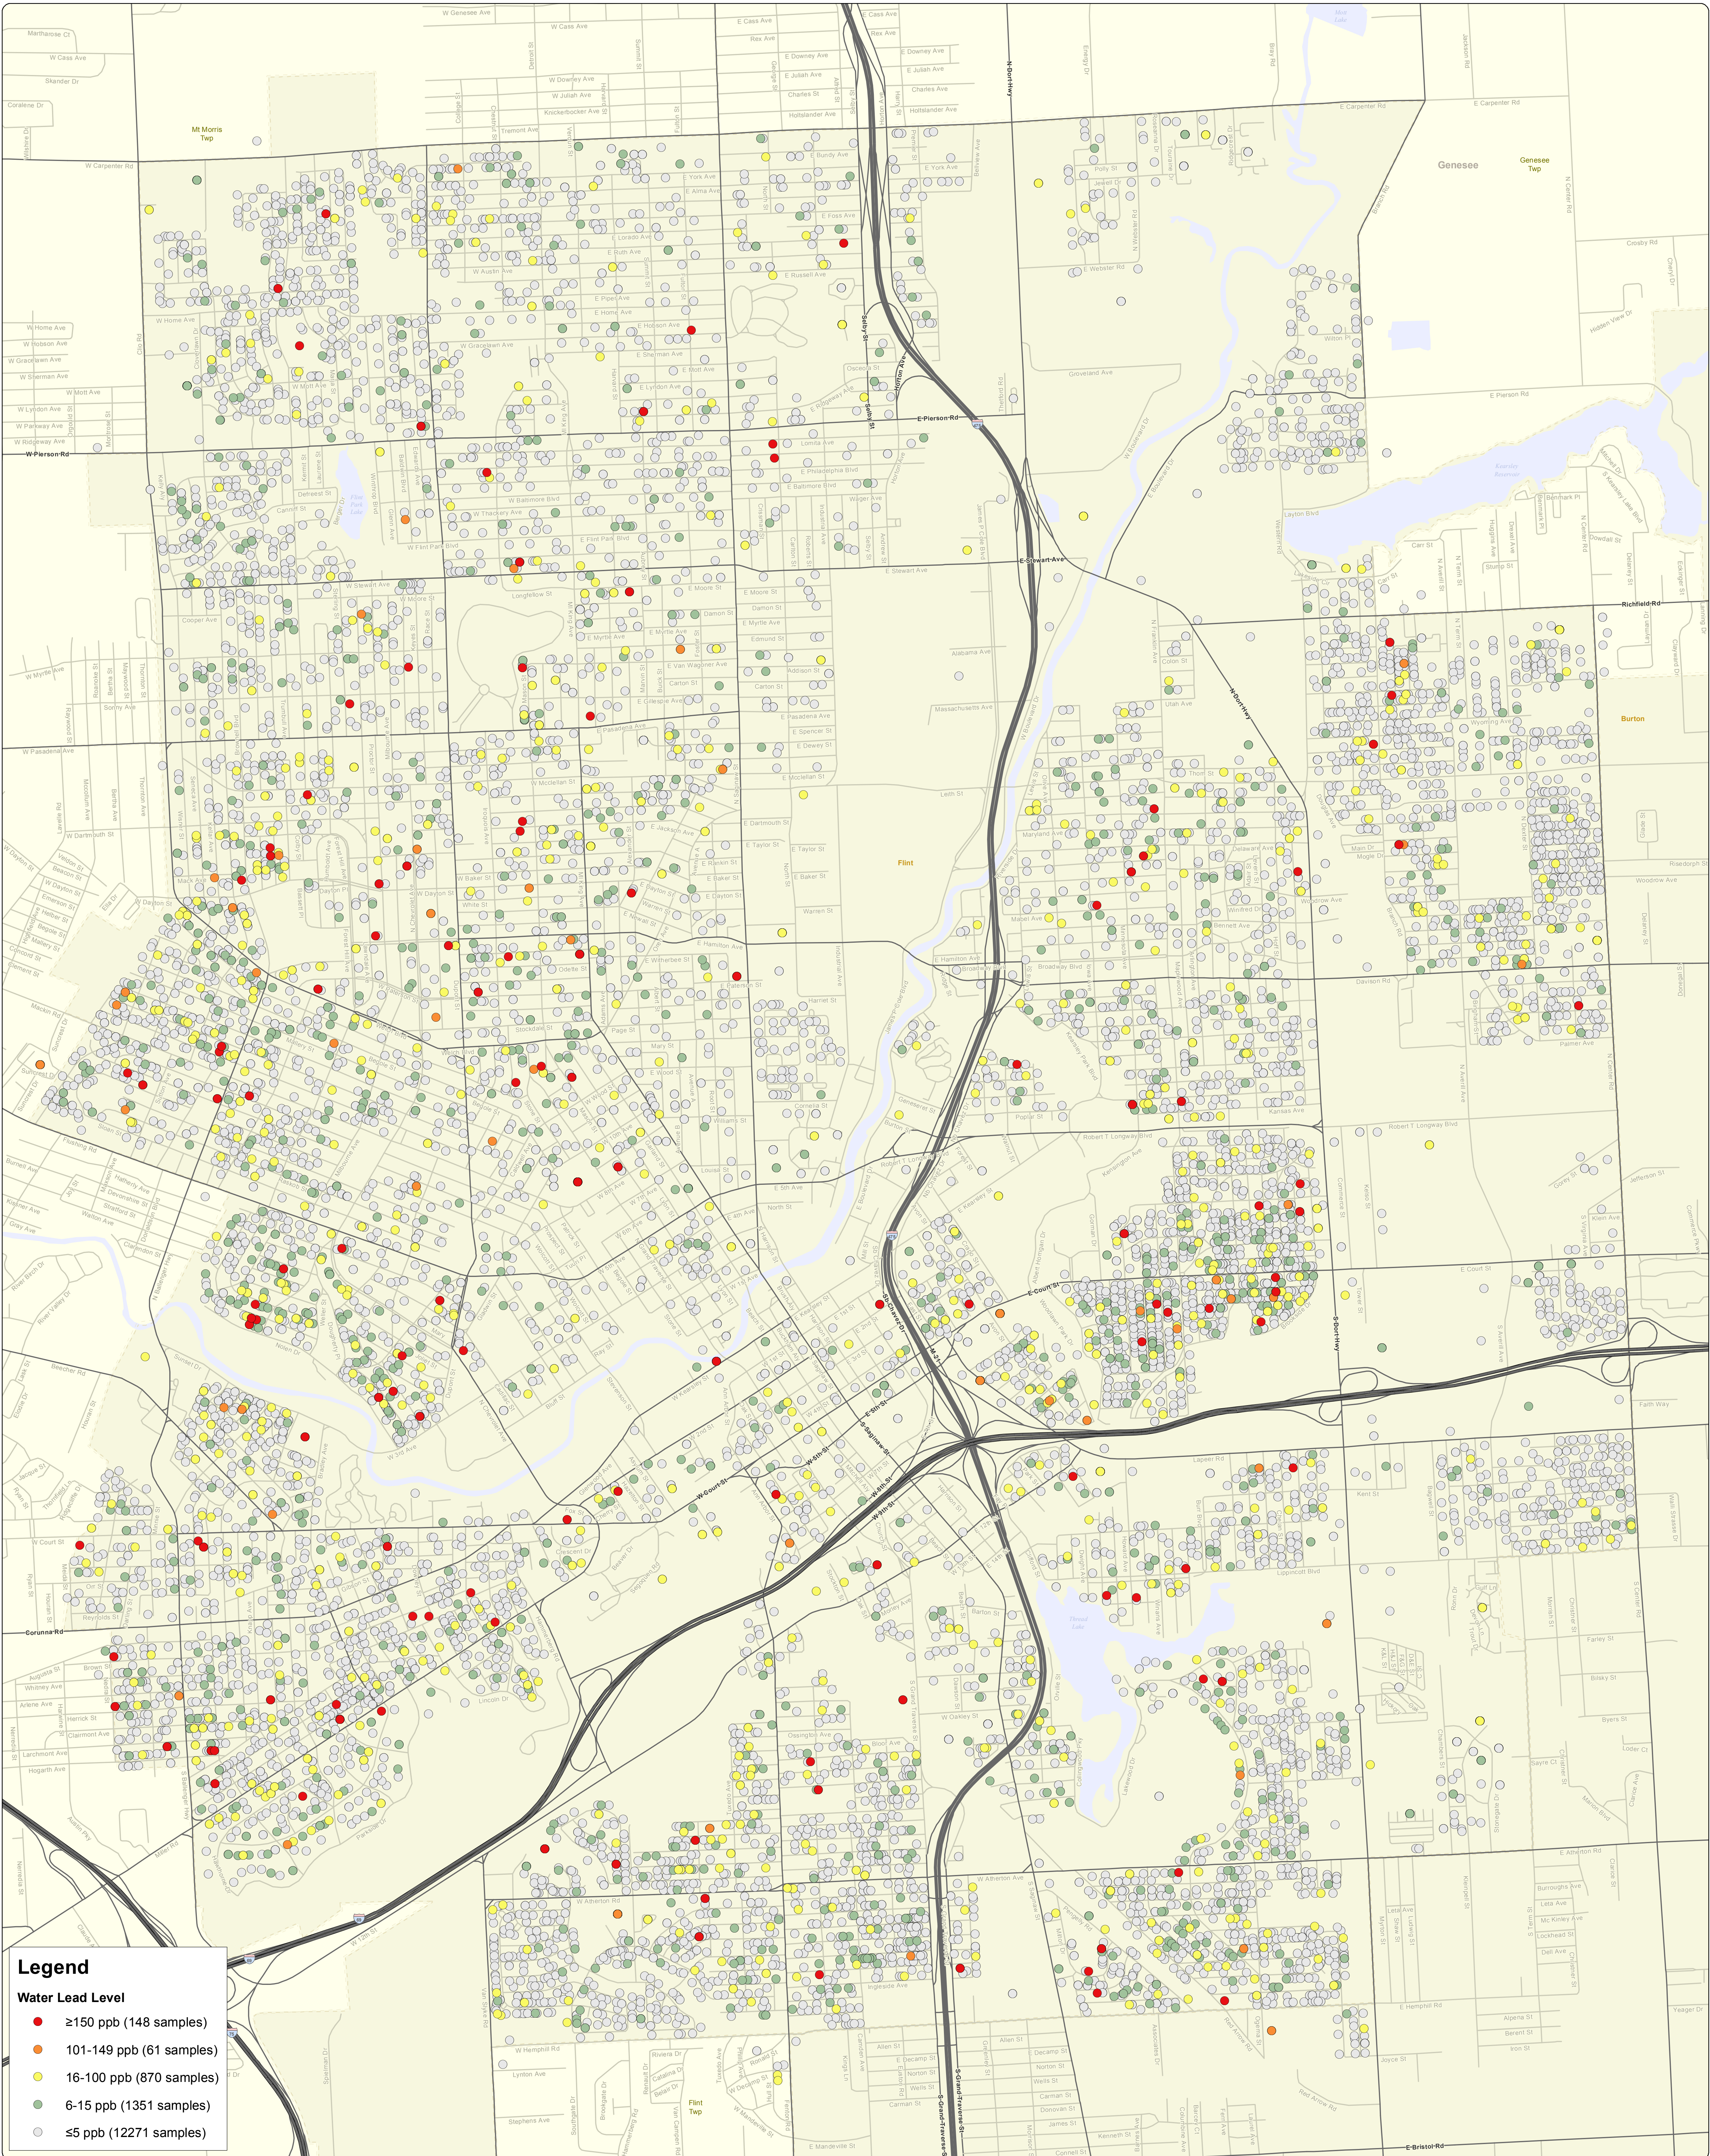

Legend

Water Lead Level

- ≥150 ppb (148 samples)
- 101-149 ppb (61 samples)
- 16-100 ppb (870 samples)
- 6-15 ppb (1351 samples)
- ≤5 ppb (12271 samples)



Michigan State Police
Emergency Management and
Homeland Security Division

Miles 0 0.75 1.5

This information is being provided by the City of Flint, Michigan State Police, Emergency Management and Homeland Security Division (MSP/EM/HS). The MSP/EM/HS assumes no responsibility for the completeness or accuracy of the data displayed on the map. Data layers were compiled from various sources and are not to be construed as a "legal description".



Author: msp-seocgis@michigan.gov, (A111)
Created: 11:22 AM, 10 Mar 16