


Flint Water Incident - Sentinel Sampling Results - Lead




Legend

- 54 Results greater than 15 parts per billion of Lead
- ◆ 510 Results less than or equal to 15 parts per billion of Lead
- Flint w/Franchise Boundary
- Flint Area Zip Codes

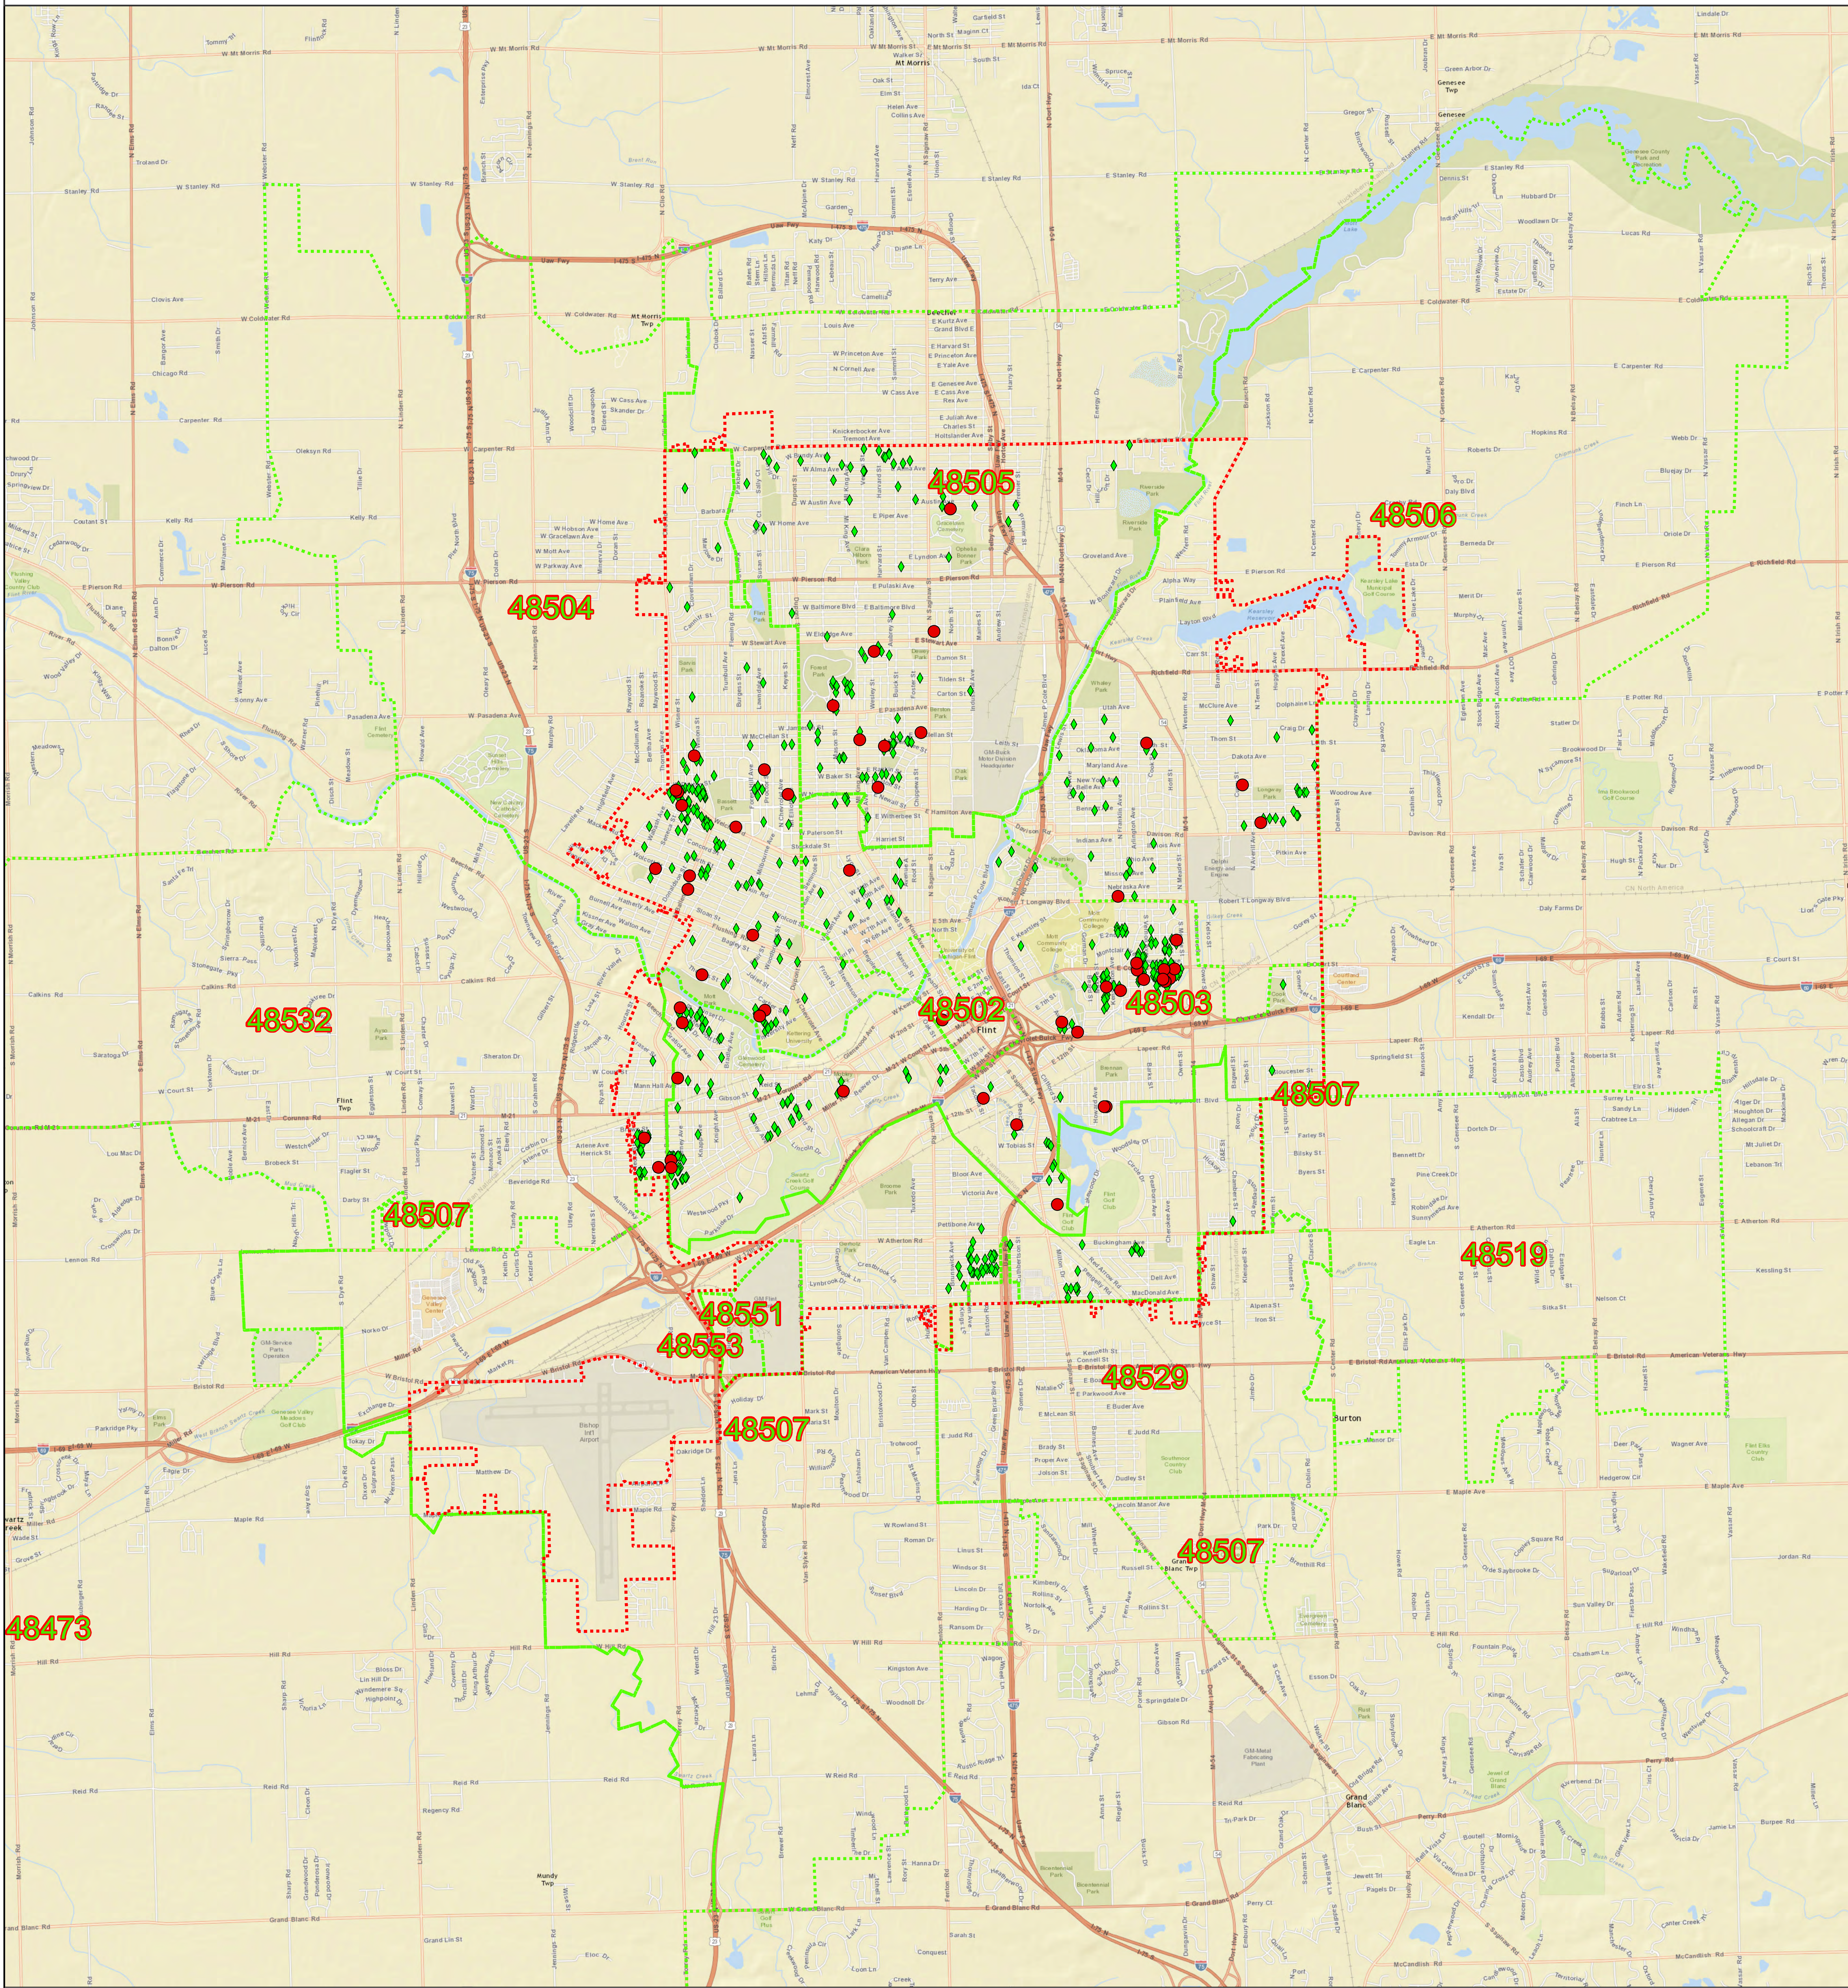

State of Michigan

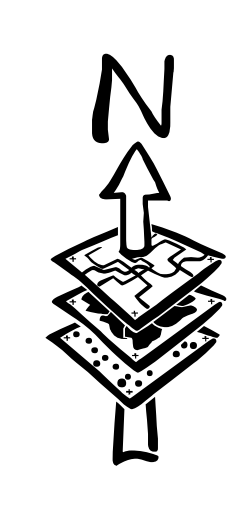

Date: 03/01/2016

