

MICHIGAN DEPARTMENT OF LABOR AND REGULATORY AFFAIRS
BUREAU OF CONSTRUCTION CODES
P.O. BOX 30254
LANSING, MI 48909

CERTIFICATE OF ACCEPTABILITY
PRODUCT APPROVAL

1634-MA

Issued by the Michigan State Construction Code Commission in accordance with authority granted under Section 21, 1972 P.A. 230, MCL 125.1521 on the recommendation of the Bureau of Construction Codes, Mechanical Division.

MANUFACTURER:

Viega LLC

PRODUCT:

MegaPressG products #'s 6611, 6612, 6615, 6616, 6618, 6626, 6660, 66151, 66155 and 66172. Sizes ½", ¾", 1", 1 ¼", 1 ½" and 2".


MANUFACTURER DESIGNATION:

301 N. Main St, Fl 9
Withita, KS 67202-4806

CONDITIONS OF USE AND INSTALLATION:

1. All requirements of the Michigan Mechanical, Michigan Residential, and International Fuel Gas Codes most current editions shall apply.
2. Must be installed per the manufacturer's installation instructions.
3. Approved only for natural gas and L.P. gas in vapor states only.
4. Not approved for underground installations.
5. Not approved for embedding applications.
6. Approved for schedule 40 pipe only.
7. Not approved above 125 PSIG.
8. The fitting installation must be pressure-tested for leaks in the presence of a code official.
9. RIGID press tool shall be re-calibrated by RIGID after a period of 30,000 presses.
10. This approval shall become void if the product no longer conforms to the current Michigan Mechanical, Michigan Residential and International Fuel Gas codes.

THIS CERTIFICATE SHALL NOT BE USED FOR ADVERTISING PURPOSES.

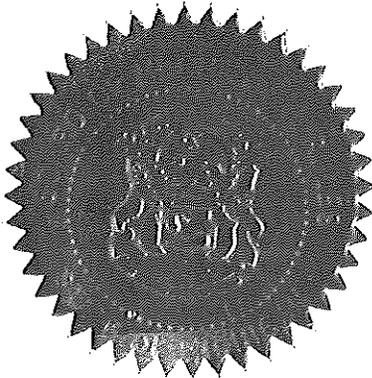

By Direction of the Construction Code Commission


Irvin J. Poke, AIA, Director


Kevin Kalakay, Chief, Mechanical Division

Effective Date: October 3, 2012

BCC-978 (Rev. 02/11)