Percentage of Persons Served by Michigan Community Fluoridated Water Systems by County

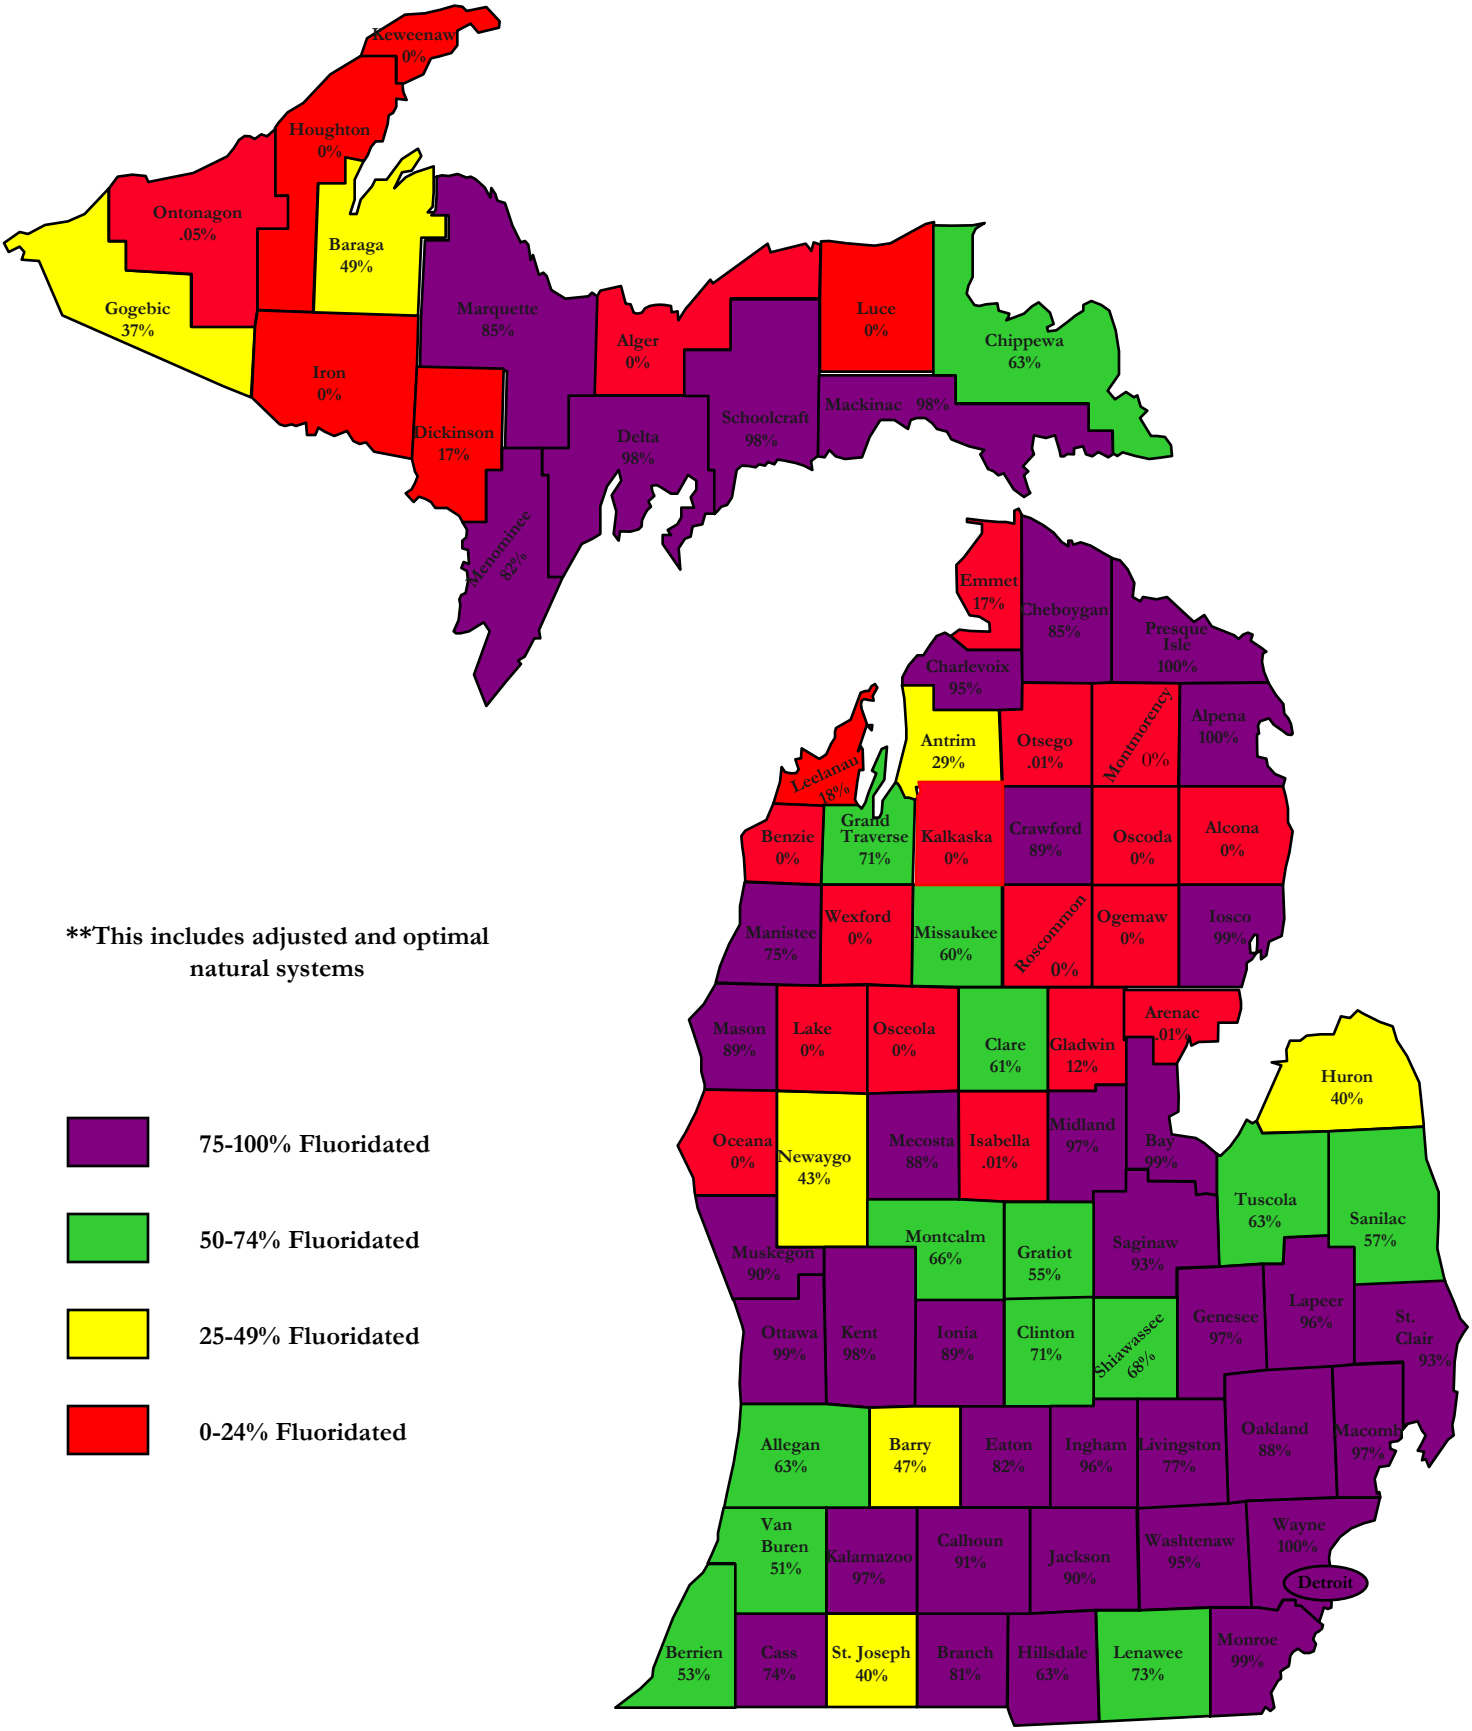

**This includes adjusted and optimal natural systems

75-100% Fluoridated

50-74% Fluoridated

25-49% Fluoridated

0-24% Fluoridated

Michigan Department of Community Health
2011