

FLINT WATER INTERAGENCY COORDINATING COMMITTEE

LEAD AND COPPER RULE REFORM



The Flint Water Interagency Coordinating Committee Policy Subcommittee developed a set of standards for the state of Michigan to follow, improving the current standards set by the federal Lead and Copper Rule and making Michigan a model state for the rest of the nation.


NEW STATE SPECIFIC STANDARDS



PROTECT THE PUBLIC BETTER

Require annual lead and copper testing for public places like schools, day cares, and adult foster care facilities.

Phase in a reduction in the lead action level from 15 ppb to 10 ppb by 2020.

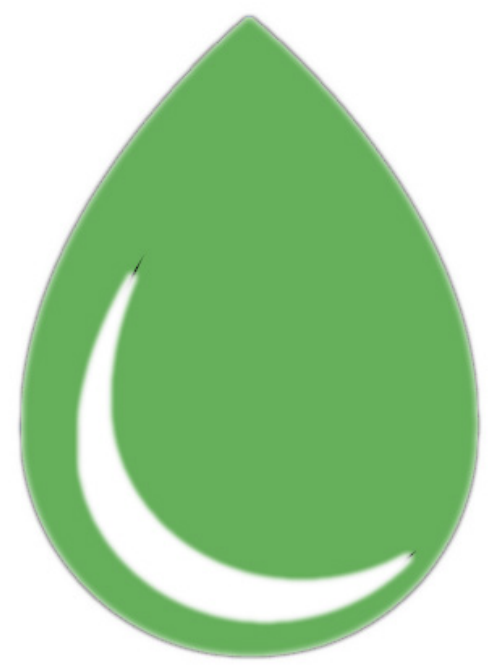

PROVIDE RESIDENTS WITH SAFE WATER

Increase state and local oversight. Require disclosure of lead service line status in all home sales and rental contracts.



ALERT THE PUBLIC BETTER

Require notices to all customers as well as public notices to all schools, community centers, and child care centers when a public water system exceeds the lead action level.




PROTECT WATER SYSTEMS BETTER

Require public water systems to follow defined corrosion control treatment standards and defined proper testing protocols regarding the frequency, size, site selection, and draw of water samples.



PROVIDE BETTER HEALTHCARE

Require strict notifications and access to blood testing for households that test over 40 parts per billion for lead.

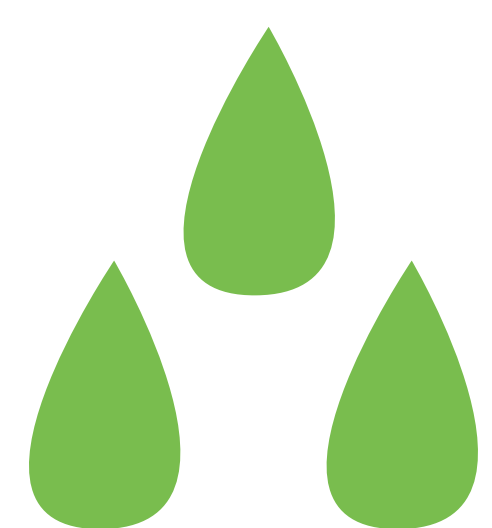

IMPROVE WATER SYSTEMS

Require every public water system to adopt a full lead service line replacement program within 10 years.

Require a two-tier approach with Advisory Commission on Drinking Water Quality on the state level and a local Water System Advisory Council for each Public Water System.