




Michigan Department of Environment, Great Lakes, and Energy

Combined Sewer Overflow (CSO), Sanitary
Sewer Overflow (SSO), and Retention
Treatment Basin (RTB) Discharge
2021 Annual Report

(January 1, 2021 -
December 31, 2021)



Act 451 Legislative Report Requirement

Section 324.3112c of Part 31, Water Resources Protection, of the Natural Resources and Environmental Protection Act, 1994 PA 451, as amended (Act 451), identifies activities to be undertaken by the Michigan Department of Environment, Great Lakes, and Energy (EGLE) to make information related to known discharges of untreated or partially treated sewage from sewer systems to land or waters of the state available to the general public. This report provides a summary of releases reported to EGLE to meet these requirements.

Information Regarding Annual Report Series

This annual report is part of a series of reports that consolidate annual release reporting data since July 2000. The reports can be accessed online from the [Library of Michigan](#):

- [CSO/SSO & RTB Discharge Annual Report Series](#)

This publication was prepared for the purpose of public information. Reliance on information from this document is not usable as a defense in an enforcement action or litigation.

To request this material in an alternative format, contact
EGLE-Accessibility@Michigan.gov or call 800-662-9278.

EGLE does not discriminate on the basis of race, sex, religion, age, national origin, color, marital status, disability, political beliefs, height, weight, genetic information, or sexual orientation in the administration of any of its programs or activities, and prohibits intimidation and retaliation, as required by applicable laws and regulations.

Annual Report Contents

A Message from the Director

2021 PROGRESS: COMBINED SEWER OVERFLOWS (CSO) and RETENTION TREATMENT BASINS.....	1
Did We Make Progress in 2021?	1
What Data Does the Detailed CSO and RTB Report (Appendices E & F) Contain?	1
Combined Sewer Overflow (CSO) Summary Report	3
How Does 2021 Compare to Previous Years?	4
2021 CSO Progress Report	8
2021 PROGRESS: SANITARY SEWER OVERFLOWS.....	11
Did We Make Progress in 2021?	11
What Data Does the Detailed SSO Report (Appendix G) Contain?	11
Sanitary Sewer Overflow (SSO) Summary Report	12
How Does 2021 Compare to Previous Years?	16
2021 SSO Progress Report.....	17
APPENDIX A: MCL 324.3112a and MCL 324.3112c	
APPENDIX B: BACKGROUND INFORMATION ON DISCHARGES	
INTRODUCTION	B-1
What Is the Difference between a Sanitary Sewer System and a Combined Sewer System?B-1	
In General, What are CSOs, SSOs, and RTB Discharges?	B-2
What Laws Require Reporting of Releases?.....	B-4
Who Will Let Me Know Whether the Water Is Safe for Swimming, Fishing, or Canoeing?	B-4
How Does Intergovernmental Cooperation Help Fund Infrastructure Improvements?	B-4
Who Do I Contact for More Information?.....	B-5
DISTRICT CONTACTS BY COUNTY	B-7
REPORT TERMS AND ACRONYMS	B-8
WASTEWATER TREATMENT	B-11
How is Wastewater Treated?	B-11
What is Blending?	B-11
What is Bypassing?	B-12
COMBINED SEWER OVERFLOWS AND RETENTION TREATMENT BASINS	B-13
What are Combined Sewer Overflows and What Causes Them?	B-13
How are CSOs Addressed?.....	B-13
What is the Main Challenge for Communities to Address in Controlling CSOs?.....	B-15
SANITARY SEWER OVERFLOWS	B-16
What are Sanitary Sewer Overflows?	B-16
What causes an SSO?	B-16
How Does the Sewage end up in the Environment?	B-17
How are SSOs Addressed?	B-17
What Factors Might Justify Longer-Term Plans for Stopping Chronic SSOs?	B-18
APPENDIX C: BLENDING DETAIL REPORT 2021	
APPENDIX D: BYPASS DETAIL REPORT 2021	
APPENDIX E: COMBINED SEWER OVERFLOW (CSO) DETAIL REPORT 2021	
APPENDIX F: RETENTION TREATMENT BASIN (RTB) DETAIL REPORT 2021	
APPENDIX G: SANITARY SEWER OVERFLOW (SSO) DETAIL REPORT 2021	

A Message from the Director

Protecting Michigan's abundant sources of fresh water is key to the mission of EGLE and important to the citizens of the state. It is imperative that we continue to align efforts in protecting our water bodies for future generations. A primary focus in this effort is controlling and reducing combined sewer overflows (CSO) and sanitary sewer overflows (SSO) to help eliminate the public health threat from raw sewage discharges into Michigan waters.

The 2021 annual report contains data on reported discharges; describes the causes of these discharges; and discusses the working relationships with local units of government, citizens, and other stakeholders in addressing this multiyear, multibillion-dollar challenge.

In 2021 Michigan experienced above average rainfall throughout the state, and this is evident in calendar year 2021 data. This demonstrates the significant impact that annual precipitation totals have on discharges from sewerage systems. While rainfall in 2021 was above average, CSO controls implemented throughout the state continue to show success in keeping raw sewage from entering surface waters. The yearly totals of untreated SSOs continue to follow the precipitation trends.

Featured below are some of the calendar year achievements, which highlight the steady gains we are making toward our long-term goals.

- Public Act 53, signed by Governor Gretchen Whitmer in April of 2022, seeks to reduce the financial burden to communities and address infrastructure needs to protect public health and the environment. Act 53 provides \$4.7 billion of infrastructure funding, including \$1.9 billion to be administered by EGLE. Funding is included from three separate funds: American Rescue Plan Act, Infrastructure Investment and Jobs Act, and General Fund. This funding will provide much needed funding to help eliminate raw sewage discharges.
- EGLE awarded more than \$211 million in loans through the State Revolving Fund to local units of government for wastewater infrastructure projects.
- Large-scale sewer separation projects continue in the cities of Lansing, Dearborn, Dearborn Heights, St. Joseph, and Manistique. The city of Detroit is planning one large separation project for a sewer district draining to the Rouge River. The cities of Detroit and Dearborn and others continue work to provide retention treatment basins for control of untreated CSOs to the Detroit River and Rouge River Watershed in southeast Michigan.
- In 2013 EGLE began an initiative to promote programs aimed at pursuing and achieving sustainable wastewater infrastructure. Such programs are referred to as asset management programs. This effort involved issuing the National Pollutant Discharge Elimination System (NPDES) major permit with asset management program requirements and, separately, the Storm Water, Asset Management, and Wastewater (SAW) Program. To help communities prepare for this initiative, the SAW Program was created in January 2013 from legislation enacted to establish grants for asset management plan development, among other planning efforts, as well as state-funded loans to construct projects identified in asset management plans. To date, approximately \$450 million has been allocated to the SAW Program, and including asset management requirements in NPDES permits continues.

Thank you for your support in protecting the environment that is so important to the physical, social, cultural, and economic well-being of Michigan and its citizens.

Sincerely,



Liesl Eichler Clark, Director
Michigan Department of Environment, Great Lakes, and Energy

2021 PROGRESS: COMBINED SEWER OVERFLOWS (CSO) and RETENTION TREATMENT BASINS

Did We Make Progress in 2021?

Precipitation in Michigan in 2021 was above average. According to the National Oceanic and Atmospheric Administration (NOAA), the annual precipitation total for all of Michigan in 2021 was 33.52 inches. Based on NOAA data, the long-term average annual precipitation for Michigan (data from 1895-2021) is approximately 31.68 inches. The resulting impacts of above average precipitation on 2021 wet weather discharges are evident in 2021 numbers. With consideration for the above, and other relevant factors described below, we believe Michigan is making progress in controlling wet weather discharges.


In addition to above average rainfall, Michigan was hit with numerous intense rain events that had an impact on 2021 wet weather discharges. In particular, about 5-7 inches of rain fell across Metro Detroit on June 25-26, 2021, causing widespread power outages and subsequent pump station failures, which helped contribute to significant flooding along roadways and in and around homes. As a result of this rain event alone, there were 3.27 billion gallons of CSO discharged and approximately 92 million gallons of SSO discharged. In 2021 the Governor initiated the Southeast Michigan Aging Infrastructure work group involving federal, state, and local partners. The goal of the work group was to identify projects to help protect public health and find additional funding sources to help address flooding.

Each year EGLE tracks elimination of uncontrolled CSO outfalls. As of the end of 2021, 100 uncontrolled CSO outfalls remain for correction, two fewer than 2020. Outfall elimination and/or treatment is not the sole indicator of progress in implementation of CSO control as extensive design and construction consistent with approved Long-Term CSO Control Programs (LTCP) is continuing in various areas of the state of Michigan. This includes ongoing sewer separation projects that are being conducted in the cities of Dearborn, Dearborn Heights, St. Joseph, and Manistique, among others; and large construction projects by the cities of Detroit, Dearborn, and others, to provide RTB or other controls for overflows to the Detroit River and Rouge River Watershed in Southeast Michigan. Continuing implementation, including design and construction of projects that occurred during calendar year 2021, will lead to elimination of additional CSOs in future years. Further examples of this are summarized in the '2021 CSO Progress Report' section below.

What Data Does the Detailed CSO and RTB Report (Appendices E & F) Contain?

The data contained in the appended CSO and RTB Reports was reported (as required by law) to EGLE by the responsible parties. During the report period from January 1, 2021, through December 31, 2021, there were 383 events reported for a total volume of approximately 46.74 billion gallons. It is noteworthy that a significant portion of this total volume, approximately 37.96 billion gallons, represents treated discharge from RTBs or equivalent structures that, in addition to settling and skimming, have been disinfected to protect the public health in compliance with the water quality standards (WQS) for discharges containing human sewage (i.e., R 323.1062 of Part 4, Water Quality Standards [Part 4 Rules], promulgated pursuant to Part 31, Water Resources Protection, of the Natural Resources and Environmental Protection Act, 1994 PA 451, as amended).

Figure 1: Reported Wet-Weather Volumes from CSOs and RTBs (2021)

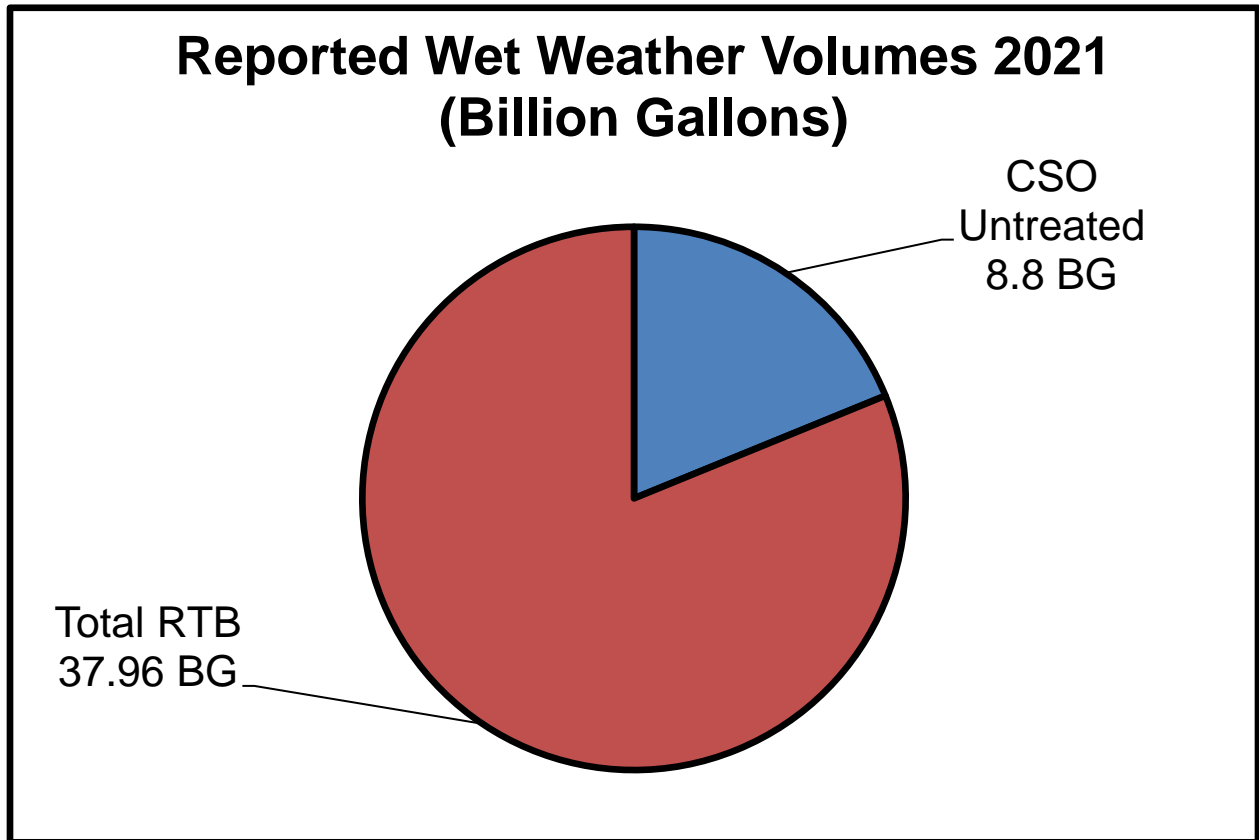

Combined Sewer Overflow (CSO) Summary Report

January 1, 2021 - December 31, 2021


Entity Name	Untreated Volume (MG)	Treated Volume (MG)	Reported Events	County	Appendix Pages
Great Lakes Water Authority WRRF	5,908.1	30,340.4	41	Wayne	E-247, F-69
Dearborn CSO	1,495.1	809.9	49	Wayne	E-174, F-59
Lansing WWTP	376	4.0	31	Ingham	E-5, F-9
Wayne Co/Redford/Livonia CSO	314.1	22.1	13	Wayne	E-449, F-139
Southgate / Wyandotte CSO RTF	288.8	857.8	17	Wayne	E-393, F-121
Wayne Co/Inkster/Dearborn Hts CSO	231.4		56	Wayne	E-424
Wayne Co/Inkster CSO	105.5	132.5	17	Wayne	E-419, F-130
Wayne Co/Dearborn Heights CSO	57.5	84.4	15	Wayne	E-398, F-128
Redford Township CSO	21.8		13	Wayne	E-389
Inkster/Dearborn Heights CSO	6.1		9	Wayne	E-385
Port Huron WWTP	0.69		23	St Clair	E-165
St. Joseph CSO	0.009		7	Berrien	E-1
George W Kuhn Dr Dist CSO RTB		3,101.3	11	Oakland	F-23
Milk River CSO RTB		779.1	12	Wayne	F-112
Martin RTB		405.7	10	Macomb	F-13
Saginaw WWTP		396.4	9	Saginaw	F-37
Chapaton RTB		353.8	7	Macomb	F-10
Bloomfield Village CSO RTB		128.4	6	Oakland	F-20
River Rouge CSO RTB		106.6	7	Wayne	F-118
Saginaw Township WWTP		101.7	8	Saginaw	F-34
Oakland Co - Acacia Park CSO RTB		94.1	8	Oakland	F-29
East Lansing WRRF		84.5	3	Ingham	F-7
Birmingham CSO RTB		79.4	3	Oakland	F-18
North Houghton Co W&SA CSO		43.4	3	Houghton	F-5
Bay City WWTP		31.7	2	Bay	F-1
Iron Mountain / Kingsford WWTP		2.1	3	Dickinson	F-3
TOTAL	8,805.0	37,959.2	383		

How Does 2021 Compare to Previous Years?

This report provides trend data through three measures: number of uncontrolled CSO outfalls eliminated per year, number of overflow events per year, and volume of discharge per year.


Michigan communities have eliminated more than 83 percent of the 613 uncontrolled CSO outfalls that existed in 1988, and the remaining 17 percent are scheduled for elimination through implementation of LTCPs. On average, since 2003, there have been approximately five CSO outfalls eliminated or redirected to RTBs per year (Figure 2).

Figure 2: Number of Uncontrolled CSO Outfalls by Year

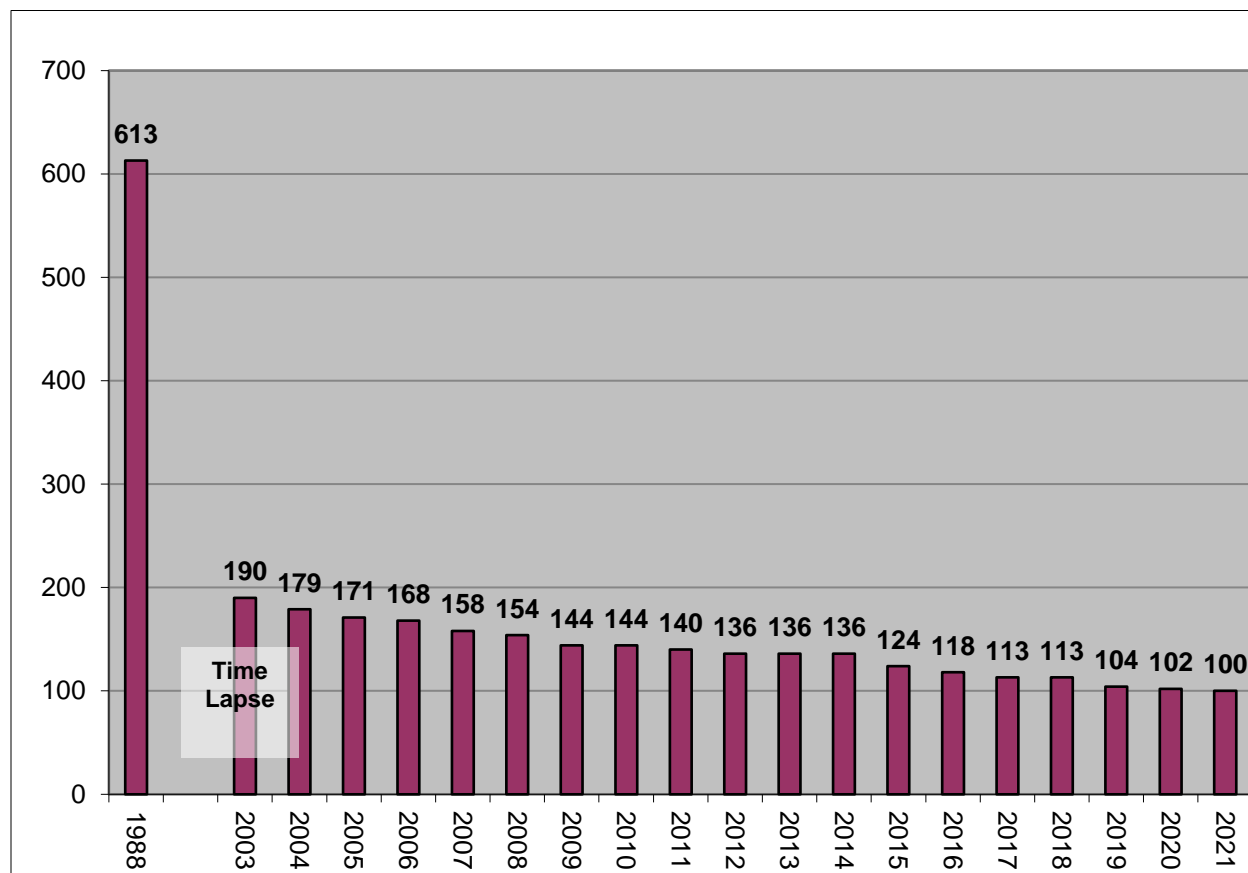

In general, with respect to the number of uncontrolled CSO overflow and RTB discharge events, an event refers to the storm that caused the discharge, even if it is from multiple outfalls (so outfalls are grouped for the purposes of counting an event). This inconsistent reporting methodology was the basis for the relatively high number of events in 2004 to 2006. This reporting methodology was made consistent in the 2007 annual report. In 2021 there were 383 overflow events.

**Figure 3: Number of Reported CSO and RTB Discharge Events/Year
(Years 2004 – 2006 Explained Above)**

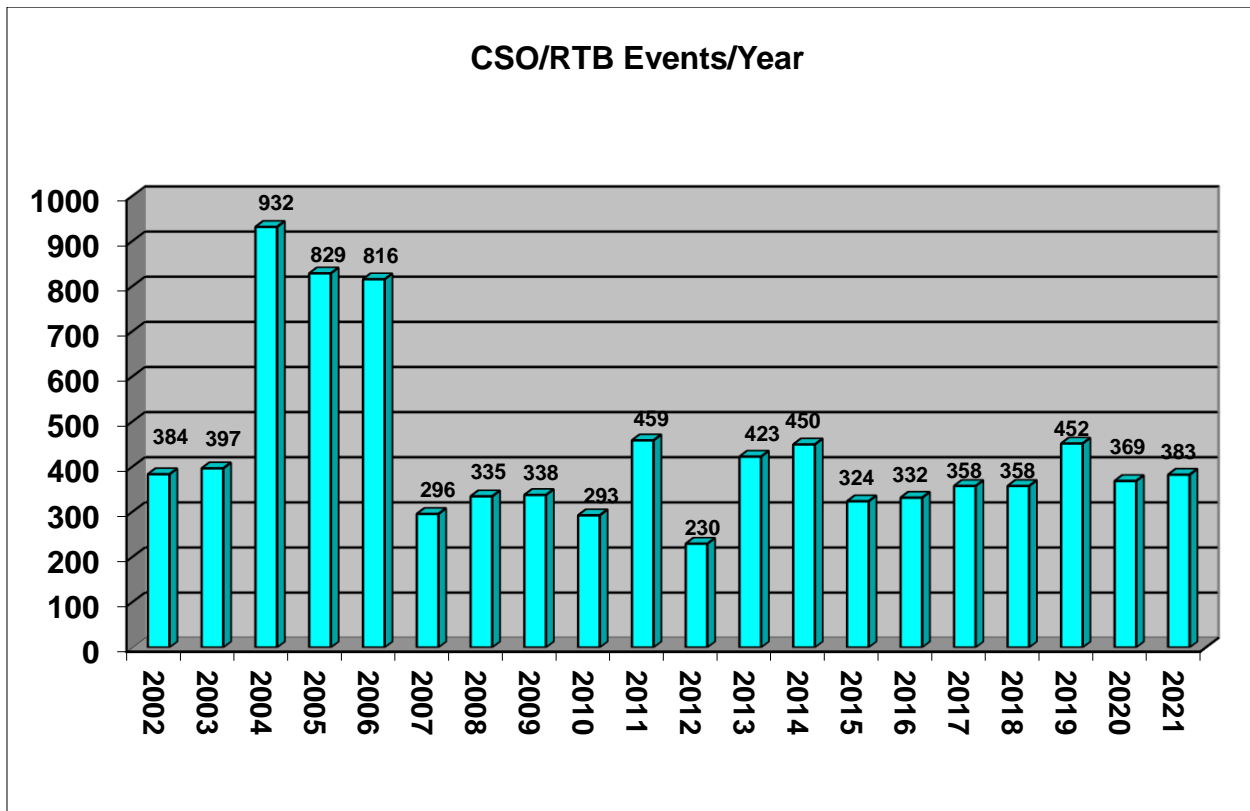

Total volume is also an indicator of success with respect to CSO control, because even a negligible volume of overflow triggers an “event” to be registered consistent with statute. Annual precipitation level variances directly affect the total overflow volume. As with previous years, the total CSO and RTB discharge volume for calendar year 2021 (46,764 MG, Figure 4) reflects the annual precipitation rates (Figure 5).

Figure 4: Total CSO, RTB, and Related Wet-Weather Discharges Reported Volume (MG/Year)



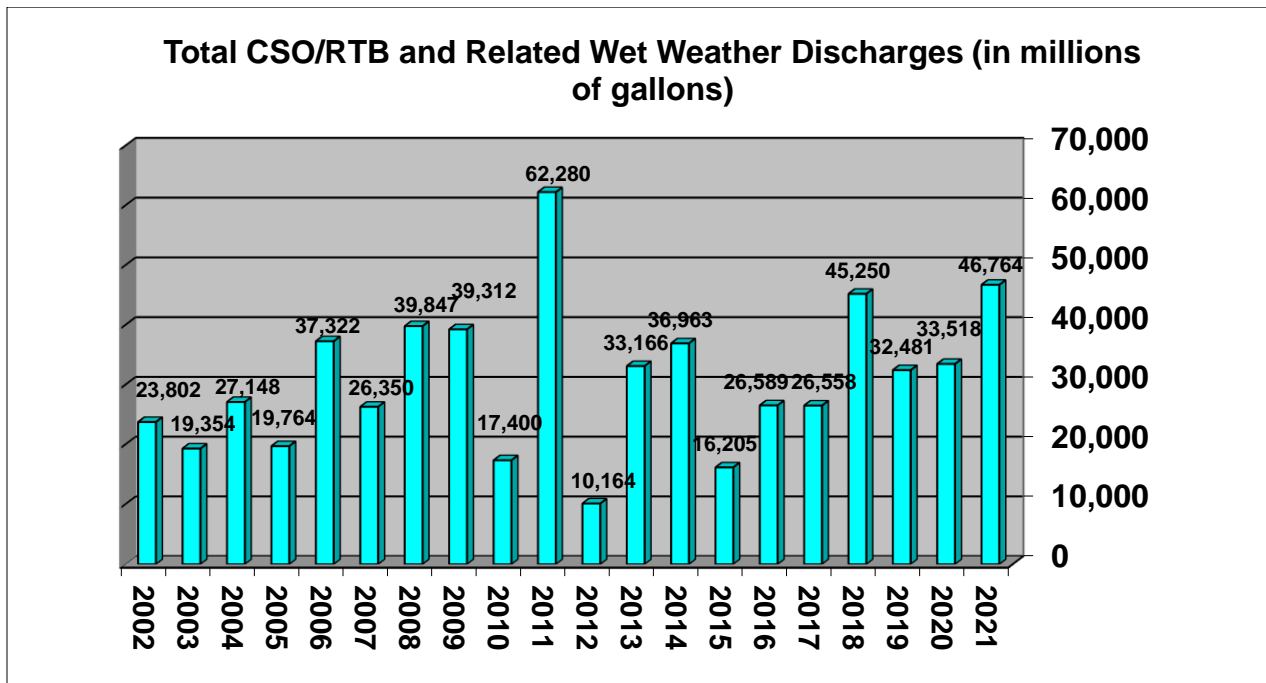


Figure 5: Annual Precipitation (Inches) for Various Michigan Cities/Year

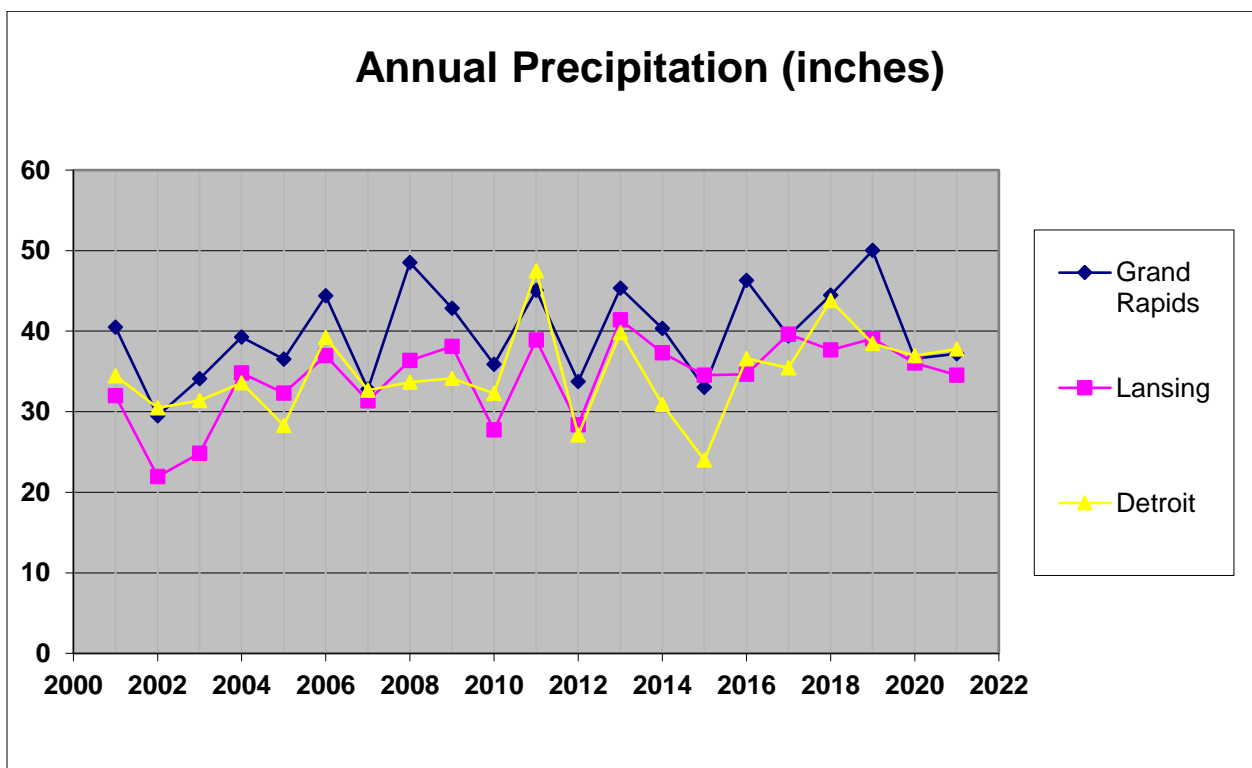

More important, in terms of volume trends, is the volume of CSO discharges versus the volume of discharge from RTBs. This is because the goal of the LTCP is to provide adequate treatment of CSO overflows to meet WQS through treatment at an RTB. When comparing annual volume of CSO discharges to the volume of treated RTB, statewide progress is evident (Figure 6). It is expected that as LTCPs are implemented, the component of the total overflow volume, that is the treated RTB volume, will continue to increase in the coming years.

Figure 6: CSO/Untreated and RTB Volume (MG per Year)

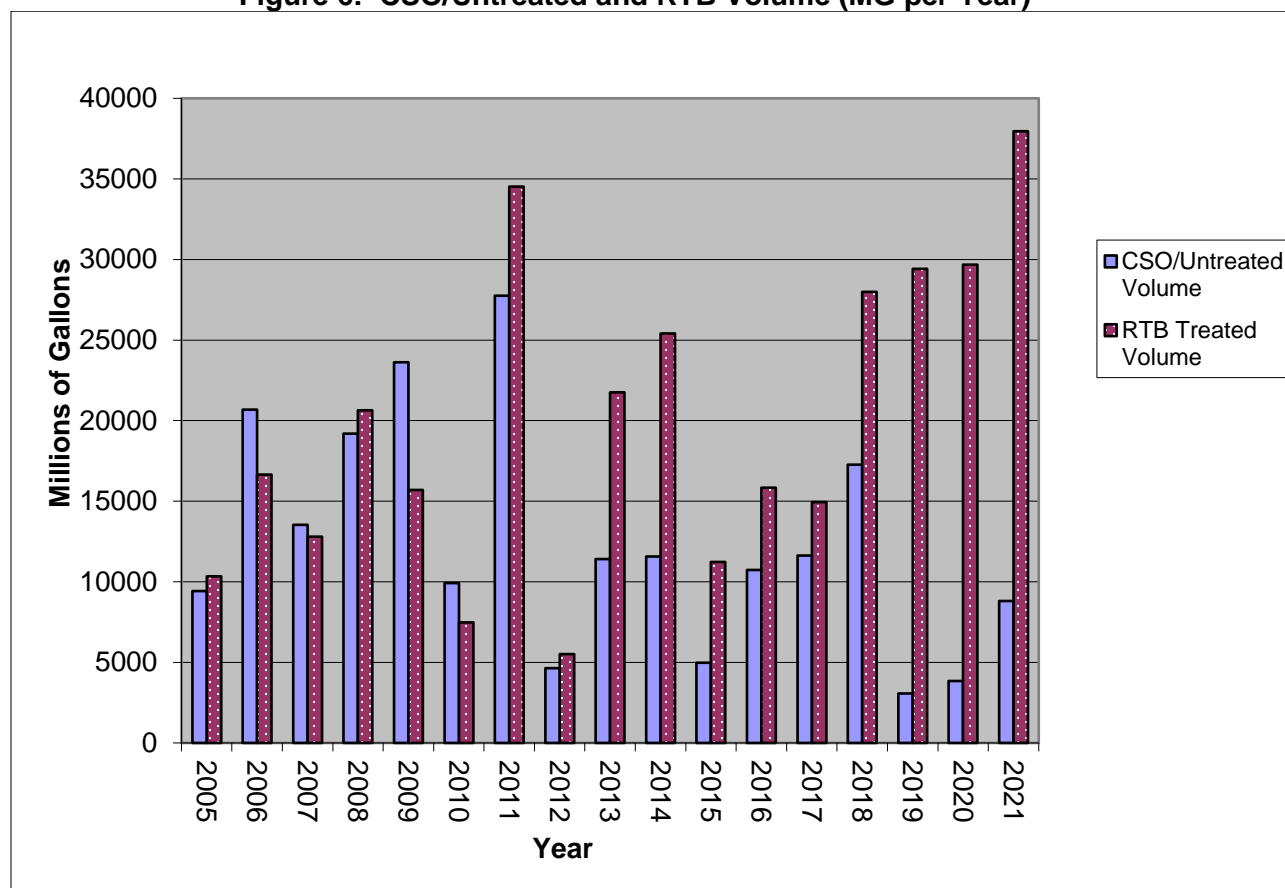

2021 CSO Progress Report

The summaries below illustrate some statewide projects aimed at controlling CSO discharges. These examples further demonstrate the ongoing progress that communities are making toward achieving the goals of the state and federal CSO Programs.

- Great Lakes Water Authority (GLWA)/Detroit Water and Sewerage Department (DWSD)

The city of Detroit has made significant progress implementing the LTCP that was first submitted in 1996. Revisions to the LTCP plans and scheduled projects were made and included in the 2003 NPDES Permit, the 2007 NPDES Permit, and the 2013 NPDES Permit. To date, well over \$1.4 billion has been spent on the control of CSO discharges from Detroit outfalls.

Detroit's LTCP has focused on: (1) bringing as much wet-weather flow as is feasible to the wastewater treatment plant (WWTP) for treatment; flows receive secondary treatment up to the capacity of the secondary units, and primary treatment for higher flows up to the capacity of the primary facilities; (2) using in-system storage in the combined collection system; and (3) storing/treating priority CSOs in the collection system using RTBs and screening and disinfection facilities.

Significant progress to-date includes completion of:

- Additional facilities at the WWTP that have increased the capacity to treat combined wet-weather flows to primary treatment levels as required by the NPDES Permit.
- Five CSO Storage/Treatment Facilities along the Rouge River.
- Four CSO Storage/Treatment Facilities along the Detroit River peak.
- Six in-system storage gates at CSO outfalls along the Rouge River.
- Thirteen in-system storage devices within the collection system.
- Rehabilitation of pump stations and regulators along the Detroit River.
- Completion of additional control facilities or elimination of outfalls for five CSOs in the lower Rouge River.
- Completion of the Rouge River Outfall (RRO) Disinfection Project.

Since the completion of the RRO Disinfection Project in April 2019, all excess wet-weather flow from the Water Resource Recovery Facility (WRRF) is fully disinfected and dechlorinated. Additionally, with the completion of the RRO Disinfection Project, GLWA/DWSD has completed its core CSO correction program. It is estimated that the completed CSO controls will provide treatment for about 95 percent of the annual wet-weather volume generated in Detroit and around 90 percent or more of the previously discharged untreated CSO volume from the city of Detroit.

The NPDES Permit includes Green Infrastructure (GI) requirements in both the Upper Rouge area of the Rouge District and the near east-side area of the Central District. The DWSD is required to spend an average of \$2 million per year during the life of this permit on GI. Additionally, requirements to build grey infrastructure have been removed from the current permit and replaced with an evaluation of potential GI projects and the associated flow reductions that may be achieved. There is potential for extensive GI implementation based on the large amounts of vacant land in this area.

- City of Port Huron

In July 2021 the city completed separation of the last CSO outfall and has successfully completed their Long-Term CSO Control Program. The city has eliminated all 19 CSO outfalls that existed in the city. The city has also completed its project performance certification (PPC) and successfully demonstrated that the city has the capacity to transport and treat the flow generated by EGLE's remedial design standard.

- City of Lansing

An Administrative Consent Order (ACO) was entered on December 19, 2019, with integrated plan requirements to correct CSO and SSO discharges. The city is currently conducting various sewer separation and sewer rehabilitation projects. The ACO requires that core CSO correction be completed by December 31, 2032. The remaining CSO correction will be completed under an adaptive management approach.

- City of Wakefield

The city has completed Phase IV of the sewer upgrade projects, and the reissued NPDES Permit requires a PPC to demonstrate transmission capacity within flows created at the 25-year, 24-hour event. The city was awarded \$0.613 million for wastewater asset management planning to further study potential inflow and infiltration sources. Approximately \$21 million in grants and loans from the United States Department of Agriculture Rural Development (\$15 million), the United States Army Corps of Engineers (\$6 million), the Michigan Economic Development Corporation (\$0.2 million), and user fees from the citizens of Wakefield were used to eliminate the CSOs to Planter Creek in 2015. After the CSOs were eliminated, *E. coli* geometric mean concentrations declined substantially (year 2015 study) in Planter Creek from 338 to 39 colony-forming units/100 milliliter (mL) (88 percent) at Wertanen Road and 258 to 148 CFUs/100 mL (43 percent) at Thomaston Road. Planter Creek now meets the state's partial body contact recreation criteria of 1,000 CFUs/100 mL but does not yet meet the full body contact criteria of 300 CFUs/100 mL.

- City of Grand Rapids

The city has completed all construction activities necessary to complete their LTCP. This includes elimination of all untreated CSO outfalls. The city is conducting a verification PPC as required by their NPDES permit, which will confirm that the construction activities associated with the LTCP have met state and federal requirements for CSO separation. The city continues to proactively maintain the sewer system to minimize discharges resulting from pipe blockages, etc.

- City of Dearborn

In the late 1990s the city of Dearborn began implementing a CSO project with a construction of an underground tunnel. The execution of the project was unsuccessful because of a groundwater condition. Since then, a study was performed to embark on a joint tunnel project with Detroit, which did not come to fruition.

CSO control with construction of a treatment shaft (sinking caisson) concept was implemented between 2004 and 2010. The construction contracts for the six treatment shafts were bid out. The construction at three of the treatment shafts was successfully completed. Two treatment shaft locations have failed due to construction issues and have since been backfilled and abandoned. Another treatment shaft has issues with groundwater, and an alternate design is in progress. The city of Dearborn has spent approximately \$270 million thus far for the caissons projects and approximately \$30 million for the failed tunnel project.

In 2009 the city of Dearborn made a decision to forego the treatment shaft concept and aggressively embarked on sewer separation projects. Since 2009, the city has constructed more than 258,963 feet of new storm and sanitary sewers to separate wastewater from storm water at a cost of approximately \$162.6 million.

- Milk River Retention Treatment Basin

An ACO was agreed to by EGLE and the Wayne County Drain Commissioner and issued on February 7, 2014, covering upgrades to the Milk River RTB. These include upgrades to the automated flushing/dewatering system, the river recirculation system, aeration system, pumping systems, disinfection system, and other necessary repairs. The construction began in 2016 at a cost of more than \$30 million.

- Martin Retention Treatment Basin

The reissued NPDES permit issued in September 2019 reclassifies this RTB as treating wet-weather flow from a combined system. When this RTB was first constructed, it was classified as a facility that stored and treated flow from a system that was regulated as combined. In the mid-2000s, EGLE evaluated the percentage of the tributary area that was served by separated sanitary sewers and combined sewers. The level of separate sanitary sewers moved past a level that EGLE then saw as significant (90 percent) and made a policy decision to then reclassify this facility as a treatment facility serving a separate sanitary system. Over the last decade, EGLE has reevaluated this decision that proved to not provide a greater degree of treatment from the RTB, nor encourage the permittee to further separate their sewers. EGLE has decided to reclassify this RTB as a facility that stores and treats combined sewage, as it was originally designed.

2021 PROGRESS: SANITARY SEWER OVERFLOWS

Did We Make Progress in 2021?

During calendar year 2021, low interest loan funding was awarded for many projects through the SRF to address system reliability and SSOs. Examples of projects aimed at controlling SSOs are summarized in the '2021 SSO Progress Report' section below.

What Data Does the Detailed SSO Report (Appendix G) Contain?

The data contained in the attached SSO Detail Report (Appendix G) was reported (as required by law) to EGLE by the responsible entities. During the report period from January 1, 2021, through December 31, 2021, there were 294 events reported, for a total SSO volume of approximately 293.48 MG (see Figures 8 and 9). SSOs for the past year are summarized and listed by volume in the following table.

Sanitary Sewer Overflow (SSO) Summary Report

January 1, 2021 - December 31, 2021 (by Volume)

Entity Name	Total Volume (MG)	Reported Events	County	Appendix Page #
Lincoln Park CM	74.92	5	Wayne	G-228
Rouge Valley Sewage Disposal System CM	65.08	6	Wayne	G-234
Dearborn CSO	47.28	10	Wayne	G-222
Evergreen-Farmington CM (Oakland Co)	36.92	5	Oakland	G-160
Lansing WWTP	20.86	2	Ingham	G-66
East Lansing WRRF	11.82	2	Ingham	G-64
Lansing WWTP	7.38	3	Oakland	G-167
Flint CM	6.11	14	Genesee	G-41
Grosse Pointe Shores CM	3.75	2	Wayne	G-228
Manistee CM	3.10	3	Manistee	G-134
Melvindale CM	2.45	2	Wayne	G-233
Warren WWTP	2.42	2	Macomb	G-132
Center Line CM	2.38	1	Macomb	G-130
Westland CM	1.96	1	Wayne	G-245
City of Troy	1.10	2	Oakland	G-158
George W Kuhn Dr Dist CSO RTB	1	1	Oakland	G-170
Crockery MHP	0.82	3	Ottawa	G-190
Rockwood WWTP	0.74	1	Wayne	G-150
Howell WWTP	0.51	1	Livingston	G-36
Allen Park CM	0.48	1	Wayne	G-220
West Bloomfield Township CM	0.30	1	Oakland	G-187
Grand Ledge WWTP	0.24	1	Eaton	G-37
Lakewood WW Auth CM	0.16	3	Ionia	G-79
Hillsdale CM	0.15	1	Hillsdale	G-59
Bangor WWSL	0.12	3	Van Buren	G-206
Chassell Twp WWSL	0.12	1	Houghton	G-60
Durand WWTP	0.10	1	Shiawassee	G-202
Sault Ste Marie WWTP	0.10	1	Chippewa	G-31
Sylvan Township CM	0.097	4	Washtenaw	G-217
Western Townships Utilities Authority	0.096	3	Wayne	G-243
Niles WWTP	0.095	1	Berrien	G-20
Goodrich CM	0.068	1	Genesee	G-51
Novi CM	0.060	1	Oakland	G-173
West Bay Co Regional WWTP	0.055	2	Bay	G-11
Adrian WWTP	0.051	2	Lenawee	G-115
Flint WWTP	0.050	3	Genesee	G-49
Monroe Metro WWTP	0.05	1	Monroe	G-149
Mesick WWTP	0.045	1	Wexford	G-251

Entity Name	Total Volume (MG)	Reported Events	County	Appendix Page #
Livingston County Drain Commission	0.0405	3	Livingston	G-127
KI Sawyer WWTP-Marquette Co	0.04	1	Marquette	G-138
DeWitt Township CM	0.03784	2	Clinton	G-35
Riverview Estates MHC	0.03	3	Kent	G-105
Howell CM	0.021	1	Livingston	G-125
Frankenmuth WWTP	0.02	1	Saginaw	G-199
Owosso/Mid Shiawassee Co WWTP	0.02	2	Shiawassee	G-203
Harbor Springs Area Sewage	0.0151	2	Emmet	G-38
Alpine Township CM	0.013	2	Kent	G-96
Gull Lake Sewer & Water Authority CM	0.012	1	Kalamazoo	G-84
Ann Arbor CM	0.01127	7	Washtenaw	G-210
Portage CM	0.011125	4	Kalamazoo	G-89
Traverse City CM	0.010045	5	Grand Traverse	G-56
Port Austin WWTP	0.01	1	Huron	G-63
South Haven Area Water Sewer Authority WWTP	0.01	1	Van Buren	G-208
Hamburg Township CM	0.00911	6	Livingston	G-122
Chikaming Township CM	0.00704	1	Berrien	G-16
Constantine CM	0.006	1	St Joseph	G-205
Manistee Township CM	0.006	1	Manistee	G-136
Staybridge Suites Auburn Hills	0.006	1	Oakland	G-185
Big Creek/Mentor Utility Auth	0.0054	1	Oscoda	G-189
Southwest Barry Co SWA	0.0053	2	Barry	G-7
Franklin CM	0.00513	1	Oakland	G-169
Billings Twp WWTP	0.005	1	Gladwin	G-52
Cadillac CM	0.005	1	Wexford	G-246
Meijer Store 30	0.005	1	Jackson	G-81
Cass Co-Lakes Area SA WWTP	0.00451	2	Cass	G-26
Pontiac CM	0.004315	13	Oakland	G-176
Portage-Baseline Lakes WWTP	0.00405	3	Washtenaw	G-214
Lake Mitchell Sewer Authority (former Wexford Co DPW) CM	0.00394	4	Wexford	G-247
Muskegon Co WWMS Metro WWTP	0.0035	2	Muskegon	G-151
Midland WWTP	0.0034	2	Midland	G-145
Kalamazoo CM	0.00314	8	Kalamazoo	G-85
Buena Vista Twp WWTP	0.003	1	Saginaw	G-198
Flint Charter Township CM	0.003	1	Genesee	G-40
Black Bear Farms WWTP	0.0025	1	Grand Traverse	G-53
Moline WWTP	0.0025	1	Allegan	G-252
Westrock BOD Battle Creek	0.0025	2	Calhoun	G-24
Grand Rapids CM	0.002288	8	Kent	G-99
Dow Silicones Corporation-Midland Site	0.00201	4	Midland	G-142

Entity Name	Total Volume (MG)	Reported Events	County	Appendix Page #
Cassopolis CM	0.002	1	Cass	G-28
Saline WWTP	0.002	1	Washtenaw	G-216
Waverly Shores Village MHC	0.002	2	Ottawa	G-196
Sunny Brook RV Resort	0.001902	1	Van Buren	G-209
Battle Creek CM	0.00182	4	Calhoun	G-22
Croswell WWTP	0.00175	1	Sanilac	G-200
Commerce Township CM	0.001375	3	Oakland	G-157
Clark Twp WWSL	0.0012	1	Mackinac	G-129
Dow Silicones Corporation-Auburn	0.00115	3	Bay	G-9
Brighton Twp WWTP	0.0011	3	Livingston	G-117
Bad Axe WWTP	0.00075	1	Huron	G-61
Brighton Village MHP CM	0.0007	1	Livingston	G-119
Rives Township CM	0.00056	1	Jackson	G-83
Bellaire WWTP	0.0005	1	Antrim	G-5
Benton Charter Township CM	0.0005	1	Berrien	G-13
Bloomfield Township CM	0.0005	1	Oakland	G-155
Northport Pointe WWTP	0.0005	1	Leelanau	G-113
Northport/Leelanau Township Utilities Authority CM	0.0005	1	Leelanau	G-114
Springrove MHC	0.0005	1	Oakland	G-184
Sunrise Senior Living	0.00048	1	Oakland	G-186
Holland CM	0.0004	1	Ottawa	G-193
Napoleon Township CM	0.0004	1	Jackson	G-82
Alpine Meadows MHC	0.000315	4	Kent	G-94
St Joseph CM	0.0003	1	Berrien	G-21
Windsor Woods Village	0.0003	1	Allegan	G-2
Marquette CM	0.00028	3	Marquette	G-139
Genoa Twp-Lake Edgewood WWTP	0.00025	1	Livingston	G-121
Hesperia WWTP	0.00025	1	Newaygo	G-153
Benton Harbor CM	0.00024	1	Berrien	G-14
East Bay Township CM	0.0002	1	Grand Traverse	G-54
Harrison WWTP	0.0002	1	Clare	G-34
Oxford Township CM	0.0002	1	Oakland	G-175
Orchard Lake Village CM	0.00017	2	Oakland	G-174
Carlton Township CM	0.00016	1	Barry	G-6
GRSD Sewer Authority WRRF	0.00015	2	Berrien	G-19
DECO-Fermi-2 Plt	0.00015	1	Monroe	G-148
Leland Township CM	0.00014	2	Leelanau	G-111
Ada Township CM	0.0001	1	Kent	G-92
Alpena Township CM	0.0001	1	Alpena	G-4
Belle-Ann Falls	0.0001	1	Oakland	G-154

Entity Name	Total Volume (MG)	Reported Events	County	Appendix Page #
Byron Center Village MHC	0.0001	1	Kent	G-97
Clare WWTP	0.0001	1	Clare	G-33
Creekside Estates MHC	0.0001	1	Wayne	G-221
Ebels Family Center	0.0001	1	Missaukee	G-147
GM-CPC-Romulus Engine	0.0001	1	Wayne	G-227
Kinross Twp WWTP	0.0001	1	Chippewa	G-30
Lake Orion CM	0.0001	1	Oakland	G-172
Metamora WWSL	0.0001	1	Lapeer	G-110
New Haven CM	0.0001	1	Macomb	G-131
Richmond Twp WWTP-Marquette Co	0.0001	1	Marquette	G-141
Woodlands MHP	0.0001	1	Oakland	G-188
Caledonia Township CM-Kent Co	0.000085	1	Kent	G-98
Deerfield Township CM	0.00008	1	Livingston	G-120
Pinebrook Village MHC	0.00007	2	Kent	G-104
Port Sanilac WWSL	0.000055	1	Sanilac	G-201
Algoma Township CM	0.00005	1	Kent	G-93
Alpena CM	0.00005	2	Alpena	G-3
Grand Haven-Spring Lake WWTP	0.00005	1	Ottawa	G-192
Grattan Township CM	0.00005	1	Kent	G-103
Green Lake Township - Bush Road Community Sewer System	0.00005	1	Grand Traverse	G-55
Highland Hills of Highland	0.00005	1	Oakland	G-171
MDNR-Port Crescent SP WWSL	0.00005	1	Huron	G-62
Presidential Estates	0.00005	1	Ottawa	G-194
Wyoming CM	0.00003	1	Kent	G-108
Chocolay Township CM	0.00002	1	Marquette	G-137
Yates Township CM	0.00002	1	Lake	G-109
Bridgman CM	0.00001	1	Berrien	G-15
River Haven MHP WWTP	0.000005	1	Ottawa	G-195
Southwood Village MHC	0.000005	1	Kent	G-107
Rochester University	0.000002	1	Oakland	G-183
Dowagiac CM	0.000001	1	Cass	G-29
Total SSO	293.48	294		

How Does 2021 Compare to Previous Years?

A summary of the number of annual SSO events and the annual discharge volume for the past seventeen years are represented below.

Figure 7: Number of SSO Events/Year


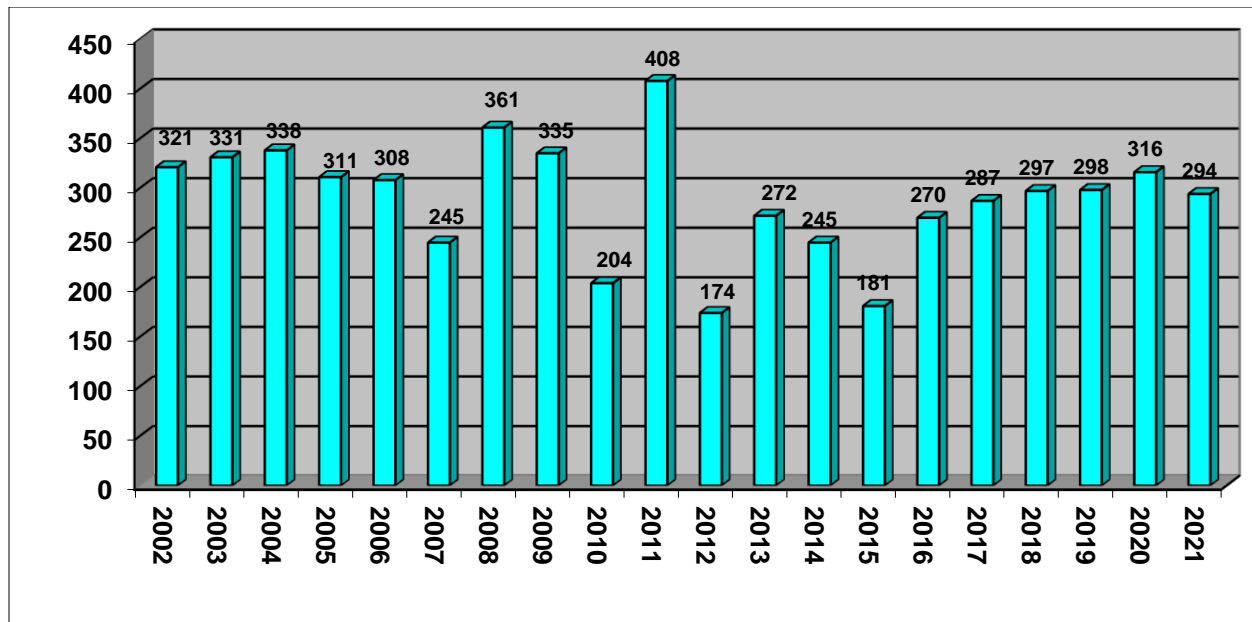


Figure 8: SSO Total Volume/Year (in Millions of Gallons)

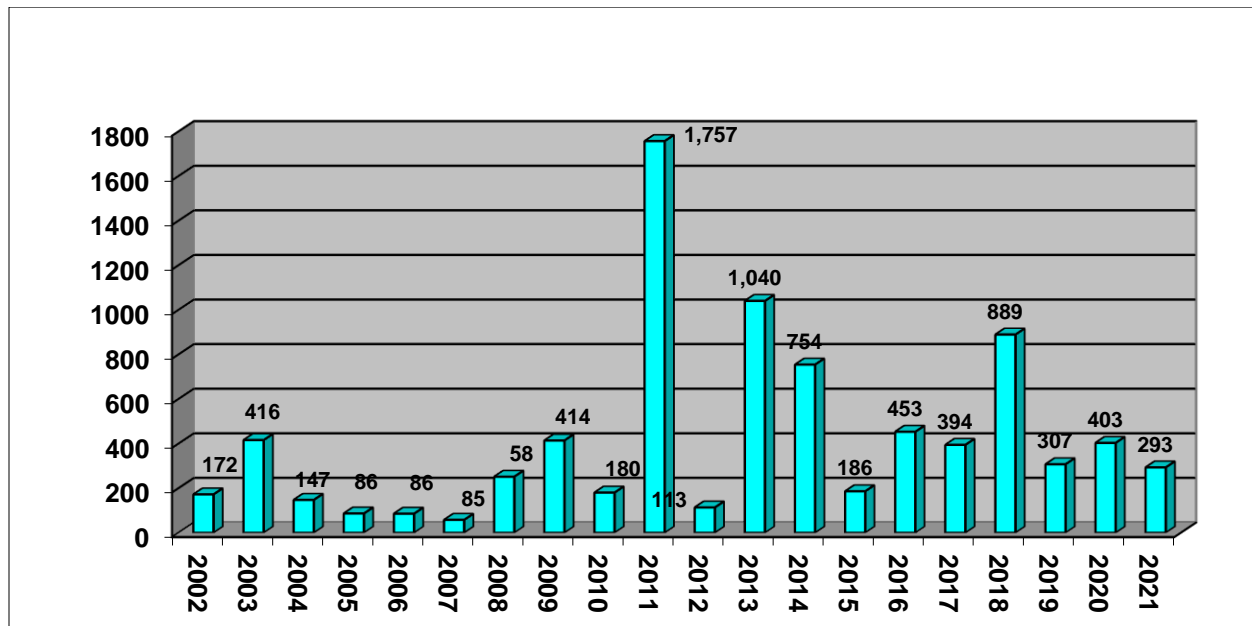

As discussed in the CSO/RTB section, above, above average precipitation totals in 2021 resulted in a marked increase in discharges compared to the relatively dry years, such as 2015.

EGLE continues to review SSO events to determine where corrective actions are needed to ensure that sewer systems are able to handle a 25-year, 24-hour storm event without having SSOs, in accordance with EGLE's [SSO Policy Statement and Clarification Statement](#).

2021 SSO Progress Report

The summaries, below, illustrate some statewide projects aimed at controlling SSO discharges. These examples further demonstrate the ongoing progress that communities are making toward achieving the goals of the state SSO Program and complying with associated state and federal laws.

- Macomb Interceptor Drain (MID)

In December 2016 a section of the 11-foot diameter interceptor of the MID collapsed in the city of Fraser. The collapse severely restricted the capacity of the interceptor, resulting in an SSO to prevent sewage from backing up in basements.

The MID entered into an ACO with EGLE on September 18, 2017. The ACO required the MID to conduct a detailed inspection of the collection system, which has been completed. As a result of the inspection results, the MID is currently rehabilitating over 12,000 feet of interceptor at an estimated cost of \$40.5 million.

- City of Warren

The city of Warren has a history of SSOs and blending at the WWTP. The city has installed relief sewers to increase the capacity of the collection system. The NPDES Permit requires the city to eliminate SSOs and stop blending at the WWTP, in accordance with the SSO Policy, by October 1, 2023.

The city has started construction of upgrades to the 9 Mile pump station, additional relief sewers, and a wet-weather detention basin, at an estimated cost of \$81 million, to meet EGLE's SSO Policy.

- Gogebic-Iron Wastewater Authority (GIWA) WWTP

This facility has worked to eliminate overflows to the Montreal River and bypassing of the secondary treatment process. The GIWA allocates their design capacity of 3.4 million gallons to the contributing municipalities of Ironwood, Michigan (2.46 million gallons per day [MGD]); Hurley, Wisconsin (0.624 MGD); and Ironwood Township, Michigan (0.316 MGD). During the 10-year period from 2001-2010, the annual average flow conveyed to the GIWA WWTP was reduced by 25 percent. Since 2006, the city of Hurley replaced 25,000 feet of sanitary sewer and installed 6,000 feet of sewer lining. During years 2011 and 2012, Ironwood Township completed sewer upgrades with two projects at a cost of \$1.5 million and \$0.3 million, respectively. The city of Ironwood sewer upgrade projects 1-3 since 2010 included over \$10 million in improvements. The NPDES Permit requires a PPC to be completed by October 1, 2024, to demonstrate conformance with EGLE's SSO Policy. The city of Ironwood was awarded \$0.726 million and Ironwood Township received \$0.279 million in SAW funding to

evaluate sewer integrity and prioritize upgrades through an asset management program. The city of Ironwood received funding from the United States Department of Agriculture Rural Development (\$1.685 million) for sewer upgrade 4.

- Clinton Township

The township has been working to eliminate SSOs from seven overflow pumps in two sewer districts since the early 2000s. They have completed all projects associated with the ACO (infiltration and inflow reduction projects, including sewer lining, manhole rehabilitation, and footing drain disconnection pilot projects) and have conducted a PPC to determine if they meet the EGLE SSO Policy. The township spent over \$30 million to date to eliminate SSOs.

- City of Centerline

The city of Centerline in Macomb County reported SSOs in their sewerage system starting in 2000. On August 24, 2001, Administrative Consent Order ACO-SW01-006 was entered for the city to eliminate their SSOs at various locations and also to remain within their total peak flow contract capacity with the GLWA. The city first invested \$9.14 million to eliminate SSOs and convert their 24" gravity outlet sewer to a force main. In 2015 the city installed an electric valve actuator at the SSO gate to further reduce SSO volumes to the Lorraine Drain. The city did not certify the project, and they are currently working on a Corrective Action Program to further reduce flow to meet EGLE's SSO Policy.

This Report was Prepared by:



Water Resources Division

Internet Address:
Michigan.gov/EGLE

Liesl Eichler Clark, Director

Special thanks to the following technical staff and managers that contribute annually towards the development of this report: Phil Argiroff, Dennis Ryan, and the many staff in field operations that review the data and populate the database throughout the year.

Report Coordinator: Dan Beauchamp

NATURAL RESOURCES AND ENVIRONMENTAL PROTECTION ACT (EXCERPT)
Act 451 of 1994

324.3112a Discharge of untreated sewage from sewer system; notification; duties of municipality; legal action by state not limited; penalties and fines; definitions.

Sec. 3112a.

(1) Except for sewer systems described in subsection (8), if untreated sewage or partially treated sewage is directly or indirectly discharged from a sewer system onto land or into the waters of the state, the person responsible for the sewer system shall immediately, but not more than 24 hours after the discharge begins, notify the department; local health departments as defined in section 1105 of the public health code, 1978 PA 368, MCL 333.1105; a daily newspaper of general circulation in the county or counties in which a municipality notified pursuant to subsection (4) is located; and a daily newspaper of general circulation in the county in which the discharge occurred or is occurring of all of the following:

(a) Promptly after the discharge starts, by telephone or in another manner required by the department, that the discharge is occurring.

(b) At the conclusion of the discharge, in writing or in another manner required by the department, all of the following:

(i) The volume and quality of the discharge as measured pursuant to procedures and analytical methods approved by the department.

(ii) The reason for the discharge.

(iii) The waters or land area, or both, receiving the discharge.

(iv) The time the discharge began and ended as measured pursuant to procedures approved by the department.

(v) Verification of the person's compliance status with the requirements of its national pollutant discharge elimination system permit or groundwater discharge permit and applicable state and federal statutes, rules, and orders.

(2) Upon being notified of a discharge under subsection (1), the department shall promptly post the notification on its website.

(3) Each time a discharge to surface waters occurs under subsection (1), the person responsible for the sewer system shall test the affected waters for E. coli to assess the risk to the public health as a result of the discharge and shall provide the test results to the affected local county health departments and to the department. The testing shall be done at locations specified by each affected local county health department but shall not exceed 10 tests for each separate discharge event. The requirement for this testing may be waived by the affected local county health department if the affected local county health department determines that such testing is not needed to assess the risk to the public health as a result of the discharge event.

(4) A person responsible for a sewer system that may discharge untreated sewage or partially treated sewage into the waters of the state shall annually contact each municipality whose jurisdiction contains waters that may be affected by the discharge. If those contacted municipalities wish to be notified in the same manner as provided in subsection (1), the person responsible for the sewer system shall provide that notification.

(5) A person who is responsible for a discharge of untreated sewage or partially treated sewage from a sewer system into the waters of the state shall comply with the requirements of its

national pollutant discharge elimination system permit or groundwater discharge permit and applicable state and federal statutes, rules, and orders.

(6) This section does not authorize the discharge of untreated sewage or partially treated sewage into the waters of the state or limit the state from bringing legal action as otherwise authorized by this part.

(7) The penalties and fines provided for in section 3115 apply to a violation of this section.

(8) For sewer systems that discharge to the groundwater via a subsurface disposal system, that do not have a groundwater discharge permit issued by the department, and the discharge of untreated sewage or partially treated sewage is not to surface waters, the person responsible for the sewer system shall notify the local health department in accordance with subsection (1)(a) and (b), but the requirements of subsections (2), (3), (4), and (5) do not apply.

(9) As used in this section:

(a) "Partially treated sewage" means any sewage, sewage and storm water, or sewage and wastewater, from domestic or industrial sources that meets 1 or more of the following:

(i) Is not treated to national secondary treatment standards for wastewater or that is treated to a level less than that required by the person's national pollutant discharge elimination system permit.

(ii) Is treated to a level less than that required by the person's groundwater discharge permit.

(iii) Is found on the ground surface.

(b) "Sewer system" means a public or privately owned sewer system designed and used to convey or treat sanitary sewage or sanitary sewage and storm water. Sewer system does not include an on-site wastewater treatment system serving 1 residential unit or duplex.

(c) "Surface water" means all of the following, but does not include drainage ways and ponds used solely for wastewater conveyance, treatment, or control:

(i) The Great Lakes and their connecting waters.

(ii) Inland lakes.

(iii) Rivers.

(iv) Streams.

(v) Impoundments.

(vi) Open drains.

(vii) Other surface bodies of water.

History: 1994, Act 451, Eff. Mar. 30, 1995 ;-- Am. 1998, Act 3, Imd. Eff. Jan. 30, 1998 ;-- Am. 2000, Act 286, Imd. Eff. July 10, 2000 ;-- Am. 2004, Act 72, Imd. Eff. Apr. 20, 2004

Popular Name: Act 451

324.3112c Discharges of untreated or partially treated sewage from sewer systems; list of occurrences; “partially treated sewage” and “sewer system” defined.

Sec. 3112c.

(1) The department shall compile and maintain a list of occurrences of discharges of untreated or partially treated sewage from sewer systems onto land or into the waters of the state that have been reported to the department or are otherwise known to the department. This list shall be made available on the department's website on an ongoing basis. In addition, the department shall annually publish this list and make it available to the general public. The list shall include all of the following:

- (a) The entity responsible for the discharge.
- (b) The waters or land area, or both, receiving the discharge.
- (c) The volume and quality of the discharge.
- (d) The time the discharge began and ended.
- (e) A description of the actions the department has taken to address the discharge.
- (f) Whether the entity responsible for the discharge is subject to a schedule of compliance approved by the department.
- (g) Any other information that the department considers relevant.

(2) As used in this section:

- (a) “Partially treated sewage” means any sewage, sewage and storm water, or sewage and wastewater, from domestic or industrial sources that is not treated to national secondary treatment standards for wastewater or that is treated to a level less than that required by a national pollutant discharge elimination system permit.
- (b) “Sewer system” means a sewer system designed and used to convey sanitary sewage or storm water, or both.

History: Add. 2000, Act 287, Imd. Eff. July 10, 2000

Popular Name: Act 451

BACKGROUND INFORMATION ON DISCHARGES

Introduction

Raw and inadequately treated sewage discharged from municipal and privately-owned sewer systems is an environmental and public health problem that has plagued Michigan for decades. The State of Michigan took a more aggressive approach to address these discharges in 1988 by initiating an aggressive Combined Sewer Overflow (CSO) control strategy and, in the year 2000, by adopting a Sanitary Sewer Overflow (SSO) control strategy. Detailed information about the Michigan CSO control strategy and its history and progress can be found in the [2007 CSO/SSO Annual Report](#). Regarding SSO control, local units of government were called upon to help protect Michigan's waters as part of the 2000 initiative. With significant stakeholder participation, EGLE adopted the [SSO Policy Statement](#) in 2002, which establishes criteria for SSO correction. This report is one step in addressing these types of discharges for the people of Michigan. Specifically, it defines and publicizes the extent of this statewide problem and the actions being taken to control these discharges.

What Is the Difference between a Sanitary Sewer System and a Combined Sewer System?


In order to understand the difference between a CSO and an SSO, it is necessary to understand some basics of sewer system design. Separate sanitary sewers are designed to carry only sanitary sewage to a wastewater treatment plant (WWTP) (see Figure 1); storm water is directed to a nearby river, lake, or stream via storm sewers. In urbanized areas, efforts are underway to address pollution issues related to discharges from separate storm water systems. For more information related to the Municipal Separate Storm Sewer System (MS4) Permit Program, please visit: Michigan.gov/EGLEStormWater. Combined sewer systems are generally older sewer systems designed to convey both sewage and storm water (combined in one pipe) to a WWTP (see Figure 2). Generally, combined sewer systems were designed with overflow points in the sewer system and/or at the WWTP. This is because the system cannot handle the entire volume of water that is associated with some larger storm water events.

The corrective action to address wet weather-related SSOs is to eliminate the discharge up to a specified rain event by drying up the system, installing retention facilities, and/or to increase transportation and/or treatment capacity of the sewerage system. The corrective action to address CSOs is to separate the sewer system and/or to install an adequate capture and treatment system. As part of final corrective action programs, many combined sewer systems have installed or are installing Retention Treatment Basins (RTB), which are designed to capture the combined sewage and rainwater that would otherwise flow to surface waters untreated. These basins hold the combined sewage long enough to provide treatment and disinfection before the combined sewage is discharged into waters of the state during periods of intense precipitation (see Figure 3). These basins also capture sewer system releases during smaller rainfall events and return all the captured sewage and rainwater back to the system to be routed to the WWTP for treatment.


In general, what are SSOs, CSOs, and RTB discharges?

SSOs are releases of raw sewage from separate sanitary sewer collection systems, which are designed to carry sanitary sewage but not storm water. CSOs (untreated discharge) are releases of raw sewage from older combined sewer collection systems designed to carry both sanitary sewage and storm water. Both CSO and SSO events can discharge untreated human and industrial waste, toxic materials, debris, and disease-causing organisms onto the ground or into our rivers, lakes, or streams. RTB discharges are treated discharges from facilities installed to collect and treat combined sewer system overflows. RTBs are designed to meet wastewater discharge permit requirements and be protective of water quality and public health.


Figure 1: Separate Sewer System

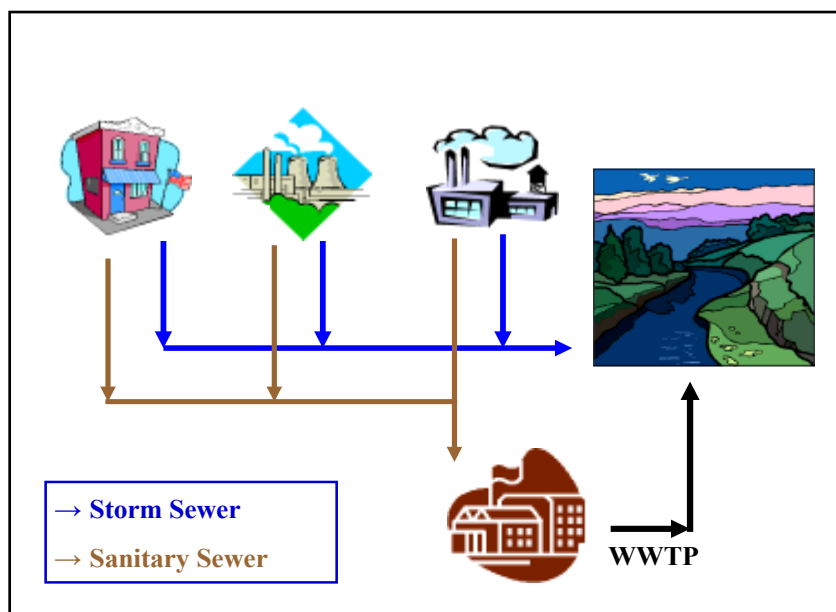

WWTP = wastewater treatment plant

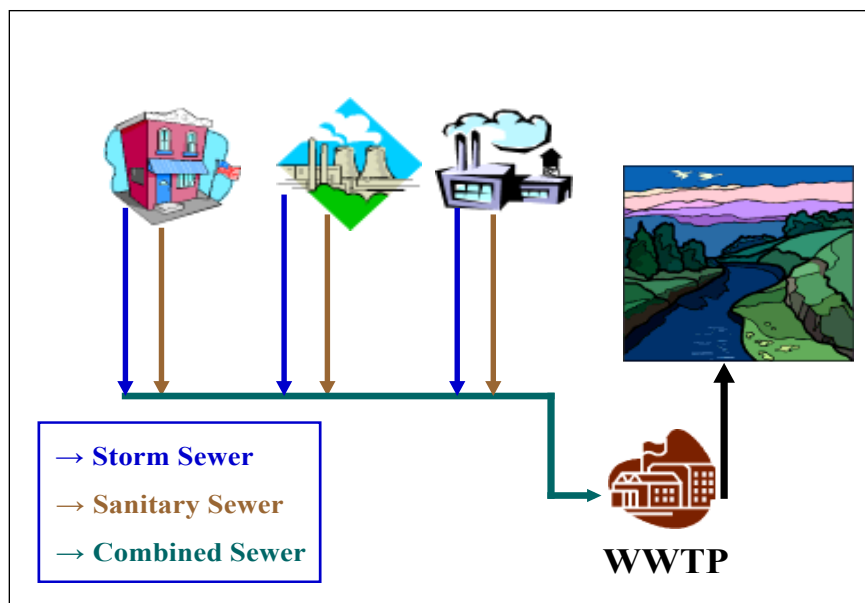Figure 2: Combined Sewer System—Dry Weather Conditions

WWTP = wastewater treatment plant

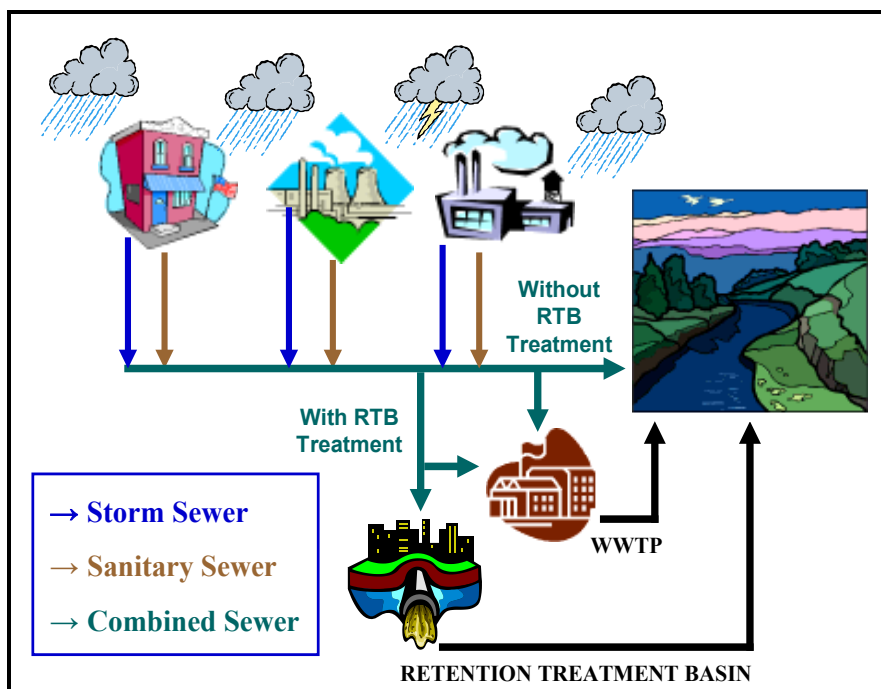Figure 3: Combined Sewer System—Wet Weather Conditions

RTB = retention treatment basin

WWTP = wastewater treatment plant

What Laws Require Reporting of Releases?

Section 324.3112(a) of the Natural Resources and Environmental Protection Act, 1994 PA 451, as amended (NREPA), requires responsible parties to report releases of untreated or partially treated sanitary sewage. Section 324.3112(c) of the NREPA requires an annual reporting of these releases. This section was added in July 2000. EGLE has produced this report as a means of providing the public with information regarding known discharges of untreated and partially treated sewage to land and waters of the state.

Although discharges from RTBs are required to be reported as a “partially treated” discharge, these discharges are designed to be fully compliant with permit requirements and protect water quality and public health.

Prior to 2004, only releases from municipalities were required to be reported. However, in 2004, Section 324.3112a was amended to include reporting of treated and partially treated sewage releases from private systems (system serving more than a duplex).

Additionally, on January 8, 2018, the United States Environmental Protection Agency published the final [Public Notification Requirements](#) for Combined Sewer Overflows to the Great Lakes. The new rule requires all CSO permittees to develop a notification plan, to provide public notification of CSOs within four hours of becoming aware of the discharge, to submit supplemental notification within seven days, and to provide an annual report with information about all CSOs.

Who Will Let Me Know Whether the Water Is Safe for Swimming, Fishing, or Canoeing?

When raw or partially treated sewage is released into a river, lake, or stream, the responsible party is required to notify the local health department and others as specified in the law. The local health department may sample, or may require the responsible party to sample, the water body that received the sewage discharge. If the discharge poses a public health threat, then the local health department is responsible for issuing a public health advisory to notify people of the dangers associated with river or lake water contact.

Additionally, the local health department gathers information related to health aspects of water pollution for public and semi-public beaches (this activity may not be specifically related to untreated or partially treated releases). They issue swimming advisories and track reported illnesses related to waterborne organisms. Some local health departments provide citizens with information and resources to do their own beach monitoring.

More information about water quality monitoring related to health aspects of water pollution, including a list of local health departments with phone numbers can be found through the State of Michigan Beach Monitoring Web site at: <https://mienviro.michigan.gov/ncore/external/home>. Phone books and the Michigan Department of Health and Human Services' [Local Health Department Maps](#) web page also contain local health department contact information. When searching the phone book, look for either the county health department or the district health department for your area.

How Does Intergovernmental Cooperation Help Fund Infrastructure Improvements?

The Clean Water State Revolving Fund (CWSRF or SRF) and the Strategic Water Quality Initiatives Fund (SWQIF) remain the primary sources of financial assistance for local units of government facing wastewater infrastructure investment needs. The SRF was created in 1989 and capitalized with federal grant funds and a required state match. The SRF has tendered over \$5 billion in loan assistance to Michigan communities for the construction, expansion, and upgrade of publicly owned sewers and wastewater treatment facilities.

The passage of the \$1 billion Great Lakes Water Quality Bond referendum in November 2002 (Proposal 2) provides additional capital into the SRF. That vote also created the SWQIF, another revolving loan fund that provides low interest loan assistance for wastewater system improvements that remain in private ownership. The portion of Proposal 2 monies dedicated to the SWQIF is available for projects that remove clear water from sewer leads on private property (often a component of successful SSO projects) or for projects to upgrade or replace failing on-site wastewater systems. A portion of these funds (\$80 million) was used to provide grants to assist loan applicants with completing the planning and design of their projects. The revolving funds will operate in perpetuity and result in significant cost savings for system owners and users compared to open market financing alternatives, while remaining the primary source of funding for water quality protection efforts in the state.


Passage of Proposal 2 also resulted in funding for the Storm Water, Asset Management, and Wastewater (SAW) Program. The SAW Program was created in January 2013 from legislation enacted to establish grants for asset management plan development, storm water plan development, testing and demonstration of innovative technology, sewage collection and treatment plan development, and state-funded loans to construct projects identified in the asset management plans and implementation of successful innovative technology. A total of \$450 million is allocated to provide grants and loans under SAW. A grant recipient must proceed with a project for which grant funding is provided within three years of grant award. For the asset management grant, this means significant progress as determined by EGLE toward achieving the funding structure to implement the asset management program. SAW funding will aid in planning and constructing projects that will further protect Michigan's valuable water resources. In December 2013, the SAW grant and loan applications were received, and in April 2014 it was announced that over 92 recipients throughout the State were selected for a total of over \$97 million in grants and loans. Additionally, in October 2014, \$94 million in SAW grants and loans were awarded to over 117 recipients, in October 2015, \$100 million in SAW grants and loans were awarded to 134 recipients, in October 2016, \$97 million in SAW grants and loans were awarded to 137 recipients and in in December 2017, \$65 million in SAW grants were awarded to 83 recipients, May 2018, \$8.2 million in SAW grants were awarded to 13 recipients and in in in April 2020, \$8.6 million in SAW grants were awarded to 19 recipients.

Who Do I Contact for More Information?

While compiling the information in this report, EGLE identified some data integrity issues and other related problems. These problems and issues were eliminated whenever possible. EGLE has made sincere efforts to assure the accuracy of this report, which is intended for informational purposes only. If you believe the information is inaccurate or if you have any questions or concerns regarding the information contained in the report, please contact the appropriate [district office](#) for your area.

For additional information regarding the State of Michigan's overall CSO/SSO control strategies and policies, or questions regarding specific events, please contact the appropriate [district office](#) for your area. More information, including a continually updated database of reported events can be found on-line at Michigan.gov/SewageDischarge.

Bay City District Office: 401 Ketchum Street, Suite B, Bay City 48708
Cadillac District Office: 120 W. Chapin St, Cadillac 49601
Gaylord District Office: 2100 West M-32, Gaylord 49735
Grand Rapids District Office: 5th Fl. 350 Ottawa Ave NW, Grand Rapids 49503
Jackson District Office: 301 E. Louis Glick Hwy, Jackson 49201
Kalamazoo District Office: 7953 Adobe Road, Kalamazoo 49009
Lansing District Office: PO Box 30242, 525 W. Allegan, Lansing 48909
Marquette District Office: 1504 W. Washington St., Marquette 49855
Warren District Office: 27700 Donald Court, Warren 48092

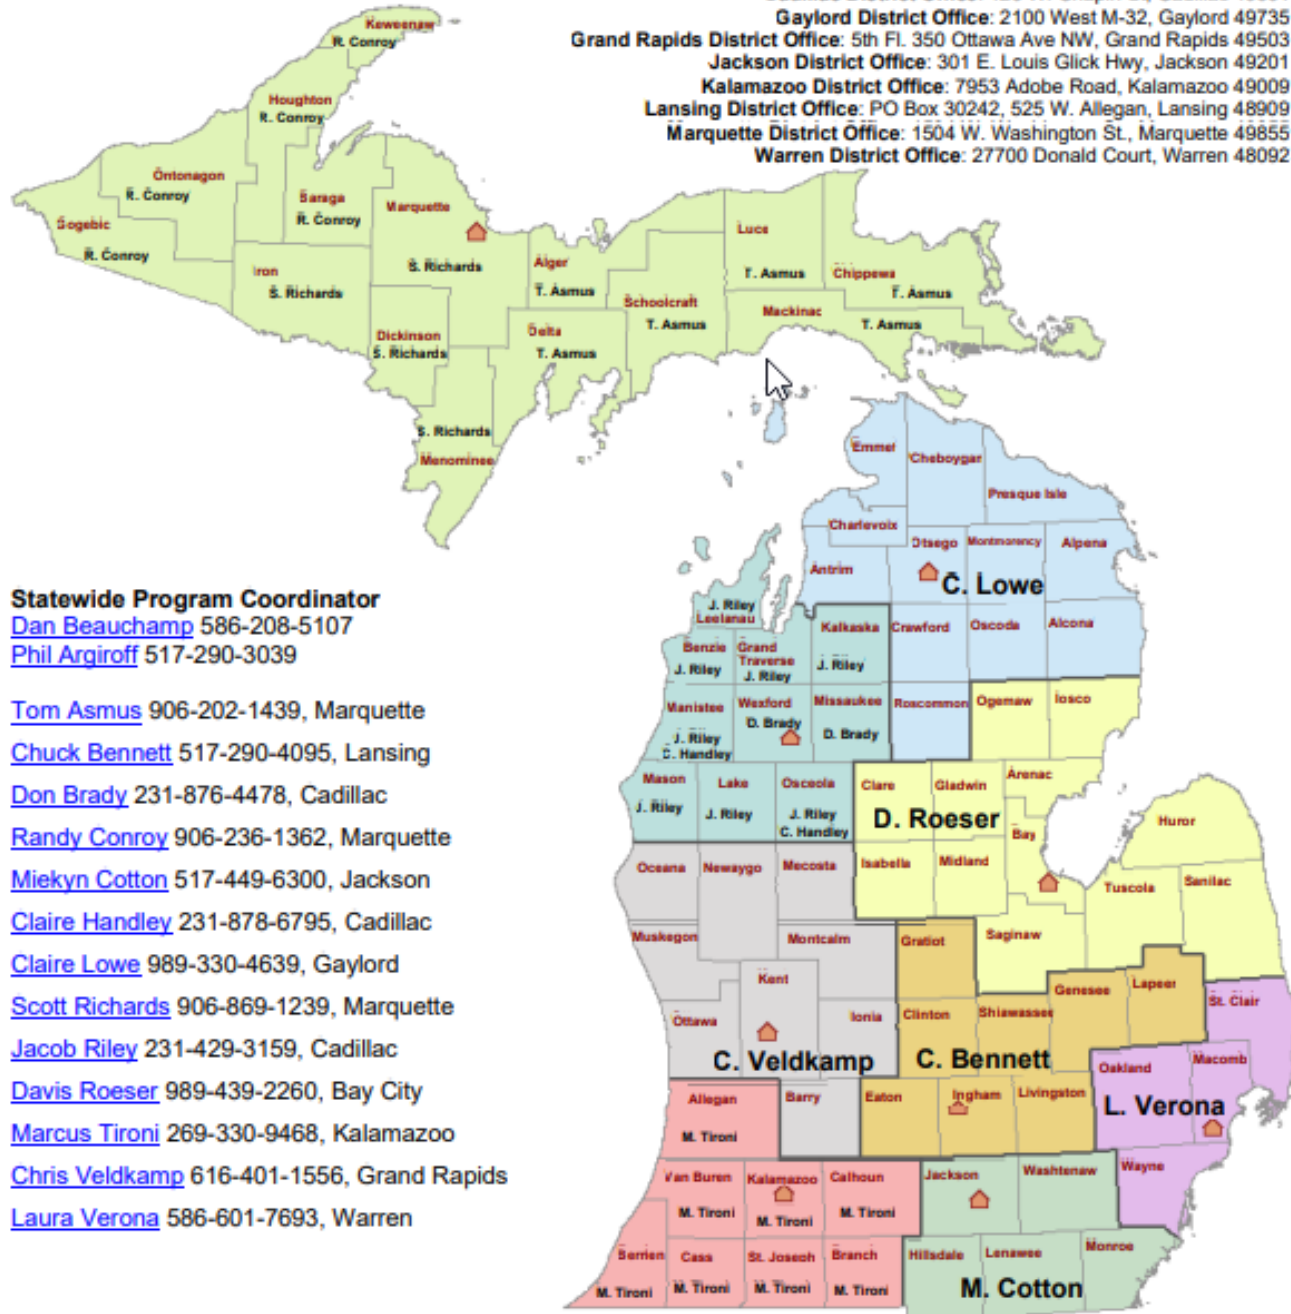

3/7/2022

Report Terms and Acronyms

For the purposes of this report, the following terms and acronyms are described below:

Explanation of Report Headings:

EventID: A unique internal EGLE tracking number assigned to an event. If you have questions about a specific event, or need additional information, providing this number to EGLE district office staff in your area will assist them in finding the correct information.

Start Date/Time: The date and time the discharge event began. If there were multiple discharge locations associated with a single event, all discharging at different dates/times, then this is the date/time of the earliest discharge.

End Date/Time: The date and time the discharge event ended. If there were multiple discharge locations associated with a single event, all discharging at different dates/times, then this is the date/time of the latest discharge.

Event Volume: Total discharge volume for the event (in MG) reported by the responsible party. This value *can* be an estimated value as is often the case with SSOs. When the report lists 'Not Specified,' no volume information was reported to EGLE.

Discharge Quality: Description of the quality of the wastewater discharged. See *Acronym/Definitions* section below for detailed explanations.

Point(s) of Discharge: Narrative description of wastewater discharge location(s). It provides information about receiving waters and/or land areas impacted by the discharge. A three-digit number preceding a receiving water name is the permittee's outfall discharge location as listed in their National Pollutant Discharge Elimination System (NPDES) permit. When the report lists "Not Specified," discharge information was not reported to EGLE for the land area or water body impacted. Note that this term is used in the appendix.

Control Program: This area of the report provides information and status of the permittee's long-term control program corrective actions as contained in their NPDES permit.

Outfall Corrective Actions: For SSOs, this area of the report provides information regarding corrective actions taken to reduce/eliminate future discharges from a particular SSO outfall discharge location (Note: These corrective actions do not pertain to a specific discharge event or to the owner of the sewer system as a whole). The specific locations where these corrective actions have taken place are listed under "Associated Outfall(s)."

Definitions/Acronyms:

Adequately Treated: RTB discharges that have been demonstrated to meet Water Quality Standards or discharges from an RTB that was designed to meet the presumptive regulatory approach.

Clear Water: Clear Water is non-sanitary or nonindustrial wastewater that may enter the sewer system. It includes, but is not limited to: groundwater that seeps in through cracks in the sewer pipes; rainwater or snowmelt that flows into the sanitary system through improperly connected roof drains; groundwater that enters from footing drains and sump pumps; and storm water that enters when storm sewers are inadvertently connected to the sanitary sewer.

Collection System: System of subsurface sewer pipes designed and used to convey either sanitary sewage or both sanitary sewage and storm water to a wastewater treatment plant.

Combined Sewer: Sanitary sewage and storm water are conveyed in the same (combined) sewer pipe.

CSO: Combined Sewer Overflow (untreated discharge), a wet weather-related, untreated discharge from a combined sewer collection system.

Demonstrative Regulatory Approach: For RTBs that are built based on approved designs that are less conservative than the “presumptive approach” and, therefore, require an evaluation upon completion of construction to demonstrate that the treated discharges meet Water Quality Standards.

EGLE: Michigan Department of Environment, Great Lakes, and Energy.

Diluted Sanitary Sewage: Sanitary sewage diluted with rainwater, snowmelt, or groundwater.

Infiltration/Inflow (I/I): Rainwater, snowmelt, or groundwater flowing into separate sanitary or combined sewers, typically introduced via connected roof downspouts and/or building footing drains or infiltrating into the pipe through cracks in the pipe walls or joints.

MG: Million Gallons, e.g., 24,000 gallons = 0.024 MG

NPDES Permit: National Pollutant Discharge Elimination System Permit. A permit issued by EGLE, authorized under the federal Clean Water Act, to discharge treated wastewater to waters of the United States.

Outfall: Point of discharge of treated, partially treated, or untreated wastewaters to surface waters of the state.

Partially Treated Sewage: Any sewage, sewage and storm water, or sewage and wastewater, from domestic or industrial sources that meets one or more of the following: (1) Is not treated to national secondary treatment standards for wastewater or that is treated to a level less than that required by the person’s NPDES Permit; (2) Is treated to a level less than that required by the person’s Groundwater Discharge Permit; and (3) Is found on the ground surface (Section 324.3112c of the NREPA).

Presumptive Regulatory Approach: For RTBs that are designed using a conservative engineering approach. In this approach, meeting Water Quality Standards (WQS) is assumed and there is no need for a demonstration following completion of construction.

Raw Sewage: Untreated sanitary sewage.

RTB: Retention Treatment Basin or equivalent facility used for control and treatment of CSOs.

Separate Sanitary Sewer: Separate sanitary sewer pipe, designed to convey only sanitary sewage and minor amounts of I/I to a wastewater treatment facility.

Sewer System: A public or privately-owned wastewater collection facility designed and used to convey or treat sanitary sewage or sanitary sewage and storm water. Sewer system does not include an on-site wastewater treatment system serving one residential unit or duplex.

SSO: Sanitary Sewer Overflow (raw or inadequately treated discharge), a discharge from the sanitary sewer collection system, and a dry weather discharge from a combined sewer collection system.

Surface Waters of the State: e.g., rivers, streams, creeks, lakes, some open ditches, and wetlands (as opposed to groundwaters, i.e., aquifers).

Twp: Township

WQS: Water Quality Standards are regulations that establish the uses for which surface waters of the state are protected and include numeric and narrative criteria to protect those uses.

WWTP: Wastewater Treatment Plant or other treatment facility such as a treatment lagoon.


Wastewater Treatment

How is Wastewater Treated?

Sanitary wastewater treatment involves various stages; generally there is primary and secondary treatment, then a disinfecting stage. During the first stage, called primary treatment, 40 percent to 50 percent of the solids in the influent (wastewater from homes and businesses) are removed from the waste stream. The technology often used in the primary treatment stage includes bar screens (that remove trash), grit chambers (that slow down the flow to let sand, grit, and solids settle and be removed), and sedimentation tanks (that allow particles to settle and be removed).

During the secondary treatment stage, the treatment process continues to remove pollutants such that, following secondary treatment, 85 percent to 90 percent of the influent pollutants have been removed from the waste stream. One method of this type of treatment includes an aeration tank followed by a secondary sedimentation tank. In the aeration tank, air is mixed into the waste stream and microorganism concentrations are kept high to speed the consumption of the organic matter. In the secondary sedimentation tank, the microorganisms and other solids settle to the bottom so they can be removed. After secondary treatment, a disinfectant such as chlorine is often used to kill disease-causing organisms before the wastewater leaves the treatment plant.

Figure 4: Wastewater Treatment Process

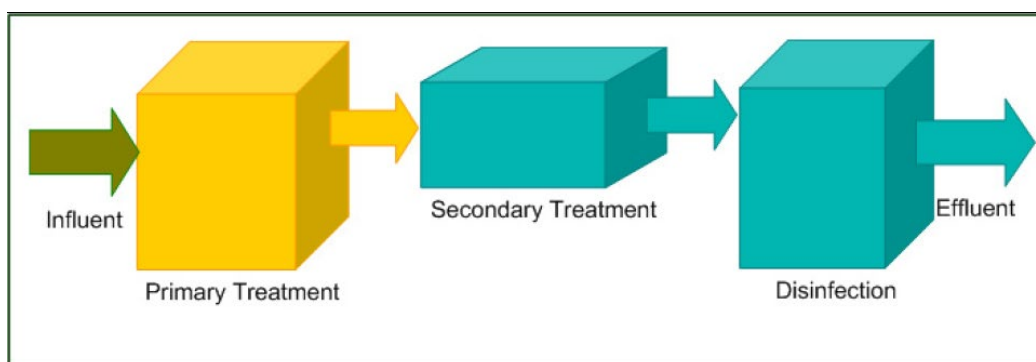


This report summarizes the discharge events of untreated or partially treated sewage from sewer systems. Most of these discharge events are classified as CSOs, RTBs, or SSOs, which are discussed at length elsewhere in this report. Other types of events that are reported are from blending and bypassing which happens at the wastewater treatment facility. These types of discharges are discussed below.

What is Blending?

As a result of wet weather events, some WWTPs experience higher influent flows due to significant levels of I/I (see definition on page B-8) in the associated separate sanitary sewer system. In order to accommodate these higher influent flows in their wastewater treatment

operations, some WWTPs have a “blending” option at their facilities (“blending” used in this discussion does not include combined sewer systems). Generally during blending, the wastewater receives primary treatment and disinfection but a portion of the wastewater will not receive secondary treatment. The term blending generally refers to the mixing of the wastewater that received full (i.e., secondary) treatment with a component of primary-treated wastewater that has been diverted around the secondary treatment process (see Figure 5 below). This mixed wastewater is disinfected and then discharged from the facility.

Figure 5: Wastewater Treatment Process - Blending Condition

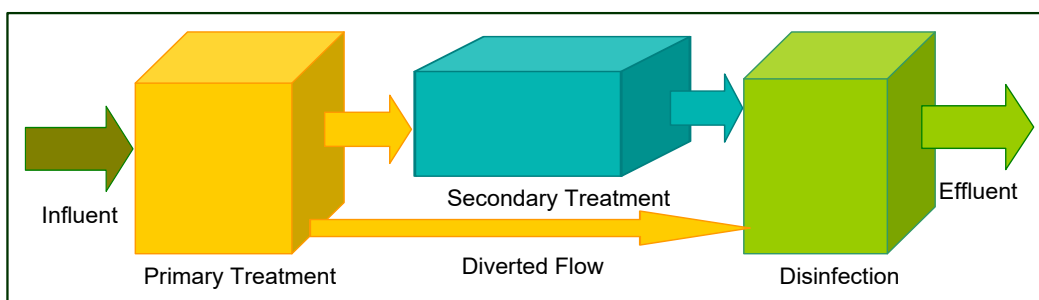

The term “blending” is used specifically for an anticipated wet weather treatment scenario approved by EGLE through issuance of an NPDES permit. The approval is an interim means to address higher influent flows as a result of wet weather conditions during storms at or below EGLE remedial design standard. Currently, there are very few approved blending scenarios in Michigan, and EGLE is working with these municipalities to eliminate these remaining blending authorizations. It is important to note that the discharges associated with these approved blending scenarios are required by the NPDES permit to produce effluent quality that complies with the Michigan WQS. Although Michigan has a small percentage of facilities that have approved blending through an NPDES permit, in other states many facilities engage in this practice under their NPDES permits.

Data in Appendix C contains blended effluent discharges reported in 2021 for facilities with approved blending scenarios in their NPDES permit. There were 9 blending events reported in 2021 representing a volume of 512.8 MG.

What is Bypassing?

Bypassing is the diversion of waste streams from any portion of a treatment facility other than approved blending described above. Similar to blending, bypassing can be the result of elevated influent flows due to wet weather events. However, bypassing may occur in the absence of a wet weather event due to equipment failure or some other difficulties at the WWTP. In contrast to blending, bypassing is not a preapproved treatment scenario and is not authorized in NPDES permits except to prevent loss of life, personal injury, or severe property damage. Further, unlike the approved blending scenarios, the discharges associated with bypassing events may or may not be compliant with the Michigan WQS. Instead, this wastewater is variable and often partially treated (usually through the treatment train up to the

process unit that failed). For example, using the wastewater process shown in Figure 4, if a malfunction shut down the mechanical disinfection system, then the wastewater would have received secondary treatment (Figure 4) but not disinfection, and this would be considered a bypass. In general, EGLE requires that the factors contributing to the occurrence of the bypass event be corrected as soon and as aggressively as is feasible.

Data in Appendix D contains bypass effluent discharges reported in 2021. There were 68 bypass events reported in 2021 representing a volume of 217.8 MG.

Combined Sewer Overflows and Retention Treatment Basins

What are Combined Sewer Overflows and What Causes Them?

Combined sewer systems are sewers that are designed to collect snowmelt, rainwater runoff, domestic sewage, and industrial wastewater in the same pipe. Most of the time, combined sewer systems transport all of their wastewater to a sewage treatment plant where it is treated and then discharged to a water body. During periods of heavy rainfall or snowmelt, however, the wastewater flow rate in a combined sewer system can exceed the capacity of the sewer system or treatment plant. For this reason, combined sewer systems were designed to overflow occasionally during wet weather and discharge excess wastewater directly to nearby streams, rivers, or other water bodies. Historically, CSOs were among the major sources for beach closings and other water quality impairments.

How are CSOs Addressed?

CSOs are a problem nationwide. Michigan initiated a CSO Control Program in 1988, and in 1994 the federal government developed a nationwide CSO Control Policy. This policy suggested that states use an enforceable mechanism, preferably the permit program that was initiated by the federal Clean Water Act (called the National Pollutant Discharge Elimination System) to require CSO communities to implement interim measures referred to as “nine minimum controls” by January 1, 1997, and to develop CSO Long-Term Control Plans (LTCP). The “nine minimum controls” basically included interim measures that could be undertaken to begin addressing the CSOs before major sewer system construction activities would be undertaken as part of the LTCP. Once the state and the community reach agreement on the LTCP, the community would then implement the CSO controls as soon as practicable. In Michigan, these LTCPs are contained in various legal documents, including state issued NPDES permits, Administrative Consent Orders, Abatement Orders, and other legal documents. In Michigan, all municipalities with CSOs have completed the necessary interim control measures and have developed LTCPs. You can learn the entire history of Michigan’s CSO control in the [2007 CSO SSO Annual Report](#).

The LTCP must assess a range of control options, including costs and benefits, and lead to selection of an alternative that would achieve appropriate water quality objectives and compliance with the federal Clean Water Act and state laws. Since the cause of CSOs is an excess of rain or snowmelt runoff entering the sewer system, some municipalities decide to separate their combined sewers, thereby redirecting the clean runoff to lakes, rivers, and streams via storm sewers. Sewer separation projects are expensive and time consuming because they involve extensive utility and road reconstruction. Sewers typically run under roads; therefore, roads need to be torn up and repaved in order to gain access to and redirect the sewers.



While separating the sewer system is a common practice to eliminate CSOs, other communities may choose to build additional treatment or storage basins to contain a portion of the volume and provide treatment of any resulting discharge to meet WQS at times of discharge. Specifically, as part of the final corrective program, many owners of combined sewer systems have installed or are installing treatment facilities called retention treatment basins (RTBs) or equivalent structures, which are designed to capture the combined sewage and runoff long enough to provide treatment and disinfection. Treatment often involves allowing solids to settle, the skimming of floatable materials such as sanitary trash and oils; and disinfection of disease-causing organisms, often accomplished through the addition of chlorine. This is the typical RTB design in the State of Michigan. The treatment provided significantly reduces the amount of pollutants discharged. It is important to note that the fully implemented LTCP requires the permittee to provide enough treatment to result in full protection of WQS and the public health.

There are two different regulatory approaches related to review, approval, and oversight of RTBs, namely presumptive and demonstrative. With the presumptive approach, the RTB is designed in a conservative manner where established engineering design criteria are met. In this approach, meeting WQS is assumed because of the conservative design and there is no need for a demonstration that WQS are met. Alternatively, sometimes economics and other factors preclude the building of such facilities, namely because of the very large size, and instead the RTB is designed less conservatively, and therefore, an evaluation is required upon completion of construction to demonstrate that discharges meet WQS. This latter scenario is considered the demonstrative approach. Most RTBs in Michigan are designed following the demonstrative regulatory approach.

Additionally, in 2018, EGLE issued an [addendum to the 1994 CSO Control Manual](#) (Addendum). One objective of the Addendum was to align the CSO control program with the other related wet weather programs. Specifically, the post-construction program requirements MS4 permits and the 2002 SSO Policy and associated 2003 Clarification Statement.

Site control measures, when used to address storm water runoff, have the potential to positively impact areas served by both separated and combined sewers. As a result, EGLE intends to reissue NPDES permits with additional control measures for combined sewer areas, where treatment was previously implemented and deemed to be adequate (either presumptive or demonstrative), and that are embedded in or directly adjacent to urbanized areas.

In addition to the MS4 Program alignment, the Addendum also aligns CSO discharge standards with the 2002 SSO Policy and 2003 Clarification Statement. The Addendum provides consistency between the SSO and CSO programs by introducing the concept of enforcement discretion for certain discharges from combined sewer systems. Enforcement discretion will be considered for untreated CSOs that discharge only during extreme events. Extreme event discharges are defined as: (1) no more than 1 untreated discharge in ten years from a CSO outfall during the April 1 through October 31 growth period; or (2) modeled to not discharge during the 3.9 inch in 24-hour storm event (during growth period, with normal soil moisture, rainfall distributed to a SCS Type II distribution).

What is the Main Challenge for Communities to Address in Controlling CSOs?

Several challenges exist in controlling CSOs, the most significant being the costs associated with mounting wastewater infrastructure improvements and the financial resource-intensive nature of CSO controls. CSO LTCPs typically involve major infrastructure investments that compete with other community financial needs.

There are several ways a community can fund CSO controls including federal grant programs and the use of bonds and user fees. However, the SRF has been a major source of financial assistance to communities addressing CSO problems and this involvement is particularly evident when reviewing the 2007 CSO/SSO Annual Report, and specifically, the CSO Summary Report within that report.

Sanitary Sewer Overflows

What are Sanitary Sewer Overflows?

Sanitary sewer overflows, or SSOs, are discharges of raw sewage from separate sanitary sewer collection systems. These systems are designed to carry sanitary sewage but not storm water. When an SSO occurs, sewage is released into areas such as the ground, streets, and/or streams, rather than being transported to a treatment facility. They are illegal and usually constitute a serious environmental and public health threat. Sewage discharges into basements may also occur, but these events are not required to be reported to EGLE for entry in this report under Section 324.3112(a) of the NREPA.

What causes an SSO?

For the purposes of this report, SSOs can be categorized in three general categories, those being chronic SSOs, site specific SSOs, and SSOs due to mechanical/electrical failure or emergency.

Chronic SSOs can occur when too much water enters into a sanitary sewer system. This water, known as “clear water,” includes, but is not limited to, the following sources:

- Groundwater that seeps in through cracks in the sewer pipes;
- Rainwater or snowmelt that flows into the sanitary system through improperly connected roof drains or other inflow sources;
- Groundwater that enters from footing drains and sump pumps; and
- Storm water that enters when storm sewers are inadvertently connected to the sanitary sewer.

Chronic SSOs can also occur when sanitary systems are too small to contain all the sanitary wastewater that is in the sewer system. Specifically, if the sewers and pumps that transport the sewage through the system are undersized, SSOs can result. Factors that can lead to chronic SSOs include: increased development in a community to the point where there is not enough sewer system capacity to handle the population; or, more likely, system deterioration due to the age of the sewer system and resulting excessive clear water inputs to the system.

Site-specific SSOs occur when blockages in the sewer cause sewage to back up in the sewer system. Some examples of blockages include tree roots growing into the sewer, when a sewer partially or totally collapses, when sediments build up in the sewers, or when grease or trash block the sewer.

Finally, SSOs occur due to power outages, emergency conditions, and equipment or mechanical failures. Examples include: faulty valves within the sewer pipes, lightning strikes to pump stations, the breaking of a sewer pipe, power failures that shut down pumps (which are installed to force sewage to higher points in the system), and even car accidents that damage sewer system pump stations.

How Does the Sewage End Up in the Environment?

Sewage may escape from a sewer system in many different ways. For example, SSO events include direct releases of sewage from a broken sewer pipe and releases of sewage through a manhole, generally in low areas of the sewer system. Sometimes sewage has been intentionally released from a sewer system into the environment to prevent basement flooding within the system. Additionally, some sewer systems have emergency storage basins (either retention or equalization basins) that hold excess sewage in an overflow scenario. These basins can provide some treatment of the sewage, and during extreme rain events, unauthorized overflow releases of sewage may occur.

How are SSOs Addressed?

Since SSOs have different causes, there are various ways that SSOs can be addressed. When SSOs are a chronic problem in a community, EGLE will require the responsible entity to implement corrective action programs within a defined schedule (“schedule of compliance” or SOC). The corrective action program outlines how the SSOs will be eliminated or treated, and the SOC will be embodied in a compliance document. Frequently, EGLE works to achieve a voluntary settlement. These settlements are often embodied in documents called District Compliance Agreements, permits, or Administrative Consent Orders. If a voluntary settlement is not achieved, then an SOC will often be sought through litigation resulting in a court order or court judgment.

For site-specific SSOs caused by sewer blockages, a response is usually undertaken by the responsible entity. The response activity will usually include the removal of the sewer blockage to restore the proper function of the sewer system, along with cleanup and/or disinfection of the areas where sewage was spilled to limit public exposure. The emergency response for SSOs due to equipment failures are handled in a similar way. The power is restored or the mechanical problem is fixed (i.e., the cracked sewer is repaired or the faulty pump is replaced); and the area is similarly cleaned up or disinfected. Such problems are addressed in the long-term through routine inspection and preventative maintenance programs.

While this report is intended to provide the public with an overview of the issues surrounding SSOs and how they are addressed, other documents may be useful for professionals in the environmental field that would like to learn more about EGLE’s policy in addressing SSOs. On December 27, 2002, a policy statement was issued and a subsequent clarification statement was issued on October 23, 2003, to address chronic SSOs due to wet weather capacity issues. The policy statement was the result of consultation with a stakeholder group to develop guidance for implementing the May 2000 “*Strategy for the Regulatory Control and Correction of Illegal Overflows from Separate Sanitary Sewer Systems in Michigan.*” These documents can be found on our Web site at: Michigan.gov/SewageDischarge

What Factors Might Justify Longer-Term Plans for Stopping Chronic SSOs?

Sewer systems are frequently complex and expensive to fix. Consider that sewer pipes are buried with other utility lines, oftentimes under roads, making access to them difficult. This limited access not only makes repair difficult, but it also makes the identification of extra sources of water to the sewer system a challenge. In addition, many sewer systems that were built over 30 years ago are reaching the end of their design life and are in need of rehabilitation or replacement. Additional costs could include engineering to study and design system improvements, upgrades to the WWTP to handle additional flow, and replacement of pumps and other equipment that make up the sewage system. Monies may or may not be available via grants, low rate loans, or rate increases; therefore, many communities and private sewer system owners need time to secure funding. Sewer system owners usually need time to find the cause of large systemic problems such as identifying the sources of “clear water” infiltrating and inflowing into the system or identifying the components in the system that are undersized. In addition, the system owners often need considerable time to review financing alternatives, design construction improvements, and to implement the project.



Detailed Discharge Report

January 1, 2021 - December 31, 2021

Appendix C	<u>Blended Report</u>
Appendix D	<u>Bypass Report</u>
Appendix E	<u>Combined Sewer Overflow Report</u>
Appendix F	<u>Retention Treatment Basin Report</u>
Appendix G	<u>Sanitary Sewer Overflow Report</u>

'Blended' Detail Report January 1 - December 31, 2021

Macomb

Warren WWTP

Warren WWTP

Submission ID. HPB-YGJY-AKSVZ

Start Day	Start Time	End Day	End Time
9/22/2021	1:35:00 PM	9/24/2021	4:00:00 PM

Rain(in.) = 5.24

Waterbody: Red Run Drain

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

103.60000

Cause: 25 year rain storm event. Major rain began falling at 7 pm on 9/21 by 7 pm on 9/22 we had already accumulated 4.24 inches of; rain.

EGLE Action: The NPDES permit contains schedule to eliminate blending at the WWTP and collection system SSOs

Warren WWTP

Submission ID. HPC-RF4V-2E4FY

Start Day	Start Time	End Day	End Time
10/25/2021	9:50:00 PM	10/26/2021	8:00:00 PM

Rain(in.) = 2.22

Waterbody: Red Run Drain

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

11.89000

Cause: Rain Event

EGLE Action: The NPDES permit contains schedule to eliminate blending at the WWTP and collection system SSOs

'Blended' Detail Report January 1 - December 31, 2021

Warren WWTP

Submission ID. HPC-VSRJ-K17XW

Start Day	Start Time	End Day	End Time
10/29/2021	11:28:00 PM	10/30/2021	4:00:00 AM

Rain(in.) = 1.31

Waterbody: Red Run Drain

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

36.02000

Cause: Rain fall. We have had excessive rainfall this week. The ground is saturated. We were still emptying basin from previous rain event during the week.

EGLE Action: The NPDES permit contains schedule to eliminate blending at the WWTP and collection system SSOs

Totals Warren WWTP

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

151.51000

County Totals Macomb

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

151.51000

'Blended' Detail Report January 1 - December 31, 2021

Wayne

Downriver WTF

Downriver WTF

Submission ID. HP9-REAH-ZE08Q

Start Day	Start Time	End Day	End Time
6/26/2021	2:40:00 AM	6/27/2021	12:49:00 AM

Rain(in.) = 2.36

Waterbody: Trenton Channel

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

16.46000

Cause: Secondary Blended Bypass event started due to excessive rainfall

EGLE Action: Evaluation of this event confirms discharge is consistent with terms of current NPDES permit.

Downriver WTF

Submission ID. HPA-8HHC-X8BT9

Start Day	Start Time	End Day	End Time
7/16/2021	2:30:00 PM	7/18/2021	3:58:00 PM

Rain(in.) = 2.3

Waterbody: Detroit River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

89.04000

Cause: Excessive rainfall over the last two days

EGLE Action: Evaluation of this event confirms discharge is consistent with terms of current NPDES permit.

'Blended' Detail Report January 1 - December 31, 2021

Downriver WTF

Submission ID. HPA-FE0T-TAKF8

Start Day	Start Time	End Day	End Time
7/25/2021	2:01:00 AM	7/25/2021	10:00:00 PM

Rain(in.) = 1.77

Waterbody: Detroit River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

18.63000

Cause: 1.77"s of rain in a very short period

EGLE Action: Evaluation of this event confirms discharge is consistent with terms of current NPDES permit.

Downriver WTF

Submission ID. HPA-XKE2-0Z28Q

Start Day	Start Time	End Day	End Time
8/12/2021	7:50:00 AM	8/13/2021	8:00:00 PM

Rain(in.) = 2.3

Waterbody: Detroit River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

65.96000

Cause: Excessive rainfall

EGLE Action: Evaluation of this event confirms discharge is consistent with terms of current NPDES permit.

'Blended' Detail Report January 1 - December 31, 2021

Downriver WTF

Submission ID. HPB-YRFZ-A0M3Z

Start Day	Start Time	End Day	End Time
9/22/2021	4:00:00 PM	9/25/2021	6:55:00 AM

Rain(in.) = 3.3

Waterbody: Detroit River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

115.25000

Cause: Excessive rainfall

EGLE Action: Evaluation of this event confirms discharge is consistent with terms of current NPDES permit.

Downriver WTF

Submission ID. HPC-R2P5-D22HF

Start Day	Start Time	End Day	End Time
10/25/2021	3:00:00 PM	10/27/2021	6:00:00 AM

Rain(in.) = 2.5

Waterbody: Detroit River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

55.92000

Cause: Rain fall over the last two days exceeded plant capacity

EGLE Action: Evaluation of this event confirms discharge is consistent with terms of current NPDES permit.

Totals Downriver WTF

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

361.26000

'Blended' Detail Report January 1 - December 31, 2021

County Totals

Wayne

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

361.26000

Report Totals

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

512.77000

'Bypass' Detail Report January 1 - December 31, 2021

Allegan

Moline WWTP

Moline WWTP

Submission ID.

HP9-9RWT-
NJDMM

Start Day	Start Time	End Day	End Time
6/6/2021	6:00:00 AM	6/6/2021	10:00:00 AM

Waterbody: Green lake stream

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00000

Cause: Discharging as normal thru treatment plant. Blowers not running due to new construction programming.

EGLE Action: Event reviewed and appears to be remediated. No further action taken at this time.

'Bypass' Detail Report January 1 - December 31, 2021

Moline WWTP

Submission ID. HP9-TDHK-GTC3N

Start Day	Start Time	End Day	End Time
6/26/2021	8:00:00 PM	6/27/2021	2:30:00 AM

Rain(in.) = 5

Waterbody: Green lake stream

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.23754

Cause: Plant received 1,077,561 gallons of water in 30 hr. period. From Friday 3:00 pm 6/25/2021 to 2:30am 6/27/2021. Partial Treatment occurred Saturday 6/26/2021 at 8:00 pm and ended at 2:30 am. on 6/27/2021 with 237,540 gallons being Partial Treated. Our normal average flow is about 180,000 GPD.

EGLE Action: Event reviewed. Facility is performing corrective actions.

Totals Moline WWTP

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.23754

County Totals Allegan

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.23754

'Bypass' Detail Report January 1 - December 31, 2021

Baraga

LAnse WWTP

LAnse WWTP

Submission ID. HP7-67E0-Z9EGK

Start Day	Start Time	End Day	End Time
3/13/2021	8:30:00 AM	3/13/2021	10:00:00 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00100

Cause: A primary tank that was once repaired from a crack failed. The water slowly made its way along the building and was noticed by the operator an area that was unusually wet. Once the leak was noticed, the operator dug a hole and put a bucket in the hole with a sump pump to keep the water from going further across the parking lot, that water was pumped into the aeration tank. We isolated the primary clarifier and the leak stopped.

EGLE Action: Compliance communication sent

Totals LAnse WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00100

County Totals Baraga

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00100

'Bypass' Detail Report January 1 - December 31, 2021

Berrien

Andrews University WWTP

Andrews University WWTP

Submission ID. HP5-P8VR-GV7GF

Start Day	Start Time	End Day	End Time
1/8/2021	12:15:00 PM	1/8/2021	1:15:00 PM

Waterbody: Lemon Creek

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

Cause: Equipment failure and operator error resulted Waste Activated Sludge overflowing a digester. Supernatant from the WAS flowed into Lemon Creek

EGLE Action: No Additional Action taken at this time.

Totals Andrews University WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

County Totals Berrien

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

'Bypass' Detail Report January 1 - December 31, 2021

Calhoun

Battle Creek WWTP

Battle Creek WWTP

Submission ID. HPD-JKCG-FW50D

Start Day	Start Time	End Day	End Time	Rain(in.) = 1
11/27/2021	1:30:00 PM	11/28/2021	12:00:00 PM	Waterbody: Kalamazoo River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.02000

Cause: Lime stabilized biosolids from storage tank. Overflow of storage structure

EGLE Action: Event reviewed and appears to be remediated.

Totals Battle Creek WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.02000

County Totals Calhoun

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.02000

'Bypass' Detail Report January 1 - December 31, 2021

Cass

Cass Co-Lakes Area SA WWTP

Cass Co-Lakes Area SA WWTP

Submission ID. HPC-RK52-ZQQSS

Start Day	Start Time	End Day	End Time
10/22/2021	9:30:00 AM	10/22/2021	10:00:00 AM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00000

Cause: The spill came from 2" lay flat discharge tubing that had small holes in it from abrasion. The discharge tubing was transferring mostly treated wastewater out of a treatment basin to perform maintenance. The spill lasted for approximately 20-30 minutes. Staff's initial attempt to patch the holes was not effective. Staff were instructed to shut down the equipment by the onsite supervisor until a proper patch could be applied. Staff hosed down the area after work was completed.

EGLE Action: Event reviewed and evaluated. Actions taken appear to be adequate to prevent a similar issue occurring.

'Bypass' Detail Report January 1 - December 31, 2021

Cass Co-Lakes Area SA WWTP

Submission ID. HPC-ZJ3P-9D188

Start Day	Start Time	End Day	End Time
11/3/2021	1:30:00 AM	11/3/2021	1:31:00 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)

0.00003

Cause: Staff were pumping rainwater from a basin that was not in service via a sludge line attached to the bottom of the basin. Earlier in the day, a staff member had been exercising valves onsite at the facility. This staff member had left a valve in the wrong position resulting in the rainwater/sludge mixture being sent to the wrong location. Staff caught the overflow almost immediately when it occurred and returned things to normal.

EGLE Action: Event and SOP reviewed. Adequate actions at this time.

Totals Cass Co-Lakes Area SA WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)

0.00003

'Bypass' Detail Report January 1 - December 31, 2021

Dowagiac WWTP

Dowagiac WWTP

Submission ID. HP6-YJTC-0X9D1

Start Day	Start Time	End Day	End Time
3/3/2021	11:30:00 AM	3/3/2021	11:30:00 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00002

Cause: City staff dumping City jetting / vacuum truck and accidentally allowed raw sewage to spill on the ground.

EGLE Action: No Further Action Taken at this Time

Totals Dowagiac WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00002

County Totals Cass

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00004

'Bypass' Detail Report January 1 - December 31, 2021

Charlevoix

East Jordan WWTP

East Jordan WWTP

Submission ID. HPE-1BK1-3VJ6C

Start Day	Start Time	End Day	End Time
12/17/2021	5:00:00 AM	12/17/2021	5:30:00 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

Cause: System wide power outage. Plant is running on generator, but lift stations are having to be cycled on using portable generators. This is causing the flow into the plant to come in large surges instead of more frequent cycles.

EGLE Action: Followed up with the City on generator condition at main lift station for emergency operating capability.

Totals East Jordan WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

County Totals Charlevoix

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

'Bypass' Detail Report January 1 - December 31, 2021

Cheboygan

Cheboygan WWTP

Cheboygan WWTP

Submission ID. HPC-RJBC-77EG0

Start Day	Start Time	End Day	End Time
10/26/2021	10:00:00 AM	11/11/2021	9:00:00 AM

Waterbody: Cheboygan River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
5.92900

Cause: Cheboygan WWTP is currently (10-26-21) out of Chlorine due to a driver shortage. Delivery arrived 11-11-21 at 9am.; Volume was totaled from days when fecal count was TNTC

EGLE Action: ACO entered to address needed facility upgrade

Totals Cheboygan WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
5.92900

County Totals Cheboygan

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
5.92900

'Bypass' Detail Report January 1 - December 31, 2021

Chippewa

Sault Ste Marie WWTP

Sault Ste Marie WWTP

Submission ID. HP7-EXV1-C2C8X

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.56
3/24/2021	1:30:00 PM	3/25/2021	6:30:00 AM	Waterbody: St Marys River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
4.89000

Cause: Primary effluent, which received screening, grit removal, chemical addition, and settling prior to blending with flow receiving complete secondary treatment. All flow was disinfected prior to discharge to the st mary. Reason for discharge was flow entering plant exceeded the capacity of secondary treatment.

EGLE Action: The facility NPDES permit requires sanitary sewer system investment to minimize inflow and infiltration of stormwater into sanitary sewer.

'Bypass' Detail Report January 1 - December 31, 2021

Sault Ste Marie WWTP

Submission ID. HPA-7GZP-VTZAT

Start Day	Start Time	End Day	End Time
7/15/2021	7:49:00 AM	7/15/2021	10:32:00 AM

Rain(in.) = 1.28

Waterbody: St Mary's River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.17500

Cause: Primary effluent, which received screening, grit removal, chemical addition, and settling prior to blending with flow receiving complete secondary treatment. All flow was disinfected prior to discharge to the St Mary's. Reason for discharge was flow entering plant exceeded the capacity of secondary treatment.

EGLE Action: NPDES permit language for sewer separation and I/I reduction.

Sault Ste Marie WWTP

Submission ID. HPA-JG91-31HHE

Start Day	Start Time	End Day	End Time
7/29/2021	5:30:00 AM	7/29/2021	10:30:00 AM

Rain(in.) = 2.41

Waterbody: St Mary's River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.71300

Cause: Primary effluent, which received screening, grit removal, chemical addition, and primary settling prior to blending with flow receiving complete secondary treatment. All flow was disinfected prior to discharge to the St Marys river. Reason for discharge was flow entering into plant exceeded the capacity of secondary treatment.

EGLE Action: I&I reduction efforts incorporated in current and draft NPDES permit.

'Bypass' Detail Report January 1 - December 31, 2021

Sault Ste Marie WWTP

Submission ID. HPA-NAMH-6SGFT

Start Day	Start Time	End Day	End Time
7/31/2021	12:14:00 PM	7/31/2021	2:07:00 PM

Rain(in.) = 0.85

Waterbody: St Mary River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.13000

Cause: Primary effluent, which received screening, grit removal, chemical addition, and settling prior to blending with flow receiving; complete secondary treatment. All flow was disinfected prior to discharge to the St Mary's. Reason for discharge was flow; entering plant exceeded the capacity of secondary treatment.

EGLE Action: Draft NPDES permit language requires a process for I&I reduction.

Sault Ste Marie WWTP

Submission ID. HPD-NQXG-H1ZQH

Start Day	Start Time	End Day	End Time
12/2/2021	5:30:00 AM	12/2/2021	4:06:00 PM

Rain(in.) = 0.45

Waterbody: St. Mary's River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.39100

Cause: Primary effluent, which received screening, grit removal, chemical addition and settling prior to blending with flow receiving complete secondary treatment. All flow was disinfected prior to discharge to the St. Mary's river. Reason for discharge was flow entering the plant exceeded the capacity of secondary treatment.

EGLE Action: Corrective actions included in NPDES permit.

'Bypass' Detail Report January 1 - December 31, 2021

Sault Ste Marie WWTP

Submission ID. HPE-OPX2-OMM46

Start Day	Start Time	End Day	End Time
12/16/2021	12:14:00 AM	12/17/2021	3:35:00 AM

Rain(in.) = 0.07

Waterbody: St Mary's river

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

4.24800

Cause: Primary effluent, which received screening, grit removal, chemical addition and settling prior to blending with flow receiving complete secondary treatment. All flow was disinfected prior to discharge to the st marys river. Reason for discharge was flow entering the plant exceeded the capacity of secondary treatment.

EGLE Action: Inflow & infiltration reduction requirement schedule of compliance are in NPDES permit.

Totals Sault Ste Marie WWTP

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

10.54700

County Totals Chippewa

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

10.54700

'Bypass' Detail Report January 1 - December 31, 2021

Delta

Escanaba WWTP

Escanaba WWTP

Submission ID. HP8-E8SR-NMG5V

Start Day	Start Time	End Day	End Time
5/2/2021	12:01:00 PM	5/6/2021	10:30:00 AM

Waterbody: Lake Michigan

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

1.80000

Cause: A sudden problem with settling occurred while draining a final created high volumes of solids over the weir, creating very poor effluent. The primary effluent was very clean in comparison. The normal time-proven protocol was followed before taking this tank out of service.

EGLE Action: Violation notice issued. Primary resolution is to use sludge judge sampler to determine the amount of sludge in a secondary clarifier prior to removing that tank from service.

Totals Escanaba WWTP

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

1.80000

County Totals Delta

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

1.80000

'Bypass' Detail Report January 1 - December 31, 2021

Eaton

Grand Ledge WWTP

Grand Ledge WWTP

Submission ID. HP9-T6QQ-PN82A

Start Day	Start Time	End Day	End Time	Rain(in.) = 5.23
6/26/2021	10:04:00 PM	6/27/2021	12:45:00 PM	Waterbody: Grand River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.50170

Cause: Discharged from the wet weather EQ basin due to an excessive amount of rainfall in a short time.

EGLE Action: Investigation for force majeure

Totals Grand Ledge WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.50170

County Totals Eaton

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.50170

'Bypass' Detail Report January 1 - December 31, 2021

Genesee

Flint WWTP

Flint WWTP

Submission ID. HP7-GT63-K8XTT

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.57
3/26/2021	3:57:00 PM	3/26/2021	11:00:00 PM	Waterbody: Flint River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
1.25000

Cause: Excessive wet weather resulted in excessive flows beyond the plant's capacity to treat. The discharge was partially treated sanitary sewage.

EGLE Action: Violation Notice sent to address discharge

Flint WWTP

Submission ID. HP9-TFK6-NMK8A

Start Day	Start Time	End Day	End Time	Rain(in.) = 4.37
6/27/2021	12:49:00 AM	6/27/2021	9:30:00 AM	Waterbody: Flint River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
5.94000

Cause: Excessive wet weather resulted in excessive flows beyond the plant's capacity to treat. The discharge was partially treated sanitary sewage.

EGLE Action: Violation notice issued to address discharge

'Bypass' Detail Report January 1 - December 31, 2021

Flint WWTP

Submission ID. HPB-YGMZ-JVKK3

Start Day	Start Time	End Day	End Time
9/23/2021	6:45:00 AM	9/24/2021	11:50:00 AM

Rain(in.) = 3.55
Waterbody: Flint River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
31.88000

Cause: Excessive wet weather resulted in excessive flows beyond the plant's capacity to treat. The discharge was partially treated sanitary sewage.

EGLE Action: Violation notice issued to address discharge

Flint WWTP

Submission ID. HPC-QTGW-NCYFK

Start Day	Start Time	End Day	End Time
10/25/2021	12:15:00 PM	10/27/2021	1:00:00 AM

Rain(in.) = 1.57
Waterbody: Flint River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
45.75000

Cause: Wet weather resulted in excessive flows beyond the plant's greatly reduced (due to large scale repairs) capacity to treat. The discharge was partially treated sanitary sewage.

EGLE Action: Violation notice issued to address discharge

'Bypass' Detail Report January 1 - December 31, 2021

Flint WWTP

Submission ID. HPC-SBQS-ZSZP8

Start Day	Start Time	End Day	End Time
10/27/2021	11:00:00 AM	11/9/2021	5:30:00 AM

Rain(in.) = 1.57
Waterbody: Flint River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
76.50000

Cause: Wet weather resulted in excessive flows beyond the plant's capacity to treat due to ongoing large-scale plant-wide improvement projects. The discharge is partially treated sanitary sewage.

EGLE Action: Violation notice issued to address discharge

Totals Flint WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
161.32000

County Totals Genesee

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
161.32000

'Bypass' Detail Report January 1 - December 31, 2021

Gladwin

Butman Twp WWTP

Butman Twp WWTP

Submission ID. HPA-XRG2-6HCHW

Start Day	Start Time	End Day	End Time
8/12/2021	9:15:00 AM	8/12/2021	9:25:00 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00001

Cause: Rear hatch on vactor did not fully lock causing a spill during a cleaning event at a lift station. Operators noticed issue immediately, shut down equipment and immediately cleaned effected area.

EGLE Action: No further action taken. Event was isolated and the facility is committed to preventing future SSO's.

Totals Butman Twp WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00001

County Totals Gladwin

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00001

'Bypass' Detail Report January 1 - December 31, 2021

Grand Traverse

Gd Traverse Co-Septage Fac

Gd Traverse Co-Septage Fac

Submission ID. HPC-1S9H-HPD5J

Start Day	Start Time	End Day	End Time
9/21/2021	11:30:00 PM	9/22/2021	6:30:00 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00015

Cause: Influent EQ pump did not stop running while in auto and we were receiving some intermittent influent EQ transducer faults.

EGLE Action: Discussed event with their staff, caused by equipment failure

Gd Traverse Co-Septage Fac

Submission ID. HPC-KTH1-2MWRD

Start Day	Start Time	End Day	End Time
10/19/2021	11:00:00 PM	10/19/2021	11:30:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00014

Cause: Influent EQ pumps failed to stop and overwhelmed the downstream lift station causing waste to flow from the lift station wet well onto the surrounding ground.

EGLE Action: Discussion with the operators on preventing future occurrences. No further action taken at this time

'Bypass' Detail Report January 1 - December 31, 2021

Totals Gd Traverse Co-Septage Fac

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00029

Traverse City WWTP

Traverse City WWTP

Submission ID. HPA-NN3S-3S7JB

Start Day	Start Time	End Day	End Time
7/24/2021	11:20:00 AM	7/24/2021	5:15:00 PM

Rain(in.) = 3.25
Waterbody: Boardman River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00536

Cause: High flow event caused elevated levels in UV channel to surpass treatment threshold by no more than 0.16ft for no more than 18.62 minutes total.

EGLE Action: Continue to work with the plant and monitor these, but they will be eliminated when the UV system is upgraded per the ACO

'Bypass' Detail Report January 1 - December 31, 2021

Traverse City WWTP

Submission ID. HPA-YF01-XE0G2

Start Day	Start Time	End Day	End Time
8/12/2021	12:14:00 PM	8/12/2021	12:15:00 AM

Waterbody: Boardman River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)

0.00750

Cause: High flow event caused elevated levels in UV channel to surpass treatment threshold by no more than 0.16ft for no more than 56 seconds.

EGLE Action: Will continue to monitor these and they will ultimately be addressed by the UV system upgrades as part of the ACO agreement

Totals Traverse City WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)

0.01286

County Totals Grand Traverse

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)

0.01315

'Bypass' Detail Report January 1 - December 31, 2021

Ingham

East Lansing WRRF

East Lansing WRRF

Submission ID. HPA-YFFF-JYJB7

Start Day	Start Time	End Day	End Time
8/12/2021	6:30:00 AM	8/12/2021	11:00:00 PM

Rain(in.) = 4.74

Waterbody: Red Cedar River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

6.93000

Cause: North Plant aeration tanks overflowed. Hydraulic capacity exceeded.

EGLE Action: Long-term Control Program complete; controls included both sewer separation and construction of a retention treatment basin (RTB) and tunnel.

Totals East Lansing WRRF

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

6.93000

'Bypass' Detail Report January 1 - December 31, 2021

Williamston WWTP

Williamston WWTP

Submission ID. HPA-XT1Q-5K6GM

Start Day	Start Time	End Day	End Time
8/12/2021	4:30:00 AM	8/12/2021	8:00:00 AM

Rain(in.) = 3.72

Waterbody: Red Cedar River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.40800

Cause: There was a major storm event. Blowers were temporarily shut down to retain secondary treatment solids.

EGLE Action: Reviewed circumstances of event. No further actions taken at this time

Totals Williamston WWTP

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.40800

County Totals Ingham

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

7.33800

'Bypass' Detail Report January 1 - December 31, 2021

Iosco

Tawas Utility Authority WWTP

Tawas Utility Authority WWTP

Submission ID. HPC-E8PM-ZY3RE

Start Day	Start Time	End Day	End Time
10/12/2021	7:00:00 PM	10/12/2021	8:00:00 PM

Rain(in.) = 0.16

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00000

Cause: sludge coming out from the top of the primary digester, the seal on the digester mixer unit not working properly.

EGLE Action: No further action taken, event was isolated and the facility is committed to preventing further events.

Totals Tawas Utility Authority WWTP

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00000

County Totals Iosco

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00000

'Bypass' Detail Report January 1 - December 31, 2021

Jackson

Leoni Twp WWTP

Leoni Twp WWTP

Submission ID. HP9-CYPP-AYTKF

Start Day	Start Time	End Day	End Time
6/11/2021	10:45:00 AM	6/11/2021	10:48:00 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

Cause: Decant water from the centrifuge is sent to the head works from the Centrate pump station. The lift station pumps failed to operate properly and caused it to over flow.

EGLE Action: Escalated enforcement pending

Totals Leoni Twp WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

County Totals Jackson

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

'Bypass' Detail Report January 1 - December 31, 2021

Kent

Riverview Estates MHC

Riverview Estates MHC

Submission ID. HP6-M7KC-HF1DW

Start Day	Start Time	End Day	End Time
1/4/2021	6:00:00 PM	1/5/2021	8:00:00 AM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.01000

Cause: The effluent valve chamber suffered a mechanical failure and overflowed treated effluent from the lid and onto the ground.

EGLE Action: discussed ongoing discharges with contractor and issued VN

Totals

Riverview Estates MHC

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.01000

'Bypass' Detail Report January 1 - December 31, 2021

Saddle Ridge Condo-Algoma

Saddle Ridge Condo-Algoma

Submission ID. HP6-XVPN-44QY0

Start Day	Start Time	End Day	End Time
3/1/2021	11:30:00 AM	3/1/2021	12:15:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)

0.00005

Cause: Appx 50 gallons of Foam escaped from the closed lids of Bioreactors 1 and 2. Foam built up on top of the tanks, and overflowed onto the parking area and down the ravine embankment

EGLE Action: The permittee has entered an Administrative Consent Order (ACO-05326) with WRD, effective 12/2/2019, to address alleged violations of NPDES Permit No. MI0056723. The compliance schedule outlined in the ACO is intended to work toward addressing facility operation and maintenance deficiencies leading to events such as this.

'Bypass' Detail Report January 1 - December 31, 2021

Saddle Ridge Condo-Algoma

Submission ID. HP7-DGMJ-1MW5A

Start Day	Start Time	End Day	End Time
3/20/2021	5:30:00 PM	3/20/2021	7:45:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00100

Cause: Partially treated raw sewage and Mixed Liquor escaped from the hatches of Reactors 1 and 2. Upon examination, An I/O card in the main PLC appear to be the culprit. This card misread the level in Reactor one, and continued to fill even after the lids were overflowing.

EGLE Action: The permittee has entered an Administrative Consent Order (ACO-05326) with WRD, effective 12/2/2019, to address alleged violations of NPDES Permit No. MI0056723. The compliance schedule outlined in the ACO is intended to work toward addressing facility operation and maintenance deficiencies leading to events such as this. The permittee has completed an assessment of facilities and a corrective action workplan. EGLE is currently reviewing the 2nd version of these documents, which were revised to address EGLE's initial review comments.

'Bypass' Detail Report January 1 - December 31, 2021

Saddle Ridge Condo-Algoma

Submission ID. HP7-DGMJ-1MW5A

Start Day	Start Time	End Day	End Time
3/21/2021	6:00:00 AM	3/21/2021	9:30:00 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00050

Cause: Partially treated raw sewage and Mixed Liquor escaped from the hatches of Reactors 1 and 2. Upon examination, An I/O card in the main PLC appear to be the culprit. This card misread the level in Reactor one, and continued to fill even after the lids were overflowing.

EGLE Action: The permittee has entered an Administrative Consent Order (ACO-05326) with WRD, effective 12/2/2019, to address alleged violations of NPDES Permit No. MI0056723. The compliance schedule outlined in the ACO is intended to work toward addressing facility operation and maintenance deficiencies leading to events such as this. The permittee has completed an assessment of facilities and a corrective action workplan. EGLE is currently reviewing the 2nd version of these documents, which were revised to address EGLE's initial review comments.

'Bypass' Detail Report January 1 - December 31, 2021

Saddle Ridge Condo-Algoma

Submission ID. HPB-QPC1-G6ZPV

Start Day	Start Time	End Day	End Time
9/13/2021	10:00:00 AM	9/15/2021	10:40:00 AM

Rain(in.) = 0.75

Waterbody: Rogue River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.05228

Cause: Partially treated Effluent. Ballast for Ultraviolet disinfection unit not functioning.

EGLE Action: Treatment system condition deficiencies are intended to be resolved through ACO-05326 entered by the permittee on 12/2/2019. The permittee has submitted, and EGLE has approved, its assessment of facilities and workplan for treatment system improvements. Part 41 applications for treatment system upgrades are expected Oct-Dec 2021.

Totals Saddle Ridge Condo-Algoma

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.05383

'Bypass' Detail Report January 1 - December 31, 2021

Sparta WWTP

Sparta WWTP

Submission ID. HP9-C6PD-4HE03

Start Day	Start Time	End Day	End Time
6/9/2021	11:45:00 AM	6/9/2021	11:46:00 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00030

Cause: Miscalculated remaining volume in sludge storage tank due to a faulty measuring device. Checked tank around 30 min before the transfer should have been complete and found the level in the tank at the very top but not yet overflowing. Immediately shut down transfer pump and opened decant valve but it was too late.

EGLE Action: Currently under review by EGLE.

Sparta WWTP

Submission ID. HPA-DXEQ-497T9

Start Day	Start Time	End Day	End Time
7/22/2021	3:30:00 PM	7/22/2021	11:00:00 PM

Rain(in.) = 0.25

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00250

Cause: At the completion of stripping the primary clarifier, the operator failed to ensure the valve closed completely. This allowed water to continue to flow into the digester until it overflowed.

EGLE Action: The discharge event is currently under review by EGLE.

'Bypass' Detail Report January 1 - December 31, 2021

Sparta WWTP

Submission ID. HPB-OTDZ-GYM05

Start Day	Start Time	End Day	End Time
8/10/2021	12:15:00 PM	8/10/2021	12:20:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

Cause: Pump sack failed at hose connection and rapidly released several hundred gallons of concentrated duckweed, most of which returned to the pond.

EGLE Action: Currently under review by EGLE.

Totals Sparta WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00290

County Totals Kent

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.06673

'Bypass' Detail Report January 1 - December 31, 2021

Livingston

Greenbrook Estates LLC

Greenbrook Estates LLC

Submission ID. HP7-ZAFT-0CJ96

Start Day	Start Time	End Day	End Time
4/7/2021	9:00:00 AM	4/8/2021	10:00:00 AM

Rain(in.) = 1

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00010

Cause: Facility owner stated the liquid pump failure causing discharge to land.

EGLE Action: Violation Notice sent to address discharge

Totals Greenbrook Estates LLC

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00010

'Bypass' Detail Report January 1 - December 31, 2021

Howell WWTP

Howell WWTP

Submission ID. HP9-JBEC-MWR05

Start Day	Start Time	End Day	End Time
6/8/2021	8:30:00 AM	6/8/2021	8:40:00 AM

Waterbody: Marion and Genoa Drain

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00005

Cause: Staff was draining the East primary clarifier for the construction project. The drain pit plugged with rags and backed up, causing primary sludge to overflow at the plant. About 50 gallons made it to the final effluent manhole just upstream of the UV channel. The primary sludge was diluted and went through disinfection.

EGLE Action: Issued CC-003382

Howell WWTP

Submission ID. HPC-7Y2V-MW6Q4

Start Day	Start Time	End Day	End Time
8/12/2021	2:00:00 AM	8/13/2021	7:45:00 AM

Rain(in.) = 5.1

Waterbody: Marion Genoa Drain

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.60000

Cause: The Wastewater Treatment Plant recorded 5 inches of rain on Thursday morning. The increase in flow at the plant maxed out our 900,000-gallon storage tank causing a Sanitary Sewer Overflow to occur on Pulford Street. Once the equilization tank was full, it spilled over onto the plant's yard.

EGLE Action: No further action taken at this time

'Bypass' Detail Report January 1 - December 31, 2021

Totals Howell WWTP

Raw Sewage (MG)	Partially Treated (MG)	Dilute Raw Sewage (MG)
	0.60005	

County Totals Livingston

Raw Sewage (MG)	Partially Treated (MG)	Dilute Raw Sewage (MG)
	0.60015	

'Bypass' Detail Report January 1 - December 31, 2021

Marquette

DNR-Parks & Rec-Van Riper

DNR-Parks & Rec-Van Riper

Submission ID. HNT-SE9D-AE6ZV

Start Day	Start Time	End Day	End Time
10/26/2021	8:00:00 AM	10/26/2021	1:00:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.08845

Cause: Seasonal discharge in campground setting. Buildings were closed for at least 2 weeks prior to discharge, allowing lagoons to dilute down further.

EGLE Action: No further action taken at this time

Totals DNR-Parks & Rec-Van Riper

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.08845

County Totals Marquette

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.08845

'Bypass' Detail Report January 1 - December 31, 2021

Mecosta

Big Rapids WWTP

Big Rapids WWTP

Submission ID. HPB-8KGK-R5JRV

Start Day	Start Time	End Day	End Time
8/24/2021	11:07:00 PM	8/25/2021	12:05:00 AM

Rain(in.) = 1.01

Waterbody: Muskegon River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.06000

Cause: At 11:07 pm, another Plant Operator received a U.V alarm call. Upon arrival, he found the U.V. lamps in channel 2 to be off. After cancelling the alarm and re-setting the operational parameters of the U.V. system, the lights in Channel 2 came back on and stayed on. The total length of time that Channel 2 remained off was 58 minutes. Estimated plant effluent flow through Channel 2 during this time period is estimated to be 50,000 to 60,000 gallons. All other treatment processes remained in service and functioned properly. So, the only treatment process that experienced an "Unanticipated Bypass" was U.V. disinfection in Channel 2.; It is our conclusion that the power outage and interruptions caused the U.V. control system to lose some setpoint information. In an effort to prevent this from happening again during and after a plant power interruption, we will double-check all operational parameters and settings of the U.V. control system.

EGLE Action: EGLE had the facility submit an explanation for what happened and how to prevent this incident from happening during power outages in the future. Also, EGLE required the facility treat this instance as an SSO.

Totals Big Rapids WWTP

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.06000

'Bypass' Detail Report January 1 - December 31, 2021

County Totals

Mecosta

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.06000

Monroe

Dundee WWTP

Dundee WWTP

Submission ID. HPC-2GFN-FDXNT

Start Day	Start Time	End Day	End Time
9/23/2021	2:00:00 AM	9/23/2021	11:45:00 PM

Rain(in.) = 3.7

Waterbody: River Raisin

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

1.08300

Cause: 1.083 million gallons of partially treated, blended sewage discharged through outfall 001 to River Raisin due to blockage in raw influent line.

EGLE Action: Violation Notice pending

Totals

Dundee WWTP

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

1.08300

County Totals

Monroe

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

1.08300

'Bypass' Detail Report January 1 - December 31, 2021

Montcalm

Carson City WWSL

Carson City WWSL

Submission ID. HPB-72D3-KDQK0

Start Day	Start Time	End Day	End Time
8/25/2021	7:00:00 AM	8/28/2021	7:15:00 AM

Waterbody: Fish Creek

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

6.73200

Cause: Due to Operators error during Spring discharge sewer lagoons are full and in need of short discharge to make room until October discharge period.

EGLE Action: EGLE issued Violation Notice VN-012448 to permittee on 11/1/2021.

Totals Carson City WWSL

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

6.73200

'Bypass' Detail Report January 1 - December 31, 2021

Greenville WWTP

Greenville WWTP

Submission ID. HPA-WY2P-T2WXH

Start Day	Start Time	End Day	End Time
8/11/2021	5:00:00 AM	8/11/2021	5:45:00 AM

Rain(in.) = 0.03

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.15000

Cause: The discharge was primary treated waste that backed up and over flowed the clarifiers due to temporary power outage that caused the Trickling Filter Tower pumps to fail.

EGLE Action: Referred for escalated enforcement

Greenville WWTP

Submission ID. HPB-7X4B-JB6Z3

Start Day	Start Time	End Day	End Time
8/24/2021	7:15:00 PM	8/24/2021	7:45:00 PM

Rain(in.) = 2

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.01000

Cause: High amount of rain in short period of time caused a second influent pump to kick on which gave the volume of water necessary to back up the back end of the plant and overflow the primary tanks before an operator could shut off the extra influent pumps that were running.

EGLE Action: Referred for escalated enforcement

'Bypass' Detail Report January 1 - December 31, 2021

Totals Greenville WWTP

Raw Sewage (MG)	Partially Treated (MG)	Dilute Raw Sewage (MG)
	0.16000	

County Totals Montcalm

Raw Sewage (MG)	Partially Treated (MG)	Dilute Raw Sewage (MG)
	6.89200	

'Bypass' Detail Report January 1 - December 31, 2021

Oakland

Oakland Co-Pontiac WWTP

Oakland Co-Pontiac WWTP

Submission ID. HP8-8WDS-6DJ91

Start Day	Start Time	End Day	End Time
4/25/2021	10:53:00 PM	4/26/2021	12:53:00 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00100

Cause: Biosolids processing cake bin #1 overfilled causing diluted raw sewage to overflow onto the asphalt drive and into catch basin 18 (see attached map).

EGLE Action: No further action required.

Oakland Co-Pontiac WWTP

Submission ID. HP9-TDZ4-83854

Start Day	Start Time	End Day	End Time
6/25/2021	8:53:00 PM	6/26/2021	1:03:00 AM

Rain(in.) = 2.74
Waterbody: Clinton River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
2.00000

Cause: Blended partially treated sewage with fully treated effluent discharged from Monitoring Point 001A through Outfall 001. Occurred due to excessive rainfall.

EGLE Action: Facility is under a consent decree

'Bypass' Detail Report January 1 - December 31, 2021

Oakland Co-Pontiac WWTP

Submission ID.

HPA-GDRJ-
MMCME

Start Day	Start Time	End Day	End Time
7/24/2021	9:47:00 PM	7/25/2021	1:26:00 AM

Rain(in.) = 1.75

Waterbody: Clinton River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

2.00000

Cause: Blended partially treated sewage with fully treated effluent and was discharged from monitoring point 001A through outfall 001, occurred due to excessive rainfall in a extremely short time frame.

EGLE Action: Facility is under a concent decree

Oakland Co-Pontiac WWTP

Submission ID.

HPA-R3CB-G7ADY

Start Day	Start Time	End Day	End Time
8/4/2021	10:09:00 PM	8/4/2021	10:14:00 PM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.01300

Cause: The discharge was backwashed tertiary wash water (this water is chlorinated plant effluent before the dichlorination process, used to backwash the Tertiary filters). Trash pump was being used to help lower the Wastewater Wash Tank and the discharge line broke.

EGLE Action: Facility is under a concent decree

'Bypass' Detail Report January 1 - December 31, 2021

Oakland Co-Pontiac WWTP

Submission ID. HPB-YMDN-HAE57

Start Day	Start Time	End Day	End Time
9/23/2021	4:15:00 AM	9/23/2021	9:30:00 PM

Rain(in.) = 4.5

Waterbody: Clinton River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

4.40000

Cause: Partially treated sewage mixed with fully treated plant effluent is being discharged from monitoring point 001A through outfall 001. Reason is due to excessive amount of rainfall.

EGLE Action: Reviewed Event. Actions in line with Wet Weather Flow Operation.

Totals

Oakland Co-Pontiac WWTP

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

8.41400

County Totals

Oakland

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

8.41400

'Bypass' Detail Report January 1 - December 31, 2021

Ottawa

Coopersville WWTP

Coopersville WWTP

Submission ID. HPA-BT1D-KSH28

Start Day	Start Time	End Day	End Time
7/20/2021	4:00:00 AM	7/20/2021	4:00:00 PM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.01100

Cause: Debris clogged an Effluent grating screen caused a backup of the in-service Clarifiers, which in turn caused a backup and overflow of Aeration Pond #1 which flowed across the WWTP driveway into the internal storm management system and discharging to the WWTP Polishing Pond. We estimate approximately 11,000 gallons of partially treated wastewater was discharged from Aeration Pond #1. Due to the extensive clay layer in this area of Ottawa County, we believe there to be minimal impact to the surrounding area groundwater.

EGLE Action: A Violation Notice will be issued

'Bypass' Detail Report January 1 - December 31, 2021

Coopersville WWTP

Submission ID. HPA-V7AK-VATGA

Start Day	Start Time	End Day	End Time
8/8/2021	8:30:00 AM	8/8/2021	12:30:00 AM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.15000

Cause: Sludge Pond 2 became overfilled and overflowed the berm into Sludge Pond 1

EGLE Action: Enforcement action is being evaluated

Totals Coopersville WWTP

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.16100

'Bypass' Detail Report January 1 - December 31, 2021

Holland WWTP

Holland WWTP

Submission ID. HPB-S508-8G6W4

Start Day	Start Time	End Day	End Time
9/15/2021	11:00:00 AM	9/15/2021	12:00:00 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00008

Cause: Foam from the secondary treatment process came up out of a manhole on the WRF west plant. Maintenance and operations staff that were cleaning up the foam inadvertently washed it into a storm drain catch basin on the WRF site. The foam then entered a ditch that runs to the main stormwater discharge point at the WRF West plant. This foam was found later in the evening sitting in the ditch as there was no water flow in the ditch as no precipitation occurred. The foam was intercepted and stopped prior to flowing down the ditch to the main discharge point.

EGLE Action: No further action taken at this time

Totals Holland WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00008

County Totals Ottawa

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.16108

'Bypass' Detail Report January 1 - December 31, 2021

Sanilac

Croswell WWTP

Croswell WWTP

Submission ID. HPD-ZW8V-CK11M

Start Day	Start Time	End Day	End Time
12/13/2021	10:00:00 AM	12/13/2021	10:30:00 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00015

Cause: It appears that during the a wind storm on 12/12/21, there were electrical "brown outs" which burned out a start capacitor to one of the pump at the lift station, limiting this lift station to one pump. During this time, on 12-13-21, the station was Inundated with water greater than the pumping capacity of the pump, The wetwell filed spilling about 150 gallons in a shallow ditch, where it remained contained until we vactored it out on 12/13/21. There was no evidence that the sewage left that area. It was a short event as when the operator arrived to check the station, the wetwell was pump down.

EGLE Action: Compliance communication issued to addressed notification requirements for local health departments and local news agencies.

Totals Croswell WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00015

County Totals Sanilac

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00015

'Bypass' Detail Report January 1 - December 31, 2021

Shiawassee

Durand WWTP

Durand WWTP

Submission ID. HPB-66T3-TSXJE

Start Day	Start Time	End Day	End Time
8/12/2021	7:00:00 AM	8/12/2021	8:20:00 AM

Rain(in.) = 1.85

Waterbody: Holly Drain

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.06000

Cause: Partially treated wastewater due to heavy overnight rain. Most of the rain fell between 4-6 AM. We totaled 1.85" of rain

EGLE Action: Referred for escalated enforcement

Durand WWTP

Submission ID. HPC-DGR6-NEF68

Start Day	Start Time	End Day	End Time
8/27/2021	5:00:00 AM	8/27/2021	6:00:00 AM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00200

Cause: The discharge was raw sewage. It occurred when the auger float failed.

EGLE Action: Referred for escalated enforcement

'Bypass' Detail Report January 1 - December 31, 2021

Durand WWTP

Submission ID. HPC-2HPM-F6C1F

Start Day	Start Time	End Day	End Time
9/23/2021	6:00:00 AM	9/23/2021	3:00:00 PM

Rain(in.) = 4.67
Waterbody: Holly Drain

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.17500

Cause: The discharge was due to high rain fall totals over 5 days. Totaling 4.67" of rain. When the discharge started occurring; (9/23/2021), we had had 3.54" of rain.

EGLE Action: Referred for escalated enforcement

Durand WWTP

Submission ID. HPC-Y5PG-9MQVX

Start Day	Start Time	End Day	End Time
10/25/2021	3:00:00 PM	10/25/2021	9:00:00 PM

Rain(in.) = 1.74
Waterbody: Holly Drain

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.06000

Cause: Overflow was due to 1.74" of rain Sunday night into Monday. The ground in the area is still very saturated from previous heavy rains.

EGLE Action: Referred for escalated enforcement

Totals Durand WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.29700

'Bypass' Detail Report January 1 - December 31, 2021

County Totals

Shiawassee

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.29700

'Bypass' Detail Report January 1 - December 31, 2021

Tuscola

Dairy Farmers of America-Cass

Dairy Farmers of America-Cass

Submission ID. HNN-QKTC-4EYW1

Start Day	Start Time	End Day	End Time
6/12/2021	7:00:00 AM	6/12/2021	7:25:00 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.07000

Cause: Discharge was partially treated waste water (mixed liquor from bio-reactor). An underground pipe had broken and caused the mixed liquor to flow backwards out of the system and up to the ground surface. The pipe break occurred where the pipe exits the building.

EGLE Action: VN issued

Totals Dairy Farmers of America-Cass

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.07000

County Totals Tuscola

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.07000

'Bypass' Detail Report January 1 - December 31, 2021

Van Buren

South Haven Area Water Sewer Authority WWTP

South Haven Area Water Sewer Authority WWTP

Submission ID. HP9-TA8V-Z6P9G

Start Day	Start Time	End Day	End Time
6/26/2021	9:00:00 PM	6/27/2021	12:30:00 AM

Rain(in.) = 7

Waterbody: Black River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.10000

Cause: Flow to the WWTP reached 11 MGD and stayed above 10 mgd long enough for the Final clarifiers to overflow. Due collection system I&I and 7" of rain in much of the collection system area over 2 days

EGLE Action: Event reviewed. Facility is looking into corrective actions. Violation Notice sent

Totals South Haven Area Water Sewer Authority WWTP

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.10000

County Totals Van Buren

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.10000

'Bypass' Detail Report January 1 - December 31, 2021

Wayne

GLWA WRRF

GLWA WRRF

Submission ID. HP6-YD07-SVRYT

Start Day	Start Time	End Day	End Time
2/23/2021	3:15:00 PM	2/23/2021	4:59:00 PM

Waterbody: Detroit River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.14000

Cause: Primary treated, chlorinated and dechlorinated effluent discharged out the Detroit River Outfall due to a control switch to primary effluent gates that malfunctioned.

EGLE Action: EGLE sent a compliance communication on 16 APR 21 addressing this discharge. No action required in the compliance communication.

Totals GLWA WRRF

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.14000

'Bypass' Detail Report January 1 - December 31, 2021

Grosse Ile Twp WWTP

Grosse Ile Twp WWTP

Submission ID. HPA-B3AG-CVBW6

Start Day	Start Time	End Day	End Time	Rain(in.) = 3.1
7/17/2021	12:09:00 AM	7/17/2021	5:05:00 PM	Waterbody: Detroit River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)

12.20000

Cause: A total of 3.1 inches of rain fell on Friday 7-16-21 into Saturday 7-17-21 on Grosse Ile. The rain came very quickly and filled the sewer collection system to maximum capacity. The EQ Basin pumps were running at max pumping rate to keep the sewer system from endangering residents on Grosse Ile. The velocity of the water coming to the WWTP was unlike anything we have seen before. The plant wet well reached a height of 23 ft. Normal sewer height is 5.5 ft.

EGLE Action: Sixth Amended AACO-000023 is in effect. Per paragraph 3.23 of this Order, completion of construction to upgrade the sewerage system to meet the SSO Policy is 10/31/25.

Totals Grosse Ile Twp WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)

12.20000

'Bypass' Detail Report January 1 - December 31, 2021

S Huron Valley UA WWTP

S Huron Valley UA WWTP

Submission ID. HP7-T2MX-84Z8T

Start Day	Start Time	End Day	End Time
4/5/2021	8:00:00 PM	4/5/2021	8:05:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00030

Cause: Class B Biosolids. Spill started at 1170 Hubbard Road and ended at Strasburg Road to the East (~3,696'). The spill was 0 to 2-foot wide (1' average), approximately 1/4" deep or less, and was sporadically on and off down the road (~1,848'). Contractor performing sludge hauling did not secure valve prior to driving away from the permitted farm field which was receiving the biosolids application.

EGLE Action: Enforcement Discretion

Totals S Huron Valley UA WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00030

County Totals Wayne

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
12.34030

'Bypass' Detail Report January 1 - December 31, 2021

Wexford

Haring Twp WWTP

Haring Twp WWTP

Submission ID. HPC-8SWX-D6E75

Start Day	Start Time	End Day	End Time
10/6/2021	8:30:00 AM	10/6/2021	8:30:00 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

Cause: A discharge hose from a transfer pump shifted and fell off the edge of the treatment tank onto the ground. The pump was immediately shut off and the hose was returned to the treatment tank.

EGLE Action: No further action taken at this time

Totals Haring Twp WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

County Totals Wexford

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

'Bypass' Detail Report January 1 - December 31, 2021

Report Totals

Raw Sewage (MG)	Partially Treated (MG)	Dilute Raw Sewage (MG)
	217.88070	

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Berrien

St Joseph CSO

St Joseph CSO

Start Day	Start Time	End Day	End Time
6/25/2021	8:00:00 AM	6/25/2021	10:29:00 AM

Rain(in.) = 1.7

Waterbody: Morrison Channel

Dilute Raw Sewage (MG)

0.00050

Cause Heavy Rainfall

Submission ID. HP9-QTW4-YAGDA

Permit MI0026735

Outfall 5

St Joseph CSO

Start Day	Start Time	End Day	End Time
6/26/2021	9:41:00 AM	6/27/2021	3:31:00 AM

Rain(in.) = 4.54

Waterbody: Morrison Channel

Dilute Raw Sewage (MG)

0.00630

Cause Heavy Rainfall

Submission ID. HP9-RQ37-BM79R

Permit MI0026735

Outfall 5

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs..

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

St Joseph CSO

Start Day	Start Time	End Day	End Time
6/29/2021	1:24:00 PM	6/29/2021	2:40:00 PM

Rain(in.) = 0.71
Waterbody: Morrison Channel

Dilute Raw Sewage (MG)
0.00050

Cause Heavy rain, rain.

Submission ID. HP9-V4Q7-5BSW3
Permit MI0026735
Outfall 5

St Joseph CSO

Start Day	Start Time	End Day	End Time
8/10/2021	12:32:00 AM	8/10/2021	2:29:00 AM

Rain(in.) = 1.28
Waterbody: Lake Michigan

Dilute Raw Sewage (MG)
0.00050

Cause Heavy rainfall (1.21" over 1.5 hours)

Submission ID. HPA-VSV2-0DRCO
Permit MI0026735
Outfall 5

St Joseph CSO

Start Day	Start Time	End Day	End Time
8/24/2021	8:49:00 PM	8/25/2021	10:02:00 PM

Rain(in.) = 2.26
Waterbody: Morrison Channel

Dilute Raw Sewage (MG)
0.00050

Cause Heavy rainfall. 1.21" over 2 hours and 45 minutes; 2.26" measured between 7:30 pm on 8/24 and 3:00 am on 8/25 at the Hawthorne Lift Station.

Submission ID. HPB-7D1F-VNP5F
Permit MI0026735
Outfall 5

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

St Joseph CSO

Start Day	Start Time	End Day	End Time
9/7/2021	6:02:00 PM	9/7/2021	7:47:00 PM

Rain(in.) = 2.52

Waterbody: Morrison Channel

Dilute Raw Sewage (MG)

0.00050

Cause High Intensity Rain Event

Submission ID. HPB-J9TK-PMD3W

Permit MI0026735

Outfall 5

St Joseph CSO

Start Day	Start Time	End Day	End Time
10/25/2021	9:15:00 AM	10/25/2021	12:53:00 PM

Rain(in.) = 2.71

Waterbody: Morrison Channel

Dilute Raw Sewage (MG)

0.00050

Cause Heavy rainfall, high antecedent soil moisture content., and high Morrison Channel levels on the downstream side of the CSO 005 chamber.

Submission ID. HPC-QRE4-51NJT

Permit MI0026735

Outfall 5

Totals St Joseph CSO

Dilute Raw Sewage (MG)

0.00930

SOC: Permit requires completion of LTCP by dec 31, 2027

EGLE Action: Long-term Control Program being implemented. The City will complete ?I/I removal and construction of the wet weather storage on or before December 31, 2027.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

County Totals

Berrien

Dilute Raw Sewage (MG)

0.00930

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Ingham

Lansing WWTP

Lansing WWTP

Start Day	Start Time	End Day	End Time
3/25/2021	8:00:00 PM	3/26/2021	10:00:00 AM

Rain(in.) = 1.12
Waterbody: Grand River

Submission ID. HP7-GA6R-1RA53
Permit MI0023400
Outfall **16**

Dilute Raw Sewage (MG)

0.43600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
3/25/2021	8:00:00 PM	3/26/2021	10:00:00 AM

Rain(in.) = 1.12
Waterbody: Grand River

Submission ID. HP7-GA6R-1RA53
Permit MI0023400
Outfall **24**

Dilute Raw Sewage (MG)

1.20400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
3/25/2021	8:00:00 PM	3/26/2021	9:30:00 AM

Rain(in.) = 1.12
Waterbody: Red Cedar River

Submission ID. HP7-GA6R-1RA53
Permit MI0023400
Outfall **26**

Dilute Raw Sewage (MG)

0.29600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs..

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
3/25/2021	8:00:00 PM	3/26/2021	11:15:00 AM

Rain(in.) = 1.12
Waterbody: Red Cedar River

Submission ID. HP7-GA6R-1RA53
Permit MI0023400
Outfall **32**

Dilute Raw Sewage (MG)
0.27400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
3/25/2021	8:00:00 PM	3/26/2021	9:00:00 AM

Rain(in.) = 1.12
Waterbody: Grand River

Submission ID. HP7-GA6R-1RA53
Permit MI0023400
Outfall **46**

Dilute Raw Sewage (MG)
0.17100

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
3/25/2021	8:15:00 PM	3/26/2021	9:15:00 AM

Rain(in.) = 1.12
Waterbody: Grand River

Submission ID. HP7-GA6R-1RA53
Permit MI0023400
Outfall **11**

Dilute Raw Sewage (MG)
0.11200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
3/25/2021	8:30:00 PM	3/26/2021	10:45:00 AM

Rain(in.) = 1.12
Waterbody: Grand River

Submission ID. HP7-GA6R-1RA53
Permit MI0023400
Outfall **15**

Dilute Raw Sewage (MG)
1.18900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
3/25/2021	8:30:00 PM	3/26/2021	9:45:00 AM

Rain(in.) = 1.12
Waterbody: Grand River

Submission ID. HP7-GA6R-1RA53
Permit MI0023400
Outfall **9**

Dilute Raw Sewage (MG)
0.59700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
3/25/2021	9:00:00 PM	3/26/2021	10:00:00 AM

Rain(in.) = 1.12
Waterbody: Grand River

Submission ID. HP7-GA6R-1RA53
Permit MI0023400
Outfall **17**

Dilute Raw Sewage (MG)
0.46700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
3/25/2021	9:15:00 PM	3/26/2021	9:45:00 AM

Rain(in.) = 1.12
Waterbody: Grand River

Submission ID. HP7-GA6R-1RA53
Permit MI0023400
Outfall **21**

Dilute Raw Sewage (MG)
0.26700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
3/25/2021	9:15:00 PM	3/26/2021	11:15:00 AM

Rain(in.) = 1.12
Waterbody: Grand River

Submission ID. HP7-GA6R-1RA53
Permit MI0023400
Outfall **22**

Dilute Raw Sewage (MG)
2.57300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
3/25/2021	9:15:00 PM	3/26/2021	10:30:00 AM

Rain(in.) = 1.12
Waterbody: Grand River

Submission ID. HP7-GA6R-1RA53
Permit MI0023400
Outfall **34**

Dilute Raw Sewage (MG)
3.15600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
3/25/2021	9:30:00 PM	3/26/2021	10:30:00 AM

Rain(in.) = 1.12
Waterbody: Grand River

Submission ID. HP7-GA6R-1RA53
Permit MI0023400
Outfall **12**

Dilute Raw Sewage (MG)
0.74500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
3/25/2021	9:45:00 PM	3/26/2021	8:00:00 AM

Rain(in.) = 1.12
Waterbody: Grand River

Submission ID. HP7-GA6R-1RA53
Permit MI0023400
Outfall **19**

Dilute Raw Sewage (MG)
0.65000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
3/26/2021	2:00:00 AM	3/26/2021	6:00:00 AM

Rain(in.) = 1.12
Waterbody: Grand River

Submission ID. HP7-GA6R-1RA53
Permit MI0023400
Outfall **8**

Dilute Raw Sewage (MG)
0.18400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/5/2021	8:00:00 AM	4/5/2021	2:45:00 PM

Rain(in.) = 0.21
Waterbody: Red Cedar River

Submission ID. HP7-RZ1Z-2TPJ0
Permit MI0023400
Outfall **32**

Dilute Raw Sewage (MG)
0.00800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/5/2021	8:00:00 AM	4/5/2021	12:00:00 PM

Rain(in.) = 0.21
Waterbody: Grand River

Submission ID. HP7-RZ1Z-2TPJ0
Permit MI0023400
Outfall **46**

Dilute Raw Sewage (MG)
0.02500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/5/2021	8:15:00 AM	4/5/2021	1:00:00 PM

Rain(in.) = 0.21
Waterbody: Grand River

Submission ID. HP7-RZ1Z-2TPJ0
Permit MI0023400
Outfall **16**

Dilute Raw Sewage (MG)
0.06400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/5/2021	8:30:00 AM	4/5/2021	12:45:00 PM

Rain(in.) = 0.21
Waterbody: Red Cedar River

Submission ID. HP7-RZ1Z-2TPJ0
Permit MI0023400
Outfall **26**

Dilute Raw Sewage (MG)
0.04300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/5/2021	9:00:00 AM	4/5/2021	12:15:00 PM

Rain(in.) = 0.21
Waterbody: Grand River

Submission ID. HP7-RZ1Z-2TPJ0
Permit MI0023400
Outfall **11**

Dilute Raw Sewage (MG)
0.01600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/5/2021	9:00:00 AM	4/5/2021	1:00:00 PM

Rain(in.) = 0.21
Waterbody: Grand River

Submission ID. HP7-RZ1Z-2TPJ0
Permit MI0023400
Outfall **24**

Dilute Raw Sewage (MG)
0.17500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/5/2021	9:00:00 AM	4/5/2021	12:45:00 PM

Rain(in.) = 0.21
Waterbody: Grand River

Submission ID. HP7-RZ1Z-2TPJ0
Permit MI0023400
Outfall 9

Dilute Raw Sewage (MG)
0.08600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/5/2021	9:15:00 AM	4/5/2021	2:00:00 PM

Rain(in.) = 0.21
Waterbody: Grand River

Submission ID. HP7-RZ1Z-2TPJ0
Permit MI0023400
Outfall 15

Dilute Raw Sewage (MG)
0.17500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/5/2021	9:30:00 AM	4/5/2021	1:00:00 PM

Rain(in.) = 0.21
Waterbody: Grand River

Submission ID. HP7-RZ1Z-2TPJ0
Permit MI0023400
Outfall 17

Dilute Raw Sewage (MG)
0.06800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/5/2021	9:30:00 AM	4/5/2021	12:45:00 PM

Rain(in.) = 0.21
Waterbody: Grand River

Submission ID. HP7-RZ1Z-2TPJ0
Permit MI0023400
Outfall **21**

Dilute Raw Sewage (MG)
0.03900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/5/2021	9:45:00 AM	4/5/2021	1:30:00 PM

Rain(in.) = 0.21
Waterbody: Grand River

Submission ID. HP7-RZ1Z-2TPJ0
Permit MI0023400
Outfall **12**

Dilute Raw Sewage (MG)
0.10900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/5/2021	9:45:00 AM	4/5/2021	2:45:00 PM

Rain(in.) = 0.21
Waterbody: Grand River

Submission ID. HP7-RZ1Z-2TPJ0
Permit MI0023400
Outfall **22**

Dilute Raw Sewage (MG)
0.35300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/5/2021	9:45:00 AM	4/5/2021	1:45:00 PM

Rain(in.) = 0.21
Waterbody: Grand River

Submission ID. HP7-RZ1Z-2TPJ0
Permit MI0023400
Outfall **34**

Dilute Raw Sewage (MG)
0.44800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/5/2021	10:00:00 AM	4/5/2021	12:00:00 PM

Rain(in.) = 0.21
Waterbody: Grand River

Submission ID. HP7-RZ1Z-2TPJ0
Permit MI0023400
Outfall **19**

Dilute Raw Sewage (MG)
0.08500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/10/2021	5:00:00 PM	4/11/2021	3:15:00 AM

Rain(in.) = 0.92
Waterbody: Grand River

Submission ID. HP7-XP9X-4FSK6
Permit MI0023400
Outfall **11**

Dilute Raw Sewage (MG)
0.09200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/10/2021	5:00:00 PM	4/11/2021	4:00:00 AM

Rain(in.) = 0.92
Waterbody: Grand River

Submission ID. HP7-XP9X-4FSK6
Permit MI0023400
Outfall **16**

Dilute Raw Sewage (MG)
0.35600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/10/2021	5:00:00 PM	4/11/2021	4:00:00 AM

Rain(in.) = 0.92
Waterbody: Grand River

Submission ID. HP7-XP9X-4FSK6
Permit MI0023400
Outfall **24**

Dilute Raw Sewage (MG)
0.97900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/10/2021	5:00:00 PM	4/11/2021	3:45:00 AM

Rain(in.) = 0.92
Waterbody: Red Cedar River

Submission ID. HP7-XP9X-4FSK6
Permit MI0023400
Outfall **26**

Dilute Raw Sewage (MG)
0.24200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/10/2021	5:00:00 PM	4/11/2021	5:45:00 AM

Rain(in.) = 0.92
Waterbody: Red Cedar River

Submission ID. HP7-XP9X-4FSK6
Permit MI0023400
Outfall **32**

Dilute Raw Sewage (MG)
0.09900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/10/2021	5:00:00 PM	4/11/2021	3:00:00 AM

Rain(in.) = 0.92
Waterbody: Grand River

Submission ID. HP7-XP9X-4FSK6
Permit MI0023400
Outfall **46**

Dilute Raw Sewage (MG)
0.14000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/10/2021	5:00:00 PM	4/11/2021	3:45:00 AM

Rain(in.) = 0.92
Waterbody: Grand River

Submission ID. HP7-XP9X-4FSK6
Permit MI0023400
Outfall **9**

Dilute Raw Sewage (MG)
0.48800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/10/2021	5:15:00 PM	4/11/2021	5:00:00 AM

Rain(in.) = 0.92
Waterbody: Grand River

Submission ID. HP7-XP9X-4FSK6
Permit MI0023400
Outfall **15**

Dilute Raw Sewage (MG)
0.97200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/10/2021	5:15:00 PM	4/11/2021	4:00:00 AM

Rain(in.) = 0.92
Waterbody: Grand River

Submission ID. HP7-XP9X-4FSK6
Permit MI0023400
Outfall **17**

Dilute Raw Sewage (MG)
0.38100

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/10/2021	5:15:00 PM	4/11/2021	3:45:00 AM

Rain(in.) = 0.92
Waterbody: Grand River

Submission ID. HP7-XP9X-4FSK6
Permit MI0023400
Outfall **21**

Dilute Raw Sewage (MG)
0.21800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/10/2021	5:15:00 PM	4/11/2021	5:45:00 AM

Rain(in.) = 0.92
Waterbody: Grand River

Submission ID. HP7-XP9X-4FSK6
Permit MI0023400
Outfall **22**

Dilute Raw Sewage (MG)
2.10200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/10/2021	5:15:00 PM	4/11/2021	4:45:00 AM

Rain(in.) = 0.92
Waterbody: Grand River

Submission ID. HP7-XP9X-4FSK6
Permit MI0023400
Outfall **34**

Dilute Raw Sewage (MG)
2.57300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/10/2021	5:30:00 PM	4/11/2021	4:30:00 AM

Rain(in.) = 0.92
Waterbody: Grand River

Submission ID. HP7-XP9X-4FSK6
Permit MI0023400
Outfall **12**

Dilute Raw Sewage (MG)
0.60900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/10/2021	5:30:00 PM	4/11/2021	3:00:00 AM

Rain(in.) = 0.92
Waterbody: Grand River

Submission ID. HP7-XP9X-4FSK6
Permit MI0023400
Outfall 19

Dilute Raw Sewage (MG)
0.52300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/10/2021	6:00:00 PM	4/11/2021	2:00:00 AM

Rain(in.) = 0.92
Waterbody: Grand River

Submission ID. HP7-XP9X-4FSK6
Permit MI0023400
Outfall 8

Dilute Raw Sewage (MG)
0.16300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/29/2021	9:00:00 AM	4/29/2021	4:15:00 PM

Rain(in.) = 0.2
Waterbody: Grand River

Submission ID. HP8-BTZE-JP1Y6
Permit MI0023400
Outfall 16

Dilute Raw Sewage (MG)
0.05500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/29/2021	9:00:00 AM	4/29/2021	4:00:00 PM

Rain(in.) = 0.2
Waterbody: Grand River

Submission ID. HP8-BTZE-JP1Y6
Permit MI0023400
Outfall **24**

Dilute Raw Sewage (MG)
0.15100

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/29/2021	9:00:00 AM	4/29/2021	3:45:00 PM

Rain(in.) = 0.2
Waterbody: Red Cedar River

Submission ID. HP8-BTZE-JP1Y6
Permit MI0023400
Outfall **26**

Dilute Raw Sewage (MG)
0.03700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/29/2021	9:00:00 AM	4/29/2021	5:45:00 PM

Rain(in.) = 0.2
Waterbody: Red Cedar River

Submission ID. HP8-BTZE-JP1Y6
Permit MI0023400
Outfall **32**

Dilute Raw Sewage (MG)
0.00700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/29/2021	9:00:00 AM	4/29/2021	3:00:00 PM

Rain(in.) = 0.2
Waterbody: Grand River

Submission ID. HP8-BTZE-JP1Y6
Permit MI0023400
Outfall **46**

Dilute Raw Sewage (MG)
0.02200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/29/2021	9:15:00 AM	4/29/2021	3:30:00 PM

Rain(in.) = 0.2
Waterbody: Grand River

Submission ID. HP8-BTZE-JP1Y6
Permit MI0023400
Outfall **11**

Dilute Raw Sewage (MG)
0.01400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/29/2021	10:00:00 AM	4/29/2021	5:15:00 PM

Rain(in.) = 0.2
Waterbody: Grand River

Submission ID. HP8-BTZE-JP1Y6
Permit MI0023400
Outfall **15**

Dilute Raw Sewage (MG)
0.15200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/29/2021	12:00:00 PM	4/29/2021	4:00:00 PM

Rain(in.) = 0.2
Waterbody: Grand River

Submission ID. HP8-BTZE-JP1Y6
Permit MI0023400
Outfall 9

Dilute Raw Sewage (MG)
0.07400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/29/2021	12:15:00 PM	4/29/2021	4:45:00 PM

Rain(in.) = 0.2
Waterbody: Grand River

Submission ID. HP8-BTZE-JP1Y6
Permit MI0023400
Outfall 12

Dilute Raw Sewage (MG)
0.09400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/29/2021	12:15:00 PM	4/29/2021	4:15:00 PM

Rain(in.) = 0.2
Waterbody: Grand River

Submission ID. HP8-BTZE-JP1Y6
Permit MI0023400
Outfall 17

Dilute Raw Sewage (MG)
0.05800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/29/2021	12:15:00 PM	4/29/2021	3:45:00 PM

Rain(in.) = 0.2
Waterbody: Grand River

Submission ID. HP8-BTZE-JP1Y6
Permit MI0023400
Outfall **21**

Dilute Raw Sewage (MG)
0.03300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/29/2021	12:15:00 PM	4/29/2021	5:45:00 PM

Rain(in.) = 0.2
Waterbody: Grand River

Submission ID. HP8-BTZE-JP1Y6
Permit MI0023400
Outfall **22**

Dilute Raw Sewage (MG)
0.29900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/29/2021	12:15:00 PM	4/29/2021	4:45:00 PM

Rain(in.) = 0.2
Waterbody: Grand River

Submission ID. HP8-BTZE-JP1Y6
Permit MI0023400
Outfall **34**

Dilute Raw Sewage (MG)
0.38300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
4/29/2021	12:30:00 PM	4/29/2021	3:15:00 PM

Rain(in.) = 0.2
Waterbody: Grand River

Submission ID. HP8-BTZE-JP1Y6
Permit MI0023400
Outfall **19**

Dilute Raw Sewage (MG)
0.06200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
5/26/2021	1:00:00 AM	5/26/2021	12:45:00 PM

Rain(in.) = 0.39
Waterbody: Red Cedar River

Submission ID. HP9-08R7-KYMW4
Permit MI0023400
Outfall **32**

Dilute Raw Sewage (MG)
0.01600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
5/26/2021	1:00:00 AM	5/26/2021	10:00:00 AM

Rain(in.) = 0.39
Waterbody: Grand River

Submission ID. HP9-08R7-KYMW4
Permit MI0023400
Outfall **46**

Dilute Raw Sewage (MG)
0.05300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
5/26/2021	1:15:00 AM	5/26/2021	11:15:00 AM

Rain(in.) = 0.39
Waterbody: Grand River

Submission ID. HP9-08R7-KYMW4
Permit MI0023400
Outfall **16**

Dilute Raw Sewage (MG)
0.13600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
5/26/2021	1:30:00 AM	5/26/2021	11:00:00 AM

Rain(in.) = 0.39
Waterbody: Red Cedar River

Submission ID. HP9-08R7-KYMW4
Permit MI0023400
Outfall **26**

Dilute Raw Sewage (MG)
0.09200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
5/26/2021	6:00:00 AM	5/26/2021	10:30:00 AM

Rain(in.) = 0.39
Waterbody: Grand River

Submission ID. HP9-08R7-KYMW4
Permit MI0023400
Outfall **11**

Dilute Raw Sewage (MG)
0.03500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
5/26/2021	6:00:00 AM	5/26/2021	11:00:00 AM

Rain(in.) = 0.39
Waterbody: Grand River

Submission ID. HP9-08R7-KYMW4
Permit MI0023400
Outfall **24**

Dilute Raw Sewage (MG)
0.37400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
5/26/2021	6:00:00 AM	5/26/2021	11:00:00 AM

Rain(in.) = 0.39
Waterbody: Grand River

Submission ID. HP9-08R7-KYMW4
Permit MI0023400
Outfall **9**

Dilute Raw Sewage (MG)
0.18700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
5/26/2021	6:15:00 AM	5/26/2021	11:45:00 AM

Rain(in.) = 0.39
Waterbody: Grand River

Submission ID. HP9-08R7-KYMW4
Permit MI0023400
Outfall **12**

Dilute Raw Sewage (MG)
0.23300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
5/26/2021	6:15:00 AM	5/26/2021	12:15:00 PM

Rain(in.) = 0.39
Waterbody: Grand River

Submission ID. HP9-08R7-KYMW4
Permit MI0023400
Outfall **15**

Dilute Raw Sewage (MG)
0.37600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
5/26/2021	6:15:00 AM	5/26/2021	11:15:00 AM

Rain(in.) = 0.39
Waterbody: Grand River

Submission ID. HP9-08R7-KYMW4
Permit MI0023400
Outfall **17**

Dilute Raw Sewage (MG)
0.14500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
5/26/2021	6:15:00 AM	5/26/2021	10:15:00 AM

Rain(in.) = 0.39
Waterbody: Grand River

Submission ID. HP9-08R7-KYMW4
Permit MI0023400
Outfall **19**

Dilute Raw Sewage (MG)
0.19300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
5/26/2021	6:15:00 AM	5/26/2021	11:00:00 AM

Rain(in.) = 0.39
Waterbody: Grand River

Submission ID. HP9-08R7-KYMW4
Permit MI0023400
Outfall **21**

Dilute Raw Sewage (MG)
0.08300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
5/26/2021	6:15:00 AM	5/26/2021	12:45:00 PM

Rain(in.) = 0.39
Waterbody: Grand River

Submission ID. HP9-08R7-KYMW4
Permit MI0023400
Outfall **22**

Dilute Raw Sewage (MG)
0.78500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
5/26/2021	6:15:00 AM	5/26/2021	12:00:00 PM

Rain(in.) = 0.39
Waterbody: Grand River

Submission ID. HP9-08R7-KYMW4
Permit MI0023400
Outfall **34**

Dilute Raw Sewage (MG)
0.97200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
5/26/2021	6:30:00 AM	5/26/2021	7:15:00 AM

Rain(in.) = 0.39
Waterbody: Grand River

Submission ID. HP9-08R7-KYMW4
Permit MI0023400
Outfall **8**

Dilute Raw Sewage (MG)
0.06200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
5/27/2021	10:00:00 PM	5/28/2021	2:45:00 PM

Rain(in.) = 0.45
Waterbody: Red Cedar River

Submission ID. HP9-1W7Q-B81YP
Permit MI0023400
Outfall **32**

Dilute Raw Sewage (MG)
0.01700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
5/27/2021	10:00:00 PM	5/28/2021	1:00:00 PM

Rain(in.) = 0.45
Waterbody: Grand River

Submission ID. HP9-1W7Q-B81YP
Permit MI0023400
Outfall **46**

Dilute Raw Sewage (MG)
0.05800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
5/27/2021	10:15:00 PM	5/28/2021	1:15:00 PM

Rain(in.) = 0.45
Waterbody: Grand River

Submission ID. HP9-1W7Q-B81YP
Permit MI0023400
Outfall **16**

Dilute Raw Sewage (MG)
0.14600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
5/27/2021	10:30:00 PM	5/28/2021	1:00:00 PM

Rain(in.) = 0.45
Waterbody: Red Cedar River

Submission ID. HP9-1W7Q-B81YP
Permit MI0023400
Outfall **26**

Dilute Raw Sewage (MG)
0.08800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
5/27/2021	11:00:00 PM	5/28/2021	12:30:00 PM

Rain(in.) = 0.45
Waterbody: Grand River

Submission ID. HP9-1W7Q-B81YP
Permit MI0023400
Outfall **11**

Dilute Raw Sewage (MG)
0.03800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
5/27/2021	11:00:00 PM	5/28/2021	1:00:00 PM

Rain(in.) = 0.45
Waterbody: Grand River

Submission ID. HP9-1W7Q-B81YP
Permit MI0023400
Outfall **24**

Dilute Raw Sewage (MG)
0.40000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
5/27/2021	11:00:00 PM	5/28/2021	1:15:00 PM

Rain(in.) = 0.45
Waterbody: Grand River

Submission ID. HP9-1W7Q-B81YP
Permit MI0023400
Outfall **9**

Dilute Raw Sewage (MG)
0.19000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
5/27/2021	11:15:00 PM	5/28/2021	2:15:00 PM

Rain(in.) = 0.45
Waterbody: Grand River

Submission ID. HP9-1W7Q-B81YP
Permit MI0023400
Outfall **15**

Dilute Raw Sewage (MG)
0.39400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
5/27/2021	11:15:00 PM	5/28/2021	1:00:00 PM

Rain(in.) = 0.45
Waterbody: Grand River

Submission ID. HP9-1W7Q-B81YP
Permit MI0023400
Outfall **21**

Dilute Raw Sewage (MG)
0.08600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
5/27/2021	11:30:00 PM	5/28/2021	1:30:00 PM

Rain(in.) = 0.45
Waterbody: Grand River

Submission ID. HP9-1W7Q-B81YP
Permit MI0023400
Outfall **17**

Dilute Raw Sewage (MG)
0.15400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
5/27/2021	11:30:00 PM	5/28/2021	2:45:00 PM

Rain(in.) = 0.45
Waterbody: Grand River

Submission ID. HP9-1W7Q-B81YP
Permit MI0023400
Outfall **22**

Dilute Raw Sewage (MG)
0.79200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
5/27/2021	11:30:00 PM	5/28/2021	2:00:00 PM

Rain(in.) = 0.45
Waterbody: Grand River

Submission ID. HP9-1W7Q-B81YP
Permit MI0023400
Outfall **34**

Dilute Raw Sewage (MG)
0.99400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
5/27/2021	11:45:00 PM	5/28/2021	2:00:00 PM

Rain(in.) = 0.45
Waterbody: Grand River

Submission ID. HP9-1W7Q-B81YP
Permit MI0023400
Outfall **12**

Dilute Raw Sewage (MG)
0.24300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
5/27/2021	11:45:00 PM	5/28/2021	12:30:00 PM

Rain(in.) = 0.45
Waterbody: Grand River

Submission ID. HP9-1W7Q-B81YP
Permit MI0023400
Outfall **19**

Dilute Raw Sewage (MG)
0.14800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/12/2021	9:00:00 PM	6/12/2021	10:45:00 PM

Rain(in.) = 0.16
Waterbody: Grand River

Submission ID. HP9-F7RY-1R1ZD
Permit MI0023400
Outfall **11**

Dilute Raw Sewage (MG)

0.01200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/12/2021	9:00:00 PM	6/12/2021	11:30:00 PM

Rain(in.) = 0.16
Waterbody: Grand River

Submission ID. HP9-F7RY-1R1ZD
Permit MI0023400
Outfall **16**

Dilute Raw Sewage (MG)

0.04700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/12/2021	9:00:00 PM	6/13/2021	12:00:00 AM

Rain(in.) = 0.16
Waterbody: Grand River

Submission ID. HP9-F7RY-1R1ZD
Permit MI0023400
Outfall **24**

Dilute Raw Sewage (MG)

0.12800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/12/2021	9:00:00 PM	6/12/2021	11:15:00 PM

Rain(in.) = 0.16
Waterbody: Red Cedar River

Submission ID. HP9-F7RY-1R1ZD
Permit MI0023400
Outfall **26**

Dilute Raw Sewage (MG)
0.03200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/12/2021	9:00:00 PM	6/13/2021	1:30:00 AM

Rain(in.) = 0.16
Waterbody: Red Cedar River

Submission ID. HP9-F7RY-1R1ZD
Permit MI0023400
Outfall **32**

Dilute Raw Sewage (MG)
0.00600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/12/2021	9:00:00 PM	6/12/2021	11:00:00 PM

Rain(in.) = 0.16
Waterbody: Grand River

Submission ID. HP9-F7RY-1R1ZD
Permit MI0023400
Outfall **46**

Dilute Raw Sewage (MG)
0.01900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/12/2021	9:00:00 PM	6/12/2021	11:15:00 PM

Rain(in.) = 0.16
Waterbody: Grand River

Submission ID. HP9-F7RY-1R1ZD
Permit MI0023400
Outfall 9

Dilute Raw Sewage (MG)
0.06600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/12/2021	9:15:00 PM	6/13/2021	12:00:00 AM

Rain(in.) = 0.16
Waterbody: Grand River

Submission ID. HP9-F7RY-1R1ZD
Permit MI0023400
Outfall 12

Dilute Raw Sewage (MG)
0.08100

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/12/2021	9:15:00 PM	6/13/2021	12:30:00 AM

Rain(in.) = 0.16
Waterbody: Grand River

Submission ID. HP9-F7RY-1R1ZD
Permit MI0023400
Outfall 15

Dilute Raw Sewage (MG)
0.13400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/12/2021	9:15:00 PM	6/12/2021	11:45:00 PM

Rain(in.) = 0.16
Waterbody: Grand River

Submission ID. HP9-F7RY-1R1ZD
Permit MI0023400
Outfall **17**

Dilute Raw Sewage (MG)
0.05000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/12/2021	9:15:00 PM	6/12/2021	11:00:00 PM

Rain(in.) = 0.16
Waterbody: Grand River

Submission ID. HP9-F7RY-1R1ZD
Permit MI0023400
Outfall **21**

Dilute Raw Sewage (MG)
0.02900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/12/2021	9:15:00 PM	6/13/2021	1:30:00 AM

Rain(in.) = 0.16
Waterbody: Grand River

Submission ID. HP9-F7RY-1R1ZD
Permit MI0023400
Outfall **22**

Dilute Raw Sewage (MG)
0.25800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/12/2021	9:15:00 PM	6/13/2021	12:15:00 AM

Rain(in.) = 0.16
Waterbody: Grand River

Submission ID. HP9-F7RY-1R1ZD
Permit MI0023400
Outfall **34**

Dilute Raw Sewage (MG)
0.33200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/12/2021	9:30:00 PM	6/12/2021	10:45:00 PM

Rain(in.) = 0.16
Waterbody: Grand River

Submission ID. HP9-F7RY-1R1ZD
Permit MI0023400
Outfall **19**

Dilute Raw Sewage (MG)
0.06400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/12/2021	9:45:00 PM	6/12/2021	10:00:00 PM

Rain(in.) = 0.16
Waterbody: Grand River

Submission ID. HP9-F7RY-1R1ZD
Permit MI0023400
Outfall **8**

Dilute Raw Sewage (MG)
0.00200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/18/2021	6:00:00 AM	6/18/2021	12:30:00 PM

Rain(in.) = 0.32
Waterbody: Red Cedar River

Submission ID. HP9-JC6Y-6FY0X
Permit MI0023400
Outfall **32**

Dilute Raw Sewage (MG)
0.01300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/18/2021	6:00:00 AM	6/18/2021	10:00:00 AM

Rain(in.) = 0.32
Waterbody: Grand River

Submission ID. HP9-JC6Y-6FY0X
Permit MI0023400
Outfall **46**

Dilute Raw Sewage (MG)
0.04400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/18/2021	6:15:00 AM	6/18/2021	10:30:00 AM

Rain(in.) = 0.32
Waterbody: Grand River

Submission ID. HP9-JC6Y-6FY0X
Permit MI0023400
Outfall **16**

Dilute Raw Sewage (MG)
0.11200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/18/2021	6:30:00 AM	6/18/2021	10:15:00 AM

Rain(in.) = 0.32
Waterbody: Red Cedar River

Submission ID. HP9-JC6Y-6FY0X
Permit MI0023400
Outfall **26**

Dilute Raw Sewage (MG)
0.07600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/18/2021	7:00:00 AM	6/18/2021	9:45:00 AM

Rain(in.) = 0.32
Waterbody: Grand River

Submission ID. HP9-JC6Y-6FY0X
Permit MI0023400
Outfall **11**

Dilute Raw Sewage (MG)
0.02900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/18/2021	7:00:00 AM	6/18/2021	11:30:00 AM

Rain(in.) = 0.32
Waterbody: Grand River

Submission ID. HP9-JC6Y-6FY0X
Permit MI0023400
Outfall **15**

Dilute Raw Sewage (MG)
0.31200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/18/2021	7:00:00 AM	6/18/2021	11:00:00 AM

Rain(in.) = 0.32
Waterbody: Grand River

Submission ID. HP9-JC6Y-6FY0X
Permit MI0023400
Outfall **24**

Dilute Raw Sewage (MG)
0.30700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/18/2021	7:00:00 AM	6/18/2021	10:15:00 AM

Rain(in.) = 0.32
Waterbody: Grand River

Submission ID. HP9-JC6Y-6FY0X
Permit MI0023400
Outfall **9**

Dilute Raw Sewage (MG)
0.15600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/18/2021	7:15:00 AM	6/18/2021	11:00:00 AM

Rain(in.) = 0.32
Waterbody: Grand River

Submission ID. HP9-JC6Y-6FY0X
Permit MI0023400
Outfall **12**

Dilute Raw Sewage (MG)
0.19300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/18/2021	7:15:00 AM	6/18/2021	10:45:00 AM

Rain(in.) = 0.32
Waterbody: Grand River

Submission ID. HP9-JC6Y-6FY0X
Permit MI0023400
Outfall **17**

Dilute Raw Sewage (MG)
0.12000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/18/2021	7:15:00 AM	6/18/2021	9:45:00 AM

Rain(in.) = 0.32
Waterbody: Grand River

Submission ID. HP9-JC6Y-6FY0X
Permit MI0023400
Outfall **19**

Dilute Raw Sewage (MG)
0.16900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/18/2021	7:15:00 AM	6/18/2021	10:00:00 AM

Rain(in.) = 0.32
Waterbody: Grand River

Submission ID. HP9-JC6Y-6FY0X
Permit MI0023400
Outfall **21**

Dilute Raw Sewage (MG)
0.06900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/18/2021	7:15:00 AM	6/18/2021	12:30:00 PM

Rain(in.) = 0.32
Waterbody: Grand River

Submission ID. HP9-JC6Y-6FY0X
Permit MI0023400
Outfall **22**

Dilute Raw Sewage (MG)
0.64800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/18/2021	7:15:00 AM	6/18/2021	11:15:00 AM

Rain(in.) = 0.32
Waterbody: Grand River

Submission ID. HP9-JC6Y-6FY0X
Permit MI0023400
Outfall **34**

Dilute Raw Sewage (MG)
0.80700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/18/2021	7:30:00 AM	6/18/2021	8:15:00 AM

Rain(in.) = 0.32
Waterbody: Grand River

Submission ID. HP9-JC6Y-6FY0X
Permit MI0023400
Outfall **8**

Dilute Raw Sewage (MG)
0.04100

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/18/2021	8:16:00 AM	6/18/2021	10:43:00 AM

Rain(in.) = 0.32
Waterbody: Grand River

Submission ID. HP9-JC6Y-6FY0X
Permit MI0023400
Outfall **10**

Dilute Raw Sewage (MG)
0.02520

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted. Overflow observed by field crew.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/20/2021	9:00:00 PM	6/21/2021	4:45:00 AM

Rain(in.) = 0.52
Waterbody: Grand River

Submission ID. HP9-MQGF-T4NQ1
Permit MI0023400
Outfall **11**

Dilute Raw Sewage (MG)
0.04900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/20/2021	9:00:00 PM	6/21/2021	5:30:00 AM

Rain(in.) = 0.52
Waterbody: Grand River

Submission ID. HP9-MQGF-T4NQ1
Permit MI0023400
Outfall **16**

Dilute Raw Sewage (MG)
0.19000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/20/2021	9:00:00 PM	6/21/2021	6:00:00 AM

Rain(in.) = 0.52
Waterbody: Grand River

Submission ID. HP9-MQGF-T4NQ1
Permit MI0023400
Outfall **24**

Dilute Raw Sewage (MG)
0.52100

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/20/2021	9:00:00 PM	6/21/2021	5:15:00 AM

Rain(in.) = 0.52
Waterbody: Red Cedar River

Submission ID. HP9-MQGF-T4NQ1
Permit MI0023400
Outfall **26**

Dilute Raw Sewage (MG)
0.12900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/20/2021	9:00:00 PM	6/21/2021	7:45:00 AM

Rain(in.) = 0.52
Waterbody: Red Cedar River

Submission ID. HP9-MQGF-T4NQ1
Permit MI0023400
Outfall **32**

Dilute Raw Sewage (MG)
0.02100

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/20/2021	9:00:00 PM	6/21/2021	5:00:00 AM

Rain(in.) = 0.52
Waterbody: Grand River

Submission ID. HP9-MQGF-T4NQ1
Permit MI0023400
Outfall **46**

Dilute Raw Sewage (MG)
0.07400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/20/2021	9:00:00 PM	6/21/2021	5:15:00 AM

Rain(in.) = 0.52
Waterbody: Grand River

Submission ID. HP9-MQGF-T4NQ1
Permit MI0023400
Outfall **9**

Dilute Raw Sewage (MG)
0.26100

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/20/2021	9:15:00 PM	6/21/2021	6:30:00 AM

Rain(in.) = 0.52
Waterbody: Grand River

Submission ID. HP9-MQGF-T4NQ1
Permit MI0023400
Outfall **15**

Dilute Raw Sewage (MG)
0.52200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/20/2021	9:15:00 PM	6/21/2021	5:45:00 AM

Rain(in.) = 0.52
Waterbody: Grand River

Submission ID. HP9-MQGF-T4NQ1
Permit MI0023400
Outfall **17**

Dilute Raw Sewage (MG)
0.20200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/20/2021	9:15:00 PM	6/21/2021	5:00:00 AM

Rain(in.) = 0.52
Waterbody: Grand River

Submission ID. HP9-MQGF-T4NQ1
Permit MI0023400
Outfall **21**

Dilute Raw Sewage (MG)
0.11600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/20/2021	9:30:00 PM	6/21/2021	6:15:00 AM

Rain(in.) = 0.52
Waterbody: Grand River

Submission ID. HP9-MQGF-T4NQ1
Permit MI0023400
Outfall **12**

Dilute Raw Sewage (MG)
0.32400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/20/2021	9:30:00 PM	6/21/2021	4:45:00 AM

Rain(in.) = 0.52
Waterbody: Grand River

Submission ID. HP9-MQGF-T4NQ1
Permit MI0023400
Outfall **19**

Dilute Raw Sewage (MG)
0.27400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/20/2021	9:30:00 PM	6/21/2021	7:45:00 AM

Rain(in.) = 0.52
Waterbody: Grand River

Submission ID. HP9-MQGF-T4NQ1
Permit MI0023400
Outfall **22**

Dilute Raw Sewage (MG)
1.09200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/20/2021	9:30:00 PM	6/21/2021	6:30:00 AM

Rain(in.) = 0.52
Waterbody: Grand River

Submission ID. HP9-MQGF-T4NQ1
Permit MI0023400
Outfall **34**

Dilute Raw Sewage (MG)
1.35300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/21/2021	3:15:00 AM	6/21/2021	4:15:00 AM

Rain(in.) = 0.52
Waterbody: Grand River

Submission ID. HP9-MQGF-T4NQ1
Permit MI0023400
Outfall 8

Dilute Raw Sewage (MG)
0.06000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/25/2021	4:00:00 AM	6/27/2021	4:45:00 PM

Rain(in.) = 5.18
Waterbody: Grand River

Submission ID. HP9-QWJ6-ZF98F
Permit MI0023400
Outfall 11

Dilute Raw Sewage (MG)
0.82200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/25/2021	4:00:00 AM	6/27/2021	5:30:00 AM

Rain(in.) = 5.18
Waterbody: Grand River

Submission ID. HP9-QWJ6-ZF98F
Permit MI0023400
Outfall 16

Dilute Raw Sewage (MG)
2.68500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/25/2021	4:00:00 AM	6/27/2021	5:30:00 AM

Rain(in.) = 5.18
Waterbody: Grand River

Submission ID. HP9-QWJ6-ZF98F
Permit MI0023400
Outfall **17**

Dilute Raw Sewage (MG)
3.63500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/25/2021	4:00:00 AM	6/26/2021	10:00:00 AM

Rain(in.) = 5.18
Waterbody: Grand River

Submission ID. HP9-QWJ6-ZF98F
Permit MI0023400
Outfall **24**

Dilute Raw Sewage (MG)
4.15900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/25/2021	4:00:00 AM	6/27/2021	5:15:00 AM

Rain(in.) = 5.18
Waterbody: Red Cedar River

Submission ID. HP9-QWJ6-ZF98F
Permit MI0023400
Outfall **26**

Dilute Raw Sewage (MG)
2.30300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/25/2021	4:00:00 AM	6/27/2021	7:15:00 AM

Rain(in.) = 5.18
Waterbody: Red Cedar River

Submission ID. HP9-QWJ6-ZF98F
Permit MI0023400
Outfall **32**

Dilute Raw Sewage (MG)
5.04100

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/25/2021	4:00:00 AM	6/27/2021	9:00:00 AM

Rain(in.) = 5.18
Waterbody: Grand River

Submission ID. HP9-QWJ6-ZF98F
Permit MI0023400
Outfall **46**

Dilute Raw Sewage (MG)
0.61000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/25/2021	4:00:00 AM	6/27/2021	5:15:00 AM

Rain(in.) = 5.18
Waterbody: Grand River

Submission ID. HP9-QWJ6-ZF98F
Permit MI0023400
Outfall **9**

Dilute Raw Sewage (MG)
5.70700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/25/2021	4:15:00 AM	6/27/2021	6:00:00 AM

Rain(in.) = 5.18
Waterbody: Grand River

Submission ID. HP9-QWJ6-ZF98F
Permit MI0023400
Outfall **12**

Dilute Raw Sewage (MG)
5.18300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/25/2021	4:15:00 AM	6/27/2021	6:30:00 AM

Rain(in.) = 5.18
Waterbody: Grand River

Submission ID. HP9-QWJ6-ZF98F
Permit MI0023400
Outfall **15**

Dilute Raw Sewage (MG)
5.64000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/25/2021	4:15:00 AM	6/27/2021	4:45:00 AM

Rain(in.) = 5.18
Waterbody: Grand River

Submission ID. HP9-QWJ6-ZF98F
Permit MI0023400
Outfall **19**

Dilute Raw Sewage (MG)
4.32300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/25/2021	4:15:00 AM	6/27/2021	5:00:00 AM

Rain(in.) = 5.18
Waterbody: Grand River

Submission ID. HP9-QWJ6-ZF98F
Permit MI0023400
Outfall **21**

Dilute Raw Sewage (MG)
2.54300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/25/2021	4:15:00 AM	6/27/2021	7:15:00 AM

Rain(in.) = 5.18
Waterbody: Grand River

Submission ID. HP9-QWJ6-ZF98F
Permit MI0023400
Outfall **22**

Dilute Raw Sewage (MG)
19.00000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/25/2021	4:15:00 AM	6/27/2021	6:15:00 AM

Rain(in.) = 5.18
Waterbody: Grand River

Submission ID. HP9-QWJ6-ZF98F
Permit MI0023400
Outfall **34**

Dilute Raw Sewage (MG)
18.40000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/25/2021	4:30:00 AM	6/26/2021	7:30:00 PM

Rain(in.) = 5.18
Waterbody: Grand River

Submission ID. HP9-QWJ6-ZF98F
Permit MI0023400
Outfall **8**

Dilute Raw Sewage (MG)
5.62500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/25/2021	8:40:00 AM	6/26/2021	7:45:00 PM

Rain(in.) = 5.18
Waterbody: Grand River

Submission ID. HP9-QWJ6-ZF98F
Permit MI0023400
Outfall **10**

Dilute Raw Sewage (MG)
0.57000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/25/2021	9:25:00 AM	6/26/2021	9:00:00 AM

Rain(in.) = 5.18
Waterbody: Grand River

Submission ID. HP9-QWJ6-ZF98F
Permit MI0023400
Outfall **47**

Dilute Raw Sewage (MG)
0.49600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/25/2021	5:00:00 PM	6/26/2021	8:15:00 PM

Rain(in.) = 5.18
Waterbody: Grand River

Submission ID. HP9-QWJ6-ZF98F
Permit MI0023400
Outfall **14**

Dilute Raw Sewage (MG)
5.03400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/28/2021	4:00:00 PM	6/29/2021	3:15:00 PM

Rain(in.) = 0.53
Waterbody: Grand River

Submission ID. HP9-VXZW-QE25K
Permit MI0023400
Outfall **16**

Dilute Raw Sewage (MG)
0.16800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/28/2021	4:00:00 PM	6/29/2021	3:00:00 PM

Rain(in.) = 0.53
Waterbody: Grand River

Submission ID. HP9-VXZW-QE25K
Permit MI0023400
Outfall **24**

Dilute Raw Sewage (MG)
0.46100

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/28/2021	4:00:00 PM	6/29/2021	3:00:00 PM

Rain(in.) = 0.53
Waterbody: Red Cedar River

Submission ID. HP9-VXZW-QE25K
Permit MI0023400
Outfall **26**

Dilute Raw Sewage (MG)
0.11500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/28/2021	4:00:00 PM	6/29/2021	5:00:00 PM

Rain(in.) = 0.53
Waterbody: Red Cedar River

Submission ID. HP9-VXZW-QE25K
Permit MI0023400
Outfall **32**

Dilute Raw Sewage (MG)
0.02000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/28/2021	4:00:00 PM	6/29/2021	2:00:00 PM

Rain(in.) = 0.53
Waterbody: Grand River

Submission ID. HP9-VXZW-QE25K
Permit MI0023400
Outfall **46**

Dilute Raw Sewage (MG)
0.06600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/28/2021	4:15:00 PM	6/29/2021	2:30:00 PM

Rain(in.) = 0.53
Waterbody: Grand River

Submission ID. HP9-VXZW-QE25K
Permit MI0023400
Outfall **11**

Dilute Raw Sewage (MG)

0.04400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/28/2021	5:00:00 PM	6/29/2021	4:15:00 PM

Rain(in.) = 0.53
Waterbody: Grand River

Submission ID. HP9-VXZW-QE25K
Permit MI0023400
Outfall **15**

Dilute Raw Sewage (MG)

0.46600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/28/2021	7:00:00 PM	6/29/2021	3:30:00 PM

Rain(in.) = 0.53
Waterbody: Grand River

Submission ID. HP9-VXZW-QE25K
Permit MI0023400
Outfall **17**

Dilute Raw Sewage (MG)

0.17900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/28/2021	7:00:00 PM	6/29/2021	3:00:00 PM

Rain(in.) = 0.53
Waterbody: Grand River

Submission ID. HP9-VXZW-QE25K
Permit MI0023400
Outfall 9

Dilute Raw Sewage (MG)
0.23000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/28/2021	7:15:00 PM	6/29/2021	3:45:00 PM

Rain(in.) = 0.53
Waterbody: Grand River

Submission ID. HP9-VXZW-QE25K
Permit MI0023400
Outfall 12

Dilute Raw Sewage (MG)
0.28600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/28/2021	7:15:00 PM	6/29/2021	2:15:00 PM

Rain(in.) = 0.53
Waterbody: Grand River

Submission ID. HP9-VXZW-QE25K
Permit MI0023400
Outfall 19

Dilute Raw Sewage (MG)
0.23400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/28/2021	7:15:00 PM	6/29/2021	3:00:00 PM

Rain(in.) = 0.53
Waterbody: Grand River

Submission ID. HP9-VXZW-QE25K
Permit MI0023400
Outfall **21**

Dilute Raw Sewage (MG)
0.10300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/28/2021	7:15:00 PM	6/29/2021	5:00:00 PM

Rain(in.) = 0.53
Waterbody: Grand River

Submission ID. HP9-VXZW-QE25K
Permit MI0023400
Outfall **22**

Dilute Raw Sewage (MG)
0.94200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/28/2021	7:15:00 PM	6/29/2021	4:00:00 PM

Rain(in.) = 0.53
Waterbody: Grand River

Submission ID. HP9-VXZW-QE25K
Permit MI0023400
Outfall **34**

Dilute Raw Sewage (MG)
1.18900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
6/28/2021	7:30:00 PM	6/29/2021	1:00:00 PM

Rain(in.) = 0.53
Waterbody: Grand River

Submission ID. HP9-VXZW-QE25K
Permit MI0023400
Outfall 8

Dilute Raw Sewage (MG)
0.09200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/8/2021	2:00:00 AM	7/8/2021	4:45:00 AM

Rain(in.) = 0.27
Waterbody: Grand River

Submission ID. HPA-27QF-C1Y0J
Permit MI0023400
Outfall 11

Dilute Raw Sewage (MG)
0.02400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/8/2021	2:00:00 AM	7/8/2021	5:30:00 AM

Rain(in.) = 0.27
Waterbody: Grand River

Submission ID. HPA-27QF-C1Y0J
Permit MI0023400
Outfall 16

Dilute Raw Sewage (MG)
0.09200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/8/2021	2:00:00 AM	7/8/2021	6:00:00 AM

Rain(in.) = 0.27
Waterbody: Grand River

Submission ID. HPA-27QF-C1Y0J
Permit MI0023400
Outfall **24**

Dilute Raw Sewage (MG)
0.25200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/8/2021	2:00:00 AM	7/8/2021	5:15:00 AM

Rain(in.) = 0.27
Waterbody: Red Cedar River

Submission ID. HPA-27QF-C1Y0J
Permit MI0023400
Outfall **26**

Dilute Raw Sewage (MG)
0.06300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/8/2021	2:00:00 AM	7/8/2021	5:00:00 AM

Rain(in.) = 0.27
Waterbody: Grand River

Submission ID. HPA-27QF-C1Y0J
Permit MI0023400
Outfall **46**

Dilute Raw Sewage (MG)
0.03600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/8/2021	2:15:00 AM	7/8/2021	5:15:00 AM

Rain(in.) = 0.27
Waterbody: Grand River

Submission ID. HPA-27QF-C1Y0J
Permit MI0023400
Outfall 9

Dilute Raw Sewage (MG)
0.12800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/8/2021	2:30:00 AM	7/8/2021	6:30:00 AM

Rain(in.) = 0.27
Waterbody: Grand River

Submission ID. HPA-27QF-C1Y0J
Permit MI0023400
Outfall 15

Dilute Raw Sewage (MG)
0.25600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/8/2021	2:30:00 AM	7/8/2021	5:45:00 AM

Rain(in.) = 0.27
Waterbody: Grand River

Submission ID. HPA-27QF-C1Y0J
Permit MI0023400
Outfall 17

Dilute Raw Sewage (MG)
0.09800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/8/2021	2:30:00 AM	7/8/2021	5:00:00 AM

Rain(in.) = 0.27
Waterbody: Grand River

Submission ID. HPA-27QF-C1Y0J
Permit MI0023400
Outfall **21**

Dilute Raw Sewage (MG)
0.05700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/8/2021	2:45:00 AM	7/8/2021	7:45:00 AM

Rain(in.) = 0.27
Waterbody: Grand River

Submission ID. HPA-27QF-C1Y0J
Permit MI0023400
Outfall **22**

Dilute Raw Sewage (MG)
0.52500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/8/2021	2:45:00 AM	7/8/2021	6:30:00 AM

Rain(in.) = 0.27
Waterbody: Grand River

Submission ID. HPA-27QF-C1Y0J
Permit MI0023400
Outfall **34**

Dilute Raw Sewage (MG)
0.65900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/8/2021	3:00:00 AM	7/8/2021	6:15:00 AM

Rain(in.) = 0.27
Waterbody: Grand River

Submission ID. HPA-27QF-C1Y0J
Permit MI0023400
Outfall **12**

Dilute Raw Sewage (MG)
0.15800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/8/2021	3:00:00 AM	7/8/2021	4:45:00 AM

Rain(in.) = 0.27
Waterbody: Grand River

Submission ID. HPA-27QF-C1Y0J
Permit MI0023400
Outfall **19**

Dilute Raw Sewage (MG)
0.13900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/8/2021	3:00:00 AM	7/8/2021	7:45:00 AM

Rain(in.) = 0.27
Waterbody: Red Cedar River

Submission ID. HPA-27QF-C1Y0J
Permit MI0023400
Outfall **32**

Dilute Raw Sewage (MG)
0.01100

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/8/2021	3:15:00 AM	7/8/2021	4:45:00 AM

Rain(in.) = 0.27
Waterbody: Grand River

Submission ID. HPA-27QF-C1Y0J
Permit MI0023400
Outfall 8

Dilute Raw Sewage (MG)
0.06900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/13/2021	2:00:00 PM	7/13/2021	10:30:00 PM

Rain(in.) = 0.38
Waterbody: Grand River

Submission ID. HPA-6TT2-7GGQM
Permit MI0023400
Outfall 11

Dilute Raw Sewage (MG)
0.03300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/13/2021	2:00:00 PM	7/13/2021	11:15:00 PM

Rain(in.) = 0.38
Waterbody: Grand River

Submission ID. HPA-6TT2-7GGQM
Permit MI0023400
Outfall 16

Dilute Raw Sewage (MG)
0.12800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/13/2021	2:00:00 PM	7/13/2021	11:00:00 PM

Rain(in.) = 0.38
Waterbody: Grand River

Submission ID. HPA-6TT2-7GGQM
Permit MI0023400
Outfall **24**

Dilute Raw Sewage (MG)
0.35300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/13/2021	2:00:00 PM	7/13/2021	10:45:00 PM

Rain(in.) = 0.38
Waterbody: Red Cedar River

Submission ID. HPA-6TT2-7GGQM
Permit MI0023400
Outfall **26**

Dilute Raw Sewage (MG)
0.08700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/13/2021	2:00:00 PM	7/13/2021	10:00:00 PM

Rain(in.) = 0.38
Waterbody: Grand River

Submission ID. HPA-6TT2-7GGQM
Permit MI0023400
Outfall **46**

Dilute Raw Sewage (MG)
0.05100

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/13/2021	2:15:00 PM	7/13/2021	11:00:00 PM

Rain(in.) = 0.38
Waterbody: Grand River

Submission ID. HPA-6TT2-7GGQM
Permit MI0023400
Outfall 9

Dilute Raw Sewage (MG)
0.17200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/13/2021	2:30:00 PM	7/14/2021	12:15:00 AM

Rain(in.) = 0.38
Waterbody: Grand River

Submission ID. HPA-6TT2-7GGQM
Permit MI0023400
Outfall 15

Dilute Raw Sewage (MG)
0.35300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/13/2021	2:30:00 PM	7/13/2021	11:15:00 PM

Rain(in.) = 0.38
Waterbody: Grand River

Submission ID. HPA-6TT2-7GGQM
Permit MI0023400
Outfall 17

Dilute Raw Sewage (MG)
0.13600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/13/2021	2:30:00 PM	7/13/2021	10:45:00 PM

Rain(in.) = 0.38
Waterbody: Grand River

Submission ID. HPA-6TT2-7GGQM
Permit MI0023400
Outfall **21**

Dilute Raw Sewage (MG)
0.07700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/13/2021	2:45:00 PM	7/14/2021	1:00:00 AM

Rain(in.) = 0.38
Waterbody: Grand River

Submission ID. HPA-6TT2-7GGQM
Permit MI0023400
Outfall **22**

Dilute Raw Sewage (MG)
0.71600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/13/2021	2:45:00 PM	7/13/2021	11:45:00 PM

Rain(in.) = 0.38
Waterbody: Grand River

Submission ID. HPA-6TT2-7GGQM
Permit MI0023400
Outfall **34**

Dilute Raw Sewage (MG)
0.90500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/13/2021	3:00:00 PM	7/13/2021	11:45:00 PM

Rain(in.) = 0.38
Waterbody: Grand River

Submission ID. HPA-6TT2-7GGQM
Permit MI0023400
Outfall **12**

Dilute Raw Sewage (MG)
0.21700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/13/2021	3:00:00 PM	7/13/2021	10:15:00 PM

Rain(in.) = 0.38
Waterbody: Grand River

Submission ID. HPA-6TT2-7GGQM
Permit MI0023400
Outfall **19**

Dilute Raw Sewage (MG)
0.16600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/13/2021	3:00:00 PM	7/14/2021	1:00:00 AM

Rain(in.) = 0.38
Waterbody: Red Cedar River

Submission ID. HPA-6TT2-7GGQM
Permit MI0023400
Outfall **32**

Dilute Raw Sewage (MG)
0.01500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/13/2021	8:30:00 PM	7/13/2021	9:15:00 PM

Rain(in.) = 0.38
Waterbody: Grand River

Submission ID. HPA-6TT2-7GGQM
Permit MI0023400
Outfall 8

Dilute Raw Sewage (MG)
0.03700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/23/2021	1:00:00 PM	7/23/2021	11:30:00 PM

Rain(in.) = 0.19
Waterbody: Red Cedar River

Submission ID. HPA-GD3A-6P1H6
Permit MI0023400
Outfall 32

Dilute Raw Sewage (MG)
0.00700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/23/2021	1:00:00 PM	7/23/2021	9:00:00 PM

Rain(in.) = 0.19
Waterbody: Grand River

Submission ID. HPA-GD3A-6P1H6
Permit MI0023400
Outfall 46

Dilute Raw Sewage (MG)
0.02200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/23/2021	1:15:00 PM	7/23/2021	9:30:00 PM

Rain(in.) = 0.19
Waterbody: Grand River

Submission ID. HPA-GD3A-6P1H6
Permit MI0023400
Outfall **16**

Dilute Raw Sewage (MG)
0.05600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/23/2021	1:30:00 PM	7/23/2021	9:15:00 PM

Rain(in.) = 0.19
Waterbody: Red Cedar River

Submission ID. HPA-GD3A-6P1H6
Permit MI0023400
Outfall **26**

Dilute Raw Sewage (MG)
0.03800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/23/2021	7:00:00 PM	7/23/2021	8:45:00 PM

Rain(in.) = 0.19
Waterbody: Grand River

Submission ID. HPA-GD3A-6P1H6
Permit MI0023400
Outfall **11**

Dilute Raw Sewage (MG)
0.01400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/23/2021	7:00:00 PM	7/23/2021	10:00:00 PM

Rain(in.) = 0.19
Waterbody: Grand River

Submission ID. HPA-GD3A-6P1H6
Permit MI0023400
Outfall **24**

Dilute Raw Sewage (MG)
0.15200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/23/2021	7:00:00 PM	7/23/2021	9:15:00 PM

Rain(in.) = 0.19
Waterbody: Grand River

Submission ID. HPA-GD3A-6P1H6
Permit MI0023400
Outfall **9**

Dilute Raw Sewage (MG)
0.07800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/23/2021	7:15:00 PM	7/23/2021	10:15:00 PM

Rain(in.) = 0.19
Waterbody: Grand River

Submission ID. HPA-GD3A-6P1H6
Permit MI0023400
Outfall **12**

Dilute Raw Sewage (MG)
0.09600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/23/2021	7:15:00 PM	7/23/2021	10:30:00 PM

Rain(in.) = 0.19
Waterbody: Grand River

Submission ID. HPA-GD3A-6P1H6
Permit MI0023400
Outfall **15**

Dilute Raw Sewage (MG)
0.15800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/23/2021	7:15:00 PM	7/23/2021	9:45:00 PM

Rain(in.) = 0.19
Waterbody: Grand River

Submission ID. HPA-GD3A-6P1H6
Permit MI0023400
Outfall **17**

Dilute Raw Sewage (MG)
0.05900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/23/2021	7:15:00 PM	7/23/2021	8:45:00 PM

Rain(in.) = 0.19
Waterbody: Grand River

Submission ID. HPA-GD3A-6P1H6
Permit MI0023400
Outfall **19**

Dilute Raw Sewage (MG)
0.07900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/23/2021	7:15:00 PM	7/23/2021	9:00:00 PM

Rain(in.) = 0.19
Waterbody: Grand River

Submission ID. HPA-GD3A-6P1H6
Permit MI0023400
Outfall **21**

Dilute Raw Sewage (MG)
0.03400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/23/2021	7:15:00 PM	7/23/2021	11:30:00 PM

Rain(in.) = 0.19
Waterbody: Grand River

Submission ID. HPA-GD3A-6P1H6
Permit MI0023400
Outfall **22**

Dilute Raw Sewage (MG)
0.30900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/23/2021	7:15:00 PM	7/23/2021	10:15:00 PM

Rain(in.) = 0.19
Waterbody: Grand River

Submission ID. HPA-GD3A-6P1H6
Permit MI0023400
Outfall **34**

Dilute Raw Sewage (MG)
0.39400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/23/2021	7:45:00 PM	7/23/2021	8:00:00 PM

Rain(in.) = 0.19
Waterbody: Grand River

Submission ID. HPA-GD3A-6P1H6
Permit MI0023400
Outfall **8**

Dilute Raw Sewage (MG)
0.01400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/24/2021	7:00:00 PM	7/24/2021	8:45:00 PM

Rain(in.) = 0.57
Waterbody: Grand River

Submission ID. HPA-KCKK-JRDGN
Permit MI0023400
Outfall **11**

Dilute Raw Sewage (MG)
0.05800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/24/2021	7:00:00 PM	7/24/2021	10:15:00 PM

Rain(in.) = 0.57
Waterbody: Grand River

Submission ID. HPA-KCKK-JRDGN
Permit MI0023400
Outfall **12**

Dilute Raw Sewage (MG)
0.38400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/24/2021	7:00:00 PM	7/24/2021	10:30:00 PM

Rain(in.) = 0.57
Waterbody: Grand River

Submission ID. HPA-KCKK-JRDGN
Permit MI0023400
Outfall **15**

Dilute Raw Sewage (MG)
0.41900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/24/2021	7:00:00 PM	7/24/2021	9:45:00 PM

Rain(in.) = 0.57
Waterbody: Grand River

Submission ID. HPA-KCKK-JRDGN
Permit MI0023400
Outfall **16**

Dilute Raw Sewage (MG)
0.22200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/24/2021	7:00:00 PM	7/24/2021	9:45:00 PM

Rain(in.) = 0.57
Waterbody: Grand River

Submission ID. HPA-KCKK-JRDGN
Permit MI0023400
Outfall **17**

Dilute Raw Sewage (MG)
0.23900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/24/2021	7:00:00 PM	7/24/2021	9:00:00 PM

Rain(in.) = 0.57
Waterbody: Grand River

Submission ID. HPA-KCKK-JRDGN
Permit MI0023400
Outfall **19**

Dilute Raw Sewage (MG)
0.37400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/24/2021	7:00:00 PM	7/24/2021	9:15:00 PM

Rain(in.) = 0.57
Waterbody: Grand River

Submission ID. HPA-KCKK-JRDGN
Permit MI0023400
Outfall **21**

Dilute Raw Sewage (MG)
0.14400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/24/2021	7:00:00 PM	7/25/2021	12:00:00 AM

Rain(in.) = 0.57
Waterbody: Grand River

Submission ID. HPA-KCKK-JRDGN
Permit MI0023400
Outfall **22**

Dilute Raw Sewage (MG)
1.31600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/24/2021	7:00:00 PM	7/24/2021	10:00:00 PM

Rain(in.) = 0.57
Waterbody: Grand River

Submission ID. HPA-KCKK-JRDGN
Permit MI0023400
Outfall **24**

Dilute Raw Sewage (MG)
0.77700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/24/2021	7:00:00 PM	7/24/2021	9:15:00 PM

Rain(in.) = 0.57
Waterbody: Red Cedar River

Submission ID. HPA-KCKK-JRDGN
Permit MI0023400
Outfall **26**

Dilute Raw Sewage (MG)
0.15200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/24/2021	7:00:00 PM	7/25/2021	12:00:00 AM

Rain(in.) = 0.57
Waterbody: Red Cedar River

Submission ID. HPA-KCKK-JRDGN
Permit MI0023400
Outfall **32**

Dilute Raw Sewage (MG)
0.02500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/24/2021	7:00:00 PM	7/24/2021	10:30:00 PM

Rain(in.) = 0.57
Waterbody: Grand River

Submission ID. HPA-KCKK-JRDGN
Permit MI0023400
Outfall **34**

Dilute Raw Sewage (MG)
1.62300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/24/2021	7:00:00 PM	7/24/2021	9:00:00 PM

Rain(in.) = 0.57
Waterbody: Grand River

Submission ID. HPA-KCKK-JRDGN
Permit MI0023400
Outfall **46**

Dilute Raw Sewage (MG)
0.12000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/24/2021	7:00:00 PM	7/24/2021	9:15:00 PM

Rain(in.) = 0.57
Waterbody: Grand River

Submission ID. HPA-KCKK-JRDGN
Permit MI0023400
Outfall **9**

Dilute Raw Sewage (MG)
0.30500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/24/2021	7:15:00 PM	7/24/2021	8:15:00 PM

Rain(in.) = 0.57
Waterbody: Grand River

Submission ID. HPA-KCKK-JRDGN
Permit MI0023400
Outfall **10**

Dilute Raw Sewage (MG)
0.00600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/24/2021	7:15:00 PM	7/24/2021	8:15:00 PM

Rain(in.) = 0.57
Waterbody: Grand River

Submission ID. HPA-KCKK-JRDGN
Permit MI0023400
Outfall **8**

Dilute Raw Sewage (MG)
0.54200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
7/24/2021	7:30:00 PM	7/24/2021	8:30:00 PM

Rain(in.) = 0.57
Waterbody: Grand River

Submission ID. HPA-KCKK-JRDGN
Permit MI0023400
Outfall **14**

Dilute Raw Sewage (MG)
0.20200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/1/2021	2:00:00 AM	8/1/2021	4:30:00 AM

Rain(in.) = 0.15
Waterbody: Grand River

Submission ID. HPA-NQ7F-VEYZJ
Permit MI0023400
Outfall **11**

Dilute Raw Sewage (MG)
0.01100

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/1/2021	2:00:00 AM	8/1/2021	5:15:00 AM

Rain(in.) = 0.15
Waterbody: Grand River

Submission ID. HPA-NQ7F-VEYZJ
Permit MI0023400
Outfall **16**

Dilute Raw Sewage (MG)
0.04100

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/1/2021	2:00:00 AM	8/1/2021	5:00:00 AM

Rain(in.) = 0.15
Waterbody: Grand River

Submission ID. HPA-NQ7F-VEYZJ
Permit MI0023400
Outfall **24**

Dilute Raw Sewage (MG)
0.11200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/1/2021	2:00:00 AM	8/1/2021	5:00:00 AM

Rain(in.) = 0.15
Waterbody: Red Cedar River

Submission ID. HPA-NQ7F-VEYZJ
Permit MI0023400
Outfall **26**

Dilute Raw Sewage (MG)
0.02800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/1/2021	2:00:00 AM	8/1/2021	6:45:00 AM

Rain(in.) = 0.15
Waterbody: Red Cedar River

Submission ID. HPA-NQ7F-VEYZJ
Permit MI0023400
Outfall **32**

Dilute Raw Sewage (MG)
0.00500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/1/2021	2:00:00 AM	8/1/2021	4:00:00 AM

Rain(in.) = 0.15
Waterbody: Grand River

Submission ID. HPA-NQ7F-VEYZJ
Permit MI0023400
Outfall **46**

Dilute Raw Sewage (MG)
0.01600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/1/2021	2:00:00 AM	8/1/2021	5:00:00 AM

Rain(in.) = 0.15
Waterbody: Grand River

Submission ID. HPA-NQ7F-VEYZJ
Permit MI0023400
Outfall 9

Dilute Raw Sewage (MG)
0.05600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/1/2021	2:15:00 AM	8/1/2021	6:15:00 AM

Rain(in.) = 0.15
Waterbody: Grand River

Submission ID. HPA-NQ7F-VEYZJ
Permit MI0023400
Outfall 15

Dilute Raw Sewage (MG)
0.11500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/1/2021	2:15:00 AM	8/1/2021	5:30:00 AM

Rain(in.) = 0.15
Waterbody: Grand River

Submission ID. HPA-NQ7F-VEYZJ
Permit MI0023400
Outfall 17

Dilute Raw Sewage (MG)
0.04400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/1/2021	2:15:00 AM	8/1/2021	5:00:00 AM

Rain(in.) = 0.15
Waterbody: Grand River

Submission ID. HPA-NQ7F-VEYZJ
Permit MI0023400
Outfall **21**

Dilute Raw Sewage (MG)
0.02500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/1/2021	2:15:00 AM	8/1/2021	6:45:00 AM

Rain(in.) = 0.15
Waterbody: Grand River

Submission ID. HPA-NQ7F-VEYZJ
Permit MI0023400
Outfall **22**

Dilute Raw Sewage (MG)
0.21900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/1/2021	2:15:00 AM	8/1/2021	6:00:00 AM

Rain(in.) = 0.15
Waterbody: Grand River

Submission ID. HPA-NQ7F-VEYZJ
Permit MI0023400
Outfall **34**

Dilute Raw Sewage (MG)
0.28500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/1/2021	2:30:00 AM	8/1/2021	5:45:00 AM

Rain(in.) = 0.15
Waterbody: Grand River

Submission ID. HPA-NQ7F-VEYZJ
Permit MI0023400
Outfall **12**

Dilute Raw Sewage (MG)
0.07000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/1/2021	2:30:00 AM	8/1/2021	4:15:00 AM

Rain(in.) = 0.15
Waterbody: Grand River

Submission ID. HPA-NQ7F-VEYZJ
Permit MI0023400
Outfall **19**

Dilute Raw Sewage (MG)
0.04800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/10/2021	2:00:00 AM	8/10/2021	5:45:00 AM

Rain(in.) = 0.38
Waterbody: Grand River

Submission ID. HPA-W1V5-RK094
Permit MI0023400
Outfall **16**

Dilute Raw Sewage (MG)
0.13900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/10/2021	2:00:00 AM	8/10/2021	6:00:00 AM

Rain(in.) = 0.38
Waterbody: Grand River

Submission ID. HPA-W1V5-RK094
Permit MI0023400
Outfall **24**

Dilute Raw Sewage (MG)
0.38500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/10/2021	2:00:00 AM	8/10/2021	5:15:00 AM

Rain(in.) = 0.38
Waterbody: Red Cedar River

Submission ID. HPA-W1V5-RK094
Permit MI0023400
Outfall **26**

Dilute Raw Sewage (MG)
0.09500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/10/2021	2:00:00 AM	8/10/2021	7:45:00 AM

Rain(in.) = 0.38
Waterbody: Red Cedar River

Submission ID. HPA-W1V5-RK094
Permit MI0023400
Outfall **32**

Dilute Raw Sewage (MG)
0.01600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/10/2021	2:00:00 AM	8/10/2021	5:00:00 AM

Rain(in.) = 0.38
Waterbody: Grand River

Submission ID. HPA-W1V5-RK094
Permit MI0023400
Outfall **46**

Dilute Raw Sewage (MG)
0.05600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/10/2021	2:15:00 AM	8/10/2021	4:45:00 AM

Rain(in.) = 0.38
Waterbody: Grand River

Submission ID. HPA-W1V5-RK094
Permit MI0023400
Outfall **11**

Dilute Raw Sewage (MG)
0.03600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/10/2021	2:30:00 AM	8/10/2021	6:30:00 AM

Rain(in.) = 0.38
Waterbody: Grand River

Submission ID. HPA-W1V5-RK094
Permit MI0023400
Outfall **15**

Dilute Raw Sewage (MG)
0.35000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/10/2021	2:30:00 AM	8/10/2021	5:15:00 AM

Rain(in.) = 0.38
Waterbody: Grand River

Submission ID. HPA-W1V5-RK094
Permit MI0023400
Outfall 9

Dilute Raw Sewage (MG)
0.19500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/10/2021	3:00:00 AM	8/10/2021	6:15:00 AM

Rain(in.) = 0.38
Waterbody: Grand River

Submission ID. HPA-W1V5-RK094
Permit MI0023400
Outfall 12

Dilute Raw Sewage (MG)
0.24000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/10/2021	3:00:00 AM	8/10/2021	5:45:00 AM

Rain(in.) = 0.38
Waterbody: Grand River

Submission ID. HPA-W1V5-RK094
Permit MI0023400
Outfall 17

Dilute Raw Sewage (MG)
0.14900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/10/2021	3:00:00 AM	8/10/2021	4:45:00 AM

Rain(in.) = 0.38
Waterbody: Grand River

Submission ID. HPA-W1V5-RK094
Permit MI0023400
Outfall **19**

Dilute Raw Sewage (MG)
0.22500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/10/2021	3:00:00 AM	8/10/2021	5:15:00 AM

Rain(in.) = 0.38
Waterbody: Grand River

Submission ID. HPA-W1V5-RK094
Permit MI0023400
Outfall **21**

Dilute Raw Sewage (MG)
0.08600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/10/2021	3:00:00 AM	8/10/2021	7:45:00 AM

Rain(in.) = 0.38
Waterbody: Grand River

Submission ID. HPA-W1V5-RK094
Permit MI0023400
Outfall **22**

Dilute Raw Sewage (MG)
0.81500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/10/2021	3:00:00 AM	8/10/2021	6:30:00 AM

Rain(in.) = 0.38
Waterbody: Grand River

Submission ID. HPA-W1V5-RK094
Permit MI0023400
Outfall **34**

Dilute Raw Sewage (MG)
1.00900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/10/2021	3:15:00 AM	8/10/2021	4:15:00 AM

Rain(in.) = 0.38
Waterbody: Grand River

Submission ID. HPA-W1V5-RK094
Permit MI0023400
Outfall **8**

Dilute Raw Sewage (MG)
0.23700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/10/2021	3:30:00 AM	8/10/2021	4:30:00 AM

Rain(in.) = 0.38
Waterbody: Grand River

Submission ID. HPA-W1V5-RK094
Permit MI0023400
Outfall **14**

Dilute Raw Sewage (MG)
0.04000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/11/2021	2:00:00 PM	8/12/2021	9:15:00 AM

Rain(in.) = 3.72
Waterbody: Red Cedar River

Submission ID. HPA-XSB3-Q3GNJ
Permit MI0023400
Outfall **32**

Dilute Raw Sewage (MG)
7.27100

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/11/2021	2:00:00 PM	8/12/2021	6:00:00 AM

Rain(in.) = 3.72
Waterbody: Grand River

Submission ID. HPA-XSB3-Q3GNJ
Permit MI0023400
Outfall **46**

Dilute Raw Sewage (MG)
1.17400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/11/2021	2:15:00 PM	8/12/2021	6:45:00 AM

Rain(in.) = 3.72
Waterbody: Grand River

Submission ID. HPA-XSB3-Q3GNJ
Permit MI0023400
Outfall **16**

Dilute Raw Sewage (MG)
3.04400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/11/2021	2:30:00 PM	8/12/2021	6:15:00 AM

Rain(in.) = 3.72
Waterbody: Red Cedar River

Submission ID. HPA-XSB3-Q3GNJ
Permit MI0023400
Outfall **26**

Dilute Raw Sewage (MG)
3.15600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/11/2021	10:00:00 PM	8/12/2021	5:45:00 AM

Rain(in.) = 3.72
Waterbody: Grand River

Submission ID. HPA-XSB3-Q3GNJ
Permit MI0023400
Outfall **11**

Dilute Raw Sewage (MG)
0.99400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/11/2021	10:00:00 PM	8/12/2021	7:00:00 AM

Rain(in.) = 3.72
Waterbody: Grand River

Submission ID. HPA-XSB3-Q3GNJ
Permit MI0023400
Outfall **24**

Dilute Raw Sewage (MG)
8.52700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/11/2021	10:00:00 PM	8/12/2021	8:00:00 AM

Rain(in.) = 3.72
Waterbody: Grand River

Submission ID. HPA-XSB3-Q3GNJ
Permit MI0023400
Outfall 9

Dilute Raw Sewage (MG)
7.77900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/11/2021	10:15:00 PM	8/12/2021	7:15:00 AM

Rain(in.) = 3.72
Waterbody: Grand River

Submission ID. HPA-XSB3-Q3GNJ
Permit MI0023400
Outfall 12

Dilute Raw Sewage (MG)
6.19300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/11/2021	10:15:00 PM	8/12/2021	12:45:00 PM

Rain(in.) = 3.72
Waterbody: Grand River

Submission ID. HPA-XSB3-Q3GNJ
Permit MI0023400
Outfall 15

Dilute Raw Sewage (MG)
5.51300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/11/2021	10:15:00 PM	8/12/2021	11:00:00 AM

Rain(in.) = 3.72
Waterbody: Grand River

Submission ID. HPA-XSB3-Q3GNJ
Permit MI0023400
Outfall **17**

Dilute Raw Sewage (MG)
5.28100

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/11/2021	10:15:00 PM	8/12/2021	6:00:00 AM

Rain(in.) = 3.72
Waterbody: Grand River

Submission ID. HPA-XSB3-Q3GNJ
Permit MI0023400
Outfall **19**

Dilute Raw Sewage (MG)
4.08400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/11/2021	10:15:00 PM	8/12/2021	6:15:00 AM

Rain(in.) = 3.72
Waterbody: Grand River

Submission ID. HPA-XSB3-Q3GNJ
Permit MI0023400
Outfall **21**

Dilute Raw Sewage (MG)
3.41100

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/11/2021	10:15:00 PM	8/12/2021	9:15:00 AM

Rain(in.) = 3.72
Waterbody: Grand River

Submission ID. HPA-XSB3-Q3GNJ
Permit MI0023400
Outfall **22**

Dilute Raw Sewage (MG)
22.29000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/11/2021	10:15:00 PM	8/12/2021	7:30:00 AM

Rain(in.) = 3.72
Waterbody: Grand River

Submission ID. HPA-XSB3-Q3GNJ
Permit MI0023400
Outfall **34**

Dilute Raw Sewage (MG)
20.72000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/11/2021	10:45:00 PM	8/12/2021	5:15:00 AM

Rain(in.) = 3.72
Waterbody: Grand River

Submission ID. HPA-XSB3-Q3GNJ
Permit MI0023400
Outfall **8**

Dilute Raw Sewage (MG)
8.90100

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/12/2021	12:15:00 AM	8/12/2021	6:00:00 AM

Rain(in.) = 3.72
Waterbody: Grand River

Submission ID. HPA-XSB3-Q3GNJ
Permit MI0023400
Outfall **14**

Dilute Raw Sewage (MG)
8.00400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/12/2021	1:00:00 PM	8/12/2021	5:15:00 AM

Rain(in.) = 3.72
Waterbody: Grand River

Submission ID. HPA-XSB3-Q3GNJ
Permit MI0023400
Outfall **10**

Dilute Raw Sewage (MG)
1.17400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/24/2021	7:00:00 PM	8/24/2021	8:45:00 PM

Rain(in.) = 0.51
Waterbody: Grand River

Submission ID. HPB-7RF9-AG7K8
Permit MI0023400
Outfall **11**

Dilute Raw Sewage (MG)
0.05100

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/24/2021	7:00:00 PM	8/24/2021	10:15:00 PM

Rain(in.) = 0.51
Waterbody: Grand River

Submission ID. HPB-7RF9-AG7K8
Permit MI0023400
Outfall **12**

Dilute Raw Sewage (MG)
0.34000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/24/2021	7:00:00 PM	8/24/2021	10:30:00 PM

Rain(in.) = 0.51
Waterbody: Grand River

Submission ID. HPB-7RF9-AG7K8
Permit MI0023400
Outfall **15**

Dilute Raw Sewage (MG)
0.39700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/24/2021	7:00:00 PM	8/24/2021	9:45:00 PM

Rain(in.) = 0.51
Waterbody: Grand River

Submission ID. HPB-7RF9-AG7K8
Permit MI0023400
Outfall **16**

Dilute Raw Sewage (MG)
0.19700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/24/2021	7:00:00 PM	8/24/2021	9:45:00 PM

Rain(in.) = 0.51
Waterbody: Grand River

Submission ID. HPB-7RF9-AG7K8
Permit MI0023400
Outfall **17**

Dilute Raw Sewage (MG)
0.21100

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/24/2021	7:00:00 PM	8/24/2021	9:00:00 PM

Rain(in.) = 0.51
Waterbody: Grand River

Submission ID. HPB-7RF9-AG7K8
Permit MI0023400
Outfall **19**

Dilute Raw Sewage (MG)
0.32900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/24/2021	7:00:00 PM	8/24/2021	9:15:00 PM

Rain(in.) = 0.51
Waterbody: Grand River

Submission ID. HPB-7RF9-AG7K8
Permit MI0023400
Outfall **21**

Dilute Raw Sewage (MG)
0.12200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/24/2021	7:00:00 PM	8/25/2021	12:00:00 AM

Rain(in.) = 0.51
Waterbody: Grand River

Submission ID. HPB-7RF9-AG7K8
Permit MI0023400
Outfall **22**

Dilute Raw Sewage (MG)
1.16600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/24/2021	7:00:00 PM	8/24/2021	10:00:00 PM

Rain(in.) = 0.51
Waterbody: Grand River

Submission ID. HPB-7RF9-AG7K8
Permit MI0023400
Outfall **24**

Dilute Raw Sewage (MG)
0.64300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/24/2021	7:00:00 PM	8/24/2021	9:15:00 PM

Rain(in.) = 0.51
Waterbody: Red Cedar River

Submission ID. HPB-7RF9-AG7K8
Permit MI0023400
Outfall **26**

Dilute Raw Sewage (MG)
0.13400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/24/2021	7:00:00 PM	8/25/2021	12:00:00 AM

Rain(in.) = 0.51
Waterbody: Red Cedar River

Submission ID. HPB-7RF9-AG7K8
Permit MI0023400
Outfall **32**

Dilute Raw Sewage (MG)
0.02200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/24/2021	7:00:00 PM	8/24/2021	10:30:00 PM

Rain(in.) = 0.51
Waterbody: Grand River

Submission ID. HPB-7RF9-AG7K8
Permit MI0023400
Outfall **34**

Dilute Raw Sewage (MG)
1.42800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/24/2021	7:00:00 PM	8/24/2021	9:00:00 PM

Rain(in.) = 0.51
Waterbody: Grand River

Submission ID. HPB-7RF9-AG7K8
Permit MI0023400
Outfall **46**

Dilute Raw Sewage (MG)
0.09900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/24/2021	7:00:00 PM	8/24/2021	9:15:00 PM

Rain(in.) = 0.51
Waterbody: Grand River

Submission ID. HPB-7RF9-AG7K8
Permit MI0023400
Outfall 9

Dilute Raw Sewage (MG)
0.27300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/24/2021	7:15:00 PM	8/24/2021	8:15:00 PM

Rain(in.) = 0.51
Waterbody: Grand River

Submission ID. HPB-7RF9-AG7K8
Permit MI0023400
Outfall 10

Dilute Raw Sewage (MG)
0.00200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/24/2021	7:15:00 PM	8/24/2021	8:15:00 PM

Rain(in.) = 0.51
Waterbody: Grand River

Submission ID. HPB-7RF9-AG7K8
Permit MI0023400
Outfall 8

Dilute Raw Sewage (MG)
0.45100

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/24/2021	7:30:00 PM	8/24/2021	8:30:00 PM

Rain(in.) = 0.51
Waterbody: Grand River

Submission ID. HPB-7RF9-AG7K8
Permit MI0023400
Outfall **14**

Dilute Raw Sewage (MG)
0.15200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/29/2021	5:00:00 PM	8/29/2021	6:45:00 PM

Rain(in.) = 0.24
Waterbody: Grand River

Submission ID. HPB-BQRX-ZP39J
Permit MI0023400
Outfall **11**

Dilute Raw Sewage (MG)
0.02100

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/29/2021	5:00:00 PM	8/29/2021	8:30:00 PM

Rain(in.) = 0.24
Waterbody: Grand River

Submission ID. HPB-BQRX-ZP39J
Permit MI0023400
Outfall **15**

Dilute Raw Sewage (MG)
0.23000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/29/2021	5:00:00 PM	8/29/2021	7:45:00 PM

Rain(in.) = 0.24
Waterbody: Grand River

Submission ID. HPB-BQRX-ZP39J
Permit MI0023400
Outfall **16**

Dilute Raw Sewage (MG)
0.08100

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/29/2021	5:00:00 PM	8/29/2021	7:45:00 PM

Rain(in.) = 0.24
Waterbody: Grand River

Submission ID. HPB-BQRX-ZP39J
Permit MI0023400
Outfall **17**

Dilute Raw Sewage (MG)
0.08700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/29/2021	5:00:00 PM	8/29/2021	8:00:00 PM

Rain(in.) = 0.24
Waterbody: Grand River

Submission ID. HPB-BQRX-ZP39J
Permit MI0023400
Outfall **24**

Dilute Raw Sewage (MG)
0.22200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/29/2021	5:00:00 PM	8/29/2021	7:15:00 PM

Rain(in.) = 0.24
Waterbody: Red Cedar River

Submission ID. HPB-BQRX-ZP39J
Permit MI0023400
Outfall **26**

Dilute Raw Sewage (MG)
0.05500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/29/2021	5:00:00 PM	8/29/2021	9:45:00 PM

Rain(in.) = 0.24
Waterbody: Red Cedar River

Submission ID. HPB-BQRX-ZP39J
Permit MI0023400
Outfall **32**

Dilute Raw Sewage (MG)
0.01000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/29/2021	5:00:00 PM	8/29/2021	7:00:00 PM

Rain(in.) = 0.24
Waterbody: Grand River

Submission ID. HPB-BQRX-ZP39J
Permit MI0023400
Outfall **46**

Dilute Raw Sewage (MG)
0.03200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/29/2021	5:00:00 PM	8/29/2021	7:15:00 PM

Rain(in.) = 0.24
Waterbody: Grand River

Submission ID. HPB-BQRX-ZP39J
Permit MI0023400
Outfall 9

Dilute Raw Sewage (MG)
0.11400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/29/2021	5:15:00 PM	8/29/2021	8:15:00 PM

Rain(in.) = 0.24
Waterbody: Grand River

Submission ID. HPB-BQRX-ZP39J
Permit MI0023400
Outfall 12

Dilute Raw Sewage (MG)
0.14000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/29/2021	5:15:00 PM	8/29/2021	6:45:00 PM

Rain(in.) = 0.24
Waterbody: Grand River

Submission ID. HPB-BQRX-ZP39J
Permit MI0023400
Outfall 19

Dilute Raw Sewage (MG)
0.12400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/29/2021	5:15:00 PM	8/29/2021	7:15:00 PM

Rain(in.) = 0.24
Waterbody: Grand River

Submission ID. HPB-BQRX-ZP39J
Permit MI0023400
Outfall **21**

Dilute Raw Sewage (MG)
0.05000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/29/2021	5:15:00 PM	8/29/2021	9:45:00 PM

Rain(in.) = 0.24
Waterbody: Grand River

Submission ID. HPB-BQRX-ZP39J
Permit MI0023400
Outfall **22**

Dilute Raw Sewage (MG)
0.46500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/29/2021	5:15:00 PM	8/29/2021	8:30:00 PM

Rain(in.) = 0.24
Waterbody: Grand River

Submission ID. HPB-BQRX-ZP39J
Permit MI0023400
Outfall **34**

Dilute Raw Sewage (MG)
0.58300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/29/2021	5:30:00 PM	8/29/2021	6:15:00 PM

Rain(in.) = 0.24
Waterbody: Grand River

Submission ID. HPB-BQRX-ZP39J
Permit MI0023400
Outfall 8

Dilute Raw Sewage (MG)
0.07500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/7/2021	5:00:00 PM	9/7/2021	11:30:00 PM

Rain(in.) = 0.19
Waterbody: Red Cedar River

Submission ID. HPB-JRJF-E05XA
Permit MI0023400
Outfall 32

Dilute Raw Sewage (MG)
0.00700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/7/2021	5:00:00 PM	9/7/2021	9:00:00 PM

Rain(in.) = 0.19
Waterbody: Grand River

Submission ID. HPB-JRJF-E05XA
Permit MI0023400
Outfall 46

Dilute Raw Sewage (MG)
0.02200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/7/2021	5:15:00 PM	9/7/2021	10:15:00 PM

Rain(in.) = 0.19
Waterbody: Grand River

Submission ID. HPB-JRJF-E05XA
Permit MI0023400
Outfall **16**

Dilute Raw Sewage (MG)
0.05500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/7/2021	5:30:00 PM	9/7/2021	10:00:00 PM

Rain(in.) = 0.19
Waterbody: Red Cedar River

Submission ID. HPB-JRJF-E05XA
Permit MI0023400
Outfall **26**

Dilute Raw Sewage (MG)
0.03700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/7/2021	6:00:00 PM	9/7/2021	9:30:00 PM

Rain(in.) = 0.19
Waterbody: Grand River

Submission ID. HPB-JRJF-E05XA
Permit MI0023400
Outfall **11**

Dilute Raw Sewage (MG)
0.01400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/7/2021	6:00:00 PM	9/7/2021	10:00:00 PM

Rain(in.) = 0.19
Waterbody: Grand River

Submission ID. HPB-JRJF-E05XA
Permit MI0023400
Outfall **24**

Dilute Raw Sewage (MG)
0.14900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/7/2021	6:00:00 PM	9/7/2021	10:00:00 PM

Rain(in.) = 0.19
Waterbody: Grand River

Submission ID. HPB-JRJF-E05XA
Permit MI0023400
Outfall **9**

Dilute Raw Sewage (MG)
0.07400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/7/2021	6:15:00 PM	9/7/2021	10:45:00 PM

Rain(in.) = 0.19
Waterbody: Grand River

Submission ID. HPB-JRJF-E05XA
Permit MI0023400
Outfall **12**

Dilute Raw Sewage (MG)
0.09200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/7/2021	6:15:00 PM	9/7/2021	11:15:00 PM

Rain(in.) = 0.19
Waterbody: Grand River

Submission ID. HPB-JRJF-E05XA
Permit MI0023400
Outfall **15**

Dilute Raw Sewage (MG)
0.15200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/7/2021	6:15:00 PM	9/7/2021	10:15:00 PM

Rain(in.) = 0.19
Waterbody: Grand River

Submission ID. HPB-JRJF-E05XA
Permit MI0023400
Outfall **17**

Dilute Raw Sewage (MG)
0.05800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/7/2021	6:15:00 PM	9/7/2021	9:15:00 PM

Rain(in.) = 0.19
Waterbody: Grand River

Submission ID. HPB-JRJF-E05XA
Permit MI0023400
Outfall **19**

Dilute Raw Sewage (MG)
0.06300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/7/2021	6:15:00 PM	9/7/2021	10:00:00 PM

Rain(in.) = 0.19
Waterbody: Grand River

Submission ID. HPB-JRJF-E05XA
Permit MI0023400
Outfall **21**

Dilute Raw Sewage (MG)
0.03300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/7/2021	6:15:00 PM	9/7/2021	11:30:00 PM

Rain(in.) = 0.19
Waterbody: Grand River

Submission ID. HPB-JRJF-E05XA
Permit MI0023400
Outfall **22**

Dilute Raw Sewage (MG)
0.29700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/7/2021	6:15:00 PM	9/7/2021	11:00:00 PM

Rain(in.) = 0.19
Waterbody: Grand River

Submission ID. HPB-JRJF-E05XA
Permit MI0023400
Outfall **34**

Dilute Raw Sewage (MG)
0.37800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/13/2021	7:00:00 AM	9/13/2021	2:45:00 PM

Rain(in.) = 0.89
Waterbody: Grand River

Submission ID. HPB-QFAX-3XMF6
Permit MI0023400
Outfall **11**

Dilute Raw Sewage (MG)
0.09600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/13/2021	7:00:00 AM	9/13/2021	3:45:00 PM

Rain(in.) = 0.89
Waterbody: Grand River

Submission ID. HPB-QFAX-3XMF6
Permit MI0023400
Outfall **16**

Dilute Raw Sewage (MG)
0.35500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/13/2021	7:00:00 AM	9/13/2021	4:00:00 PM

Rain(in.) = 0.89
Waterbody: Grand River

Submission ID. HPB-QFAX-3XMF6
Permit MI0023400
Outfall **24**

Dilute Raw Sewage (MG)
1.36800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/13/2021	7:00:00 AM	9/13/2021	3:15:00 PM

Rain(in.) = 0.89
Waterbody: Red Cedar River

Submission ID. HPB-QFAX-3XMF6
Permit MI0023400
Outfall **26**

Dilute Raw Sewage (MG)
0.26600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/13/2021	7:00:00 AM	9/13/2021	6:00:00 PM

Rain(in.) = 0.89
Waterbody: Red Cedar River

Submission ID. HPB-QFAX-3XMF6
Permit MI0023400
Outfall **32**

Dilute Raw Sewage (MG)
0.08600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/13/2021	7:00:00 AM	9/13/2021	3:00:00 PM

Rain(in.) = 0.89
Waterbody: Grand River

Submission ID. HPB-QFAX-3XMF6
Permit MI0023400
Outfall **46**

Dilute Raw Sewage (MG)
0.20700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/13/2021	7:00:00 AM	9/13/2021	3:30:00 PM

Rain(in.) = 0.89
Waterbody: Grand River

Submission ID. HPB-QFAX-3XMF6
Permit MI0023400
Outfall 9

Dilute Raw Sewage (MG)
0.61700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/13/2021	7:15:00 AM	9/13/2021	4:30:00 PM

Rain(in.) = 0.89
Waterbody: Grand River

Submission ID. HPB-QFAX-3XMF6
Permit MI0023400
Outfall 15

Dilute Raw Sewage (MG)
0.59000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/13/2021	7:15:00 AM	9/13/2021	3:15:00 PM

Rain(in.) = 0.89
Waterbody: Grand River

Submission ID. HPB-QFAX-3XMF6
Permit MI0023400
Outfall 21

Dilute Raw Sewage (MG)
0.31800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/13/2021	7:30:00 AM	9/13/2021	3:45:00 PM

Rain(in.) = 0.89
Waterbody: Grand River

Submission ID. HPB-QFAX-3XMF6
Permit MI0023400
Outfall **17**

Dilute Raw Sewage (MG)
0.41700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/13/2021	7:30:00 AM	9/13/2021	6:00:00 PM

Rain(in.) = 0.89
Waterbody: Grand River

Submission ID. HPB-QFAX-3XMF6
Permit MI0023400
Outfall **22**

Dilute Raw Sewage (MG)
2.07200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/13/2021	7:30:00 AM	9/13/2021	4:30:00 PM

Rain(in.) = 0.89
Waterbody: Grand River

Submission ID. HPB-QFAX-3XMF6
Permit MI0023400
Outfall **34**

Dilute Raw Sewage (MG)
2.52000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/13/2021	7:45:00 AM	9/13/2021	4:15:00 PM

Rain(in.) = 0.89
Waterbody: Grand River

Submission ID. HPB-QFAX-3XMF6
Permit MI0023400
Outfall **12**

Dilute Raw Sewage (MG)
0.62700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/13/2021	7:45:00 AM	9/13/2021	3:00:00 PM

Rain(in.) = 0.89
Waterbody: Grand River

Submission ID. HPB-QFAX-3XMF6
Permit MI0023400
Outfall **19**

Dilute Raw Sewage (MG)
0.57300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/13/2021	1:00:00 PM	9/13/2021	2:15:00 PM

Rain(in.) = 0.89
Waterbody: Grand River

Submission ID. HPB-QFAX-3XMF6
Permit MI0023400
Outfall **10**

Dilute Raw Sewage (MG)
0.04200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/13/2021	1:00:00 PM	9/13/2021	2:15:00 PM

Rain(in.) = 0.89
Waterbody: Grand River

Submission ID. HPB-QFAX-3XMF6
Permit MI0023400
Outfall **8**

Dilute Raw Sewage (MG)
0.85200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/13/2021	1:15:00 PM	9/13/2021	2:45:00 PM

Rain(in.) = 0.89
Waterbody: Grand River

Submission ID. HPB-QFAX-3XMF6
Permit MI0023400
Outfall **14**

Dilute Raw Sewage (MG)
0.37100

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/21/2021	11:00:00 AM	9/23/2021	9:45:00 PM

Rain(in.) = 2.01
Waterbody: Grand River

Submission ID. HPB-ZCFP-8AH6Z
Permit MI0023400
Outfall **16**

Dilute Raw Sewage (MG)
0.73400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/21/2021	11:00:00 AM	9/22/2021	5:00:00 PM

Rain(in.) = 2.01
Waterbody: Grand River

Submission ID. HPB-ZCFP-8AH6Z
Permit MI0023400
Outfall **24**

Dilute Raw Sewage (MG)
0.88200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/21/2021	11:00:00 AM	9/23/2021	9:30:00 PM

Rain(in.) = 2.01
Waterbody: Red Cedar River

Submission ID. HPB-ZCFP-8AH6Z
Permit MI0023400
Outfall **26**

Dilute Raw Sewage (MG)
0.49600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/21/2021	11:00:00 AM	9/23/2021	10:45:00 PM

Rain(in.) = 2.01
Waterbody: Red Cedar River

Submission ID. HPB-ZCFP-8AH6Z
Permit MI0023400
Outfall **32**

Dilute Raw Sewage (MG)
0.93500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/21/2021	11:00:00 AM	9/22/2021	5:00:00 PM

Rain(in.) = 2.01
Waterbody: Grand River

Submission ID. HPB-ZCFP-8AH6Z
Permit MI0023400
Outfall **46**

Dilute Raw Sewage (MG)
0.12700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/21/2021	11:15:00 AM	9/23/2021	9:15:00 PM

Rain(in.) = 2.01
Waterbody: Grand River

Submission ID. HPB-ZCFP-8AH6Z
Permit MI0023400
Outfall **11**

Dilute Raw Sewage (MG)
0.19000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/21/2021	12:00:00 PM	9/23/2021	10:45:00 PM

Rain(in.) = 2.01
Waterbody: Grand River

Submission ID. HPB-ZCFP-8AH6Z
Permit MI0023400
Outfall **15**

Dilute Raw Sewage (MG)
1.98200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/21/2021	7:00:00 PM	9/23/2021	9:45:00 PM

Rain(in.) = 2.01
Waterbody: Grand River

Submission ID. HPB-ZCFP-8AH6Z
Permit MI0023400
Outfall 9

Dilute Raw Sewage (MG)
0.97200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/21/2021	7:15:00 PM	9/23/2021	10:30:00 PM

Rain(in.) = 2.01
Waterbody: Grand River

Submission ID. HPB-ZCFP-8AH6Z
Permit MI0023400
Outfall 12

Dilute Raw Sewage (MG)
1.23400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/21/2021	7:15:00 PM	9/23/2021	10:00:00 PM

Rain(in.) = 2.01
Waterbody: Grand River

Submission ID. HPB-ZCFP-8AH6Z
Permit MI0023400
Outfall 17

Dilute Raw Sewage (MG)
0.77700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/21/2021	7:15:00 PM	9/23/2021	6:15:00 PM

Rain(in.) = 2.01
Waterbody: Grand River

Submission ID. HPB-ZCFP-8AH6Z
Permit MI0023400
Outfall **19**

Dilute Raw Sewage (MG)
0.88200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/21/2021	7:15:00 PM	9/23/2021	9:45:00 PM

Rain(in.) = 2.01
Waterbody: Grand River

Submission ID. HPB-ZCFP-8AH6Z
Permit MI0023400
Outfall **21**

Dilute Raw Sewage (MG)
0.43900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/21/2021	7:15:00 PM	9/23/2021	10:45:00 PM

Rain(in.) = 2.01
Waterbody: Grand River

Submission ID. HPB-ZCFP-8AH6Z
Permit MI0023400
Outfall **22**

Dilute Raw Sewage (MG)
4.18900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/21/2021	7:15:00 PM	9/23/2021	10:30:00 PM

Rain(in.) = 2.01
Waterbody: Grand River

Submission ID. HPB-ZCFP-8AH6Z
Permit MI0023400
Outfall **34**

Dilute Raw Sewage (MG)
5.16100

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
9/23/2021	1:15:00 AM	9/23/2021	3:15:00 AM

Rain(in.) = 2.01
Waterbody: Grand River

Submission ID. HPB-ZCFP-8AH6Z
Permit MI0023400
Outfall **8**

Dilute Raw Sewage (MG)
0.16300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/3/2021	4:00:00 AM	10/4/2021	6:30:00 PM

Rain(in.) = 0.69
Waterbody: Red Cedar River

Submission ID. HPC-78J8-9HCEB
Permit MI0023400
Outfall **32**

Dilute Raw Sewage (MG)
0.02500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/3/2021	4:00:00 AM	10/4/2021	10:00:00 AM

Rain(in.) = 0.69
Waterbody: Grand River

Submission ID. HPC-78J8-9HCEB
Permit MI0023400
Outfall **46**

Dilute Raw Sewage (MG)
0.07300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/3/2021	4:15:00 AM	10/4/2021	5:15:00 PM

Rain(in.) = 0.69
Waterbody: Grand River

Submission ID. HPC-78J8-9HCEB
Permit MI0023400
Outfall **16**

Dilute Raw Sewage (MG)
0.22100

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/3/2021	4:30:00 AM	10/4/2021	5:00:00 PM

Rain(in.) = 0.69
Waterbody: Red Cedar River

Submission ID. HPC-78J8-9HCEB
Permit MI0023400
Outfall **26**

Dilute Raw Sewage (MG)
0.15000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/3/2021	1:00:00 PM	10/4/2021	10:00:00 AM

Rain(in.) = 0.69
Waterbody: Grand River

Submission ID. HPC-78J8-9HCEB
Permit MI0023400
Outfall **24**

Dilute Raw Sewage (MG)
0.47500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/3/2021	1:15:00 PM	10/4/2021	4:30:00 PM

Rain(in.) = 0.69
Waterbody: Grand River

Submission ID. HPC-78J8-9HCEB
Permit MI0023400
Outfall **11**

Dilute Raw Sewage (MG)
0.05700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/3/2021	1:45:00 PM	10/4/2021	6:15:00 PM

Rain(in.) = 0.69
Waterbody: Grand River

Submission ID. HPC-78J8-9HCEB
Permit MI0023400
Outfall **15**

Dilute Raw Sewage (MG)
0.60200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/3/2021	2:00:00 PM	10/4/2021	5:30:00 PM

Rain(in.) = 0.69
Waterbody: Grand River

Submission ID. HPC-78J8-9HCEB
Permit MI0023400
Outfall **17**

Dilute Raw Sewage (MG)
0.23400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/3/2021	2:00:00 PM	10/4/2021	5:15:00 PM

Rain(in.) = 0.69
Waterbody: Grand River

Submission ID. HPC-78J8-9HCEB
Permit MI0023400
Outfall **9**

Dilute Raw Sewage (MG)
0.29600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/3/2021	2:15:00 PM	10/4/2021	6:00:00 PM

Rain(in.) = 0.69
Waterbody: Grand River

Submission ID. HPC-78J8-9HCEB
Permit MI0023400
Outfall **12**

Dilute Raw Sewage (MG)
0.37100

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/3/2021	2:15:00 PM	10/4/2021	4:15:00 PM

Rain(in.) = 0.69
Waterbody: Grand River

Submission ID. HPC-78J8-9HCEB
Permit MI0023400
Outfall **19**

Dilute Raw Sewage (MG)
0.26800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/3/2021	2:15:00 PM	10/4/2021	5:00:00 PM

Rain(in.) = 0.69
Waterbody: Grand River

Submission ID. HPC-78J8-9HCEB
Permit MI0023400
Outfall **21**

Dilute Raw Sewage (MG)
0.13300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/3/2021	2:15:00 PM	10/4/2021	6:30:00 PM

Rain(in.) = 0.69
Waterbody: Grand River

Submission ID. HPC-78J8-9HCEB
Permit MI0023400
Outfall **22**

Dilute Raw Sewage (MG)
1.21100

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/3/2021	2:15:00 PM	10/4/2021	6:00:00 PM

Rain(in.) = 0.69
Waterbody: Grand River

Submission ID. HPC-78J8-9HCEB
Permit MI0023400
Outfall **34**

Dilute Raw Sewage (MG)
1.52600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/4/2021	9:15:00 AM	10/4/2021	10:15:00 AM

Rain(in.) = 0.69
Waterbody: Grand River

Submission ID. HPC-78J8-9HCEB
Permit MI0023400
Outfall **8**

Dilute Raw Sewage (MG)
0.03200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/8/2021	8:00:00 AM	10/9/2021	1:15:00 AM

Rain(in.) = 1.01
Waterbody: Red Cedar River

Submission ID. HPC-CQJE-86ZPE
Permit MI0023400
Outfall **32**

Dilute Raw Sewage (MG)
0.16400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/8/2021	8:00:00 AM	10/8/2021	11:00:00 PM

Rain(in.) = 1.01
Waterbody: Grand River

Submission ID. HPC-CQJE-86ZPE
Permit MI0023400
Outfall **46**

Dilute Raw Sewage (MG)
0.20400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/8/2021	8:15:00 AM	10/8/2021	11:30:00 PM

Rain(in.) = 1.01
Waterbody: Grand River

Submission ID. HPC-CQJE-86ZPE
Permit MI0023400
Outfall **16**

Dilute Raw Sewage (MG)
0.38600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/8/2021	8:30:00 AM	10/8/2021	11:15:00 PM

Rain(in.) = 1.01
Waterbody: Red Cedar River

Submission ID. HPC-CQJE-86ZPE
Permit MI0023400
Outfall **26**

Dilute Raw Sewage (MG)
0.26400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/8/2021	9:00:00 AM	10/8/2021	10:45:00 PM

Rain(in.) = 1.01
Waterbody: Grand River

Submission ID. HPC-CQJE-86ZPE
Permit MI0023400
Outfall **11**

Dilute Raw Sewage (MG)
0.10000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/8/2021	9:00:00 AM	10/9/2021	12:30:00 AM

Rain(in.) = 1.01
Waterbody: Grand River

Submission ID. HPC-CQJE-86ZPE
Permit MI0023400
Outfall **15**

Dilute Raw Sewage (MG)
0.81500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/8/2021	9:00:00 AM	10/8/2021	11:45:00 PM

Rain(in.) = 1.01
Waterbody: Grand River

Submission ID. HPC-CQJE-86ZPE
Permit MI0023400
Outfall **17**

Dilute Raw Sewage (MG)
0.41400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/8/2021	9:00:00 AM	10/8/2021	11:00:00 PM

Rain(in.) = 1.01
Waterbody: Grand River

Submission ID. HPC-CQJE-86ZPE
Permit MI0023400
Outfall **21**

Dilute Raw Sewage (MG)
0.25000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/8/2021	9:00:00 AM	10/9/2021	1:15:00 AM

Rain(in.) = 1.01
Waterbody: Grand River

Submission ID. HPC-CQJE-86ZPE
Permit MI0023400
Outfall **22**

Dilute Raw Sewage (MG)
2.26600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/8/2021	9:00:00 AM	10/9/2021	12:00:00 AM

Rain(in.) = 1.01
Waterbody: Grand River

Submission ID. HPC-CQJE-86ZPE
Permit MI0023400
Outfall **24**

Dilute Raw Sewage (MG)
1.35300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/8/2021	9:00:00 AM	10/9/2021	12:15:00 AM

Rain(in.) = 1.01
Waterbody: Grand River

Submission ID. HPC-CQJE-86ZPE
Permit MI0023400
Outfall **34**

Dilute Raw Sewage (MG)
2.78200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/8/2021	9:00:00 AM	10/8/2021	11:15:00 PM

Rain(in.) = 1.01
Waterbody: Grand River

Submission ID. HPC-CQJE-86ZPE
Permit MI0023400
Outfall **9**

Dilute Raw Sewage (MG)
0.53000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/8/2021	9:15:00 AM	10/9/2021	12:00:00 AM

Rain(in.) = 1.01
Waterbody: Grand River

Submission ID. HPC-CQJE-86ZPE
Permit MI0023400
Outfall **12**

Dilute Raw Sewage (MG)
0.66000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/8/2021	9:15:00 AM	10/8/2021	10:45:00 PM

Rain(in.) = 1.01
Waterbody: Grand River

Submission ID. HPC-CQJE-86ZPE
Permit MI0023400
Outfall **19**

Dilute Raw Sewage (MG)
0.61100

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/8/2021	9:15:00 AM	10/8/2021	11:15:00 AM

Rain(in.) = 1.01
Waterbody: Grand River

Submission ID. HPC-CQJE-86ZPE
Permit MI0023400
Outfall **8**

Dilute Raw Sewage (MG)
0.74200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/8/2021	9:45:00 AM	10/8/2021	11:30:00 AM

Rain(in.) = 1.01
Waterbody: Grand River

Submission ID. HPC-CQJE-86ZPE
Permit MI0023400
Outfall **14**

Dilute Raw Sewage (MG)
0.24700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/8/2021	10:15:00 AM	10/8/2021	11:15:00 AM

Rain(in.) = 1.01
Waterbody: Grand River

Submission ID. HPC-CQJE-86ZPE
Permit MI0023400
Outfall **10**

Dilute Raw Sewage (MG)
0.00200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/14/2021	3:00:00 PM	10/14/2021	4:45:00 PM

Rain(in.) = 0.3
Waterbody: Grand River

Submission ID. HPC-FVC4-1V0X4
Permit MI0023400
Outfall **11**

Dilute Raw Sewage (MG)
0.02800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/14/2021	3:00:00 PM	10/14/2021	5:45:00 PM

Rain(in.) = 0.3
Waterbody: Grand River

Submission ID. HPC-FVC4-1V0X4
Permit MI0023400
Outfall **16**

Dilute Raw Sewage (MG)
0.10600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/14/2021	3:00:00 PM	10/14/2021	5:45:00 PM

Rain(in.) = 0.3
Waterbody: Grand River

Submission ID. HPC-FVC4-1V0X4
Permit MI0023400
Outfall **17**

Dilute Raw Sewage (MG)
0.11500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/14/2021	3:00:00 PM	10/14/2021	7:45:00 PM

Rain(in.) = 0.3
Waterbody: Grand River

Submission ID. HPC-FVC4-1V0X4
Permit MI0023400
Outfall **21**

Dilute Raw Sewage (MG)
0.62000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/14/2021	3:00:00 PM	10/14/2021	5:15:00 PM

Rain(in.) = 0.3
Waterbody: Grand River

Submission ID. HPC-FVC4-1V0X4
Permit MI0023400
Outfall **21**

Dilute Raw Sewage (MG)
0.06600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/14/2021	3:00:00 PM	10/14/2021	6:00:00 PM

Rain(in.) = 0.3
Waterbody: Grand River

Submission ID. HPC-FVC4-1V0X4
Permit MI0023400
Outfall **24**

Dilute Raw Sewage (MG)
0.29300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/14/2021	3:00:00 PM	10/14/2021	5:15:00 PM

Rain(in.) = 0.3
Waterbody: Red Cedar River

Submission ID. HPC-FVC4-1V0X4
Permit MI0023400
Outfall **26**

Dilute Raw Sewage (MG)
0.07300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/14/2021	3:00:00 PM	10/14/2021	7:45:00 PM

Rain(in.) = 0.3
Waterbody: Red Cedar River

Submission ID. HPC-FVC4-1V0X4
Permit MI0023400
Outfall **32**

Dilute Raw Sewage (MG)
0.01200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/14/2021	3:00:00 PM	10/14/2021	6:30:00 PM

Rain(in.) = 0.3
Waterbody: Grand River

Submission ID. HPC-FVC4-1V0X4
Permit MI0023400
Outfall **34**

Dilute Raw Sewage (MG)
0.77000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/14/2021	3:00:00 PM	10/14/2021	5:00:00 PM

Rain(in.) = 0.3
Waterbody: Grand River

Submission ID. HPC-FVC4-1V0X4
Permit MI0023400
Outfall **46**

Dilute Raw Sewage (MG)
0.04200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/14/2021	3:00:00 PM	10/14/2021	5:15:00 PM

Rain(in.) = 0.3
Waterbody: Grand River

Submission ID. HPC-FVC4-1V0X4
Permit MI0023400
Outfall **9**

Dilute Raw Sewage (MG)
0.15000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/14/2021	3:15:00 PM	10/14/2021	6:15:00 PM

Rain(in.) = 0.3
Waterbody: Grand River

Submission ID. HPC-FVC4-1V0X4
Permit MI0023400
Outfall **12**

Dilute Raw Sewage (MG)
0.18500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/14/2021	3:15:00 PM	10/14/2021	6:30:00 PM

Rain(in.) = 0.3
Waterbody: Grand River

Submission ID. HPC-FVC4-1V0X4
Permit MI0023400
Outfall **15**

Dilute Raw Sewage (MG)
0.29000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/14/2021	3:15:00 PM	10/14/2021	4:45:00 PM

Rain(in.) = 0.3
Waterbody: Grand River

Submission ID. HPC-FVC4-1V0X4
Permit MI0023400
Outfall **19**

Dilute Raw Sewage (MG)
0.16900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/14/2021	3:30:00 PM	10/14/2021	4:15:00 PM

Rain(in.) = 0.3
Waterbody: Grand River

Submission ID. HPC-FVC4-1V0X4
Permit MI0023400
Outfall **8**

Dilute Raw Sewage (MG)
0.15100

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/14/2021	3:45:00 PM	10/14/2021	4:30:00 PM

Rain(in.) = 0.3
Waterbody: Grand River

Submission ID. HPC-FVC4-1V0X4
Permit MI0023400
Outfall **14**

Dilute Raw Sewage (MG)
0.01000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/15/2021	4:00:00 PM	10/16/2021	5:30:00 AM

Rain(in.) = 0.35
Waterbody: Grand River

Submission ID. HPC-J6JQ-A6HZN
Permit MI0023400
Outfall **11**

Dilute Raw Sewage (MG)
0.02700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/15/2021	4:00:00 PM	10/16/2021	6:15:00 AM

Rain(in.) = 0.35
Waterbody: Grand River

Submission ID. HPC-J6JQ-A6HZN
Permit MI0023400
Outfall **16**

Dilute Raw Sewage (MG)
0.10600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/15/2021	4:00:00 PM	10/16/2021	6:00:00 AM

Rain(in.) = 0.35
Waterbody: Grand River

Submission ID. HPC-J6JQ-A6HZN
Permit MI0023400
Outfall **24**

Dilute Raw Sewage (MG)
0.29100

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/15/2021	4:00:00 PM	10/16/2021	5:45:00 AM

Rain(in.) = 0.35
Waterbody: Red Cedar River

Submission ID. HPC-J6JQ-A6HZN
Permit MI0023400
Outfall **26**

Dilute Raw Sewage (MG)
0.07200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/15/2021	4:00:00 PM	10/16/2021	7:15:00 AM

Rain(in.) = 0.35
Waterbody: Red Cedar River

Submission ID. HPC-J6JQ-A6HZN
Permit MI0023400
Outfall **32**

Dilute Raw Sewage (MG)
0.01300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/15/2021	4:00:00 PM	10/16/2021	5:00:00 AM

Rain(in.) = 0.35
Waterbody: Grand River

Submission ID. HPC-J6JQ-A6HZN
Permit MI0023400
Outfall **46**

Dilute Raw Sewage (MG)
0.04200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/15/2021	4:15:00 PM	10/16/2021	6:00:00 AM

Rain(in.) = 0.35
Waterbody: Grand River

Submission ID. HPC-J6JQ-A6HZN
Permit MI0023400
Outfall **9**

Dilute Raw Sewage (MG)
0.13900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/15/2021	4:30:00 PM	10/16/2021	7:15:00 AM

Rain(in.) = 0.35
Waterbody: Grand River

Submission ID. HPC-J6JQ-A6HZN
Permit MI0023400
Outfall **15**

Dilute Raw Sewage (MG)
0.28700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/15/2021	4:30:00 PM	10/16/2021	5:45:00 AM

Rain(in.) = 0.35
Waterbody: Grand River

Submission ID. HPC-J6JQ-A6HZN
Permit MI0023400
Outfall **21**

Dilute Raw Sewage (MG)
0.06300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/15/2021	4:45:00 PM	10/16/2021	6:15:00 AM

Rain(in.) = 0.35
Waterbody: Grand River

Submission ID. HPC-J6JQ-A6HZN
Permit MI0023400
Outfall **17**

Dilute Raw Sewage (MG)
0.11200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/15/2021	5:00:00 PM	10/16/2021	6:45:00 AM

Rain(in.) = 0.35
Waterbody: Grand River

Submission ID. HPC-J6JQ-A6HZN
Permit MI0023400
Outfall **12**

Dilute Raw Sewage (MG)
0.17800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/15/2021	5:00:00 PM	10/16/2021	7:15:00 AM

Rain(in.) = 0.35
Waterbody: Grand River

Submission ID. HPC-J6JQ-A6HZN
Permit MI0023400
Outfall **22**

Dilute Raw Sewage (MG)
0.57100

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/15/2021	5:00:00 PM	10/16/2021	6:45:00 AM

Rain(in.) = 0.35
Waterbody: Grand River

Submission ID. HPC-J6JQ-A6HZN
Permit MI0023400
Outfall **34**

Dilute Raw Sewage (MG)
0.72800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/15/2021	5:30:00 PM	10/16/2021	5:00:00 AM

Rain(in.) = 0.35
Waterbody: Grand River

Submission ID. HPC-J6JQ-A6HZN
Permit MI0023400
Outfall **19**

Dilute Raw Sewage (MG)
0.11500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/21/2021	3:00:00 AM	10/21/2021	7:15:00 AM

Rain(in.) = 0.26
Waterbody: Grand River

Submission ID. HPC-NCCY-P85QC
Permit MI0023400
Outfall **16**

Dilute Raw Sewage (MG)
0.08600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/21/2021	3:00:00 AM	10/21/2021	7:00:00 AM

Rain(in.) = 0.26
Waterbody: Grand River

Submission ID. HPC-NCCY-P85QC
Permit MI0023400
Outfall **24**

Dilute Raw Sewage (MG)
0.23800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/21/2021	3:00:00 AM	10/21/2021	6:45:00 AM

Rain(in.) = 0.26
Waterbody: Red Cedar River

Submission ID. HPC-NCCY-P85QC
Permit MI0023400
Outfall **26**

Dilute Raw Sewage (MG)
0.05900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/21/2021	3:00:00 AM	10/21/2021	9:00:00 AM

Rain(in.) = 0.26
Waterbody: Red Cedar River

Submission ID. HPC-NCCY-P85QC
Permit MI0023400
Outfall **32**

Dilute Raw Sewage (MG)
0.01000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/21/2021	3:00:00 AM	10/21/2021	6:00:00 AM

Rain(in.) = 0.26
Waterbody: Grand River

Submission ID. HPC-NCCY-P85QC
Permit MI0023400
Outfall **46**

Dilute Raw Sewage (MG)
0.03400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/21/2021	3:00:00 AM	10/21/2021	6:00:00 AM

Rain(in.) = 0.26
Waterbody: Grand River

Submission ID. HPC-NCCY-P85QC
Permit MI0023400
Outfall **8**

Dilute Raw Sewage (MG)
0.06200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/21/2021	3:15:00 AM	10/21/2021	6:30:00 AM

Rain(in.) = 0.26
Waterbody: Grand River

Submission ID. HPC-NCCY-P85QC
Permit MI0023400
Outfall **11**

Dilute Raw Sewage (MG)
0.02200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/21/2021	4:00:00 AM	10/21/2021	8:15:00 AM

Rain(in.) = 0.26
Waterbody: Grand River

Submission ID. HPC-NCCY-P85QC
Permit MI0023400
Outfall **15**

Dilute Raw Sewage (MG)
0.24300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/21/2021	4:00:00 AM	10/21/2021	7:15:00 AM

Rain(in.) = 0.26
Waterbody: Grand River

Submission ID. HPC-NCCY-P85QC
Permit MI0023400
Outfall **17**

Dilute Raw Sewage (MG)
0.09200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/21/2021	4:00:00 AM	10/21/2021	6:45:00 AM

Rain(in.) = 0.26
Waterbody: Grand River

Submission ID. HPC-NCCY-P85QC
Permit MI0023400
Outfall **21**

Dilute Raw Sewage (MG)
0.05300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/21/2021	4:00:00 AM	10/21/2021	9:00:00 AM

Rain(in.) = 0.26
Waterbody: Grand River

Submission ID. HPC-NCCY-P85QC
Permit MI0023400
Outfall **22**

Dilute Raw Sewage (MG)
0.49700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/21/2021	4:00:00 AM	10/21/2021	8:00:00 AM

Rain(in.) = 0.26
Waterbody: Grand River

Submission ID. HPC-NCCY-P85QC
Permit MI0023400
Outfall **34**

Dilute Raw Sewage (MG)
0.62100

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/21/2021	4:00:00 AM	10/21/2021	7:00:00 AM

Rain(in.) = 0.26
Waterbody: Grand River

Submission ID. HPC-NCCY-P85QC
Permit MI0023400
Outfall **9**

Dilute Raw Sewage (MG)
0.12000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/21/2021	4:15:00 AM	10/21/2021	7:45:00 AM

Rain(in.) = 0.26
Waterbody: Grand River

Submission ID. HPC-NCCY-P85QC
Permit MI0023400
Outfall **12**

Dilute Raw Sewage (MG)
0.14900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/21/2021	4:15:00 AM	10/21/2021	6:15:00 AM

Rain(in.) = 0.26
Waterbody: Grand River

Submission ID. HPC-NCCY-P85QC
Permit MI0023400
Outfall **19**

Dilute Raw Sewage (MG)
0.12800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/24/2021	8:00:00 PM	10/25/2021	5:15:00 PM

Rain(in.) = 1.74
Waterbody: Grand River

Submission ID. HPC-QR7K-8V9S7
Permit MI0023400
Outfall **11**

Dilute Raw Sewage (MG)
0.17500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/24/2021	8:00:00 PM	10/25/2021	10:15:00 PM

Rain(in.) = 1.74
Waterbody: Grand River

Submission ID. HPC-QR7K-8V9S7
Permit MI0023400
Outfall **16**

Dilute Raw Sewage (MG)
0.68100

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/24/2021	8:00:00 PM	10/25/2021	6:00:00 PM

Rain(in.) = 1.74
Waterbody: Grand River

Submission ID. HPC-QR7K-8V9S7
Permit MI0023400
Outfall **24**

Dilute Raw Sewage (MG)
1.87700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/24/2021	8:00:00 PM	10/25/2021	10:00:00 PM

Rain(in.) = 1.74
Waterbody: Red Cedar River

Submission ID. HPC-QR7K-8V9S7
Permit MI0023400
Outfall **26**

Dilute Raw Sewage (MG)
0.46300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/24/2021	8:00:00 PM	10/25/2021	7:00:00 PM

Rain(in.) = 1.74
Waterbody: Red Cedar River

Submission ID. HPC-QR7K-8V9S7
Permit MI0023400
Outfall **32**

Dilute Raw Sewage (MG)
0.80700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/24/2021	8:00:00 PM	10/25/2021	10:00:00 PM

Rain(in.) = 1.74
Waterbody: Grand River

Submission ID. HPC-QR7K-8V9S7
Permit MI0023400
Outfall **46**

Dilute Raw Sewage (MG)
0.26800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/24/2021	8:15:00 PM	10/25/2021	5:45:00 PM

Rain(in.) = 1.74
Waterbody: Grand River

Submission ID. HPC-QR7K-8V9S7
Permit MI0023400
Outfall **9**

Dilute Raw Sewage (MG)
0.92700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/24/2021	8:30:00 PM	10/25/2021	6:45:00 PM

Rain(in.) = 1.74
Waterbody: Grand River

Submission ID. HPC-QR7K-8V9S7
Permit MI0023400
Outfall **15**

Dilute Raw Sewage (MG)
1.84700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/24/2021	8:30:00 PM	10/25/2021	5:45:00 PM

Rain(in.) = 1.74
Waterbody: Grand River

Submission ID. HPC-QR7K-8V9S7
Permit MI0023400
Outfall **21**

Dilute Raw Sewage (MG)
0.41500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/24/2021	8:45:00 PM	10/25/2021	6:00:00 PM

Rain(in.) = 1.74
Waterbody: Grand River

Submission ID. HPC-QR7K-8V9S7
Permit MI0023400
Outfall **17**

Dilute Raw Sewage (MG)
0.73000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/24/2021	9:00:00 PM	10/25/2021	6:30:00 PM

Rain(in.) = 1.74
Waterbody: Grand River

Submission ID. HPC-QR7K-8V9S7
Permit MI0023400
Outfall **12**

Dilute Raw Sewage (MG)
1.16600

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/24/2021	9:00:00 PM	10/25/2021	7:00:00 PM

Rain(in.) = 1.74
Waterbody: Grand River

Submission ID. HPC-QR7K-8V9S7
Permit MI0023400
Outfall **22**

Dilute Raw Sewage (MG)
4.03900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/24/2021	9:00:00 PM	10/25/2021	6:30:00 PM

Rain(in.) = 1.74
Waterbody: Grand River

Submission ID. HPC-QR7K-8V9S7
Permit MI0023400
Outfall **34**

Dilute Raw Sewage (MG)
4.93700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/24/2021	9:15:00 PM	10/25/2021	3:30:00 PM

Rain(in.) = 1.74
Waterbody: Grand River

Submission ID. HPC-QR7K-8V9S7
Permit MI0023400
Outfall **19**

Dilute Raw Sewage (MG)
0.99400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/24/2021	11:00:00 PM	10/25/2021	12:30:00 AM

Rain(in.) = 1.74
Waterbody: Grand River

Submission ID. HPC-QR7K-8V9S7
Permit MI0023400
Outfall **8**

Dilute Raw Sewage (MG)
0.19500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
10/24/2021	11:30:00 PM	10/25/2021	12:15:00 AM

Rain(in.) = 1.74
Waterbody: Grand River

Submission ID. HPC-QR7K-8V9S7
Permit MI0023400
Outfall **14**

Dilute Raw Sewage (MG)
0.00700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
11/17/2021	11:00:00 AM	11/17/2021	11:30:00 PM

Rain(in.) = 0.54
Waterbody: Red Cedar River

Submission ID. HPD-ANQG-8KQ55
Permit MI0023400
Outfall **32**

Dilute Raw Sewage (MG)
0.02200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
11/17/2021	11:00:00 AM	11/17/2021	9:00:00 PM

Rain(in.) = 0.54
Waterbody: Grand River

Submission ID. HPD-ANQG-8KQS5
Permit MI0023400
Outfall **46**

Dilute Raw Sewage (MG)
0.07800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
11/17/2021	11:15:00 AM	11/17/2021	9:30:00 PM

Rain(in.) = 0.54
Waterbody: Grand River

Submission ID. HPD-ANQG-8KQS5
Permit MI0023400
Outfall **16**

Dilute Raw Sewage (MG)
0.19800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
11/17/2021	11:30:00 AM	11/17/2021	9:15:00 PM

Rain(in.) = 0.54
Waterbody: Red Cedar River

Submission ID. HPD-ANQG-8KQS5
Permit MI0023400
Outfall **26**

Dilute Raw Sewage (MG)
0.13400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
11/17/2021	3:00:00 PM	11/17/2021	10:00:00 PM

Rain(in.) = 0.54
Waterbody: Grand River

Submission ID. HPD-ANQG-8KQS5
Permit MI0023400
Outfall **24**

Dilute Raw Sewage (MG)
0.54400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
11/17/2021	3:15:00 PM	11/17/2021	8:45:00 PM

Rain(in.) = 0.54
Waterbody: Grand River

Submission ID. HPD-ANQG-8KQS5
Permit MI0023400
Outfall **11**

Dilute Raw Sewage (MG)
0.05100

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
11/17/2021	3:45:00 PM	11/17/2021	10:30:00 PM

Rain(in.) = 0.54
Waterbody: Grand River

Submission ID. HPD-ANQG-8KQS5
Permit MI0023400
Outfall **15**

Dilute Raw Sewage (MG)
0.54400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
11/17/2021	4:15:00 PM	11/17/2021	9:30:00 PM

Rain(in.) = 0.54
Waterbody: Grand River

Submission ID. HPD-ANQG-8KQS5
Permit MI0023400
Outfall **17**

Dilute Raw Sewage (MG)
0.21200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
11/17/2021	4:15:00 PM	11/17/2021	9:00:00 PM

Rain(in.) = 0.54
Waterbody: Grand River

Submission ID. HPD-ANQG-8KQS5
Permit MI0023400
Outfall **21**

Dilute Raw Sewage (MG)
0.12100

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
11/17/2021	4:15:00 PM	11/17/2021	11:30:00 PM

Rain(in.) = 0.54
Waterbody: Grand River

Submission ID. HPD-ANQG-8KQS5
Permit MI0023400
Outfall **22**

Dilute Raw Sewage (MG)
1.15900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
11/17/2021	4:15:00 PM	11/17/2021	10:15:00 PM

Rain(in.) = 0.54
Waterbody: Grand River

Submission ID. HPD-ANQG-8KQS5
Permit MI0023400
Outfall **34**

Dilute Raw Sewage (MG)
1.42800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
11/17/2021	4:30:00 PM	11/17/2021	10:00:00 PM

Rain(in.) = 0.54
Waterbody: Grand River

Submission ID. HPD-ANQG-8KQS5
Permit MI0023400
Outfall **12**

Dilute Raw Sewage (MG)
0.34000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
11/17/2021	4:30:00 PM	11/17/2021	8:45:00 PM

Rain(in.) = 0.54
Waterbody: Grand River

Submission ID. HPD-ANQG-8KQS5
Permit MI0023400
Outfall **19**

Dilute Raw Sewage (MG)
0.30100

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
11/17/2021	6:00:00 PM	11/17/2021	7:15:00 PM

Rain(in.) = 0.54
Waterbody: Grand River

Submission ID. HPD-ANQG-8KQS5
Permit MI0023400
Outfall **8**

Dilute Raw Sewage (MG)
0.12000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
11/17/2021	6:00:00 PM	11/17/2021	9:15:00 PM

Rain(in.) = 0.54
Waterbody: Grand River

Submission ID. HPD-ANQG-8KQS5
Permit MI0023400
Outfall **9**

Dilute Raw Sewage (MG)
0.27300

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
12/10/2021	7:00:00 PM	12/11/2021	6:00:00 AM

Rain(in.) = 0.82
Waterbody: Red Cedar River

Submission ID. HPD-Y8WY-5HBAX
Permit MI0023400
Outfall **32**

Dilute Raw Sewage (MG)
0.03500

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
12/10/2021	7:00:00 PM	12/11/2021	8:00:00 AM

Rain(in.) = 0.82
Waterbody: Grand River

Submission ID. HPD-Y8WY-5HBAX
Permit MI0023400
Outfall **46**

Dilute Raw Sewage (MG)
0.14800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
12/10/2021	7:15:00 PM	12/11/2021	8:30:00 AM

Rain(in.) = 0.82
Waterbody: Grand River

Submission ID. HPD-Y8WY-5HBAX
Permit MI0023400
Outfall **16**

Dilute Raw Sewage (MG)
0.30800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
12/10/2021	7:30:00 PM	12/11/2021	8:15:00 AM

Rain(in.) = 0.82
Waterbody: Red Cedar River

Submission ID. HPD-Y8WY-5HBAX
Permit MI0023400
Outfall **26**

Dilute Raw Sewage (MG)
0.21000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
12/10/2021	8:00:00 PM	12/11/2021	3:15:00 AM

Rain(in.) = 0.82
Waterbody: Grand River

Submission ID. HPD-Y8WY-5HBAX
Permit MI0023400
Outfall **11**

Dilute Raw Sewage (MG)
0.08000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
12/10/2021	8:00:00 PM	12/11/2021	8:00:00 AM

Rain(in.) = 0.82
Waterbody: Grand River

Submission ID. HPD-Y8WY-5HBAX
Permit MI0023400
Outfall **24**

Dilute Raw Sewage (MG)
0.97900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
12/10/2021	8:00:00 PM	12/11/2021	3:45:00 AM

Rain(in.) = 0.82
Waterbody: Grand River

Submission ID. HPD-Y8WY-5HBAX
Permit MI0023400
Outfall **9**

Dilute Raw Sewage (MG)
0.42400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
12/10/2021	8:15:00 PM	12/11/2021	4:30:00 AM

Rain(in.) = 0.82
Waterbody: Grand River

Submission ID. HPD-Y8WY-5HBAX
Permit MI0023400
Outfall **12**

Dilute Raw Sewage (MG)
0.52800

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
12/10/2021	8:15:00 PM	12/11/2021	5:00:00 AM

Rain(in.) = 0.82
Waterbody: Grand River

Submission ID. HPD-Y8WY-5HBAX
Permit MI0023400
Outfall **15**

Dilute Raw Sewage (MG)
0.69200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
12/10/2021	8:15:00 PM	12/11/2021	8:30:00 AM

Rain(in.) = 0.82
Waterbody: Grand River

Submission ID. HPD-Y8WY-5HBAX
Permit MI0023400
Outfall **17**

Dilute Raw Sewage (MG)
0.33000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
12/10/2021	8:15:00 PM	12/11/2021	3:45:00 AM

Rain(in.) = 0.82
Waterbody: Grand River

Submission ID. HPD-Y8WY-5HBAX
Permit MI0023400
Outfall **21**

Dilute Raw Sewage (MG)
0.19400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
12/10/2021	8:15:00 PM	12/11/2021	6:00:00 AM

Rain(in.) = 0.82
Waterbody: Grand River

Submission ID. HPD-Y8WY-5HBAX
Permit MI0023400
Outfall **22**

Dilute Raw Sewage (MG)
1.81700

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
12/10/2021	8:15:00 PM	12/11/2021	4:45:00 AM

Rain(in.) = 0.82
Waterbody: Grand River

Submission ID. HPD-Y8WY-5HBAX
Permit MI0023400
Outfall **34**

Dilute Raw Sewage (MG)
2.22900

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Lansing WWTP

Start Day	Start Time	End Day	End Time
12/10/2021	8:30:00 PM	12/11/2021	3:00:00 AM

Rain(in.) = 0.82
Waterbody: Grand River

Submission ID. HPD-Y8WY-5HBAX
Permit MI0023400
Outfall **19**

Dilute Raw Sewage (MG)
0.48000

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
12/11/2021	1:00:00 AM	12/11/2021	2:15:00 AM

Rain(in.) = 0.82
Waterbody: Grand River

Submission ID. HPD-Y8WY-5HBAX
Permit MI0023400
Outfall **8**

Dilute Raw Sewage (MG)
0.47200

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

Lansing WWTP

Start Day	Start Time	End Day	End Time
12/11/2021	1:15:00 AM	12/11/2021	2:30:00 AM

Rain(in.) = 0.82
Waterbody: Grand River

Submission ID. HPD-Y8WY-5HBAX
Permit MI0023400
Outfall **14**

Dilute Raw Sewage (MG)
0.15400

Cause Combined stormwater and sewage. CSO was due to rainfall. Discharge was not disinfected. Only the surface water was impacted.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Totals Lansing WWTP

Dilute Raw Sewage (MG)
376.03020

SOC: CSO/SSO elimination

EGLE Action: Long-term Control Program being implemented; an Administrative Consent Order (ACO) with integrated plan requirements to correct CSO and SSO discharges. The ACO requires that core CSO correction be completed by December 31, 2032. The remaining CSO correction will be completed under the adaptive management approach. Adaptive management will consider lessons learned during the previous phase; a recalibrated hydraulic model and Wet Weather Control Plan update in 2023; green infrastructure; and includes appropriate revisions to correction projects specified for subsequent phases.

County Totals Ingham

Dilute Raw Sewage (MG)
376.03020

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

St. Clair

Port Huron WWTP

Port Huron WWTP

Start Day	Start Time	End Day	End Time
1/1/2021	7:30:00 PM	1/1/2021	8:30:00 PM

Rain(in.) = 0.29

Waterbody: Black River

Dilute Raw Sewage (MG)

0.00600

Cause Combined sewer overflow due to rain event. 6,000 gallons of combined wastewater was discharged, of which approximately 363 gallons was sanitary wastewater.

Submission ID. HP5-HMAK-GRN1K

Permit MI0023833

Outfall **5**

Port Huron WWTP

Start Day	Start Time	End Day	End Time
1/3/2021	2:30:00 PM	1/3/2021	3:30:00 PM

Rain(in.) = 0.34

Waterbody: Black River

Dilute Raw Sewage (MG)

0.00800

Cause Combined sewer overflow due to rain event. 8,000 gallons of combined wastewater was discharged, of which approximately 298 gallons was sanitary wastewater.

Submission ID. HP5-HMRY-4JVVH

Permit MI0023833

Outfall **5**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Port Huron WWTP

Start Day	Start Time	End Day	End Time
1/27/2021	11:00:00 AM	1/27/2021	12:00:00 PM

Rain(in.) = 0.23
Waterbody: Black River

Submission ID. HP6-4G5E-FS8HP
Permit MI0023833
Outfall 5

Dilute Raw Sewage (MG)
0.00400

Cause Combined sewer overflow due to snow melt. 4,000 gallons of combined wastewater was discharged, of which approximately 805 gallons was sanitary wastewater.

Port Huron WWTP

Start Day	Start Time	End Day	End Time
2/15/2021	10:00:00 AM	2/15/2021	11:00:00 AM

Rain(in.) = 0.28
Waterbody: Black River

Submission ID. HP6-QA37-XG25Y
Permit MI0023833
Outfall 5

Dilute Raw Sewage (MG)
0.00600

Cause Combined sewer overflow due to snow melt. 6,000 gallons of combined wastewater was discharged, of which approximately 350 gallons was sanitary wastewater.

Port Huron WWTP

Start Day	Start Time	End Day	End Time
2/21/2021	1:00:00 PM	2/21/2021	2:00:00 PM

Rain(in.) = 0.22
Waterbody: Black River

Submission ID. HP6-QAHH-A3Z13
Permit MI0023833
Outfall 5

Dilute Raw Sewage (MG)
0.00400

Cause Combined sewer overflow due to snow melt. 4,000 gallons of combined wastewater was discharged, of which approximately 660 gallons was sanitary wastewater.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Port Huron WWTP

Start Day	Start Time	End Day	End Time
2/23/2021	3:30:00 PM	2/23/2021	6:00:00 PM

Rain(in.) = 0.3
Waterbody: Black River

Submission ID. HP6-TGC4-NFHJV
Permit MI0023833
Outfall 5

Dilute Raw Sewage (MG)
0.00700

Cause Combined sewer overflow due to snow melt. 7,000 gallons of combined wastewater was discharged, of which approximately 1,050 gallons was sanitary wastewater.

Port Huron WWTP

Start Day	Start Time	End Day	End Time
3/26/2021	3:30:00 AM	3/27/2021	3:00:00 AM

Rain(in.) = 2.04
Waterbody: Black River

Submission ID. HP7-S103-P6JWB
Permit MI0023833
Outfall 5

Dilute Raw Sewage (MG)
0.19500

Cause Combined sewer overflow due to rain event. 195,000 gallons of combined wastewater was discharged, of which approximately 2,000 gallons was sanitary wastewater.

Port Huron WWTP

Start Day	Start Time	End Day	End Time
3/28/2021	1:00:00 AM	3/29/2021	3:00:00 AM

Rain(in.) = 0.65
Waterbody: Black River

Submission ID. HP7-S1BK-JMX6K
Permit MI0023833
Outfall 5

Dilute Raw Sewage (MG)
0.02600

Cause Combined sewer overflow due to rain event. 26,000 gallons of combined wastewater was discharged, of which approximately 1,544 gallons was sanitary wastewater.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Port Huron WWTP

Start Day	Start Time	End Day	End Time
4/29/2021	1:00:00 PM	4/29/2021	7:00:00 PM

Rain(in.) = 0.33
Waterbody: Black River

Submission ID. HP8-BWQ7-383XC
Permit MI0023833
Outfall 5

Dilute Raw Sewage (MG)
0.00800

Cause Combined sewer overflow due to rain event. 8,000 gallons of combined wastewater was discharged, of which approximately 908 gallons was sanitary wastewater.

Port Huron WWTP

Start Day	Start Time	End Day	End Time
5/22/2021	12:00:00 PM	5/22/2021	2:30:00 PM

Rain(in.) = 0.32
Waterbody: Black River

Submission ID. HP8-YPEW-3GN1S
Permit MI0023833
Outfall 5

Dilute Raw Sewage (MG)
0.00800

Cause Combined sewer overflow due to rain event. 8,000 gallons of combined wastewater was discharged, of which approximately 320 gallons was sanitary wastewater.

Port Huron WWTP

Start Day	Start Time	End Day	End Time
5/28/2021	11:00:00 AM	5/28/2021	5:30:00 PM

Rain(in.) = 0.7
Waterbody: Black River

Submission ID. HP9-5ZNK-JCAHF
Permit MI0023833
Outfall 5

Dilute Raw Sewage (MG)
0.05200

Cause Combined sewer overflow due to rain event. 52,000 gallons of combined wastewater was discharged, of which approximately 6,720 gallons was sanitary wastewater.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Port Huron WWTP

Start Day	Start Time	End Day	End Time
6/2/2021	9:00:00 PM	6/2/2021	11:00:00 PM

Rain(in.) = 0.41
Waterbody: Black River

Submission ID. HP9-6QXE-3S1MP
Permit MI0023833
Outfall 5

Dilute Raw Sewage (MG)
0.01200

Cause Combined sewer overflow due to rain event. 12,000 gallons of combined wastewater was discharged, of which approximately 1,435 gallons was sanitary wastewater.

Port Huron WWTP

Start Day	Start Time	End Day	End Time
6/14/2021	8:00:00 AM	6/14/2021	3:00:00 PM

Rain(in.) = 0.26
Waterbody: Black River

Submission ID. HP9-MMJ2-03FYH
Permit MI0023833
Outfall 5

Dilute Raw Sewage (MG)
0.00500

Cause Combined sewer overflow due to rain event. 5,000 gallons of combined wastewater was discharged, of which approximately 455 gallons was sanitary wastewater.

Port Huron WWTP

Start Day	Start Time	End Day	End Time
6/18/2021	11:00:00 AM	6/18/2021	12:30:00 PM

Rain(in.) = 0.26
Waterbody: Black River

Submission ID. HP9-MQ6F-YZBS3
Permit MI0023833
Outfall 5

Dilute Raw Sewage (MG)
0.00500

Cause Combined sewer overflow due to rain event. 5,000 gallons of combined wastewater was discharged, of which approximately 520 gallons was sanitary wastewater.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs..

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Port Huron WWTP

Start Day	Start Time	End Day	End Time
6/21/2021	6:00:00 AM	6/21/2021	9:00:00 AM

Rain(in.) = 1.57
Waterbody: Black River

Submission ID. HP9-R01M-ACX63
Permit MI0023833
Outfall 5

Dilute Raw Sewage (MG)
0.12300

Cause Combined sewer overflow due to rain event. 123,000 gallons of combined wastewater was discharged, of which approximately 2,000 gallons was sanitary wastewater.

Port Huron WWTP

Start Day	Start Time	End Day	End Time
6/25/2021	12:30:00 PM	6/26/2021	4:00:00 AM

Rain(in.) = 1.83
Waterbody: Black River

Submission ID. HP9-T6QM-AM96K
Permit MI0023833
Outfall 5

Dilute Raw Sewage (MG)
0.16100

Cause Combined sewer overflow due to rain event. 161,000 gallons of combined wastewater was discharged, of which approximately 6,000 gallons was sanitary wastewater.

Port Huron WWTP

Start Day	Start Time	End Day	End Time
6/26/2021	7:00:00 AM	6/27/2021	1:00:00 AM

Rain(in.) = 0.37
Waterbody: Black River

Submission ID. HP9-T8K8-V5CCG
Permit MI0023833
Outfall 5

Dilute Raw Sewage (MG)
0.01000

Cause Combined sewer overflow due to rain event. 10,000 gallons of combined wastewater was discharged, of which approximately 925 gallons was sanitary wastewater.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Port Huron WWTP

Start Day	Start Time	End Day	End Time
6/28/2021	8:30:00 PM	6/29/2021	1:00:00 AM

Rain(in.) = 0.33
Waterbody: Black River

Submission ID. HP9-TYP2-7AXA2
Permit MI0023833
Outfall 5

Dilute Raw Sewage (MG)
0.00800

Cause Combined sewer overflow due to rain event. 8,000 gallons of combined wastewater was discharged, of which approximately 413 gallons was sanitary wastewater.

Port Huron WWTP

Start Day	Start Time	End Day	End Time
7/7/2021	3:30:00 PM	7/7/2021	5:00:00 PM

Rain(in.) = 0.31
Waterbody: Black River

Submission ID. HPA-2ZDQ-5901R
Permit MI0023833
Outfall 5

Dilute Raw Sewage (MG)
0.00700

Cause Combined sewer overflow due to rain event. 7,000 gallons of combined wastewater was discharged, of which approximately 853 gallons was sanitary wastewater.

Port Huron WWTP

Start Day	Start Time	End Day	End Time
7/8/2021	9:00:00 AM	7/8/2021	11:00:00 PM

Rain(in.) = 0.32
Waterbody: Black River

Submission ID. HPA-2ZS7-69GY1
Permit MI0023833
Outfall 5

Dilute Raw Sewage (MG)
0.00800

Cause Combined sewer overflow due to rain event. 8,000 gallons of combined wastewater, of which approximately 1,040 was sanitary wastewater.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Port Huron WWTP

Start Day	Start Time	End Day	End Time
7/11/2021	11:30:00 AM	7/11/2021	6:30:00 PM

Rain(in.) = 0.26
Waterbody: Black River

Submission ID. HPA-58YG-MK4M0
Permit MI0023833
Outfall 5

Dilute Raw Sewage (MG)
0.00500

Cause Combined sewer overflow due to rain event. 5,000 gallons of combined wastewater was discharged, of which approximately 1,560 gallons was sanitary wastewater.

Port Huron WWTP

Start Day	Start Time	End Day	End Time
7/13/2021	4:00:00 PM	7/13/2021	11:00:00 PM

Rain(in.) = 0.32
Waterbody: Black River

Submission ID. HPA-8GZ6-B2MRC
Permit MI0023833
Outfall 5

Dilute Raw Sewage (MG)
0.00800

Cause Combined sewer overflow due to rain event 8,000 gallons of combined wastewater was discharged, of which approximately 800 gallons was sanitary wastewater.

Port Huron WWTP

Start Day	Start Time	End Day	End Time
7/24/2021	11:00:00 AM	7/24/2021	11:30:00 PM

Rain(in.) = 0
Waterbody: Black River

Submission ID. HPA-GC3A-8CV1W
Permit MI0023833
Outfall 5

Dilute Raw Sewage (MG)
0.01400

Cause combined sewer overflow due to rain event. 14,000 gallons of combined wastewater was discharged, of which approximately 563 gallons was sanitary wastewater.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Totals Port Huron WWTP

Dilute Raw Sewage (MG)

0.69000

SOC: The NPDES Permit requires elimination of all overflow outfalls by December 31, 2022

EGLE Action: Long-term Control Program (sewer separation project) being implemented; Director's Final Order (issued 2/19/98) & permit include schedule requiring elimination of all overflow outfalls by Dec. 31, 2012. The City requested a 4 year schedule extension in April, 2007, due to economic hardship. The Department approved the City's request and issued a schedule in the modified permit requiring elimination of all overflow outfalls by December 31, 2022; several outfalls and the associated overflows have already been eliminated through sewer separation construction.

County Totals St. Clair

Dilute Raw Sewage (MG)

0.69000

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne

Dearborn CSO

Dearborn CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.33
1/1/2021	8:50:00 PM	1/2/2021	3:21:00 AM	Waterbody: Rouge River

Dilute Raw Sewage (MG)

0.10000

Cause Rain water in combined sewers caused levels to crest weir walls and spill to river

Submission ID. HP5-ERYM-ZHA3M
Permit MI0025542
Outfall **1**

Dearborn CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.33
1/1/2021	8:50:00 PM	1/2/2021	3:21:00 AM	Waterbody: Rouge River

Dilute Raw Sewage (MG)

1.10000

Cause Rain water in combined sewers caused levels to crest weir walls and spill to river

Submission ID. HP5-ERYM-ZHA3M
Permit MI0025542
Outfall **13**

Dearborn CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.33
1/1/2021	8:50:00 PM	1/2/2021	3:21:00 AM	Waterbody: Rouge River

Dilute Raw Sewage (MG)

0.58000

Cause Rain water in combined sewers caused levels to crest weir walls and spill to river

Submission ID. HP5-ERYM-ZHA3M
Permit MI0025542
Outfall **3**

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs..

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
1/3/2021	8:00:00 AM	1/3/2021	11:08:00 AM

Rain(in.) = 0.19
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.02000

Cause Rain water in combined sewers caused levels to crest weir walls and spill to river

Submission ID. HP5-FZXP-J10VX
Permit MI0025542
Outfall **1**

Dearborn CSO

Start Day	Start Time	End Day	End Time
1/3/2021	8:00:00 AM	1/3/2021	11:08:00 AM

Rain(in.) = 0.19
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.24000

Cause Rain water in combined sewers caused levels to crest weir walls and spill to river

Submission ID. HP5-FZXP-J10VX
Permit MI0025542
Outfall **13**

Dearborn CSO

Start Day	Start Time	End Day	End Time
1/3/2021	8:00:00 AM	1/3/2021	11:08:00 AM

Rain(in.) = 0.19
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.13000

Cause Rain water in combined sewers caused levels to crest weir walls and spill to river

Submission ID. HP5-FZXP-J10VX
Permit MI0025542
Outfall **3**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
1/15/2021	2:23:00 PM	1/15/2021	4:01:00 PM

Rain(in.) = 0.17
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.01000

Cause Rain water in combined sewers crested weir walls and spilled to river

Submission ID. HP5-SJ54-1PDCF
Permit MI0025542
Outfall **1**

Dearborn CSO

Start Day	Start Time	End Day	End Time
1/15/2021	2:23:00 PM	1/15/2021	4:01:00 PM

Rain(in.) = 0.17
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.12000

Cause Rain water in combined sewers crested weir walls and spilled to river

Submission ID. HP5-SJ54-1PDCF
Permit MI0025542
Outfall **13**

Dearborn CSO

Start Day	Start Time	End Day	End Time
1/15/2021	2:23:00 PM	1/15/2021	4:01:00 PM

Rain(in.) = 0.17
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.06000

Cause Rain water in combined sewers crested weir walls and spilled to river

Submission ID. HP5-SJ54-1PDCF
Permit MI0025542
Outfall **3**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
3/26/2021	12:52:00 AM	3/26/2021	8:42:00 AM

Rain(in.) = 1.28
Waterbody: Rouge River

Dilute Raw Sewage (MG)
1.02000

Cause Rain water caused sewer levels to crest weir walls and spill to river

Submission ID. HP7-G3FP-RZPYK
Permit MI0025542
Outfall **1**

Dearborn CSO

Start Day	Start Time	End Day	End Time
3/26/2021	12:52:00 AM	3/26/2021	8:42:00 AM

Rain(in.) = 1.28
Waterbody: Rouge River

Dilute Raw Sewage (MG)
8.49000

Cause Rain water caused sewer levels to crest weir walls and spill to river

Submission ID. HP7-G3FP-RZPYK
Permit MI0025542
Outfall **13**

Dearborn CSO

Start Day	Start Time	End Day	End Time
3/26/2021	12:52:00 AM	3/26/2021	8:42:00 AM

Rain(in.) = 1.28
Waterbody: Rouge River

Dilute Raw Sewage (MG)
5.94000

Cause Rain water caused sewer levels to crest weir walls and spill to river

Submission ID. HP7-G3FP-RZPYK
Permit MI0025542
Outfall **14**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
3/26/2021	12:52:00 AM	3/26/2021	8:42:00 AM

Rain(in.) = 1.28
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.04000

Cause Rain water caused sewer levels to crest weir walls and spill to river

Submission ID. HP7-G3FP-RZPYK
Permit MI0025542
Outfall **2**

Dearborn CSO

Start Day	Start Time	End Day	End Time
3/26/2021	12:52:00 AM	3/26/2021	8:42:00 AM

Rain(in.) = 1.28
Waterbody: Rouge River

Dilute Raw Sewage (MG)
3.88000

Cause Rain water caused sewer levels to crest weir walls and spill to river

Submission ID. HP7-G3FP-RZPYK
Permit MI0025542
Outfall **3**

Dearborn CSO

Start Day	Start Time	End Day	End Time
3/26/2021	12:52:00 AM	3/26/2021	8:42:00 AM

Rain(in.) = 1.28
Waterbody: Rouge River

Dilute Raw Sewage (MG)
2.55000

Cause Rain water caused sewer levels to crest weir walls and spill to river

Submission ID. HP7-G3FP-RZPYK
Permit MI0025542
Outfall **4**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
3/27/2021	10:28:00 PM	3/28/2021	9:54:00 AM

Rain(in.) = 1.04
Waterbody: Rouge River

Dilute Raw Sewage (MG)
15.24000

Cause Rain water caused levels in sewers to crest weir walls and spill to river

Submission ID. HP7-HM8D-8ZAVK
Permit MI0025542
Outfall **1**

Dearborn CSO

Start Day	Start Time	End Day	End Time
3/27/2021	10:28:00 PM	3/28/2021	9:54:00 AM

Rain(in.) = 1.04
Waterbody: Rouge River

Dilute Raw Sewage (MG)
6.37000

Cause Rain water caused levels in sewers to crest weir walls and spill to river

Submission ID. HP7-HM8D-8ZAVK
Permit MI0025542
Outfall **13**

Dearborn CSO

Start Day	Start Time	End Day	End Time
3/27/2021	10:28:00 PM	3/28/2021	9:54:00 AM

Rain(in.) = 1.04
Waterbody: Rouge River

Dilute Raw Sewage (MG)
3.35000

Cause Rain water caused levels in sewers to crest weir walls and spill to river

Submission ID. HP7-HM8D-8ZAVK
Permit MI0025542
Outfall **14**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
3/27/2021	10:28:00 PM	3/28/2021	9:54:00 AM

Rain(in.) = 1.04
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.01000

Cause Rain water caused levels in sewers to crest weir walls and spill to river

Submission ID. HP7-HM8D-8ZAVK
Permit MI0025542
Outfall **2**

Dearborn CSO

Start Day	Start Time	End Day	End Time
3/27/2021	10:28:00 PM	3/28/2021	9:54:00 AM

Rain(in.) = 1.04
Waterbody: Rouge River

Dilute Raw Sewage (MG)
3.01000

Cause Rain water caused levels in sewers to crest weir walls and spill to river

Submission ID. HP7-HM8D-8ZAVK
Permit MI0025542
Outfall **3**

Dearborn CSO

Start Day	Start Time	End Day	End Time
3/27/2021	10:28:00 PM	3/28/2021	9:54:00 AM

Rain(in.) = 1.04
Waterbody: Rouge River

Dilute Raw Sewage (MG)
1.77000

Cause Rain water caused levels in sewers to crest weir walls and spill to river

Submission ID. HP7-HM8D-8ZAVK
Permit MI0025542
Outfall **4**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
4/5/2021	12:42:00 PM	4/5/2021	1:43:00 PM

Rain(in.) = 0.16
Waterbody: Rouge River

Submission ID. HP7-RAVP-RW3M9
Permit MI0025542
Outfall **1**

Dilute Raw Sewage (MG)
0.01000

Cause Rain water caused the combined sewers to overflow designated weir walls to the Rouge River per city of Dearborn permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
4/5/2021	12:42:00 PM	4/5/2021	1:43:00 PM

Rain(in.) = 0.16
Waterbody: Rouge River

Submission ID. HP7-RAVP-RW3M9
Permit MI0025542
Outfall **13**

Dilute Raw Sewage (MG)
0.06000

Cause Rain water caused the combined sewers to overflow designated weir walls to the Rouge River per city of Dearborn permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
4/5/2021	12:42:00 PM	4/5/2021	1:43:00 PM

Rain(in.) = 0.16
Waterbody: Rouge River

Submission ID. HP7-RAVP-RW3M9
Permit MI0025542
Outfall **3**

Dilute Raw Sewage (MG)
0.03000

Cause Rain water caused the combined sewers to overflow designated weir walls to the Rouge River per city of Dearborn permit.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
4/8/2021	4:40:00 PM	4/9/2021	7:47:00 AM

Rain(in.) = 0.5
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.26000

Cause Rain water caused levels in sewers to crest weir walls and spill to river

Submission ID. HP7-TT3A-EZ5NH
Permit MI0025542
Outfall **1**

Dearborn CSO

Start Day	Start Time	End Day	End Time
4/8/2021	4:40:00 PM	4/9/2021	7:47:00 AM

Rain(in.) = 0.5
Waterbody: Rouge River

Dilute Raw Sewage (MG)
2.65000

Cause Rain water caused levels in sewers to crest weir walls and spill to river

Submission ID. HP7-TT3A-EZ5NH
Permit MI0025542
Outfall **13**

Dearborn CSO

Start Day	Start Time	End Day	End Time
4/8/2021	4:40:00 PM	4/9/2021	7:47:00 AM

Rain(in.) = 0.5
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.35000

Cause Rain water caused levels in sewers to crest weir walls and spill to river

Submission ID. HP7-TT3A-EZ5NH
Permit MI0025542
Outfall **14**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
4/8/2021	4:40:00 PM	4/9/2021	7:47:00 AM

Rain(in.) = 0.5
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.01000

Cause Rain water caused levels in sewers to crest weir walls and spill to river

Submission ID. HP7-TT3A-EZ5NH
Permit MI0025542
Outfall **2**

Dearborn CSO

Start Day	Start Time	End Day	End Time
4/8/2021	4:40:00 PM	4/9/2021	7:47:00 AM

Rain(in.) = 0.5
Waterbody: Rouge River

Dilute Raw Sewage (MG)
1.35000

Cause Rain water caused levels in sewers to crest weir walls and spill to river

Submission ID. HP7-TT3A-EZ5NH
Permit MI0025542
Outfall **3**

Dearborn CSO

Start Day	Start Time	End Day	End Time
4/8/2021	4:40:00 PM	4/9/2021	7:47:00 AM

Rain(in.) = 0.5
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.40000

Cause Rain water caused levels in sewers to crest weir walls and spill to river

Submission ID. HP7-TT3A-EZ5NH
Permit MI0025542
Outfall **4**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
4/10/2021	9:33:00 PM	4/11/2021	3:16:00 AM

Rain(in.) = 0.43
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.16000

Cause Rain water in combined sewers caused levels to crest weir walls and spill to river

Submission ID. HP7-WJ17-CWMHY
Permit MI0025542
Outfall **1**

Dearborn CSO

Start Day	Start Time	End Day	End Time
4/10/2021	9:33:00 PM	4/11/2021	3:16:00 AM

Rain(in.) = 0.43
Waterbody: Rouge River

Dilute Raw Sewage (MG)
1.76000

Cause Rain water in combined sewers caused levels to crest weir walls and spill to river

Submission ID. HP7-WJ17-CWMHY
Permit MI0025542
Outfall **13**

Dearborn CSO

Start Day	Start Time	End Day	End Time
4/10/2021	9:33:00 PM	4/11/2021	3:16:00 AM

Rain(in.) = 0.43
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.04000

Cause Rain water in combined sewers caused levels to crest weir walls and spill to river

Submission ID. HP7-WJ17-CWMHY
Permit MI0025542
Outfall **14**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
4/10/2021	9:33:00 PM	4/11/2021	3:16:00 AM

Rain(in.) = 0.43
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.91000

Cause Rain water in combined sewers caused levels to crest weir walls and spill to river

Submission ID. HP7-WJ17-CWMHY
Permit MI0025542
Outfall **3**

Dearborn CSO

Start Day	Start Time	End Day	End Time
4/10/2021	9:33:00 PM	4/11/2021	3:16:00 AM

Rain(in.) = 0.43
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.07000

Cause Rain water in combined sewers caused levels to crest weir walls and spill to river

Submission ID. HP7-WJ17-CWMHY
Permit MI0025542
Outfall **4**

Dearborn CSO

Start Day	Start Time	End Day	End Time
4/29/2021	3:40:00 PM	4/29/2021	6:35:00 PM

Rain(in.) = 0.26
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.06000

Cause Rain fall caused combined sewers to over flow weir walls at designated sites per city of Dearborn permit.

Submission ID. HP8-B99T-VWF9Q
Permit MI0025542
Outfall **1**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
4/29/2021	3:40:00 PM	4/29/2021	6:35:00 PM

Rain(in.) = 0.26
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.66000

Cause Rain fall caused combined sewers to over flow weir walls at designated sites per city of Dearborn permit.

Submission ID. HP8-B99T-VWF9Q
Permit MI0025542
Outfall **13**

Dearborn CSO

Start Day	Start Time	End Day	End Time
4/29/2021	3:40:00 PM	4/29/2021	6:35:00 PM

Rain(in.) = 0.26
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.36000

Cause Rain fall caused combined sewers to over flow weir walls at designated sites per city of Dearborn permit.

Submission ID. HP8-B99T-VWF9Q
Permit MI0025542
Outfall **3**

Dearborn CSO

Start Day	Start Time	End Day	End Time
5/3/2021	2:00:00 PM	5/3/2021	9:00:00 PM

Rain(in.) = 0.21
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.03000

Cause Rain fall caused combined sewers to over flow weir walls to the Rouge River at designated sites per city of Dearborn permit.

Submission ID. HP8-EC07-1BN1V
Permit MI0025542
Outfall **1**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
5/3/2021	2:00:00 PM	5/3/2021	9:00:00 PM

Rain(in.) = 0.21
Waterbody: Rouge River

Submission ID. HP8-EC07-1BN1V
Permit MI0025542
Outfall **13**

Dilute Raw Sewage (MG)
0.36000

Cause Rain fall caused combined sewers to over flow weir walls to the Rouge River at designated sites per city of Dearborn permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
5/3/2021	2:00:00 PM	5/3/2021	9:00:00 PM

Rain(in.) = 0.21
Waterbody: Rouge River

Submission ID. HP8-EC07-1BN1V
Permit MI0025542
Outfall **3**

Dilute Raw Sewage (MG)
0.19000

Cause Rain fall caused combined sewers to over flow weir walls to the Rouge River at designated sites per city of Dearborn permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
5/7/2021	6:09:00 PM	5/7/2021	11:25:00 PM

Rain(in.) = 0.23
Waterbody: Rouge River

Submission ID. HP8-HMYP-YGXD6
Permit MI0025542
Outfall **1**

Dilute Raw Sewage (MG)
0.04000

Cause Rain fall caused combined sewers to overflow weir walls to the Rouge River at designated sites per city of Dearborn permit.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
5/7/2021	6:09:00 PM	5/7/2021	11:25:00 PM

Rain(in.) = 0.23
Waterbody: Rouge River

Submission ID. HP8-HMYP-YGXD6
Permit MI0025542
Outfall **13**

Dilute Raw Sewage (MG)
0.48000

Cause Rain fall caused combined sewers to overflow weir walls to the Rouge River at designated sites per city of Dearborn permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
5/7/2021	6:09:00 PM	5/7/2021	11:25:00 PM

Rain(in.) = 0.23
Waterbody: Rouge River

Submission ID. HP8-HMYP-YGXD6
Permit MI0025542
Outfall **3**

Dilute Raw Sewage (MG)
0.26000

Cause Rain fall caused combined sewers to overflow weir walls to the Rouge River at designated sites per city of Dearborn permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
5/9/2021	1:49:00 PM	5/10/2021	12:09:00 AM

Rain(in.) = 0.21
Waterbody: Rouge River

Submission ID. HP8-K2PK-DN6Z0
Permit MI0025542
Outfall **1**

Dilute Raw Sewage (MG)
0.03000

Cause Rain fall caused combined sewers to overflow weir walls to the Rouge River at designated sites per city of Dearborn Permit.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
5/9/2021	1:49:00 PM	5/10/2021	12:09:00 AM

Rain(in.) = 0.21
Waterbody: Rouge River

Submission ID. HP8-K2PK-DN6Z0
Permit MI0025542
Outfall **13**

Dilute Raw Sewage (MG)
0.36000

Cause Rain fall caused combined sewers to overflow weir walls to the Rouge River at designated sites per city of Dearborn Permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
5/9/2021	1:49:00 PM	5/10/2021	12:09:00 AM

Rain(in.) = 0.21
Waterbody: Rouge River

Submission ID. HP8-K2PK-DN6Z0
Permit MI0025542
Outfall **3**

Dilute Raw Sewage (MG)
0.19000

Cause Rain fall caused combined sewers to overflow weir walls to the Rouge River at designated sites per city of Dearborn Permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
5/23/2021	8:56:00 PM	5/23/2021	10:35:00 PM

Rain(in.) = 0.25
Waterbody: Rouge River

Submission ID. HP8-YACR-23M02
Permit MI0025542
Outfall **1**

Dilute Raw Sewage (MG)
0.05000

Cause Rain fall caused combined sewers to overflow weir walls at designated site and discharge to the Rouge River per city of Dearborn permit.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
5/23/2021	8:56:00 PM	5/23/2021	10:35:00 PM

Rain(in.) = 0.25
Waterbody: Rouge River

Submission ID. HP8-YACR-23M02
Permit MI0025542
Outfall **13**

Dilute Raw Sewage (MG)
0.60000

Cause Rain fall caused combined sewers to overflow weir walls at designated site and discharge to the Rouge River per city of Dearborn permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
5/23/2021	8:56:00 PM	5/23/2021	10:35:00 PM

Rain(in.) = 0.25
Waterbody: Rouge River

Submission ID. HP8-YACR-23M02
Permit MI0025542
Outfall **3**

Dilute Raw Sewage (MG)
0.32000

Cause Rain fall caused combined sewers to overflow weir walls at designated site and discharge to the Rouge River per city of Dearborn permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
5/26/2021	9:29:00 AM	5/26/2021	1:30:00 PM

Rain(in.) = 0.33
Waterbody: Rouge River

Submission ID. HP9-OATJ-MDYH6
Permit MI0025542
Outfall **1**

Dilute Raw Sewage (MG)
0.10000

Cause Rain fall caused combined sewers to overflow weir walls at designated sites per city of Dearborn permit.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
5/26/2021	9:29:00 AM	5/26/2021	1:30:00 PM

Rain(in.) = 0.33
Waterbody: Rouge River

Dilute Raw Sewage (MG)
1.10000

Cause Rain fall caused combined sewers to overflow weir walls at designated sites per city of Dearborn permit.

Submission ID. HP9-OATJ-MDYH6
Permit MI0025542
Outfall **13**

Dearborn CSO

Start Day	Start Time	End Day	End Time
5/26/2021	9:29:00 AM	5/26/2021	1:30:00 PM

Rain(in.) = 0.33
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.58000

Cause Rain fall caused combined sewers to overflow weir walls at designated sites per city of Dearborn permit.

Submission ID. HP9-OATJ-MDYH6
Permit MI0025542
Outfall **3**

Dearborn CSO

Start Day	Start Time	End Day	End Time
5/28/2021	5:56:00 AM	5/28/2021	3:43:00 PM

Rain(in.) = 0.81
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.48000

Cause Rain water in combined sewers caused levels crest weir walls and spill to the river.

Submission ID. HP9-1SE3-BJBFN
Permit MI0025542
Outfall **1**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
5/28/2021	5:56:00 AM	5/28/2021	3:43:00 PM

Rain(in.) = 0.81
Waterbody: Rouge River

Dilute Raw Sewage (MG)
4.51000

Cause Rain water in combined sewers caused levels crest weir walls and spill to the river.

Submission ID. HP9-1SE3-BJBFN
Permit MI0025542
Outfall **13**

Dearborn CSO

Start Day	Start Time	End Day	End Time
5/28/2021	5:56:00 AM	5/28/2021	3:43:00 PM

Rain(in.) = 0.81
Waterbody: Rouge River

Dilute Raw Sewage (MG)
1.54000

Cause Rain water in combined sewers caused levels crest weir walls and spill to the river.

Submission ID. HP9-1SE3-BJBFN
Permit MI0025542
Outfall **14**

Dearborn CSO

Start Day	Start Time	End Day	End Time
5/28/2021	5:56:00 AM	5/28/2021	3:43:00 PM

Rain(in.) = 0.81
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.01000

Cause Rain water in combined sewers caused levels crest weir walls and spill to the river.

Submission ID. HP9-1SE3-BJBFN
Permit MI0025542
Outfall **2**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
5/28/2021	5:56:00 AM	5/28/2021	3:43:00 PM

Rain(in.) = 0.81
Waterbody: Rouge River

Dilute Raw Sewage (MG)
2.20000

Cause Rain water in combined sewers caused levels crest weir walls and spill to the river.

Submission ID. HP9-1SE3-BJBFN
Permit MI0025542
Outfall **3**

Dearborn CSO

Start Day	Start Time	End Day	End Time
5/28/2021	5:56:00 AM	5/28/2021	3:43:00 PM

Rain(in.) = 0.81
Waterbody: Rouge River

Dilute Raw Sewage (MG)
1.08000

Cause Rain water in combined sewers caused levels crest weir walls and spill to the river.

Submission ID. HP9-1SE3-BJBFN
Permit MI0025542
Outfall **4**

Dearborn CSO

Start Day	Start Time	End Day	End Time
6/2/2021	5:57:00 PM	6/2/2021	11:20:00 PM

Rain(in.) = 0.66
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.34000

Cause Rian fall caused combined sewers to overflow weir walls at designated sites and discharge to the Rouge River per city of Dearborn Permit.

Submission ID. HP9-630X-8BAAC
Permit MI0025542
Outfall **1**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
6/2/2021	5:57:00 PM	6/2/2021	11:20:00 PM

Rain(in.) = 0.66
Waterbody: Rouge River

Submission ID. HP9-630X-8BAAC
Permit MI0025542
Outfall **13**

Dilute Raw Sewage (MG)
3.37000

Cause Rian fall caused combined sewers to overflow weir walls at designated sites and discharge to the Rouge River per city of Dearborn Permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
6/2/2021	5:57:00 PM	6/2/2021	11:20:00 PM

Rain(in.) = 0.66
Waterbody: Rouge River

Submission ID. HP9-630X-8BAAC
Permit MI0025542
Outfall **14**

Dilute Raw Sewage (MG)
0.73000

Cause Rian fall caused combined sewers to overflow weir walls at designated sites and discharge to the Rouge River per city of Dearborn Permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
6/2/2021	5:57:00 PM	6/2/2021	11:20:00 PM

Rain(in.) = 0.66
Waterbody: Rouge River

Submission ID. HP9-630X-8BAAC
Permit MI0025542
Outfall **2**

Dilute Raw Sewage (MG)
0.01000

Cause Rian fall caused combined sewers to overflow weir walls at designated sites and discharge to the Rouge River per city of Dearborn Permit.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
6/2/2021	5:57:00 PM	6/2/2021	11:20:00 PM

Rain(in.) = 0.66
Waterbody: Rouge River

Submission ID. HP9-630X-8BAAC
Permit MI0025542
Outfall **3**

Dilute Raw Sewage (MG)
1.69000

Cause Rian fall caused combined sewers to overflow weir walls at designated sites and discharge to the Rouge River per city of Dearborn Permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
6/2/2021	5:57:00 PM	6/2/2021	11:20:00 PM

Rain(in.) = 0.66
Waterbody: Rouge River

Submission ID. HP9-630X-8BAAC
Permit MI0025542
Outfall **4**

Dilute Raw Sewage (MG)
0.66000

Cause Rian fall caused combined sewers to overflow weir walls at designated sites and discharge to the Rouge River per city of Dearborn Permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
6/18/2021	6:30:00 AM	6/18/2021	11:06:00 AM

Rain(in.) = 0.67
Waterbody: Rouge River

Submission ID. HP9-J908-5EYMW
Permit MI0025542
Outfall **1**

Dilute Raw Sewage (MG)
0.35000

Cause Rain fall caused combined sewers to overflow weir walls at designated sites to the Rouge River per city of Dearborn Permit.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
6/18/2021	6:30:00 AM	6/18/2021	11:06:00 AM

Rain(in.) = 0.67
Waterbody: Rouge River

Submission ID. HP9-J908-5EYMW
Permit MI0025542
Outfall **13**

Dilute Raw Sewage (MG)
3.44000

Cause Rain fall caused combined sewers to overflow weir walls at designated sites to the Rouge River per city of Dearborn Permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
6/18/2021	6:30:00 AM	6/18/2021	11:06:00 AM

Rain(in.) = 0.67
Waterbody: Rouge River

Submission ID. HP9-J908-5EYMW
Permit MI0025542
Outfall **14**

Dilute Raw Sewage (MG)
0.78000

Cause Rain fall caused combined sewers to overflow weir walls at designated sites to the Rouge River per city of Dearborn Permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
6/18/2021	6:30:00 AM	6/18/2021	11:06:00 AM

Rain(in.) = 0.67
Waterbody: Rouge River

Submission ID. HP9-J908-5EYMW
Permit MI0025542
Outfall **2**

Dilute Raw Sewage (MG)
0.01000

Cause Rain fall caused combined sewers to overflow weir walls at designated sites to the Rouge River per city of Dearborn Permit.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
6/18/2021	6:30:00 AM	6/18/2021	11:06:00 AM

Rain(in.) = 0.67
Waterbody: Rouge River

Submission ID. HP9-J908-5EYMW
Permit MI0025542
Outfall **3**

Dilute Raw Sewage (MG)
1.72000

Cause Rain fall caused combined sewers to overflow weir walls at designated sites to the Rouge River per city of Dearborn Permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
6/18/2021	6:30:00 AM	6/18/2021	11:06:00 AM

Rain(in.) = 0.67
Waterbody: Rouge River

Submission ID. HP9-J908-5EYMW
Permit MI0025542
Outfall **4**

Dilute Raw Sewage (MG)
0.69000

Cause Rain fall caused combined sewers to overflow weir walls at designated sites to the Rouge River per city of Dearborn Permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
6/20/2021	10:33:00 PM	6/21/2021	6:47:00 AM

Rain(in.) = 1.46
Waterbody: Rouge River

Submission ID. HP9-MC8J-Z9SDX
Permit MI0025542
Outfall **1**

Dilute Raw Sewage (MG)
1.27000

Cause Rain fall caused combined sewers to over flow weir walls to the Rouge River at designated sites per city of Dearborn permit.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
6/20/2021	10:33:00 PM	6/21/2021	6:47:00 AM

Rain(in.) = 1.46
Waterbody: Rouge River

Submission ID. HP9-MC8J-Z9SDX
Permit MI0025542
Outfall **13**

Dilute Raw Sewage (MG)
10.18000

Cause Rain fall caused combined sewers to over flow weir walls to the Rouge River at designated sites per city of Dearborn permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
6/20/2021	10:33:00 PM	6/21/2021	6:47:00 AM

Rain(in.) = 1.46
Waterbody: Rouge River

Submission ID. HP9-MC8J-Z9SDX
Permit MI0025542
Outfall **14**

Dilute Raw Sewage (MG)
8.37000

Cause Rain fall caused combined sewers to over flow weir walls to the Rouge River at designated sites per city of Dearborn permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
6/20/2021	10:33:00 PM	6/21/2021	6:47:00 AM

Rain(in.) = 1.46
Waterbody: Rouge River

Submission ID. HP9-MC8J-Z9SDX
Permit MI0025542
Outfall **2**

Dilute Raw Sewage (MG)
0.06000

Cause Rain fall caused combined sewers to over flow weir walls to the Rouge River at designated sites per city of Dearborn permit.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
6/20/2021	10:33:00 PM	6/21/2021	6:47:00 AM

Rain(in.) = 1.46
Waterbody: Rouge River

Submission ID. HP9-MC8J-Z9SDX
Permit MI0025542
Outfall 3

Dilute Raw Sewage (MG)
4.55000

Cause Rain fall caused combined sewers to over flow weir walls to the Rouge River at designated sites per city of Dearborn permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
6/20/2021	10:33:00 PM	6/21/2021	6:47:00 AM

Rain(in.) = 1.46
Waterbody: Rouge River

Submission ID. HP9-MC8J-Z9SDX
Permit MI0025542
Outfall 4

Dilute Raw Sewage (MG)
3.18000

Cause Rain fall caused combined sewers to over flow weir walls to the Rouge River at designated sites per city of Dearborn permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
6/25/2021	10:09:00 AM	6/26/2021	5:11:00 AM

Rain(in.) = 7.57
Waterbody: Rouge River

Submission ID. HP9-ROC3-XWJRM
Permit MI0025542
Outfall 1

Dilute Raw Sewage (MG)
24.47000

Cause Rain water in combined sewers caused levels to raise and spill to river.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
6/25/2021	10:09:00 AM	6/26/2021	5:11:00 AM

Rain(in.) = 7.57
Waterbody: Rouge River

Dilute Raw Sewage (MG)
123.58000

Cause Rain water in combined sewers caused levels to raise and spill to river.

Submission ID. HP9-ROC3-XWJRM
Permit MI0025542
Outfall **13**

Dearborn CSO

Start Day	Start Time	End Day	End Time
6/25/2021	10:09:00 AM	6/26/2021	5:11:00 AM

Rain(in.) = 7.57
Waterbody: Rouge River

Dilute Raw Sewage (MG)
335.32000

Cause Rain water in combined sewers caused levels to raise and spill to river.

Submission ID. HP9-ROC3-XWJRM
Permit MI0025542
Outfall **14**

Dearborn CSO

Start Day	Start Time	End Day	End Time
6/25/2021	10:09:00 AM	6/26/2021	5:11:00 AM

Rain(in.) = 7.57
Waterbody: Rouge River

Dilute Raw Sewage (MG)
3.85000

Cause Rain water in combined sewers caused levels to raise and spill to river.

Submission ID. HP9-ROC3-XWJRM
Permit MI0025542
Outfall **2**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
6/25/2021	10:09:00 AM	6/26/2021	5:11:00 AM

Rain(in.) = 7.57
Waterbody: Rouge River

Dilute Raw Sewage (MG)
34.79000

Cause Rain water in combined sewers caused levels to raise and spill to river.

Submission ID. HP9-ROC3-XWJRM
Permit MI0025542
Outfall **3**

Dearborn CSO

Start Day	Start Time	End Day	End Time
6/25/2021	10:09:00 AM	6/26/2021	5:11:00 AM

Rain(in.) = 7.57
Waterbody: Rouge River

Dilute Raw Sewage (MG)
45.96000

Cause Rain water in combined sewers caused levels to raise and spill to river.

Submission ID. HP9-ROC3-XWJRM
Permit MI0025542
Outfall **4**

Dearborn CSO

Start Day	Start Time	End Day	End Time
6/28/2021	9:42:00 PM	6/28/2021	11:25:00 PM

Rain(in.) = 0.22
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.03000

Cause Rain fall caused combined sewers to over flow weir walls to the Rouge River at designated sites per city of Dearborn permit.

Submission ID. HP9-TMD4-KQ4CC
Permit MI0025542
Outfall **1**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
6/28/2021	9:42:00 PM	6/28/2021	11:25:00 PM

Rain(in.) = 0.22
Waterbody: Rouge River

Submission ID. HP9-TMD4-KQ4CC
Permit MI0025542
Outfall **13**

Dilute Raw Sewage (MG)
0.42000

Cause Rain fall caused combined sewers to over flow weir walls to the Rouge River at designated sites per city of Dearborn permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
6/28/2021	9:42:00 PM	6/28/2021	11:25:00 PM

Rain(in.) = 0.22
Waterbody: Rouge River

Submission ID. HP9-TMD4-KQ4CC
Permit MI0025542
Outfall **3**

Dilute Raw Sewage (MG)
0.23000

Cause Rain fall caused combined sewers to over flow weir walls to the Rouge River at designated sites per city of Dearborn permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
6/29/2021	8:47:00 PM	6/30/2021	1:09:00 PM

Rain(in.) = 0.2
Waterbody: Rouge River

Submission ID. HP9-VCJV-FBYM7
Permit MI0025542
Outfall **1**

Dilute Raw Sewage (MG)
0.02000

Cause Rain fall caused combined sewers to overflow weir walls at designated sites per city of Dearborn permit.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
6/29/2021	8:47:00 PM	6/30/2021	1:09:00 PM

Rain(in.) = 0.2
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.30000

Submission ID. HP9-VCJV-FBYM7
Permit MI0025542
Outfall **13**

Cause Rain fall caused combined sewers to overflow weir walls at designated sites per city of Dearborn permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
6/29/2021	8:47:00 PM	6/30/2021	1:09:00 PM

Rain(in.) = 0.2
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.16000

Submission ID. HP9-VCJV-FBYM7
Permit MI0025542
Outfall **3**

Cause Rain fall caused combined sewers to overflow weir walls at designated sites per city of Dearborn permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
7/11/2021	7:34:00 AM	7/11/2021	9:20:00 PM

Rain(in.) = 0.44
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.17000

Submission ID. HPA-4JN6-7PCSJ
Permit MI0025542
Outfall **1**

Cause Rain water caused combined sewers to over flow weir walls at designated sites per City of Dearborn permit.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
7/11/2021	7:34:00 AM	7/11/2021	9:20:00 PM

Rain(in.) = 0.44
Waterbody: Rouge River

Dilute Raw Sewage (MG)
1.82000

Cause Rain water caused combined sewers to over flow weir walls at designated sites per City of Dearborn permit.

Submission ID. HPA-4JN6-7PCSJ
Permit MI0025542
Outfall **13**

Dearborn CSO

Start Day	Start Time	End Day	End Time
7/11/2021	7:34:00 AM	7/11/2021	9:20:00 PM

Rain(in.) = 0.44
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.06000

Cause Rain water caused combined sewers to over flow weir walls at designated sites per City of Dearborn permit.

Submission ID. HPA-4JN6-7PCSJ
Permit MI0025542
Outfall **14**

Dearborn CSO

Start Day	Start Time	End Day	End Time
7/11/2021	7:34:00 AM	7/11/2021	9:20:00 PM

Rain(in.) = 0.44
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.95000

Cause Rain water caused combined sewers to over flow weir walls at designated sites per City of Dearborn permit.

Submission ID. HPA-4JN6-7PCSJ
Permit MI0025542
Outfall **3**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
7/11/2021	7:34:00 AM	7/11/2021	9:20:00 PM

Rain(in.) = 0.44
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.10000

Submission ID. HPA-4JN6-7PCSJ
Permit MI0025542
Outfall **4**

Cause Rain water caused combined sewers to over flow weir walls at designated sites per City of Dearborn permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
7/13/2021	5:43:00 PM	7/13/2021	7:36:00 PM

Rain(in.) = 0.19
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.02000

Submission ID. HPA-69M5-5HJW7
Permit MI0025542
Outfall **1**

Cause Rain fall caused combined sewers to over flow weir walls at designated sites per city of Dearborn permit

Dearborn CSO

Start Day	Start Time	End Day	End Time
7/13/2021	5:43:00 PM	7/13/2021	7:36:00 PM

Rain(in.) = 0.19
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.24000

Submission ID. HPA-69M5-5HJW7
Permit MI0025542
Outfall **13**

Cause Rain fall caused combined sewers to over flow weir walls at designated sites per city of Dearborn permit

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
7/13/2021	5:43:00 PM	7/13/2021	7:36:00 PM

Rain(in.) = 0.19
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.13000

Cause Rain fall caused combined sewers to over flow weir walls at designated sites per city of Dearborn permit

Submission ID. HPA-69M5-5HJW7
Permit MI0025542
Outfall **3**

Dearborn CSO

Start Day	Start Time	End Day	End Time
7/16/2021	9:09:00 AM	7/17/2021	8:08:00 AM

Rain(in.) = 4.41
Waterbody: Rouge River

Dilute Raw Sewage (MG)
8.92000

Cause Rainfall caused combined sewers to overflow weir walls at designated sites per City of Dearborn Permit

Submission ID. HPA-8ERG-PFVYZ
Permit MI0025542
Outfall **1**

Dearborn CSO

Start Day	Start Time	End Day	End Time
7/16/2021	9:09:00 AM	7/17/2021	8:08:00 AM

Rain(in.) = 4.41
Waterbody: Rouge River

Dilute Raw Sewage (MG)
51.38000

Cause Rainfall caused combined sewers to overflow weir walls at designated sites per City of Dearborn Permit

Submission ID. HPA-8ERG-PFVYZ
Permit MI0025542
Outfall **13**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
7/16/2021	9:09:00 AM	7/17/2021	8:08:00 AM

Rain(in.) = 4.41
Waterbody: Rouge River

Dilute Raw Sewage (MG)
106.93000

Cause Rainfall caused combined sewers to overflow weir walls at designated sites per City of Dearborn Permit

Submission ID. HPA-8ERG-PFVYZ
Permit MI0025542
Outfall **14**

Dearborn CSO

Start Day	Start Time	End Day	End Time
7/16/2021	9:09:00 AM	7/17/2021	8:08:00 AM

Rain(in.) = 4.41
Waterbody: Rouge River

Dilute Raw Sewage (MG)
1.15000

Cause Rainfall caused combined sewers to overflow weir walls at designated sites per City of Dearborn Permit

Submission ID. HPA-8ERG-PFVYZ
Permit MI0025542
Outfall **2**

Dearborn CSO

Start Day	Start Time	End Day	End Time
7/16/2021	9:09:00 AM	7/17/2021	8:08:00 AM

Rain(in.) = 4.41
Waterbody: Rouge River

Dilute Raw Sewage (MG)
17.24000

Cause Rainfall caused combined sewers to overflow weir walls at designated sites per City of Dearborn Permit

Submission ID. HPA-8ERG-PFVYZ
Permit MI0025542
Outfall **3**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
7/16/2021	9:09:00 AM	7/17/2021	8:08:00 AM

Rain(in.) = 4.41
Waterbody: Rouge River

Dilute Raw Sewage (MG)
18.64000

Cause Rainfall caused combined sewers to overflow weir walls at designated sites per City of Dearborn Permit

Submission ID. HPA-8ERG-PFVYZ
Permit MI0025542
Outfall **4**

Dearborn CSO

Start Day	Start Time	End Day	End Time
7/20/2021	8:04:00 PM	7/21/2021	12:00:00 AM

Rain(in.) = 0.4
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.14000

Cause Rainfall caused combined sewers to over flow weir walls at designated sites per City of Dearborn permit.

Submission ID. HPA-BX57-RQ1MS
Permit MI0025542
Outfall **1**

Dearborn CSO

Start Day	Start Time	End Day	End Time
7/20/2021	8:04:00 PM	7/21/2021	12:00:00 AM

Rain(in.) = 0.4
Waterbody: Rouge River

Dilute Raw Sewage (MG)
1.56000

Cause Rainfall caused combined sewers to over flow weir walls at designated sites per City of Dearborn permit.

Submission ID. HPA-BX57-RQ1MS
Permit MI0025542
Outfall **13**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
7/20/2021	8:04:00 PM	7/21/2021	12:00:00 AM

Rain(in.) = 0.4
Waterbody: Rouge River

Submission ID. HPA-BX57-RQ1MS
Permit MI0025542
Outfall **3**

Dilute Raw Sewage (MG)
0.81000

Cause Rainfall caused combined sewers to over flow weir walls at designated sites per City of Dearborn permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
7/23/2021	8:07:00 AM	7/23/2021	1:00:00 PM

Rain(in.) = 0
Waterbody: Rouge River

Submission ID. HPA-DVWZ-FRF6Y
Permit MI0025542
Outfall **1**

Dilute Raw Sewage (MG)
0.11000

Cause Rain fall caused levels in combined sewers to raise and crest weir walls at designated spill points per City of Dearborn permit

Dearborn CSO

Start Day	Start Time	End Day	End Time
7/23/2021	8:07:00 AM	7/23/2021	1:00:00 PM

Rain(in.) = 0
Waterbody: Rouge River

Submission ID. HPA-DVWZ-FRF6Y
Permit MI0025542
Outfall **13**

Dilute Raw Sewage (MG)
1.23000

Cause Rain fall caused levels in combined sewers to raise and crest weir walls at designated spill points per City of Dearborn permit

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
7/23/2021	8:07:00 AM	7/23/2021	1:00:00 PM

Rain(in.) = 0
Waterbody: Rouge River

Submission ID. HPA-DVWZ-FRF6Y
Permit MI0025542
Outfall **3**

Dilute Raw Sewage (MG)
0.65000

Cause Rain fall caused levels in combined sewers to raise and crest weir walls at designated spill points per City of Dearborn permit

Dearborn CSO

Start Day	Start Time	End Day	End Time
7/25/2021	9:03:00 PM	7/24/2021	11:23:00 PM

Rain(in.) = 2.8
Waterbody: Rouge River

Submission ID. HPA-F4MK-7VD02
Permit MI0025542
Outfall **1**

Dilute Raw Sewage (MG)
3.92000

Cause Rain fall caused levels in combined sewers to crest weir walls and discharge at designated locations per City of Dearborn permit

Dearborn CSO

Start Day	Start Time	End Day	End Time
7/25/2021	9:03:00 PM	7/24/2021	11:23:00 PM

Rain(in.) = 2.8
Waterbody: Rouge River

Submission ID. HPA-F4MK-7VD02
Permit MI0025542
Outfall **13**

Dilute Raw Sewage (MG)
25.76000

Cause Rain fall caused levels in combined sewers to crest weir walls and discharge at designated locations per City of Dearborn permit

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
7/25/2021	9:03:00 PM	7/24/2021	11:23:00 PM

Rain(in.) = 2.8
Waterbody: Rouge River

Submission ID. HPA-F4MK-7VD02
Permit MI0025542
Outfall **14**

Dilute Raw Sewage (MG)
39.42000

Cause Rain fall caused levels in combined sewers to crest weir walls and discharge at designated locations per City of Dearborn permit

Dearborn CSO

Start Day	Start Time	End Day	End Time
7/25/2021	9:03:00 PM	7/24/2021	11:23:00 PM

Rain(in.) = 2.8
Waterbody: Rouge River

Submission ID. HPA-F4MK-7VD02
Permit MI0025542
Outfall **2**

Dilute Raw Sewage (MG)
0.38000

Cause Rain fall caused levels in combined sewers to crest weir walls and discharge at designated locations per City of Dearborn permit

Dearborn CSO

Start Day	Start Time	End Day	End Time
7/25/2021	9:03:00 PM	7/24/2021	11:23:00 PM

Rain(in.) = 2.8
Waterbody: Rouge River

Submission ID. HPA-F4MK-7VD02
Permit MI0025542
Outfall **3**

Dilute Raw Sewage (MG)
9.90000

Cause Rain fall caused levels in combined sewers to crest weir walls and discharge at designated locations per City of Dearborn permit

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
7/25/2021	9:03:00 PM	7/24/2021	11:23:00 PM

Rain(in.) = 2.8
Waterbody: Rouge River

Submission ID. HPA-F4MK-7VD02
Permit MI0025542
Outfall 4

Dilute Raw Sewage (MG)
9.00000

Cause Rain fall caused levels in combined sewers to crest weir walls and discharge at designated locations per City of Dearborn permit

Dearborn CSO

Start Day	Start Time	End Day	End Time
8/9/2021	2:30:00 PM	8/9/2021	8:14:00 PM

Rain(in.) = 1.44
Waterbody: Rouge River

Submission ID. HPA-VD2C-X35R0
Permit MI0025542
Outfall 1

Dilute Raw Sewage (MG)
1.24000

Cause Rain fall caused combined sewers to over flow weir walls at designated sites and discharge to the Rouge River per city of Dearborn permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
8/9/2021	2:30:00 PM	8/9/2021	8:14:00 PM

Rain(in.) = 1.44
Waterbody: Rouge River

Submission ID. HPA-VD2C-X35R0
Permit MI0025542
Outfall 13

Dilute Raw Sewage (MG)
9.99000

Cause Rain fall caused combined sewers to over flow weir walls at designated sites and discharge to the Rouge River per city of Dearborn permit.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
8/9/2021	2:30:00 PM	8/9/2021	8:14:00 PM

Rain(in.) = 1.44
Waterbody: Rouge River

Submission ID. HPA-VD2C-X35R0
Permit MI0025542
Outfall **14**

Dilute Raw Sewage (MG)
8.08000

Cause Rain fall caused combined sewers to over flow weir walls at designated sites and discharge to the Rouge River per city of Dearborn permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
8/9/2021	2:30:00 PM	8/9/2021	8:14:00 PM

Rain(in.) = 1.44
Waterbody: Rouge River

Submission ID. HPA-VD2C-X35R0
Permit MI0025542
Outfall **2**

Dilute Raw Sewage (MG)
0.05000

Cause Rain fall caused combined sewers to over flow weir walls at designated sites and discharge to the Rouge River per city of Dearborn permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
8/9/2021	2:30:00 PM	8/9/2021	8:14:00 PM

Rain(in.) = 1.44
Waterbody: Rouge River

Submission ID. HPA-VD2C-X35R0
Permit MI0025542
Outfall **3**

Dilute Raw Sewage (MG)
4.47000

Cause Rain fall caused combined sewers to over flow weir walls at designated sites and discharge to the Rouge River per city of Dearborn permit.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
8/9/2021	2:30:00 PM	8/9/2021	8:14:00 PM

Rain(in.) = 1.44
Waterbody: Rouge River

Submission ID. HPA-VD2C-X35R0
Permit MI0025542
Outfall **4**

Dilute Raw Sewage (MG)
3.11000

Cause Rain fall caused combined sewers to over flow weir walls at designated sites and discharge to the Rouge River per city of Dearborn permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
8/11/2021	4:05:00 PM	8/12/2021	10:22:00 AM

Rain(in.) = 3.52
Waterbody: Rouge River

Submission ID. HPA-X0SF-F8P3B
Permit MI0025542
Outfall **1**

Dilute Raw Sewage (MG)
5.91000

Cause Rain fall caused combined sewer to over flow weir walls at designated sites to the Rouge River per city of Dearborn permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
8/11/2021	4:05:00 PM	8/12/2021	10:22:00 AM

Rain(in.) = 3.52
Waterbody: Rouge River

Submission ID. HPA-X0SF-F8P3B
Permit MI0025542
Outfall **13**

Dilute Raw Sewage (MG)
36.28000

Cause Rain fall caused combined sewer to over flow weir walls at designated sites to the Rouge River per city of Dearborn permit.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
8/11/2021	4:05:00 PM	8/12/2021	10:22:00 AM

Rain(in.) = 3.52
Waterbody: Rouge River

Submission ID. HPA-X0SF-F8P3B
Permit MI0025542
Outfall **14**

Dilute Raw Sewage (MG)
65.53000

Cause Rain fall caused combined sewer to over flow weir walls at designated sites to the Rouge River per city of Dearborn permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
8/11/2021	4:05:00 PM	8/12/2021	10:22:00 AM

Rain(in.) = 3.52
Waterbody: Rouge River

Submission ID. HPA-X0SF-F8P3B
Permit MI0025542
Outfall **2**

Dilute Raw Sewage (MG)
0.67000

Cause Rain fall caused combined sewer to over flow weir walls at designated sites to the Rouge River per city of Dearborn permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
8/11/2021	4:05:00 PM	8/12/2021	10:22:00 AM

Rain(in.) = 3.52
Waterbody: Rouge River

Submission ID. HPA-X0SF-F8P3B
Permit MI0025542
Outfall **3**

Dilute Raw Sewage (MG)
13.08000

Cause Rain fall caused combined sewer to over flow weir walls at designated sites to the Rouge River per city of Dearborn permit.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
8/11/2021	4:05:00 PM	8/12/2021	10:22:00 AM

Rain(in.) = 3.52
Waterbody: Rouge River

Submission ID. HPA-X0SF-F8P3B
Permit MI0025542
Outfall **4**

Dilute Raw Sewage (MG)
12.95000

Cause Rain fall caused combined sewer to over flow weir walls at designated sites to the Rouge River per city of Dearborn permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
8/24/2021	7:38:00 PM	8/24/2021	11:41:00 PM

Rain(in.) = 0.62
Waterbody: Rouge River

Submission ID. HPB-7BR4-H3MZ1
Permit MI0025542
Outfall **1**

Dilute Raw Sewage (MG)
0.31000

Cause Rain fall caused combined sewers to overflow weir walls, at designated sites per the city of Dearborn permit, to the Rouge River.

Dearborn CSO

Start Day	Start Time	End Day	End Time
8/24/2021	7:38:00 PM	8/24/2021	11:41:00 PM

Rain(in.) = 0.62
Waterbody: Rouge River

Submission ID. HPB-7BR4-H3MZ1
Permit MI0025542
Outfall **13**

Dilute Raw Sewage (MG)
3.08000

Cause Rain fall caused combined sewers to overflow weir walls, at designated sites per the city of Dearborn permit, to the Rouge River.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
8/24/2021	7:38:00 PM	8/24/2021	11:41:00 PM

Rain(in.) = 0.62
Waterbody: Rouge River

Submission ID. HPB-7BR4-H3MZ1
Permit MI0025542
Outfall **14**

Dilute Raw Sewage (MG)
0.56000

Cause Rain fall caused combined sewers to overflow weir walls, at designated sites per the city of Dearborn permit, to the Rouge River.

Dearborn CSO

Start Day	Start Time	End Day	End Time
8/24/2021	7:38:00 PM	8/24/2021	11:41:00 PM

Rain(in.) = 0.62
Waterbody: Rouge River

Submission ID. HPB-7BR4-H3MZ1
Permit MI0025542
Outfall **2**

Dilute Raw Sewage (MG)
0.01000

Cause Rain fall caused combined sewers to overflow weir walls, at designated sites per the city of Dearborn permit, to the Rouge River.

Dearborn CSO

Start Day	Start Time	End Day	End Time
8/24/2021	7:38:00 PM	8/24/2021	11:41:00 PM

Rain(in.) = 0.62
Waterbody: Rouge River

Submission ID. HPB-7BR4-H3MZ1
Permit MI0025542
Outfall **3**

Dilute Raw Sewage (MG)
1.55000

Cause Rain fall caused combined sewers to overflow weir walls, at designated sites per the city of Dearborn permit, to the Rouge River.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
8/24/2021	7:38:00 PM	8/24/2021	11:41:00 PM

Rain(in.) = 0.62
Waterbody: Rouge River

Submission ID. HPB-7BR4-H3MZ1
Permit MI0025542
Outfall **4**

Dilute Raw Sewage (MG)
0.56000

Cause Rain fall caused combined sewers to overflow weir walls, at designated sites per the city of Dearborn permit, to the Rouge River.

Dearborn CSO

Start Day	Start Time	End Day	End Time
8/27/2021	12:55:00 PM	8/27/2021	3:23:00 PM

Rain(in.) = 1.04
Waterbody: Rouge River

Submission ID. HPB-9J1H-HJ9DT
Permit MI0025542
Outfall **1**

Dilute Raw Sewage (MG)
0.72000

Cause Rainfall caused combined sewers to overflow weir walls at designed sites per City of Dearborn Permit

Dearborn CSO

Start Day	Start Time	End Day	End Time
8/27/2021	12:55:00 PM	8/27/2021	3:23:00 PM

Rain(in.) = 1.04
Waterbody: Rouge River

Submission ID. HPB-9J1H-HJ9DT
Permit MI0025542
Outfall **13**

Dilute Raw Sewage (MG)
6.37000

Cause Rainfall caused combined sewers to overflow weir walls at designed sites per City of Dearborn Permit

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
8/27/2021	12:55:00 PM	8/27/2021	3:23:00 PM

Rain(in.) = 1.04
Waterbody: Rouge River

Dilute Raw Sewage (MG)
3.35000

Cause Rainfall caused combined sewers to overflow weir walls at designed sites per City of Dearborn Permit

Submission ID. HPB-9J1H-HJ9DT
Permit MI0025542
Outfall **14**

Dearborn CSO

Start Day	Start Time	End Day	End Time
8/27/2021	12:55:00 PM	8/27/2021	3:23:00 PM

Rain(in.) = 1.04
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.01000

Cause Rainfall caused combined sewers to overflow weir walls at designed sites per City of Dearborn Permit

Submission ID. HPB-9J1H-HJ9DT
Permit MI0025542
Outfall **2**

Dearborn CSO

Start Day	Start Time	End Day	End Time
8/27/2021	12:55:00 PM	8/27/2021	3:23:00 PM

Rain(in.) = 1.04
Waterbody: Rouge River

Dilute Raw Sewage (MG)
3.01000

Cause Rainfall caused combined sewers to overflow weir walls at designed sites per City of Dearborn Permit

Submission ID. HPB-9J1H-HJ9DT
Permit MI0025542
Outfall **3**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
8/27/2021	12:55:00 PM	8/27/2021	3:23:00 PM

Rain(in.) = 1.04
Waterbody: Rouge River

Dilute Raw Sewage (MG)
1.77000

Cause Rainfall caused combined sewers to overflow weir walls at designed sites per City of Dearborn Permit

Submission ID. HPB-9J1H-HJ9DT
Permit MI0025542
Outfall **4**

Dearborn CSO

Start Day	Start Time	End Day	End Time
8/29/2021	7:41:00 PM	8/30/2021	12:15:00 AM

Rain(in.) = 0.37
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.12000

Cause Rain fall caused combined sewer to overflow weir walls to Rouge River, per city of Dearborn permit.

Submission ID. HPB-B9GE-V0FC9
Permit MI0025542
Outfall **1**

Dearborn CSO

Start Day	Start Time	End Day	End Time
8/29/2021	7:41:00 PM	8/30/2021	12:15:00 AM

Rain(in.) = 0.37
Waterbody: Rouge River

Dilute Raw Sewage (MG)
1.36000

Cause Rain fall caused combined sewer to overflow weir walls to Rouge River, per city of Dearborn permit.

Submission ID. HPB-B9GE-V0FC9
Permit MI0025542
Outfall **13**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
8/29/2021	7:41:00 PM	8/30/2021	12:15:00 AM

Rain(in.) = 0.37
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.72000

Cause Rain fall caused combined sewer to overflow weir walls to Rouge River, per city of Dearborn permit.

Submission ID. HPB-B9GE-V0FC9
Permit MI0025542
Outfall **3**

Dearborn CSO

Start Day	Start Time	End Day	End Time
9/7/2021	9:13:00 PM	9/8/2021	4:51:00 AM

Rain(in.) = 0.56
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.26000

Cause Rain fall causes combined sewers to overflow weir walls at designated sites, per city of Dearborn permit.

Submission ID. HPB-JDBJ-JCKQT
Permit MI0025542
Outfall **1**

Dearborn CSO

Start Day	Start Time	End Day	End Time
9/7/2021	9:13:00 PM	9/8/2021	4:51:00 AM

Rain(in.) = 0.56
Waterbody: Rouge River

Dilute Raw Sewage (MG)
2.65000

Cause Rain fall causes combined sewers to overflow weir walls at designated sites, per city of Dearborn permit.

Submission ID. HPB-JDBJ-JCKQT
Permit MI0025542
Outfall **13**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
9/7/2021	9:13:00 PM	9/8/2021	4:51:00 AM

Rain(in.) = 0.56
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.35000

Cause Rain fall causes combined sewers to overflow weir walls at designated sites, per city of Dearborn permit.

Submission ID. HPB-JDBJ-JCKQT
Permit MI0025542
Outfall **14**

Dearborn CSO

Start Day	Start Time	End Day	End Time
9/7/2021	9:13:00 PM	9/8/2021	4:51:00 AM

Rain(in.) = 0.56
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.01000

Cause Rain fall causes combined sewers to overflow weir walls at designated sites, per city of Dearborn permit.

Submission ID. HPB-JDBJ-JCKQT
Permit MI0025542
Outfall **2**

Dearborn CSO

Start Day	Start Time	End Day	End Time
9/7/2021	9:13:00 PM	9/8/2021	4:51:00 AM

Rain(in.) = 0.56
Waterbody: Rouge River

Dilute Raw Sewage (MG)
1.35000

Cause Rain fall causes combined sewers to overflow weir walls at designated sites, per city of Dearborn permit.

Submission ID. HPB-JDBJ-JCKQT
Permit MI0025542
Outfall **3**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
9/7/2021	9:13:00 PM	9/8/2021	4:51:00 AM

Rain(in.) = 0.56
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.40000

Cause Rain fall causes combined sewers to overflow weir walls at designated sites, per city of Dearborn permit.

Submission ID. HPB-JDBJ-JCKQT
Permit MI0025542
Outfall **4**

Dearborn CSO

Start Day	Start Time	End Day	End Time
9/14/2021	8:28:00 PM	9/14/2021	9:47:00 PM

Rain(in.) = 0.73
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.40000

Cause Rain fall caused combined sewers to overflow weir walls at designated sites per city of Dearborn Permit.

Submission ID. HPB-QXXA-T2QQP
Permit MI0025542
Outfall **1**

Dearborn CSO

Start Day	Start Time	End Day	End Time
9/14/2021	8:28:00 PM	9/14/2021	9:47:00 PM

Rain(in.) = 0.73
Waterbody: Rouge River

Dilute Raw Sewage (MG)
3.89000

Cause Rain fall caused combined sewers to overflow weir walls at designated sites per city of Dearborn Permit.

Submission ID. HPB-QXXA-T2QQP
Permit MI0025542
Outfall **13**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
9/14/2021	8:28:00 PM	9/14/2021	9:47:00 PM

Rain(in.) = 0.73
Waterbody: Rouge River

Dilute Raw Sewage (MG)
1.07000

Submission ID. HPB-QXXA-T2QQP
Permit MI0025542
Outfall **14**

Cause Rain fall caused combined sewers to overflow weir walls at designated sites per city of Dearborn Permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
9/14/2021	8:28:00 PM	9/14/2021	9:47:00 PM

Rain(in.) = 0.73
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.01000

Submission ID. HPB-QXXA-T2QQP
Permit MI0025542
Outfall **2**

Cause Rain fall caused combined sewers to overflow weir walls at designated sites per city of Dearborn Permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
9/14/2021	8:28:00 PM	9/14/2021	9:47:00 PM

Rain(in.) = 0.73
Waterbody: Rouge River

Dilute Raw Sewage (MG)
1.93000

Submission ID. HPB-QXXA-T2QQP
Permit MI0025542
Outfall **3**

Cause Rain fall caused combined sewers to overflow weir walls at designated sites per city of Dearborn Permit.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
9/14/2021	8:28:00 PM	9/14/2021	9:47:00 PM

Rain(in.) = 0.73
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.86000

Cause Rain fall caused combined sewers to overflow weir walls at designated sites per city of Dearborn Permit.

Submission ID. HPB-QXXA-T2QQP
Permit MI0025542
Outfall **4**

Dearborn CSO

Start Day	Start Time	End Day	End Time
9/21/2021	8:03:00 PM	9/23/2021	8:31:00 PM

Rain(in.) = 4.97
Waterbody: Rouge River

Dilute Raw Sewage (MG)
11.12000

Cause Rain fall caused combined sewers to overflow weir walls at designated sites per city of Dearborn permit.

Submission ID. HPB-XC4P-RRT2V
Permit MI0025542
Outfall **1**

Dearborn CSO

Start Day	Start Time	End Day	End Time
9/21/2021	8:03:00 PM	9/23/2021	8:31:00 PM

Rain(in.) = 4.97
Waterbody: Rouge River

Dilute Raw Sewage (MG)
62.06000

Cause Rain fall caused combined sewers to overflow weir walls at designated sites per city of Dearborn permit.

Submission ID. HPB-XC4P-RRT2V
Permit MI0025542
Outfall **13**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
9/21/2021	8:03:00 PM	9/23/2021	8:31:00 PM

Rain(in.) = 4.97
Waterbody: Rouge River

Dilute Raw Sewage (MG)
62.06000

Cause Rain fall caused combined sewers to overflow weir walls at designated sites per city of Dearborn permit.

Submission ID. HPB-XC4P-RRT2V
Permit MI0025542
Outfall **14**

Dearborn CSO

Start Day	Start Time	End Day	End Time
9/21/2021	8:03:00 PM	9/23/2021	8:31:00 PM

Rain(in.) = 4.97
Waterbody: Rouge River

Dilute Raw Sewage (MG)
20.10000

Cause Rain fall caused combined sewers to overflow weir walls at designated sites per city of Dearborn permit.

Submission ID. HPB-XC4P-RRT2V
Permit MI0025542
Outfall **3**

Dearborn CSO

Start Day	Start Time	End Day	End Time
9/21/2021	8:03:00 PM	9/23/2021	8:31:00 PM

Rain(in.) = 4.97
Waterbody: Rouge River

Dilute Raw Sewage (MG)
22.67000

Cause Rain fall caused combined sewers to overflow weir walls at designated sites per city of Dearborn permit.

Submission ID. HPB-XC4P-RRT2V
Permit MI0025542
Outfall **4**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Submission ID. HPC-09XS-A7H42

Start Day	Start Time	End Day	End Time
9/25/2021	10:51:00 AM	9/25/2021	12:06:00 PM

Rain(in.) = 0.17
Waterbody: Rouge River

Outfall **1**

Dilute Raw Sewage (MG)
0.01000

Cause Rainfall caused combined sewers to overflow weir walls at designated sites per city permit

Dearborn CSO

Submission ID. HPC-09XS-A7H42

Start Day	Start Time	End Day	End Time
9/25/2021	10:51:00 AM	9/25/2021	12:06:00 PM

Rain(in.) = 0.17
Waterbody: Rouge River

Outfall **13**

Dilute Raw Sewage (MG)
0.12000

Cause Rainfall caused combined sewers to overflow weir walls at designated sites per city permit

Dearborn CSO

Submission ID. HPC-09XS-A7H42

Start Day	Start Time	End Day	End Time
9/25/2021	10:51:00 AM	9/25/2021	12:06:00 PM

Rain(in.) = 0.17
Waterbody: Rouge River

Outfall **3**

Dilute Raw Sewage (MG)
0.06000

Cause Rainfall caused combined sewers to overflow weir walls at designated sites per city permit

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
10/2/2021	11:44:00 PM	10/3/2021	9:19:00 AM

Rain(in.) = 0.57
Waterbody: Rouge River

Submission ID. HPC-65PG-45D0X
Permit MI0025542
Outfall **1**

Dilute Raw Sewage (MG)
0.27000

Cause Rain water in combined sewers caused levels to crest weir walls and discharge at designated spill points per city permit

Dearborn CSO

Start Day	Start Time	End Day	End Time
10/2/2021	11:44:00 PM	10/3/2021	9:19:00 AM

Rain(in.) = 0.57
Waterbody: Rouge River

Submission ID. HPC-65PG-45D0X
Permit MI0025542
Outfall **13**

Dilute Raw Sewage (MG)
2.72000

Cause Rain water in combined sewers caused levels to crest weir walls and discharge at designated spill points per city permit

Dearborn CSO

Start Day	Start Time	End Day	End Time
10/2/2021	11:44:00 PM	10/3/2021	9:19:00 AM

Rain(in.) = 0.57
Waterbody: Rouge River

Submission ID. HPC-65PG-45D0X
Permit MI0025542
Outfall **14**

Dilute Raw Sewage (MG)
0.38000

Cause Rain water in combined sewers caused levels to crest weir walls and discharge at designated spill points per city permit

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
10/2/2021	11:44:00 PM	10/3/2021	9:19:00 AM

Rain(in.) = 0.57
Waterbody: Rouge River

Submission ID. HPC-65PG-45D0X
Permit MI0025542
Outfall **3**

Dilute Raw Sewage (MG)
1.38000

Cause Rain water in combined sewers caused levels to crest weir walls and discharge at designated spill points per city permit

Dearborn CSO

Start Day	Start Time	End Day	End Time
10/2/2021	11:44:00 PM	10/3/2021	9:19:00 AM

Rain(in.) = 0.57
Waterbody: Rouge River

Submission ID. HPC-65PG-45D0X
Permit MI0025542
Outfall **4**

Dilute Raw Sewage (MG)
0.43000

Cause Rain water in combined sewers caused levels to crest weir walls and discharge at designated spill points per city permit

Dearborn CSO

Start Day	Start Time	End Day	End Time
10/8/2021	1:53:00 PM	10/8/2021	3:07:00 PM

Rain(in.) = 0.22
Waterbody: Rouge River

Submission ID. HPC-AJ49-DKYTP
Permit MI0025542
Outfall **1**

Dilute Raw Sewage (MG)
0.03000

Cause Rain water in combined sewers caused levels to crest weir walls and spill to river at designated points per city permit

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
10/8/2021	1:53:00 PM	10/8/2021	3:07:00 PM

Rain(in.) = 0.22
Waterbody: Rouge River

Submission ID. HPC-AJ49-DKYTP
Permit MI0025542
Outfall **13**

Dilute Raw Sewage (MG)
0.03000

Cause Rain water in combined sewers caused levels to crest weir walls and spill to river at designated points per city permit

Dearborn CSO

Start Day	Start Time	End Day	End Time
10/8/2021	1:53:00 PM	10/8/2021	3:07:00 PM

Rain(in.) = 0.22
Waterbody: Rouge River

Submission ID. HPC-AJ49-DKYTP
Permit MI0025542
Outfall **3**

Dilute Raw Sewage (MG)
0.03000

Cause Rain water in combined sewers caused levels to crest weir walls and spill to river at designated points per city permit

Dearborn CSO

Start Day	Start Time	End Day	End Time
10/14/2021	6:40:00 PM	10/16/2021	8:23:00 AM

Rain(in.) = 0.92
Waterbody: Rouge River

Submission ID. HPC-FEHC-9C84K
Permit MI0025542
Outfall **1**

Dilute Raw Sewage (MG)
0.59000

Cause Rain water in combined sewers caused levels to crest weir walls and spill at designated points per city permit.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
10/14/2021	6:40:00 PM	10/16/2021	8:23:00 AM

Rain(in.) = 0.92
Waterbody: Rouge River

Dilute Raw Sewage (MG)
5.38000

Cause Rain water in combined sewers caused levels to crest weir walls and spill at designated points per city permit.

Submission ID. HPC-FEHC-9C84K
Permit MI0025542
Outfall **13**

Dearborn CSO

Start Day	Start Time	End Day	End Time
10/14/2021	6:40:00 PM	10/16/2021	8:23:00 AM

Rain(in.) = 0.92
Waterbody: Rouge River

Dilute Raw Sewage (MG)
2.32000

Cause Rain water in combined sewers caused levels to crest weir walls and spill at designated points per city permit.

Submission ID. HPC-FEHC-9C84K
Permit MI0025542
Outfall **14**

Dearborn CSO

Start Day	Start Time	End Day	End Time
10/14/2021	6:40:00 PM	10/16/2021	8:23:00 AM

Rain(in.) = 0.92
Waterbody: Rouge River

Dilute Raw Sewage (MG)
2.59000

Cause Rain water in combined sewers caused levels to crest weir walls and spill at designated points per city permit.

Submission ID. HPC-FEHC-9C84K
Permit MI0025542
Outfall **3**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
10/14/2021	6:40:00 PM	10/16/2021	8:23:00 AM

Rain(in.) = 0.92
Waterbody: Rouge River

Dilute Raw Sewage (MG)
1.40000

Cause Rain water in combined sewers caused levels to crest weir walls and spill at designated points per city permit.

Submission ID. HPC-FEHC-9C84K
Permit MI0025542
Outfall **4**

Dearborn CSO

Start Day	Start Time	End Day	End Time
10/21/2021	7:04:00 AM	10/21/2021	10:02:00 AM

Rain(in.) = 0.32
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.09000

Cause Rain fall caused combined sewers to over flow weir walls at designated sites per city of Dearborn permit.

Submission ID. HPC-MGH0-78BE5
Permit MI0025542
Outfall **1**

Dearborn CSO

Start Day	Start Time	End Day	End Time
10/21/2021	7:04:00 AM	10/21/2021	10:02:00 AM

Rain(in.) = 0.32
Waterbody: Rouge River

Dilute Raw Sewage (MG)
1.04000

Cause Rain fall caused combined sewers to over flow weir walls at designated sites per city of Dearborn permit.

Submission ID. HPC-MGH0-78BE5
Permit MI0025542
Outfall **13**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
10/21/2021	7:04:00 AM	10/21/2021	10:02:00 AM

Rain(in.) = 0.32
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.55000

Cause Rain fall caused combined sewers to over flow weir walls at designated sites per city of Dearborn permit.

Submission ID. HPC-MGH0-78BE5
Permit MI0025542
Outfall **3**

Dearborn CSO

Start Day	Start Time	End Day	End Time
10/24/2021	7:40:00 PM	10/25/2021	10:14:00 PM

Rain(in.) = 2.21
Waterbody: Rouge River

Dilute Raw Sewage (MG)
2.59000

Cause Rain fall in combined sewers caused levels to raise and spill to river at designated sites per city permit

Submission ID. HPC-Q9PJ-GSANY
Permit MI0025542
Outfall **1**

Dearborn CSO

Start Day	Start Time	End Day	End Time
10/24/2021	7:40:00 PM	10/25/2021	10:14:00 PM

Rain(in.) = 2.21
Waterbody: Rouge River

Dilute Raw Sewage (MG)
18.26000

Cause Rain fall in combined sewers caused levels to raise and spill to river at designated sites per city permit

Submission ID. HPC-Q9PJ-GSANY
Permit MI0025542
Outfall **13**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
10/24/2021	7:40:00 PM	10/25/2021	10:14:00 PM

Rain(in.) = 2.21
Waterbody: Rouge River

Dilute Raw Sewage (MG)
22.93000

Cause Rain fall in combined sewers caused levels to raise and spill to river at designated sites per city permit

Submission ID. HPC-Q9PJ-GSANY
Permit MI0025542
Outfall **14**

Dearborn CSO

Start Day	Start Time	End Day	End Time
10/24/2021	7:40:00 PM	10/25/2021	10:14:00 PM

Rain(in.) = 2.21
Waterbody: Rouge River

Dilute Raw Sewage (MG)
7.46000

Cause Rain fall in combined sewers caused levels to raise and spill to river at designated sites per city permit

Submission ID. HPC-Q9PJ-GSANY
Permit MI0025542
Outfall **3**

Dearborn CSO

Start Day	Start Time	End Day	End Time
10/24/2021	7:40:00 PM	10/25/2021	10:14:00 PM

Rain(in.) = 2.21
Waterbody: Rouge River

Dilute Raw Sewage (MG)
6.19000

Cause Rain fall in combined sewers caused levels to raise and spill to river at designated sites per city permit

Submission ID. HPC-Q9PJ-GSANY
Permit MI0025542
Outfall **4**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
10/29/2021	4:03:00 AM	10/30/2021	12:53:00 AM

Rain(in.) = 0.97
Waterbody: Rouge River

Submission ID. HPC-TS7K-3QV0P
Permit MI0025542
Outfall **1**

Dilute Raw Sewage (MG)
0.64000

Cause Rain fall cause combined sewers to overflow weir walls and discharge to Rouge River at designated sites per city of Dearborn Permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
10/29/2021	4:03:00 AM	10/30/2021	12:53:00 AM

Rain(in.) = 0.97
Waterbody: Rouge River

Submission ID. HPC-TS7K-3QV0P
Permit MI0025542
Outfall **13**

Dilute Raw Sewage (MG)
5.79000

Cause Rain fall cause combined sewers to overflow weir walls and discharge to Rouge River at designated sites per city of Dearborn Permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
10/29/2021	4:03:00 AM	10/30/2021	12:53:00 AM

Rain(in.) = 0.97
Waterbody: Rouge River

Submission ID. HPC-TS7K-3QV0P
Permit MI0025542
Outfall **14**

Dilute Raw Sewage (MG)
2.73000

Cause Rain fall cause combined sewers to overflow weir walls and discharge to Rouge River at designated sites per city of Dearborn Permit.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
10/29/2021	4:03:00 AM	10/30/2021	12:53:00 AM

Rain(in.) = 0.97
Waterbody: Rouge River

Submission ID. HPC-TS7K-3QV0P
Permit MI0025542
Outfall **3**

Dilute Raw Sewage (MG)
2.77000

Cause Rain fall cause combined sewers to overflow weir walls and discharge to Rouge River at designated sites per city of Dearborn Permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
10/29/2021	4:03:00 AM	10/30/2021	12:53:00 AM

Rain(in.) = 0.97
Waterbody: Rouge River

Submission ID. HPC-TS7K-3QV0P
Permit MI0025542
Outfall **4**

Dilute Raw Sewage (MG)
1.56000

Cause Rain fall cause combined sewers to overflow weir walls and discharge to Rouge River at designated sites per city of Dearborn Permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
11/11/2021	6:54:00 PM	11/11/2021	9:57:00 PM

Rain(in.) = 0.43
Waterbody: Rouge River

Submission ID. HPD-5EC4-JAE93
Permit MI0025542
Outfall **1**

Dilute Raw Sewage (MG)
0.16000

Cause Rain fall caused combined sewers to overflow weir walls at designated sites per city of Dearborn permit and discharge to Rouge River.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
11/11/2021	6:54:00 PM	11/11/2021	9:57:00 PM

Rain(in.) = 0.43
Waterbody: Rouge River

Submission ID. HPD-5EC4-JAE93
Permit MI0025542
Outfall **13**

Dilute Raw Sewage (MG)
1.76000

Cause Rain fall caused combined sewers to overflow weir walls at designated sites per city of Dearborn permit and discharge to Rouge River.

Dearborn CSO

Start Day	Start Time	End Day	End Time
11/11/2021	6:54:00 PM	11/11/2021	9:57:00 PM

Rain(in.) = 0.43
Waterbody: Rouge River

Submission ID. HPD-5EC4-JAE93
Permit MI0025542
Outfall **14**

Dilute Raw Sewage (MG)
0.04000

Cause Rain fall caused combined sewers to overflow weir walls at designated sites per city of Dearborn permit and discharge to Rouge River.

Dearborn CSO

Start Day	Start Time	End Day	End Time
11/11/2021	6:54:00 PM	11/11/2021	9:57:00 PM

Rain(in.) = 0.43
Waterbody: Rouge River

Submission ID. HPD-5EC4-JAE93
Permit MI0025542
Outfall **3**

Dilute Raw Sewage (MG)
0.91000

Cause Rain fall caused combined sewers to overflow weir walls at designated sites per city of Dearborn permit and discharge to Rouge River.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
11/11/2021	6:54:00 PM	11/11/2021	9:57:00 PM

Rain(in.) = 0.43
Waterbody: Rouge River

Submission ID. HPD-5EC4-JAE93
Permit MI0025542
Outfall **4**

Dilute Raw Sewage (MG)
0.07000

Cause Rain fall caused combined sewers to overflow weir walls at designated sites per city of Dearborn permit and discharge to Rouge River.

Dearborn CSO

Start Day	Start Time	End Day	End Time
11/17/2021	11:53:00 PM	11/18/2021	12:53:00 AM

Rain(in.) = 0.17
Waterbody: Rouge River

Submission ID. HPD-AJP9-TSG8M
Permit MI0025542
Outfall **1**

Dilute Raw Sewage (MG)
0.01000

Cause Rain fall caused combined sewers to overflow weir walls at designated sites per city of Dearborn permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
11/17/2021	11:53:00 PM	11/18/2021	12:53:00 AM

Rain(in.) = 0.17
Waterbody: Rouge River

Submission ID. HPD-AJP9-TSG8M
Permit MI0025542
Outfall **13**

Dilute Raw Sewage (MG)
0.12000

Cause Rain fall caused combined sewers to overflow weir walls at designated sites per city of Dearborn permit.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
11/17/2021	11:53:00 PM	11/18/2021	12:53:00 AM

Rain(in.) = 0.17
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.06000

Cause Rain fall caused combined sewers to overflow weir walls at designated sites per city of Dearborn permit.

Submission ID. HPD-AJP9-TSG8M
Permit MI0025542
Outfall **3**

Dearborn CSO

Start Day	Start Time	End Day	End Time
11/21/2021	1:55:00 PM	11/21/2021	10:21:00 PM

Rain(in.) = 0.24
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.05000

Cause Rain water in combined sewers crested weir walls and spilled to river at designated points per city permit.

Submission ID. HPD-D6PN-CVH3K
Permit MI0025542
Outfall **1**

Dearborn CSO

Start Day	Start Time	End Day	End Time
11/21/2021	1:55:00 PM	11/21/2021	10:21:00 PM

Rain(in.) = 0.24
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.54000

Cause Rain water in combined sewers crested weir walls and spilled to river at designated points per city permit.

Submission ID. HPD-D6PN-CVH3K
Permit MI0025542
Outfall **13**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
11/21/2021	1:55:00 PM	11/21/2021	10:21:00 PM

Rain(in.) = 0.24
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.29000

Cause Rain water in combined sewers crested weir walls and spilled to river at designated points per city permit.

Submission ID. HPD-D6PN-CVH3K
Permit MI0025542
Outfall **3**

Dearborn CSO

Start Day	Start Time	End Day	End Time
11/25/2021	3:56:00 AM	11/25/2021	6:34:00 PM

Rain(in.) = 0.54
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.24000

Cause Rain fall caused combined sewers to overflow weir walls at designated sites per city of Dearborn permit.

Submission ID. HPD-FYVN-GNCNJ
Permit MI0025542
Outfall **1**

Dearborn CSO

Start Day	Start Time	End Day	End Time
11/25/2021	3:56:00 AM	11/25/2021	6:34:00 PM

Rain(in.) = 0.54
Waterbody: Rouge River

Dilute Raw Sewage (MG)
2.51000

Cause Rain fall caused combined sewers to overflow weir walls at designated sites per city of Dearborn permit.

Submission ID. HPD-FYVN-GNCNJ
Permit MI0025542
Outfall **13**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
11/25/2021	3:56:00 AM	11/25/2021	6:34:00 PM

Rain(in.) = 0.54
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.29000

Submission ID. HPD-FYVN-GNCNJ
Permit MI0025542
Outfall **14**

Cause Rain fall caused combined sewers to overflow weir walls at designated sites per city of Dearborn permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
11/25/2021	3:56:00 AM	11/25/2021	6:34:00 PM

Rain(in.) = 0.54
Waterbody: Rouge River

Dilute Raw Sewage (MG)
1.28000

Submission ID. HPD-FYVN-GNCNJ
Permit MI0025542
Outfall **3**

Cause Rain fall caused combined sewers to overflow weir walls at designated sites per city of Dearborn permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
11/25/2021	3:56:00 AM	11/25/2021	6:34:00 PM

Rain(in.) = 0.54
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.35000

Submission ID. HPD-FYVN-GNCNJ
Permit MI0025542
Outfall **4**

Cause Rain fall caused combined sewers to overflow weir walls at designated sites per city of Dearborn permit.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
12/5/2021	6:08:00 PM	12/6/2021	1:45:00 AM

Rain(in.) = 0.52
Waterbody: Rouge River

Submission ID. HPD-RW26-4HB7M
Permit MI0025542
Outfall **1**

Dilute Raw Sewage (MG)
0.23000

Cause Rain fall caused combined sewers to overflow weir walls and discharge to the Rouge River per city of Dearborn permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
12/5/2021	6:08:00 PM	12/6/2021	1:45:00 AM

Rain(in.) = 0.52
Waterbody: Rouge River

Submission ID. HPD-RW26-4HB7M
Permit MI0025542
Outfall **13**

Dilute Raw Sewage (MG)
2.37000

Cause Rain fall caused combined sewers to overflow weir walls and discharge to the Rouge River per city of Dearborn permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
12/5/2021	6:08:00 PM	12/6/2021	1:45:00 AM

Rain(in.) = 0.52
Waterbody: Rouge River

Submission ID. HPD-RW26-4HB7M
Permit MI0025542
Outfall **14**

Dilute Raw Sewage (MG)
0.23000

Cause Rain fall caused combined sewers to overflow weir walls and discharge to the Rouge River per city of Dearborn permit.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
12/5/2021	6:08:00 PM	12/6/2021	1:45:00 AM

Rain(in.) = 0.52
Waterbody: Rouge River

Submission ID. HPD-RW26-4HB7M
Permit MI0025542
Outfall **3**

Dilute Raw Sewage (MG)
1.21000

Cause Rain fall caused combined sewers to overflow weir walls and discharge to the Rouge River per city of Dearborn permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
12/5/2021	6:08:00 PM	12/6/2021	1:45:00 AM

Rain(in.) = 0.52
Waterbody: Rouge River

Submission ID. HPD-RW26-4HB7M
Permit MI0025542
Outfall **4**

Dilute Raw Sewage (MG)
0.30000

Cause Rain fall caused combined sewers to overflow weir walls and discharge to the Rouge River per city of Dearborn permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
12/10/2021	9:39:00 PM	12/11/2021	4:29:00 AM

Rain(in.) = 1.29
Waterbody: Rouge River

Submission ID. HPD-WC7R-53Z8V
Permit MI0025542
Outfall **1**

Dilute Raw Sewage (MG)
1.03000

Cause Rainfall in combined sewers crested weir walls and spilled at designated areas per city permit

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
12/10/2021	9:39:00 PM	12/11/2021	4:29:00 AM

Rain(in.) = 1.29
Waterbody: Rouge River

Dilute Raw Sewage (MG)
8.58000

Cause Rainfall in combined sewers crested weir walls and spilled at designated areas per city permit

Submission ID. HPD-WC7R-53Z8V
Permit MI0025542
Outfall **13**

Dearborn CSO

Start Day	Start Time	End Day	End Time
12/10/2021	9:39:00 PM	12/11/2021	4:29:00 AM

Rain(in.) = 1.29
Waterbody: Rouge River

Dilute Raw Sewage (MG)
6.07000

Cause Rainfall in combined sewers crested weir walls and spilled at designated areas per city permit

Submission ID. HPD-WC7R-53Z8V
Permit MI0025542
Outfall **14**

Dearborn CSO

Start Day	Start Time	End Day	End Time
12/10/2021	9:39:00 PM	12/11/2021	4:29:00 AM

Rain(in.) = 1.29
Waterbody: Rouge River

Dilute Raw Sewage (MG)
3.92000

Cause Rainfall in combined sewers crested weir walls and spilled at designated areas per city permit

Submission ID. HPD-WC7R-53Z8V
Permit MI0025542
Outfall **3**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
12/10/2021	9:39:00 PM	12/11/2021	4:29:00 AM

Rain(in.) = 1.29
Waterbody: Rouge River

Dilute Raw Sewage (MG)
2.59000

Cause Rainfall in combined sewers crested weir walls and spilled at designated areas per city permit

Submission ID. HPD-WC7R-53Z8V
Permit MI0025542
Outfall **4**

Dearborn CSO

Start Day	Start Time	End Day	End Time
12/25/2021	3:07:00 AM	12/25/2021	1:10:00 PM

Rain(in.) = 0.56
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.26000

Cause Rain fall caused combined sewers to overflow weir walls at designated sites per city of Dearborn Permit.

Submission ID. HPE-7GNC-4APX7
Permit MI0025542
Outfall **1**

Dearborn CSO

Start Day	Start Time	End Day	End Time
12/25/2021	3:07:00 AM	12/25/2021	1:10:00 PM

Rain(in.) = 0.56
Waterbody: Rouge River

Dilute Raw Sewage (MG)
2.65000

Cause Rain fall caused combined sewers to overflow weir walls at designated sites per city of Dearborn Permit.

Submission ID. HPE-7GNC-4APX7
Permit MI0025542
Outfall **13**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
12/25/2021	3:07:00 AM	12/25/2021	1:10:00 PM

Rain(in.) = 0.56
Waterbody: Rouge River

Submission ID. HPE-7GNC-4APX7
Permit MI0025542
Outfall **14**

Dilute Raw Sewage (MG)
0.35000

Cause Rain fall caused combined sewers to overflow weir walls at designated sites per city of Dearborn Permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time
12/25/2021	3:07:00 AM	12/25/2021	1:10:00 PM

Rain(in.) = 0.56
Waterbody: Rouge River

Submission ID. HPE-7GNC-4APX7
Permit MI0025542
Outfall **3**

Dilute Raw Sewage (MG)
1.35000

Cause Rain fall caused combined sewers to overflow weir walls at designated sites per city of Dearborn Permit.

Totals Dearborn CSO

Dilute Raw Sewage (MG)
1495.05000

SOC: The NPDES Permit requires elimination of all uncontrolled CSO outfalls by December 31, 2027

EGLE Action: Long-term Control Program being implemented; the Department reissued a permit that recognizes a modified LTCP. The permittee submitted a revised basis of design report in late 2009 followed by a financial capability assessment. The City requested a modified LTCP (and NPDES permit), to extend the construction schedule due to economic hardship. The modified LTCP will 1) correct existing construction issues with some shafts by using sewer separation and/or reconfigured use of shafts, and 2) revise some of the additional shaft projects to sewer separation projects. The Department approved the City's request and issued a schedule in the modified permit requiring elimination of all untreated overflow outfalls by December 31, 2027; several outfalls and the associated overflows have already been eliminated.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

GLWA WRRF

Start Day	Start Time	End Day	End Time
2/23/2021	1:42:00 PM	2/24/2021	4:04:00 PM

Rain(in.) = 0.02
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.16000

Cause Melting Snow

Submission ID. HP6-REF0-5W8XP

Outfall **63**

GLWA WRRF

Start Day	Start Time	End Day	End Time
2/23/2021	2:28:00 PM	2/23/2021	5:47:00 PM

Rain(in.) = 0.02
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.46000

Cause Snow melt

Submission ID. HP6-REF0-5W8XP

Outfall **66**

GLWA WRRF

Start Day	Start Time	End Day	End Time
3/26/2021	12:06:00 AM	3/28/2021	4:17:00 AM

Rain(in.) = 2.1
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.32000

Cause Rain

Submission ID. HP7-G5JP-9EXB9

Outfall **63**

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs..

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP7-G5JP-9EXB9

Start Day	Start Time	End Day	End Time
3/26/2021	12:08:00 AM	3/26/2021	10:05:00 AM

Rain(in.) = 2.1
Waterbody: Rouge River

Outfall **66**

Dilute Raw Sewage (MG)
0.47000

Cause Rain

GLWA WRRF

Submission ID. HP7-G5JP-9EXB9

Start Day	Start Time	End Day	End Time
3/26/2021	12:18:00 AM	3/28/2021	1:17:00 AM

Rain(in.) = 2.1
Waterbody: Rouge River

Outfall **67**

Dilute Raw Sewage (MG)
0.35000

Cause Rain

GLWA WRRF

Submission ID. HP7-G5JP-9EXB9

Start Day	Start Time	End Day	End Time
3/26/2021	1:24:00 AM	3/26/2021	4:36:00 AM

Rain(in.) = 2.1
Waterbody: Rouge River

Outfall **75**

Dilute Raw Sewage (MG)
0.19000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP7-G5JP-9EXB9

Start Day	Start Time	End Day	End Time
3/26/2021	1:27:00 AM	3/26/2021	1:55:00 AM

Rain(in.) = 2.1
Waterbody: Rouge River

Outfall **68**

Dilute Raw Sewage (MG)
0.02000

Cause Rain

GLWA WRRF

Submission ID. HP7-G5JP-9EXB9

Start Day	Start Time	End Day	End Time
3/26/2021	1:36:00 AM	3/28/2021	3:30:00 AM

Rain(in.) = 2.1
Waterbody: Rouge River

Outfall **62**

Dilute Raw Sewage (MG)
1.26000

Cause Rain

GLWA WRRF

Submission ID. HP7-G5JP-9EXB9

Start Day	Start Time	End Day	End Time
3/26/2021	1:37:00 AM	3/26/2021	3:48:00 AM

Rain(in.) = 2.1
Waterbody: Rouge River

Outfall **59**

Dilute Raw Sewage (MG)
2.84000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP7-G5JP-9EXB9

Start Day	Start Time	End Day	End Time
3/26/2021	1:44:00 AM	3/26/2021	5:15:00 AM

Rain(in.) = 2.1
Waterbody: Rouge River

Outfall **74**

Dilute Raw Sewage (MG)
23.64000

Cause Rain

GLWA WRRF

Submission ID. HP7-G5JP-9EXB9

Start Day	Start Time	End Day	End Time
3/26/2021	1:53:00 AM	3/26/2021	4:55:00 AM

Rain(in.) = 2.1
Waterbody: Detroit River

Outfall **7**

Dilute Raw Sewage (MG)
7.88000

Cause Rain

GLWA WRRF

Submission ID. HP7-G5JP-9EXB9

Start Day	Start Time	End Day	End Time
3/26/2021	2:03:00 AM	3/26/2021	4:19:00 AM

Rain(in.) = 2.1
Waterbody: Detroit River

Outfall **16**

Dilute Raw Sewage (MG)
1.51000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP7-G5JP-9EXB9

Start Day	Start Time	End Day	End Time
3/26/2021	2:05:00 AM	3/26/2021	3:34:00 AM

Rain(in.) = 2.1

Waterbody: Detroit River

Outfall **9**

Dilute Raw Sewage (MG)

3.98000

Cause Rain

GLWA WRRF

Submission ID. HP7-G5JP-9EXB9

Start Day	Start Time	End Day	End Time
3/26/2021	2:11:00 AM	3/26/2021	5:45:00 AM

Rain(in.) = 2.1

Waterbody: Detroit River

Outfall **22**

Dilute Raw Sewage (MG)

0.00100

Cause Rain

GLWA WRRF

Submission ID. HP7-G5JP-9EXB9

Start Day	Start Time	End Day	End Time
3/26/2021	2:17:00 AM	3/26/2021	6:21:00 AM

Rain(in.) = 2.1

Waterbody: Rouge River

Outfall **60**

Dilute Raw Sewage (MG)

62.55000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP7-G5JP-9EXB9

Start Day	Start Time	End Day	End Time
3/26/2021	2:20:00 AM	3/26/2021	3:36:00 AM

Rain(in.) = 2.1

Waterbody: Rouge River

Outfall **77**

Dilute Raw Sewage (MG)

0.55000

Cause Rain

GLWA WRRF

Submission ID. HP7-G5JP-9EXB9

Start Day	Start Time	End Day	End Time
3/26/2021	2:20:00 AM	3/26/2021	3:36:00 AM

Rain(in.) = 2.1

Waterbody: Rouge River

Outfall **79**

Dilute Raw Sewage (MG)

0.00100

Cause Rain

GLWA WRRF

Submission ID. HP7-G5JP-9EXB9

Start Day	Start Time	End Day	End Time
3/26/2021	2:27:00 AM	3/26/2021	4:40:00 AM

Rain(in.) = 2.1

Waterbody: Detroit River

Outfall **5**

Dilute Raw Sewage (MG)

0.17000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP7-G5JP-9EXB9

Start Day	Start Time	End Day	End Time
3/26/2021	2:28:00 AM	3/26/2021	5:05:00 AM

Rain(in.) = 2.1
Waterbody: Rouge River

Outfall **61**

Dilute Raw Sewage (MG)
6.62000

Cause Rain

GLWA WRRF

Submission ID. HP7-G5JP-9EXB9

Start Day	Start Time	End Day	End Time
3/26/2021	2:38:00 AM	3/26/2021	2:53:00 AM

Rain(in.) = 2.1
Waterbody: Detroit River

Outfall **19**

Dilute Raw Sewage (MG)
0.65000

Cause Rain

GLWA WRRF

Submission ID. HP7-G5JP-9EXB9

Start Day	Start Time	End Day	End Time
3/26/2021	2:38:00 AM	3/26/2021	3:59:00 AM

Rain(in.) = 2.1
Waterbody: Rouge River

Outfall **64**

Dilute Raw Sewage (MG)
1.65000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP7-G5JP-9EXB9

Start Day	Start Time	End Day	End Time
3/26/2021	2:43:00 AM	3/26/2021	4:08:00 AM

Rain(in.) = 2.1
Waterbody: Rouge River

Outfall **65**

Dilute Raw Sewage (MG)
1.91000

Cause Rain

GLWA WRRF

Submission ID. HP7-G5JP-9EXB9

Start Day	Start Time	End Day	End Time
3/26/2021	2:44:00 AM	3/26/2021	5:35:00 AM

Rain(in.) = 2.1
Waterbody: Detroit River

Outfall **11**

Dilute Raw Sewage (MG)
3.09000

Cause Rain

GLWA WRRF

Submission ID. HP7-G5JP-9EXB9

Start Day	Start Time	End Day	End Time
3/26/2021	2:49:00 AM	3/26/2021	2:54:00 AM

Rain(in.) = 2.1
Waterbody: Detroit River

Outfall **27**

Dilute Raw Sewage (MG)
0.02000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP7-G5JP-9EXB9

Start Day	Start Time	End Day	End Time
3/26/2021	2:52:00 AM	3/26/2021	4:21:00 AM

Rain(in.) = 2.1

Waterbody: Detroit River

Outfall **31**

Dilute Raw Sewage (MG)

4.37000

Cause Rain

GLWA WRRF

Submission ID. HP7-G5JP-9EXB9

Start Day	Start Time	End Day	End Time
3/26/2021	3:00:00 AM	3/28/2021	12:11:00 AM

Rain(in.) = 2.1

Waterbody: Detroit River

Outfall **12**

Dilute Raw Sewage (MG)

0.00100

Cause Rain

GLWA WRRF

Submission ID. HP7-G5JP-9EXB9

Start Day	Start Time	End Day	End Time
3/26/2021	3:21:00 AM	3/26/2021	5:33:00 AM

Rain(in.) = 2.1

Waterbody: Detroit River

Outfall **25**

Dilute Raw Sewage (MG)

64.80000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP7-G5JP-9EXB9

Start Day	Start Time	End Day	End Time
3/26/2021	4:20:00 AM	3/26/2021	7:08:00 AM

Rain(in.) = 2.1

Waterbody: Detroit River

Outfall **6**

Dilute Raw Sewage (MG)

23.23000

Cause Rain

GLWA WRRF

Submission ID. HP7-G5JP-9EXB9

Start Day	Start Time	End Day	End Time
3/26/2021	4:44:00 AM	3/26/2021	5:54:00 AM

Rain(in.) = 2.1

Waterbody: Detroit River

Outfall **38**

Dilute Raw Sewage (MG)

0.00100

Cause Rain

GLWA WRRF

Submission ID. HP7-TXCC-CPP1Z

Start Day	Start Time	End Day	End Time
4/8/2021	3:53:00 PM	4/8/2021	6:20:00 PM

Rain(in.) = 0.28

Waterbody: Rouge River

Outfall **63**

Dilute Raw Sewage (MG)

0.04000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP7-TXCC-CPP1Z

Start Day	Start Time	End Day	End Time
4/8/2021	4:16:00 PM	4/8/2021	4:35:00 PM

Rain(in.) = 0.28
Waterbody: Rouge River

Outfall **59**

Dilute Raw Sewage (MG)
0.43000

Cause Rain

GLWA WRRF

Submission ID. HP7-TXCC-CPP1Z

Start Day	Start Time	End Day	End Time
4/8/2021	5:36:00 PM	4/8/2021	6:10:00 PM

Rain(in.) = 0.28
Waterbody: Rouge River

Outfall **64**

Dilute Raw Sewage (MG)
0.76000

Cause Rain

GLWA WRRF

Submission ID. HP7-WS0Z-CWF99

Start Day	Start Time	End Day	End Time
4/10/2021	8:37:00 PM	4/11/2021	1:58:00 AM

Rain(in.) = 0.66
Waterbody: Rouge River

Outfall **63**

Dilute Raw Sewage (MG)
0.04000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP7-WS0Z-CWF99

Start Day	Start Time	End Day	End Time
4/10/2021	8:45:00 PM	4/11/2021	3:07:00 AM

Rain(in.) = 0.66
Waterbody: Rouge River

Outfall **64**

Dilute Raw Sewage (MG)
0.54000

Cause Rain

GLWA WRRF

Submission ID. HP7-WS0Z-CWF99

Start Day	Start Time	End Day	End Time
4/11/2021	1:26:00 AM	4/11/2021	2:06:00 AM

Rain(in.) = 0.66
Waterbody: Rouge River

Outfall **59**

Dilute Raw Sewage (MG)
0.90000

Cause Rain

GLWA WRRF

Submission ID. HP7-WS0Z-CWF99

Start Day	Start Time	End Day	End Time
4/11/2021	1:30:00 AM	4/11/2021	1:40:00 AM

Rain(in.) = 0.66
Waterbody: Rouge River

Outfall **67**

Dilute Raw Sewage (MG)
0.04000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP7-WS0Z-CWF99

Start Day	Start Time	End Day	End Time
4/11/2021	2:51:00 AM	4/11/2021	2:56:00 AM

Rain(in.) = 0.66
Waterbody: Rouge River

Outfall **79**

Dilute Raw Sewage (MG)
0.06000

Cause Rain

GLWA WRRF

Submission ID. HP9-13YT-084HZ

Start Day	Start Time	End Day	End Time
5/23/2021	4:29:00 PM	5/23/2021	7:30:00 PM

Rain(in.) = 0.3
Waterbody: Rouge River

Outfall **63**

Dilute Raw Sewage (MG)
0.05000

Cause Rain

GLWA WRRF

Submission ID. HP9-13YT-084HZ

Start Day	Start Time	End Day	End Time
5/23/2021	4:37:00 PM	5/23/2021	6:00:00 PM

Rain(in.) = 0.3
Waterbody: Rouge River

Outfall **62**

Dilute Raw Sewage (MG)
0.55000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP9-13YT-084HZ

Start Day	Start Time	End Day	End Time
5/23/2021	5:12:00 PM	5/23/2021	11:10:00 PM

Rain(in.) = 0.3

Waterbody: Rouge River

Outfall **64**

Dilute Raw Sewage (MG)

0.73000

Cause Rain

GLWA WRRF

Submission ID. HP9-13YT-084HZ

Start Day	Start Time	End Day	End Time
5/23/2021	5:18:00 PM	5/23/2021	10:52:00 PM

Rain(in.) = 0.3

Waterbody: Rouge River

Outfall **60**

Dilute Raw Sewage (MG)

31.20000

Cause Rain

GLWA WRRF

Submission ID. HP9-13YT-084HZ

Start Day	Start Time	End Day	End Time
5/23/2021	5:19:00 PM	5/23/2021	5:52:00 PM

Rain(in.) = 0.3

Waterbody: Rouge River

Outfall **67**

Dilute Raw Sewage (MG)

0.15000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP9-13YT-084HZ

Start Day	Start Time	End Day	End Time
5/23/2021	5:24:00 PM	5/23/2021	6:00:00 PM

Rain(in.) = 0.3

Waterbody: Rouge River

Outfall **59**

Dilute Raw Sewage (MG)

0.56000

Cause Rain

GLWA WRRF

Submission ID. HP9-13YT-084HZ

Start Day	Start Time	End Day	End Time
5/23/2021	5:28:00 PM	5/23/2021	5:58:00 PM

Rain(in.) = 0.3

Waterbody: Rouge River

Outfall **79**

Dilute Raw Sewage (MG)

0.09000

Cause Rain

GLWA WRRF

Submission ID. HP9-13YT-084HZ

Start Day	Start Time	End Day	End Time
5/23/2021	5:41:00 PM	5/23/2021	7:01:00 PM

Rain(in.) = 0.3

Waterbody: Rouge River

Outfall **74**

Dilute Raw Sewage (MG)

0.75000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time
5/28/2021	9:27:00 AM	5/28/2021	1:16:00 PM

Rain(in.) = 0.49
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.10000

Cause Rain

Submission ID. HP9-1XRQ-4X0VE

Outfall **63**

GLWA WRRF

Start Day	Start Time	End Day	End Time
5/28/2021	9:51:00 AM	5/28/2021	10:52:00 AM

Rain(in.) = 0.49
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.05000

Cause Rain

Submission ID. HP9-1XRQ-4X0VE

Outfall **67**

GLWA WRRF

Start Day	Start Time	End Day	End Time
5/28/2021	1:31:00 PM	5/28/2021	4:31:00 PM

Rain(in.) = 0.49
Waterbody: Rouge River

Dilute Raw Sewage (MG)
10.00000

Cause Rain

Submission ID. HP9-1XRQ-4X0VE

Outfall **60**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP9-66J3-50FJV

Start Day	Start Time	End Day	End Time
6/2/2021	6:10:00 PM	6/2/2021	6:31:00 PM

Rain(in.) = 0.53
Waterbody: Rouge River

Outfall **63**

Dilute Raw Sewage (MG)
0.01000

Cause Rain

GLWA WRRF

Submission ID. HP9-66J3-50FJV

Start Day	Start Time	End Day	End Time
6/2/2021	6:12:00 PM	6/2/2021	7:32:00 PM

Rain(in.) = 0.53
Waterbody: Rouge River

Outfall **67**

Dilute Raw Sewage (MG)
0.15000

Cause Rain

GLWA WRRF

Submission ID. HP9-66J3-50FJV

Start Day	Start Time	End Day	End Time
6/2/2021	6:42:00 PM	6/2/2021	6:46:00 PM

Rain(in.) = 0.53
Waterbody: Rouge River

Outfall **79**

Dilute Raw Sewage (MG)
0.04000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP9-ATDD-2233N

Start Day	Start Time	End Day	End Time
6/8/2021	2:26:00 PM	6/8/2021	2:48:00 PM

Rain(in.) = 0.37

Waterbody: Detroit River

Outfall **11**

Dilute Raw Sewage (MG)

0.44000

Cause Rain

GLWA WRRF

Submission ID. HP9-ATDD-2233N

Start Day	Start Time	End Day	End Time
6/8/2021	2:46:00 PM	6/8/2021	3:20:00 PM

Rain(in.) = 0.37

Waterbody: Detroit River

Outfall **7**

Dilute Raw Sewage (MG)

0.83000

Cause Rain

GLWA WRRF

Submission ID. HP9-ATDD-2233N

Start Day	Start Time	End Day	End Time
6/8/2021	3:23:00 PM	6/8/2021	4:03:00 PM

Rain(in.) = 0.37

Waterbody: Rouge River

Outfall **75**

Dilute Raw Sewage (MG)

0.06000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP9-ATDD-2233N

Start Day	Start Time	End Day	End Time
6/8/2021	3:23:00 PM	6/8/2021	4:14:00 PM

Rain(in.) = 0.37
Waterbody: Rouge River

Outfall **79**

Dilute Raw Sewage (MG)
1.35000

Cause Rain

GLWA WRRF

Submission ID. HP9-ATDD-2233N

Start Day	Start Time	End Day	End Time
6/8/2021	3:27:00 PM	6/8/2021	3:55:00 PM

Rain(in.) = 0.37
Waterbody: Rouge River

Outfall **64**

Dilute Raw Sewage (MG)
0.34000

Cause Rain

GLWA WRRF

Submission ID. HP9-ATDD-2233N

Start Day	Start Time	End Day	End Time
6/8/2021	3:30:00 PM	6/8/2021	4:15:00 PM

Rain(in.) = 0.37
Waterbody: Rouge River

Outfall **77**

Dilute Raw Sewage (MG)
0.68000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP9-ATDD-2233N

Start Day	Start Time	End Day	End Time
6/8/2021	3:36:00 PM	6/8/2021	4:26:00 PM

Rain(in.) = 0.37
Waterbody: Rouge River

Outfall **74**

Dilute Raw Sewage (MG)
2.14000

Cause Rain

GLWA WRRF

Submission ID. HP9-ATDD-2233N

Start Day	Start Time	End Day	End Time
6/8/2021	4:42:00 PM	6/8/2021	6:22:00 PM

Rain(in.) = 0.37
Waterbody: Detroit River

Outfall **22**

Dilute Raw Sewage (MG)
51.67000

Cause Rain

GLWA WRRF

Submission ID. HP9-JEZ2-FC628

Start Day	Start Time	End Day	End Time
6/18/2021	8:10:00 AM	6/18/2021	8:26:00 AM

Rain(in.) = 0.51
Waterbody: Detroit River

Outfall **27**

Dilute Raw Sewage (MG)
0.41000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP9-JEZ2-FC628

Start Day	Start Time	End Day	End Time
6/18/2021	8:51:00 AM	6/18/2021	8:57:00 AM

Rain(in.) = 0.51
Waterbody: Rouge River

Outfall **67**

Dilute Raw Sewage (MG)
0.03000

Cause Rain

GLWA WRRF

Submission ID. HP9-MBJD-BX0BC

Start Day	Start Time	End Day	End Time
6/20/2021	8:56:00 PM	6/20/2021	9:01:00 PM

Rain(in.) = 1.1
Waterbody: Detroit River

Outfall **27**

Dilute Raw Sewage (MG)
0.01000

Cause Rain

GLWA WRRF

Submission ID. HP9-MBJD-BX0BC

Start Day	Start Time	End Day	End Time
6/20/2021	9:01:00 PM	6/21/2021	12:44:00 AM

Rain(in.) = 1.1
Waterbody: Detroit River

Outfall **11**

Dilute Raw Sewage (MG)
11.56000

Cause Rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs..

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP9-MBJD-BX0BC

Start Day	Start Time	End Day	End Time
6/20/2021	9:01:00 PM	6/21/2021	12:44:00 AM

Rain(in.) = 1.1

Waterbody: Detroit River

Outfall **12**

Dilute Raw Sewage (MG)

0.00100

Cause Rain

GLWA WRRF

Submission ID. HP9-MBJD-BX0BC

Start Day	Start Time	End Day	End Time
6/20/2021	9:08:00 PM	6/20/2021	10:00:00 PM

Rain(in.) = 1.1

Waterbody: Detroit River

Outfall **19**

Dilute Raw Sewage (MG)

2.09000

Cause Rain

GLWA WRRF

Submission ID. HP9-MBJD-BX0BC

Start Day	Start Time	End Day	End Time
6/20/2021	9:10:00 PM	6/20/2021	11:00:00 PM

Rain(in.) = 1.1

Waterbody: Detroit River

Outfall **7**

Dilute Raw Sewage (MG)

5.21000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP9-MBJD-BX0BC

Start Day	Start Time	End Day	End Time
6/20/2021	9:14:00 PM	6/20/2021	11:20:00 PM

Rain(in.) = 1.1

Waterbody: Detroit River

Outfall **16**

Dilute Raw Sewage (MG)

1.10000

Cause Rain

GLWA WRRF

Submission ID. HP9-MBJD-BX0BC

Start Day	Start Time	End Day	End Time
6/20/2021	9:14:00 PM	6/21/2021	7:51:00 AM

Rain(in.) = 1.1

Waterbody: Detroit River

Outfall **22**

Dilute Raw Sewage (MG)

0.00100

Cause Rain

GLWA WRRF

Submission ID. HP9-MBJD-BX0BC

Start Day	Start Time	End Day	End Time
6/20/2021	9:34:00 PM	6/20/2021	9:50:00 PM

Rain(in.) = 1.1

Waterbody: Detroit River

Outfall **18**

Dilute Raw Sewage (MG)

0.00100

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP9-MBJD-BX0BC

Start Day	Start Time	End Day	End Time
6/20/2021	9:38:00 PM	6/21/2021	5:19:00 AM

Rain(in.) = 1.1
Waterbody: Rouge River

Outfall **63**

Dilute Raw Sewage (MG)
0.21000

Cause Rain

GLWA WRRF

Submission ID. HP9-MBJD-BX0BC

Start Day	Start Time	End Day	End Time
6/20/2021	9:39:00 PM	6/20/2021	11:04:00 PM

Rain(in.) = 1.1
Waterbody: Detroit River

Outfall **5**

Dilute Raw Sewage (MG)
0.08000

Cause Rain

GLWA WRRF

Submission ID. HP9-MBJD-BX0BC

Start Day	Start Time	End Day	End Time
6/20/2021	9:39:00 PM	6/21/2021	4:30:00 AM

Rain(in.) = 1.1
Waterbody: Rouge River

Outfall **67**

Dilute Raw Sewage (MG)
0.57000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP9-R8MN-7KGPD

Start Day	Start Time	End Day	End Time
6/20/2021	9:39:00 PM	6/21/2021	4:00:00 AM

Rain(in.) = 1.1
Waterbody: Rouge River

Outfall **68**

Dilute Raw Sewage (MG)
0.18000

Cause Rain

GLWA WRRF

Submission ID. HP9-MBJD-BX0BC

Start Day	Start Time	End Day	End Time
6/20/2021	9:42:00 PM	6/20/2021	9:59:00 PM

Rain(in.) = 1.1
Waterbody: Detroit River

Outfall **31**

Dilute Raw Sewage (MG)
0.61000

Cause Rain

GLWA WRRF

Submission ID. HP9-MBJD-BX0BC

Start Day	Start Time	End Day	End Time
6/20/2021	9:47:00 PM	6/21/2021	12:01:00 AM

Rain(in.) = 1.1
Waterbody: Detroit River

Outfall **25**

Dilute Raw Sewage (MG)
66.64000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP9-MBJD-BX0BC

Start Day	Start Time	End Day	End Time
6/20/2021	9:49:00 PM	6/21/2021	4:49:00 AM

Rain(in.) = 1.1

Waterbody: Rouge River

Outfall **62**

Dilute Raw Sewage (MG)

0.72000

Cause Rain

GLWA WRRF

Submission ID. HP9-MBJD-BX0BC

Start Day	Start Time	End Day	End Time
6/20/2021	9:59:00 PM	6/20/2021	10:51:00 PM

Rain(in.) = 1.1

Waterbody: Detroit River

Outfall **23**

Dilute Raw Sewage (MG)

8.35000

Cause Rain

GLWA WRRF

Submission ID. HP9-R8MN-7KGPD

Start Day	Start Time	End Day	End Time
6/20/2021	10:07:00 PM	6/21/2021	5:09:00 AM

Rain(in.) = 1.1

Waterbody: Rouge River

Outfall **79**

Dilute Raw Sewage (MG)

13.05000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP9-R8MN-7KGPD

Start Day	Start Time	End Day	End Time
6/20/2021	10:18:00 PM	6/21/2021	12:47:00 AM

Rain(in.) = 1.1
Waterbody: Rouge River

Outfall **64**

Dilute Raw Sewage (MG)
1.93000

Cause Rain

GLWA WRRF

Submission ID. HP9-MBJD-BX0BC

Start Day	Start Time	End Day	End Time
6/20/2021	10:20:00 PM	6/20/2021	11:06:00 PM

Rain(in.) = 1.1
Waterbody: Detroit River

Outfall **9**

Dilute Raw Sewage (MG)
2.06000

Cause Rain

GLWA WRRF

Submission ID. HP9-R8MN-7KGPD

Start Day	Start Time	End Day	End Time
6/20/2021	10:30:00 PM	6/21/2021	6:11:00 AM

Rain(in.) = 1.1
Waterbody: Rouge River

Outfall **74**

Dilute Raw Sewage (MG)
13.79000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP9-MBJD-BX0BC

Start Day	Start Time	End Day	End Time
6/21/2021	12:01:00 AM	6/21/2021	5:54:00 AM

Rain(in.) = 1.1

Waterbody: Rouge River

Outfall **60**

Dilute Raw Sewage (MG)

71.91000

Cause Rain

GLWA WRRF

Submission ID. HP9-R8MN-7KGPD

Start Day	Start Time	End Day	End Time
6/21/2021	4:11:00 AM	6/21/2021	5:11:00 AM

Rain(in.) = 1.1

Waterbody: Rouge River

Outfall **77**

Dilute Raw Sewage (MG)

0.35000

Cause Rain

GLWA WRRF

Submission ID. HP9-R8MN-7KGPD

Start Day	Start Time	End Day	End Time
6/21/2021	3:52:00 PM	6/21/2021	5:08:00 AM

Rain(in.) = 1.1

Waterbody: Rouge River

Outfall **75**

Dilute Raw Sewage (MG)

0.11000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP9-XG49-54C72

Start Day	Start Time	End Day	End Time
6/25/2021	9:06:00 AM	6/29/2021	3:05:00 PM

Rain(in.) = 2.52
Waterbody: Rouge River

Outfall **67**

Dilute Raw Sewage (MG)
1.56000

Cause Rain

GLWA WRRF

Submission ID. HP9-XG49-54C72

Start Day	Start Time	End Day	End Time
6/25/2021	9:49:00 AM	6/29/2021	2:16:00 PM

Rain(in.) = 2.52
Waterbody: Rouge River

Outfall **68**

Dilute Raw Sewage (MG)
0.88000

Cause Rain

GLWA WRRF

Submission ID. HP9-XG49-54C72

Start Day	Start Time	End Day	End Time
6/25/2021	9:56:00 AM	6/29/2021	7:06:00 PM

Rain(in.) = 2.52
Waterbody: Rouge River

Outfall **74**

Dilute Raw Sewage (MG)
197.37000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP9-XG49-54C72

Start Day	Start Time	End Day	End Time
6/25/2021	10:03:00 AM	6/29/2021	2:59:00 PM

Rain(in.) = 2.52
Waterbody: Rouge River

Outfall **75**

Dilute Raw Sewage (MG)
0.55000

Cause Rain

GLWA WRRF

Submission ID. HP9-XG49-54C72

Start Day	Start Time	End Day	End Time
6/25/2021	10:04:00 AM	6/29/2021	3:56:00 PM

Rain(in.) = 2.52
Waterbody: Rouge River

Outfall **63**

Dilute Raw Sewage (MG)
0.53000

Cause Rain

GLWA WRRF

Submission ID. HP9-XG49-54C72

Start Day	Start Time	End Day	End Time
6/25/2021	10:06:00 AM	6/29/2021	3:07:00 PM

Rain(in.) = 2.52
Waterbody: Rouge River

Outfall **79**

Dilute Raw Sewage (MG)
20.83000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP9-XG49-54C72

Start Day	Start Time	End Day	End Time
6/25/2021	10:09:00 AM	6/29/2021	2:44:00 PM

Rain(in.) = 2.52
Waterbody: Rouge River

Outfall **62**

Dilute Raw Sewage (MG)
1.92000

Cause Rain

GLWA WRRF

Submission ID. HP9-XG49-54C72

Start Day	Start Time	End Day	End Time
6/25/2021	10:09:00 AM	6/28/2021	8:37:00 PM

Rain(in.) = 2.52
Waterbody: Rouge River

Outfall **77**

Dilute Raw Sewage (MG)
4.04000

Cause Rain

GLWA WRRF

Submission ID. HP9-XG49-54C72

Start Day	Start Time	End Day	End Time
6/25/2021	10:11:00 AM	6/25/2021	11:01:00 AM

Rain(in.) = 2.52
Waterbody: Rouge River

Outfall **59**

Dilute Raw Sewage (MG)
1.11000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP9-XG49-54C72

Start Day	Start Time	End Day	End Time
6/25/2021	10:34:00 AM	6/25/2021	8:20:00 PM

Rain(in.) = 2.52
Waterbody: Rouge River

Outfall **60**

Dilute Raw Sewage (MG)
90.48000

Cause Rain

GLWA WRRF

Submission ID. HP9-XG49-54C72

Start Day	Start Time	End Day	End Time
6/25/2021	10:43:00 AM	6/26/2021	12:26:00 AM

Rain(in.) = 2.52
Waterbody: Rouge River

Outfall **64**

Dilute Raw Sewage (MG)
9.67000

Cause Rain

GLWA WRRF

Submission ID. HP9-XG49-54C72

Start Day	Start Time	End Day	End Time
6/25/2021	10:51:00 AM	6/25/2021	8:00:00 PM

Rain(in.) = 2.52
Waterbody: Rouge River

Outfall **61**

Dilute Raw Sewage (MG)
20.66000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP9-XEJH-X14P7

Start Day	Start Time	End Day	End Time
6/25/2021	6:41:00 PM	6/29/2021	2:46:00 PM

Rain(in.) = 2.52
Waterbody: Detroit River

Outfall **19**

Dilute Raw Sewage (MG)
8.53000

Cause Rain

GLWA WRRF

Submission ID. HP9-XEJH-X14P7

Start Day	Start Time	End Day	End Time
6/25/2021	6:42:00 PM	6/29/2021	2:27:00 PM

Rain(in.) = 2.52
Waterbody: Detroit River

Outfall **11**

Dilute Raw Sewage (MG)
89.81000

Cause Rain

GLWA WRRF

Submission ID. HP9-XG49-54C72

Start Day	Start Time	End Day	End Time
6/25/2021	6:43:00 PM	6/25/2021	7:29:00 PM

Rain(in.) = 2.52
Waterbody: Rouge River

Outfall **69**

Dilute Raw Sewage (MG)
1.81000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP9-XEJH-X14P7

Start Day	Start Time	End Day	End Time
6/25/2021	6:44:00 PM	6/29/2021	3:27:00 PM

Rain(in.) = 2.52
Waterbody: Detroit River

Outfall **7**

Dilute Raw Sewage (MG)
46.91000

Cause Rain

GLWA WRRF

Submission ID. HP9-XEJH-X14P7

Start Day	Start Time	End Day	End Time
6/25/2021	6:45:00 PM	6/26/2021	6:53:00 AM

Rain(in.) = 2.52
Waterbody: Detroit River

Outfall **18**

Dilute Raw Sewage (MG)
0.00100

Cause Rain

GLWA WRRF

Submission ID. HP9-XG49-54C72

Start Day	Start Time	End Day	End Time
6/25/2021	6:46:00 PM	6/26/2021	4:08:00 AM

Rain(in.) = 2.52
Waterbody: Rouge River

Outfall **65**

Dilute Raw Sewage (MG)
78.48000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP9-XEJH-X14P7

Start Day	Start Time	End Day	End Time
6/25/2021	7:22:00 PM	6/26/2021	10:49:00 PM

Rain(in.) = 2.52

Waterbody: Detroit River

Outfall **22**

Dilute Raw Sewage (MG)

339.86000

Cause Rain

GLWA WRRF

Submission ID. HP9-XEJH-X14P7

Start Day	Start Time	End Day	End Time
6/25/2021	7:29:00 PM	6/26/2021	11:05:00 AM

Rain(in.) = 2.52

Waterbody: Detroit River

Outfall **23**

Dilute Raw Sewage (MG)

251.37000

Cause Rain

GLWA WRRF

Submission ID. HP9-XEJH-X14P7

Start Day	Start Time	End Day	End Time
6/25/2021	7:47:00 PM	6/26/2021	8:10:00 PM

Rain(in.) = 2.52

Waterbody: Detroit River

Outfall **25**

Dilute Raw Sewage (MG)

599.99000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP9-XEJH-X14P7

Start Day	Start Time	End Day	End Time
6/25/2021	9:29:00 PM	6/26/2021	9:27:00 AM

Rain(in.) = 2.52
Waterbody: Detroit River

Outfall **9**

Dilute Raw Sewage (MG)
0.00100

Cause Rain

GLWA WRRF

Submission ID. HP9-XEJH-X14P7

Start Day	Start Time	End Day	End Time
6/25/2021	10:02:00 PM	6/26/2021	5:41:00 AM

Rain(in.) = 2.52
Waterbody: Detroit River

Outfall **27**

Dilute Raw Sewage (MG)
10.43000

Cause Rain

GLWA WRRF

Submission ID. HP9-XEJH-X14P7

Start Day	Start Time	End Day	End Time
6/25/2021	10:07:00 PM	6/28/2021	2:48:00 AM

Rain(in.) = 2.52
Waterbody: Detroit River

Outfall **21**

Dilute Raw Sewage (MG)
32.96000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP9-XEJH-X14P7

Start Day	Start Time	End Day	End Time
6/25/2021	10:12:00 PM	6/30/2021	5:55:00 PM

Rain(in.) = 2.52
Waterbody: Detroit River

Outfall **5**

Dilute Raw Sewage (MG)
19.34000

Cause Rain

GLWA WRRF

Submission ID. HP9-XEJH-X14P7

Start Day	Start Time	End Day	End Time
6/25/2021	10:14:00 PM	6/26/2021	6:02:00 AM

Rain(in.) = 2.52
Waterbody: Detroit River

Outfall **32**

Dilute Raw Sewage (MG)
0.00100

Cause Rain

GLWA WRRF

Submission ID. HP9-XG49-54C72

Start Day	Start Time	End Day	End Time
6/25/2021	10:16:00 PM	6/26/2021	7:32:00 AM

Rain(in.) = 2.52
Waterbody: Detroit River

Outfall **43**

Dilute Raw Sewage (MG)
0.00100

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP9-XEJH-X14P7

Start Day	Start Time	End Day	End Time
6/25/2021	10:17:00 PM	6/26/2021	11:53:00 AM

Rain(in.) = 2.52

Waterbody: Detroit River

Outfall **12**

Dilute Raw Sewage (MG)

452.36000

Cause Rain

GLWA WRRF

Submission ID. HP9-XG49-54C72

Start Day	Start Time	End Day	End Time
6/25/2021	10:43:00 PM	6/27/2021	8:06:00 AM

Rain(in.) = 2.52

Waterbody: Detroit River

Outfall **38**

Dilute Raw Sewage (MG)

0.00100

Cause Rain

GLWA WRRF

Submission ID. HP9-XEJH-X14P7

Start Day	Start Time	End Day	End Time
6/25/2021	11:01:00 PM	6/26/2021	4:10:00 AM

Rain(in.) = 2.52

Waterbody: Detroit River

Outfall **34**

Dilute Raw Sewage (MG)

0.00100

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time
6/25/2021	11:07:00 PM	6/28/2021	7:50:00 PM

Rain(in.) = 2.52
Waterbody: Detroit River

Dilute Raw Sewage (MG)
0.00100

Cause Rain

Submission ID. HP9-XEJH-X14P7

Outfall **24**

GLWA WRRF

Start Day	Start Time	End Day	End Time
6/25/2021	11:10:00 PM	6/26/2021	4:33:00 AM

Rain(in.) = 2.52
Waterbody: Detroit River

Dilute Raw Sewage (MG)
2.68000

Cause Rain

Submission ID. HP9-XEJH-X14P7

Outfall **31**

GLWA WRRF

Start Day	Start Time	End Day	End Time
6/25/2021	11:11:00 PM	6/26/2021	2:20:00 AM

Rain(in.) = 2.52
Waterbody: Detroit River

Dilute Raw Sewage (MG)
1.68000

Cause Rain

Submission ID. HP9-XEJH-X14P7

Outfall **29**

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs..

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP9-XEJH-X14P7

Start Day	Start Time	End Day	End Time
6/25/2021	11:17:00 PM	6/26/2021	1:19:00 AM

Rain(in.) = 2.52

Waterbody: Detroit River

Outfall **30**

Dilute Raw Sewage (MG)

2.43000

Cause Rain

GLWA WRRF

Submission ID. HP9-XEJH-X14P7

Start Day	Start Time	End Day	End Time
6/25/2021	11:27:00 PM	6/26/2021	1:56:00 AM

Rain(in.) = 2.52

Waterbody: Detroit River

Outfall **33**

Dilute Raw Sewage (MG)

2.75000

Cause Rain

GLWA WRRF

Submission ID. HP9-XG49-54C72

Start Day	Start Time	End Day	End Time
6/25/2021	11:33:00 PM	6/26/2021	2:11:00 AM

Rain(in.) = 2.52

Waterbody: Detroit River

Outfall **39**

Dilute Raw Sewage (MG)

0.00100

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP9-XEJH-X14P7

Start Day	Start Time	End Day	End Time
6/25/2021	11:39:00 PM	6/26/2021	2:43:00 AM

Rain(in.) = 2.52

Waterbody: Detroit River

Outfall **6**

Dilute Raw Sewage (MG)

11.09000

Cause Rain

GLWA WRRF

Submission ID. HP9-XG49-54C72

Start Day	Start Time	End Day	End Time
6/25/2021	11:50:00 PM	6/26/2021	3:37:00 AM

Rain(in.) = 2.52

Waterbody: Detroit River

Outfall **44**

Dilute Raw Sewage (MG)

2.05000

Cause Rain

GLWA WRRF

Submission ID. HPA-R7DJ-8YGSZ

Start Day	Start Time	End Day	End Time
6/26/2021	12:04:00 AM	6/26/2021	8:46:00 AM

Rain(in.) = 7

Waterbody: Rouge River

Permit MI0022802

Outfall **107**

Dilute Raw Sewage (MG)

88.30000

Cause Due to heavy and sustained rainfall in the tributary area (approximately 5" - 8" of precipitation), elevations in the upstream sewer were high posing a potential for basement backups. The bypass gates were opened when the influent level reached 99.23 feet.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HP9-XEJH-X14P7

Start Day	Start Time	End Day	End Time
6/26/2021	12:04:00 AM	6/26/2021	4:05:00 AM

Rain(in.) = 2.52
Waterbody: Detroit River

Outfall **80**

Dilute Raw Sewage (MG)
0.00100

Cause Rain

GLWA WRRF

Submission ID. HPA-5ACT-VSRSW

Start Day	Start Time	End Day	End Time
7/6/2021	5:43:00 PM	7/6/2021	6:30:00 PM

Rain(in.) = 0.16
Waterbody: Rouge River

Outfall **63**

Dilute Raw Sewage (MG)
0.04000

Cause Rain

GLWA WRRF

Submission ID. HPA-2KCV-83HN1

Start Day	Start Time	End Day	End Time
7/8/2021	8:58:00 AM	7/8/2021	9:02:00 AM

Rain(in.) = 0.28
Waterbody: Rouge River

Outfall **68**

Dilute Raw Sewage (MG)
0.21000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPA-2KCV-83HN1

Start Day	Start Time	End Day	End Time
7/8/2021	9:20:00 AM	7/8/2021	9:30:00 AM

Rain(in.) = 0.28
Waterbody: Rouge River

Outfall **67**

Dilute Raw Sewage (MG)
0.04000

Cause Rain

GLWA WRRF

Submission ID. HPA-2KCV-83HN1

Start Day	Start Time	End Day	End Time
7/8/2021	4:56:00 PM	7/8/2021	5:16:00 PM

Rain(in.) = 0.28
Waterbody: Detroit River

Outfall **7**

Dilute Raw Sewage (MG)
0.21000

Cause Rain

GLWA WRRF

Submission ID. HPA-5DA3-41WV2

Start Day	Start Time	End Day	End Time
7/12/2021	12:34:00 PM	7/12/2021	1:00:00 PM

Rain(in.) = 0.32
Waterbody: Detroit River

Outfall **44**

Dilute Raw Sewage (MG)
4.19000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPA-5DA3-41WV2

Start Day	Start Time	End Day	End Time
7/13/2021	12:35:00 PM	7/13/2021	12:51:00 AM

Rain(in.) = 0.32
Waterbody: Rouge River

Outfall **68**

Dilute Raw Sewage (MG)
0.07000

Cause Rain

GLWA WRRF

Submission ID. HPA-5DA3-41WV2

Start Day	Start Time	End Day	End Time
7/13/2021	12:40:00 PM	7/13/2021	1:20:00 PM

Rain(in.) = 0.32
Waterbody: Rouge River

Outfall **67**

Dilute Raw Sewage (MG)
0.18000

Cause Rain

GLWA WRRF

Submission ID. HPA-5DA3-41WV2

Start Day	Start Time	End Day	End Time
7/13/2021	12:47:00 PM	7/13/2021	1:16:00 PM

Rain(in.) = 0.32
Waterbody: Rouge River

Outfall **63**

Dilute Raw Sewage (MG)
0.04000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPA-5DA3-41WV2

Start Day	Start Time	End Day	End Time
7/13/2021	1:11:00 PM	7/13/2021	5:02:00 PM

Rain(in.) = 0.32
Waterbody: Rouge River

Outfall **74**

Dilute Raw Sewage (MG)
0.00000

Cause Rain

GLWA WRRF

Submission ID. HPA-5DA3-41WV2

Start Day	Start Time	End Day	End Time
7/13/2021	1:15:00 PM	7/13/2021	1:45:00 PM

Rain(in.) = 0.32
Waterbody: Rouge River

Outfall **59**

Dilute Raw Sewage (MG)
0.67000

Cause Rain

GLWA WRRF

Submission ID. HPA-5DA3-41WV2

Start Day	Start Time	End Day	End Time
7/13/2021	1:22:00 PM	7/13/2021	3:50:00 PM

Rain(in.) = 0.32
Waterbody: Rouge River

Outfall **64**

Dilute Raw Sewage (MG)
3.32000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPA-5DA3-41WV2

Start Day	Start Time	End Day	End Time
7/13/2021	2:30:00 PM	7/13/2021	2:35:00 PM

Rain(in.) = 0.32
Waterbody: Detroit River

Outfall **33**

Dilute Raw Sewage (MG)
0.02000

Cause Rain

GLWA WRRF

Submission ID. HPA-E8S2-E066K

Start Day	Start Time	End Day	End Time
7/16/2021	8:34:00 AM	7/16/2021	9:59:00 AM

Rain(in.) = 2.37
Waterbody: Rouge River

Outfall **59**

Dilute Raw Sewage (MG)
1.91000

Cause Rain

GLWA WRRF

Submission ID. HPA-E6TJ-5YA3N

Start Day	Start Time	End Day	End Time
7/16/2021	8:45:00 AM	7/16/2021	1:59:00 PM

Rain(in.) = 2.37
Waterbody: Detroit River

Outfall **19**

Dilute Raw Sewage (MG)
2.42000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPA-E6TJ-5YA3N

Start Day	Start Time	End Day	End Time
7/16/2021	8:46:00 AM	7/16/2021	11:00:00 PM

Rain(in.) = 2.37

Waterbody: Detroit River

Outfall **7**

Dilute Raw Sewage (MG)

40.97000

Cause Rain

GLWA WRRF

Submission ID. HPA-E6TJ-5YA3N

Start Day	Start Time	End Day	End Time
7/16/2021	8:52:00 AM	7/16/2021	8:15:00 PM

Rain(in.) = 2.37

Waterbody: Detroit River

Outfall **11**

Dilute Raw Sewage (MG)

9.75000

Cause Rain

GLWA WRRF

Submission ID. HPA-E8S2-E066K

Start Day	Start Time	End Day	End Time
7/16/2021	9:00:00 AM	7/16/2021	5:21:00 PM

Rain(in.) = 2.37

Waterbody: Rouge River

Outfall **67**

Dilute Raw Sewage (MG)

0.00100

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPA-E6TJ-5YA3N

Start Day	Start Time	End Day	End Time
7/16/2021	9:06:00 AM	7/16/2021	9:48:00 PM

Rain(in.) = 2.37

Waterbody: Detroit River

Outfall **5**

Dilute Raw Sewage (MG)

6.23000

Cause Rain

GLWA WRRF

Submission ID. HPA-E8S2-E066K

Start Day	Start Time	End Day	End Time
7/16/2021	9:19:00 AM	7/16/2021	3:33:00 PM

Rain(in.) = 2.37

Waterbody: Rouge River

Outfall **60**

Dilute Raw Sewage (MG)

28.10000

Cause Rain

GLWA WRRF

Submission ID. HPA-E6TJ-5YA3N

Start Day	Start Time	End Day	End Time
7/16/2021	9:28:00 AM	7/16/2021	3:38:00 PM

Rain(in.) = 2.37

Waterbody: Detroit River

Outfall **31**

Dilute Raw Sewage (MG)

9.60000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPA-E6TJ-5YA3N

Start Day	Start Time	End Day	End Time
7/16/2021	9:31:00 AM	7/16/2021	7:07:00 PM

Rain(in.) = 2.37

Waterbody: Detroit River

Outfall **23**

Dilute Raw Sewage (MG)

165.83000

Cause Rain

GLWA WRRF

Submission ID. HPA-E6TJ-5YA3N

Start Day	Start Time	End Day	End Time
7/16/2021	9:49:00 AM	7/17/2021	10:24:00 AM

Rain(in.) = 2.37

Waterbody: Detroit River

Outfall **21**

Dilute Raw Sewage (MG)

3.96000

Cause Rain

GLWA WRRF

Submission ID. HPA-E6TJ-5YA3N

Start Day	Start Time	End Day	End Time
7/16/2021	9:49:00 AM	7/16/2021	1:24:00 PM

Rain(in.) = 2.37

Waterbody: Detroit River

Outfall **27**

Dilute Raw Sewage (MG)

3.75000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPA-E6TJ-5YA3N

Start Day	Start Time	End Day	End Time
7/16/2021	9:52:00 AM	7/16/2021	10:22:00 AM

Rain(in.) = 2.37

Waterbody: Detroit River

Outfall **20**

Dilute Raw Sewage (MG)

0.39000

Cause Rain

GLWA WRRF

Submission ID. HPA-E6TJ-5YA3N

Start Day	Start Time	End Day	End Time
7/16/2021	9:55:00 AM	7/16/2021	11:00:00 AM

Rain(in.) = 2.37

Waterbody: Detroit River

Outfall **29**

Dilute Raw Sewage (MG)

0.30000

Cause Rain

GLWA WRRF

Submission ID. HPA-E6TJ-5YA3N

Start Day	Start Time	End Day	End Time
7/16/2021	9:56:00 AM	7/16/2021	10:06:00 AM

Rain(in.) = 2.37

Waterbody: Detroit River

Outfall **34**

Dilute Raw Sewage (MG)

0.03000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPA-E8S2-E066K

Start Day	Start Time	End Day	End Time
7/16/2021	9:56:00 AM	7/16/2021	3:20:00 PM

Rain(in.) = 2.37
Waterbody: Rouge River

Outfall **79**

Dilute Raw Sewage (MG)
2.41000

Cause Rain

GLWA WRRF

Submission ID. HPA-E8S2-E066K

Start Day	Start Time	End Day	End Time
7/16/2021	10:12:00 AM	7/16/2021	11:59:00 AM

Rain(in.) = 2.37
Waterbody: Rouge River

Outfall **75**

Dilute Raw Sewage (MG)
0.16000

Cause Rain

GLWA WRRF

Submission ID. HPA-E8S2-E066K

Start Day	Start Time	End Day	End Time
7/16/2021	10:14:00 AM	7/16/2021	3:38:00 PM

Rain(in.) = 2.37
Waterbody: Rouge River

Outfall **74**

Dilute Raw Sewage (MG)
9.44000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPA-E6TJ-5YA3N

Start Day	Start Time	End Day	End Time
7/16/2021	10:16:00 AM	7/16/2021	10:26:00 AM

Rain(in.) = 2.37

Waterbody: Detroit River

Outfall **40**

Dilute Raw Sewage (MG)
0.69000

Cause Rain

GLWA WRRF

Submission ID. HPA-E8S2-E066K

Start Day	Start Time	End Day	End Time
7/16/2021	10:20:00 AM	7/16/2021	12:59:00 PM

Rain(in.) = 2.37

Waterbody: Rouge River

Outfall **77**

Dilute Raw Sewage (MG)
4.00000

Cause Rain

GLWA WRRF

Submission ID. HPA-E8S2-E066K

Start Day	Start Time	End Day	End Time
7/16/2021	10:35:00 AM	7/16/2021	4:10:00 PM

Rain(in.) = 2.37

Waterbody: Detroit River

Outfall **25**

Dilute Raw Sewage (MG)
60.24000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPA-E8S2-E066K

Start Day	Start Time	End Day	End Time
7/16/2021	10:36:00 AM	7/16/2021	12:29:00 PM

Rain(in.) = 2.37
Waterbody: Rouge River

Outfall **65**

Dilute Raw Sewage (MG)
2.50000

Cause Rain

GLWA WRRF

Submission ID. HPA-E8S2-E066K

Start Day	Start Time	End Day	End Time
7/16/2021	11:00:00 AM	7/16/2021	1:28:00 PM

Rain(in.) = 2.37
Waterbody: Rouge River

Outfall **69**

Dilute Raw Sewage (MG)
0.00100

Cause Rain

GLWA WRRF

Submission ID. HPA-VB8Z-A19J4

Start Day	Start Time	End Day	End Time
7/16/2021	11:20:00 AM	7/16/2021	4:40:00 PM

Rain(in.) = 4.5
Waterbody: Rouge River

Permit MI0022802
Outfall **107**

Dilute Raw Sewage (MG)
11.40000

Cause Due to heavy and sustained rainfall in the tributary area (approximately 2.4"-4.5" of precipitation), elevations in the upstream sewer were high posing a potential for basement backups. The bypass gates were opened when the influent level reached 100.06 f

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPA-E8S2-E066K

Start Day	Start Time	End Day	End Time
7/16/2021	11:28:00 AM	7/16/2021	12:08:00 PM

Rain(in.) = 2.37
Waterbody: Rouge River

Outfall **68**

Dilute Raw Sewage (MG)
0.25000

Cause Rain

GLWA WRRF

Submission ID. HPA-E8S2-E066K

Start Day	Start Time	End Day	End Time
7/16/2021	11:34:00 AM	7/16/2021	12:29:00 PM

Rain(in.) = 2.37
Waterbody: Rouge River

Outfall **72**

Dilute Raw Sewage (MG)
6.51000

Cause Rain

GLWA WRRF

Submission ID. HPA-E8S2-E066K

Start Day	Start Time	End Day	End Time
7/16/2021	9:00:00 PM	7/16/2021	3:11:00 PM

Rain(in.) = 2.37
Waterbody: Rouge River

Outfall **63**

Dilute Raw Sewage (MG)
0.22000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPA-E8S2-E066K

Start Day	Start Time	End Day	End Time
7/16/2021	9:48:00 PM	7/16/2021	9:59:00 PM

Rain(in.) = 2.37
Waterbody: Rouge River

Outfall **61**

Dilute Raw Sewage (MG)
2.43000

Cause Rain

GLWA WRRF

Submission ID. HPA-E8S2-E066K

Start Day	Start Time	End Day	End Time
7/16/2021	10:19:00 PM	7/16/2021	2:26:00 PM

Rain(in.) = 2.37
Waterbody: Rouge River

Outfall **64**

Dilute Raw Sewage (MG)
28.36000

Cause Rain

GLWA WRRF

Submission ID. HPA-BVR5-F8NKX

Start Day	Start Time	End Day	End Time
7/20/2021	7:12:00 PM	7/20/2021	7:22:00 PM

Rain(in.) = 1.56
Waterbody: Rouge River

Outfall **79**

Dilute Raw Sewage (MG)
2.41000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPA-BVR5-F8NKX

Start Day	Start Time	End Day	End Time
7/20/2021	7:16:00 PM	7/20/2021	7:31:00 PM

Rain(in.) = 1.56
Waterbody: Rouge River

Outfall **63**

Dilute Raw Sewage (MG)
0.02000

Cause Rain

GLWA WRRF

Submission ID. HPA-BVR5-F8NKX

Start Day	Start Time	End Day	End Time
7/20/2021	7:16:00 PM	7/20/2021	9:21:00 PM

Rain(in.) = 1.56
Waterbody: Rouge River

Outfall **64**

Dilute Raw Sewage (MG)
0.58000

Cause Rain

GLWA WRRF

Submission ID. HPA-BVR5-F8NKX

Start Day	Start Time	End Day	End Time
7/20/2021	7:20:00 PM	7/20/2021	8:15:00 PM

Rain(in.) = 1.56
Waterbody: Rouge River

Outfall **68**

Dilute Raw Sewage (MG)
2.50000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPA-NT49-1QVQY

Start Day	Start Time	End Day	End Time
7/24/2021	7:41:00 PM	7/24/2021	8:22:00 PM

Rain(in.) = 0.04
Waterbody: Rouge River

Outfall **68**

Dilute Raw Sewage (MG)
0.19000

Cause Rain

GLWA WRRF

Submission ID. HPA-NT49-1QVQY

Start Day	Start Time	End Day	End Time
7/24/2021	7:48:00 PM	7/25/2021	1:14:00 AM

Rain(in.) = 0.04
Waterbody: Rouge River

Outfall **67**

Dilute Raw Sewage (MG)
15.15000

Cause Rain

GLWA WRRF

Submission ID. HPA-NT49-1QVQY

Start Day	Start Time	End Day	End Time
7/24/2021	7:50:00 PM	7/24/2021	11:30:00 PM

Rain(in.) = 0.04
Waterbody: Rouge River

Outfall **63**

Dilute Raw Sewage (MG)
0.15000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPA-NWFZ-8CW0Z

Start Day	Start Time	End Day	End Time
7/24/2021	7:56:00 PM	7/24/2021	8:26:00 PM

Rain(in.) = 0.04
Waterbody: Rouge River

Outfall **79**

Dilute Raw Sewage (MG)
2.41000

Cause Rain

GLWA WRRF

Submission ID. HPA-NT49-1QVQY

Start Day	Start Time	End Day	End Time
7/24/2021	8:04:00 PM	7/24/2021	8:28:00 PM

Rain(in.) = 0.04
Waterbody: Rouge River

Outfall **59**

Dilute Raw Sewage (MG)
0.44000

Cause Rain

GLWA WRRF

Submission ID. HPA-NT49-1QVQY

Start Day	Start Time	End Day	End Time
7/24/2021	8:04:00 PM	7/24/2021	11:06:00 PM

Rain(in.) = 0.04
Waterbody: Rouge River

Outfall **74**

Dilute Raw Sewage (MG)
9.39000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPA-NT49-1QVQY

Start Day	Start Time	End Day	End Time
7/24/2021	8:07:00 PM	7/25/2021	5:08:00 AM

Rain(in.) = 0.04

Waterbody: Detroit River

Outfall **7**

Dilute Raw Sewage (MG)

26.09000

Cause Rain

GLWA WRRF

Submission ID. HPA-NT49-1QVQY

Start Day	Start Time	End Day	End Time
7/24/2021	8:10:00 PM	7/25/2021	5:07:00 AM

Rain(in.) = 0.04

Waterbody: Detroit River

Outfall **5**

Dilute Raw Sewage (MG)

4.19000

Cause Rain

GLWA WRRF

Submission ID. HPA-NT49-1QVQY

Start Day	Start Time	End Day	End Time
7/24/2021	8:11:00 PM	7/25/2021	7:42:00 AM

Rain(in.) = 0.04

Waterbody: Detroit River

Outfall **11**

Dilute Raw Sewage (MG)

12.23000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPA-NWFZ-8CW0Z

Start Day	Start Time	End Day	End Time
7/24/2021	8:11:00 PM	7/24/2021	9:56:00 PM

Rain(in.) = 0.04
Waterbody: Rouge River

Outfall **65**

Dilute Raw Sewage (MG)
7.37000

Cause Rain

GLWA WRRF

Submission ID. HPA-NT49-1QVQY

Start Day	Start Time	End Day	End Time
7/24/2021	8:13:00 PM	7/24/2021	10:51:00 PM

Rain(in.) = 0.04
Waterbody: Rouge River

Outfall **60**

Dilute Raw Sewage (MG)
0.33000

Cause Rain

GLWA WRRF

Submission ID. HPA-NT49-1QVQY

Start Day	Start Time	End Day	End Time
7/24/2021	8:13:00 PM	7/24/2021	10:40:00 PM

Rain(in.) = 0.04
Waterbody: Rouge River

Outfall **64**

Dilute Raw Sewage (MG)
20.26000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPA-NT49-1QVQY

Start Day	Start Time	End Day	End Time
7/24/2021	8:14:00 PM	7/24/2021	8:54:00 PM

Rain(in.) = 0.04
Waterbody: Detroit River

Outfall **19**

Dilute Raw Sewage (MG)
0.77000

Cause Rain

GLWA WRRF

Submission ID. HPA-NT49-1QVQY

Start Day	Start Time	End Day	End Time
7/24/2021	8:17:00 PM	7/24/2021	9:17:00 PM

Rain(in.) = 0.04
Waterbody: Detroit River

Outfall **21**

Dilute Raw Sewage (MG)
1.17000

Cause Rain

GLWA WRRF

Submission ID. HPA-NT49-1QVQY

Start Day	Start Time	End Day	End Time
7/24/2021	8:17:00 PM	7/25/2021	1:11:00 AM

Rain(in.) = 0.04
Waterbody: Detroit River

Outfall **22**

Dilute Raw Sewage (MG)
0.00100

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPA-NT49-1QVQY

Start Day	Start Time	End Day	End Time
7/24/2021	8:18:00 PM	7/24/2021	10:48:00 PM

Rain(in.) = 0.04

Waterbody: Detroit River

Outfall **27**

Dilute Raw Sewage (MG)

2.97000

Cause Rain

GLWA WRRF

Submission ID. HPA-NT49-1QVQY

Start Day	Start Time	End Day	End Time
7/24/2021	8:20:00 PM	7/25/2021	3:00:00 AM

Rain(in.) = 0.04

Waterbody: Rouge River

Outfall **62**

Dilute Raw Sewage (MG)

3.58000

Cause Rain

GLWA WRRF

Submission ID. HPA-NT49-1QVQY

Start Day	Start Time	End Day	End Time
7/24/2021	8:21:00 PM	7/24/2021	8:41:00 PM

Rain(in.) = 0.04

Waterbody: Detroit River

Outfall **29**

Dilute Raw Sewage (MG)

0.06000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPA-NT49-1QVQY

Start Day	Start Time	End Day	End Time
7/24/2021	8:25:00 PM	7/25/2021	1:11:00 AM

Rain(in.) = 0.04

Waterbody: Detroit River

Outfall **23**

Dilute Raw Sewage (MG)

66.91000

Cause Rain

GLWA WRRF

Submission ID. HPA-NT49-1QVQY

Start Day	Start Time	End Day	End Time
7/24/2021	8:25:00 PM	7/25/2021	3:32:00 AM

Rain(in.) = 0.04

Waterbody: Detroit River

Outfall **25**

Dilute Raw Sewage (MG)

279.82000

Cause Rain

GLWA WRRF

Submission ID. HPA-NWFZ-8CW0Z

Start Day	Start Time	End Day	End Time
7/24/2021	8:46:00 PM	7/24/2021	8:59:00 PM

Rain(in.) = 0.04

Waterbody: Rouge River

Outfall **75**

Dilute Raw Sewage (MG)

0.04000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPA-NT49-1QVQY

Start Day	Start Time	End Day	End Time
7/24/2021	8:58:00 PM	7/24/2021	11:23:00 PM

Rain(in.) = 0.04

Waterbody: Detroit River

Outfall **40**

Dilute Raw Sewage (MG)
9.22000

Cause Rain

GLWA WRRF

Submission ID. HPA-NT49-1QVQY

Start Day	Start Time	End Day	End Time
7/24/2021	9:45:00 PM	7/24/2021	10:00:00 PM

Rain(in.) = 0.04

Waterbody: Detroit River

Outfall **38**

Dilute Raw Sewage (MG)
2.55000

Cause Rain

GLWA WRRF

Submission ID. HPA-VBNF-641VR

Start Day	Start Time	End Day	End Time
7/24/2021	10:00:00 PM	7/25/2021	12:00:00 AM

Rain(in.) = 3.4

Waterbody: Rouge River

Permit MI0022802

Outfall **107**

Dilute Raw Sewage (MG)
4.20000

Cause Due to heavy and sustained rainfall in the tributary area (approximately 3.4"), elevations in the upstream sewer were high posing a potential for basement backups. The bypass gates were opened when the influent level reached 99.8 feet. The opening of the

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPA-NT49-1QVQY

Start Day	Start Time	End Day	End Time
7/25/2021	12:24:00 AM	7/25/2021	12:29:00 AM

Rain(in.) = 0.04
Waterbody: Detroit River

Outfall **9**

Dilute Raw Sewage (MG)
0.22000

Cause Rain

GLWA WRRF

Submission ID. HPA-TQ5F-RQNE9

Start Day	Start Time	End Day	End Time
8/8/2021	6:25:00 AM	8/8/2021	7:10:00 AM

Rain(in.) = 0.02
Waterbody: Rouge River

Outfall **79**

Dilute Raw Sewage (MG)
0.33000

Cause Rain

GLWA WRRF

Submission ID. HPA-TQ5F-RQNE9

Start Day	Start Time	End Day	End Time
8/8/2021	7:01:00 AM	8/8/2021	7:20:00 AM

Rain(in.) = 0.02
Waterbody: Detroit River

Outfall **19**

Dilute Raw Sewage (MG)
0.00100

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPA-TQ5F-RQNE9

Start Day	Start Time	End Day	End Time
8/8/2021	7:06:00 AM	8/8/2021	7:28:00 AM

Rain(in.) = 0.02

Waterbody: Detroit River

Outfall **11**

Dilute Raw Sewage (MG)

0.71000

Cause Rain

GLWA WRRF

Submission ID. HPA-TQ5F-RQNE9

Start Day	Start Time	End Day	End Time
8/8/2021	7:09:00 AM	8/8/2021	7:49:00 AM

Rain(in.) = 0.02

Waterbody: Detroit River

Outfall **7**

Dilute Raw Sewage (MG)

0.30000

Cause Rain

GLWA WRRF

Submission ID. HPB-0Q08-3X1GW

Start Day	Start Time	End Day	End Time
8/9/2021	1:36:00 PM	8/9/2021	1:47:00 PM

Rain(in.) = 0.72

Waterbody: Rouge River

Outfall **68**

Dilute Raw Sewage (MG)

0.05000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPA-VFQC-APZZE

Start Day	Start Time	End Day	End Time
8/9/2021	1:44:00 PM	8/9/2021	2:34:00 PM

Rain(in.) = 0.72
Waterbody: Rouge River

Outfall **67**

Dilute Raw Sewage (MG)
0.22000

Cause Rain

GLWA WRRF

Submission ID. HPA-VFQC-APZZE

Start Day	Start Time	End Day	End Time
8/9/2021	1:45:00 PM	8/9/2021	2:46:00 PM

Rain(in.) = 0.72
Waterbody: Rouge River

Outfall **63**

Dilute Raw Sewage (MG)
0.06000

Cause Rain

GLWA WRRF

Submission ID. HPA-VFQC-APZZE

Start Day	Start Time	End Day	End Time
8/9/2021	1:49:00 PM	8/9/2021	2:29:00 PM

Rain(in.) = 0.72
Waterbody: Rouge River

Outfall **59**

Dilute Raw Sewage (MG)
0.90000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time
8/9/2021	1:56:00 PM	8/9/2021	2:40:00 PM

Rain(in.) = 0.72
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.49000

Cause Rain

Submission ID. HPA-VFQC-APZZE

Outfall **62**

GLWA WRRF

Start Day	Start Time	End Day	End Time
8/9/2021	2:11:00 PM	8/9/2021	2:32:00 PM

Rain(in.) = 0.72
Waterbody: Detroit River

Dilute Raw Sewage (MG)
0.00100

Cause Rain

Submission ID. HPB-0Q08-3X1GW

Outfall **18**

GLWA WRRF

Start Day	Start Time	End Day	End Time
8/9/2021	2:12:00 PM	8/9/2021	2:27:00 PM

Rain(in.) = 0.72
Waterbody: Detroit River

Dilute Raw Sewage (MG)
0.31000

Cause Rain

Submission ID. HPA-VFQC-APZZE

Outfall **19**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time
8/9/2021	2:13:00 PM	8/9/2021	2:38:00 PM

Rain(in.) = 0.72
Waterbody: Detroit River

Dilute Raw Sewage (MG)
0.00100

Cause Rain

Submission ID. HPA-VFQC-APZZE

Outfall **22**

GLWA WRRF

Start Day	Start Time	End Day	End Time
8/9/2021	2:13:00 PM	8/9/2021	2:38:00 PM

Rain(in.) = 0.72
Waterbody: Detroit River

Dilute Raw Sewage (MG)
4.40000

Cause Rain

Submission ID. HPA-VFQC-APZZE

Outfall **23**

GLWA WRRF

Start Day	Start Time	End Day	End Time
8/9/2021	2:13:00 PM	8/9/2021	4:12:00 PM

Rain(in.) = 0.72
Waterbody: Detroit River

Dilute Raw Sewage (MG)
0.00100

Cause Rain

Submission ID. HPA-VFQC-APZZE

Outfall **24**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPA-VFQC-APZZE

Start Day	Start Time	End Day	End Time
8/9/2021	2:14:00 PM	8/9/2021	2:49:00 PM

Rain(in.) = 0.72
Waterbody: Detroit River

Outfall **11**

Dilute Raw Sewage (MG)
0.66000

Cause Rain

GLWA WRRF

Submission ID. HPB-0Q08-3X1GW

Start Day	Start Time	End Day	End Time
8/9/2021	2:14:00 PM	8/9/2021	2:19:00 PM

Rain(in.) = 0.72
Waterbody: Detroit River

Outfall **21**

Dilute Raw Sewage (MG)
0.00100

Cause Rain

GLWA WRRF

Submission ID. HPA-VFQC-APZZE

Start Day	Start Time	End Day	End Time
8/9/2021	2:17:00 PM	8/9/2021	3:36:00 PM

Rain(in.) = 0.72
Waterbody: Detroit River

Outfall **5**

Dilute Raw Sewage (MG)
0.10000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPA-VFQC-APZZE

Start Day	Start Time	End Day	End Time
8/9/2021	2:19:00 PM	8/9/2021	3:44:00 PM

Rain(in.) = 0.72

Waterbody: Detroit River

Outfall **7**

Dilute Raw Sewage (MG)

3.63000

Cause Rain

GLWA WRRF

Submission ID. HPA-VFQC-APZZE

Start Day	Start Time	End Day	End Time
8/9/2021	2:21:00 PM	8/9/2021	2:49:00 PM

Rain(in.) = 0.72

Waterbody: Detroit River

Outfall **31**

Dilute Raw Sewage (MG)

0.46000

Cause Rain

GLWA WRRF

Submission ID. HPA-VFQC-APZZE

Start Day	Start Time	End Day	End Time
8/9/2021	2:21:00 PM	8/9/2021	4:47:00 PM

Rain(in.) = 0.72

Waterbody: Rouge River

Outfall **64**

Dilute Raw Sewage (MG)

2.22000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPB-0Q08-3X1GW

Start Day	Start Time	End Day	End Time
8/9/2021	2:26:00 PM	8/9/2021	3:01:00 PM

Rain(in.) = 0.72

Waterbody: Detroit River

Outfall **12**

Dilute Raw Sewage (MG)

0.00100

Cause Rain

GLWA WRRF

Submission ID. HPA-VFQC-APZZE

Start Day	Start Time	End Day	End Time
8/9/2021	3:02:00 PM	8/9/2021	5:22:00 PM

Rain(in.) = 0.72

Waterbody: Rouge River

Outfall **60**

Dilute Raw Sewage (MG)

24.33000

Cause Rain

GLWA WRRF

Submission ID. HPA-VFQC-APZZE

Start Day	Start Time	End Day	End Time
8/9/2021	3:09:00 PM	8/9/2021	3:55:00 PM

Rain(in.) = 0.72

Waterbody: Rouge River

Outfall **61**

Dilute Raw Sewage (MG)

1.99000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPA-VFQC-APZZE

Start Day	Start Time	End Day	End Time
8/9/2021	3:10:00 PM	8/9/2021	4:12:00 PM

Rain(in.) = 0.72

Waterbody: Detroit River

Outfall **25**

Dilute Raw Sewage (MG)

20.12000

Cause Rain

GLWA WRRF

Submission ID. HPA-VFQC-APZZE

Start Day	Start Time	End Day	End Time
8/9/2021	3:24:00 PM	8/9/2021	4:03:00 PM

Rain(in.) = 0.72

Waterbody: Detroit River

Outfall **9**

Dilute Raw Sewage (MG)

0.45000

Cause Rain

GLWA WRRF

Submission ID. HPA-X2JE-K1349

Start Day	Start Time	End Day	End Time
8/11/2021	3:05:00 PM	8/11/2021	3:37:00 PM

Rain(in.) = 3.14

Waterbody: River Rouge

Outfall **63**

Dilute Raw Sewage (MG)

0.04000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPA-X2JE-K1349

Start Day	Start Time	End Day	End Time
8/11/2021	3:08:00 PM	8/12/2021	7:40:00 AM

Rain(in.) = 3.14

Waterbody: River Rouge

Outfall **67**

Dilute Raw Sewage (MG)

1.55000

Cause Rain

GLWA WRRF

Submission ID. HPA-X2JE-K1349

Start Day	Start Time	End Day	End Time
8/12/2021	1:54:00 AM	8/12/2021	2:28:00 AM

Rain(in.) = 3.14

Waterbody: River Rouge

Outfall **68**

Dilute Raw Sewage (MG)

0.06000

Cause Rain

GLWA WRRF

Submission ID. HPA-X2JE-K1349

Start Day	Start Time	End Day	End Time
8/12/2021	1:55:00 AM	8/12/2021	6:41:00 AM

Rain(in.) = 3.14

Waterbody: River Rouge

Outfall **79**

Dilute Raw Sewage (MG)

31.92000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPA-X2JE-K1349

Start Day	Start Time	End Day	End Time
8/12/2021	2:04:00 AM	8/12/2021	2:38:00 AM

Rain(in.) = 3.14

Waterbody: River Rouge

Outfall **74**

Dilute Raw Sewage (MG)

78.04000

Cause Rain

GLWA WRRF

Submission ID. HPA-X2JE-K1349

Start Day	Start Time	End Day	End Time
8/12/2021	2:04:00 AM	8/12/2021	5:15:00 AM

Rain(in.) = 3.14

Waterbody: River Rouge

Outfall **75**

Dilute Raw Sewage (MG)

0.22000

Cause Rain

GLWA WRRF

Submission ID. HPA-X2JE-K1349

Start Day	Start Time	End Day	End Time
8/12/2021	2:09:00 AM	8/12/2021	5:36:00 AM

Rain(in.) = 3.14

Waterbody: River Rouge

Outfall **77**

Dilute Raw Sewage (MG)

2.58000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPA-X2JE-K1349

Start Day	Start Time	End Day	End Time
8/12/2021	2:11:00 AM	8/12/2021	10:37:00 AM

Rain(in.) = 3.14

Waterbody: Detroit River

Outfall **11**

Dilute Raw Sewage (MG)

11.86000

Cause Rain

GLWA WRRF

Submission ID. HPA-X2JE-K1349

Start Day	Start Time	End Day	End Time
8/12/2021	2:12:00 AM	8/12/2021	2:38:00 AM

Rain(in.) = 3.14

Waterbody: River Rouge

Outfall **60**

Dilute Raw Sewage (MG)

6.07000

Cause Rain

GLWA WRRF

Submission ID. HPA-X2JE-K1349

Start Day	Start Time	End Day	End Time
8/12/2021	2:12:00 AM	8/12/2021	3:06:00 AM

Rain(in.) = 3.14

Waterbody: River Rouge

Outfall **61**

Dilute Raw Sewage (MG)

9.29000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPA-X2JE-K1349

Start Day	Start Time	End Day	End Time
8/12/2021	2:12:00 AM	8/12/2021	6:56:00 AM

Rain(in.) = 3.14
Waterbody: River Rouge

Outfall **64**

Dilute Raw Sewage (MG)
33.69000

Cause Rain

GLWA WRRF

Submission ID. HPA-X2JE-K1349

Start Day	Start Time	End Day	End Time
8/12/2021	2:13:00 AM	8/12/2021	7:37:00 AM

Rain(in.) = 3.14
Waterbody: Detroit River

Outfall **20**

Dilute Raw Sewage (MG)
0.00100

Cause Rain

GLWA WRRF

Submission ID. HPA-X2JE-K1349

Start Day	Start Time	End Day	End Time
8/12/2021	2:13:00 AM	8/12/2021	5:39:00 AM

Rain(in.) = 3.14
Waterbody: River Rouge

Outfall **65**

Dilute Raw Sewage (MG)
2.89000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPA-X2JE-K1349

Start Day	Start Time	End Day	End Time
8/12/2021	2:15:00 AM	8/12/2021	7:22:00 AM

Rain(in.) = 3.14
Waterbody: Detroit River

Outfall **18**

Dilute Raw Sewage (MG)
0.00100

Cause Rain

GLWA WRRF

Submission ID. HPA-X2JE-K1349

Start Day	Start Time	End Day	End Time
8/12/2021	2:15:00 AM	8/12/2021	7:44:00 AM

Rain(in.) = 3.14
Waterbody: Detroit River

Outfall **19**

Dilute Raw Sewage (MG)
6.05000

Cause Rain

GLWA WRRF

Submission ID. HPA-X2JE-K1349

Start Day	Start Time	End Day	End Time
8/12/2021	2:16:00 AM	8/12/2021	9:45:00 AM

Rain(in.) = 3.14
Waterbody: Detroit River

Outfall **23**

Dilute Raw Sewage (MG)
86.13000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPA-X2JE-K1349

Start Day	Start Time	End Day	End Time
8/12/2021	2:16:00 AM	8/12/2021	9:45:00 AM

Rain(in.) = 3.14
Waterbody: Detroit River

Outfall **24**

Dilute Raw Sewage (MG)
0.00100

Cause Rain

GLWA WRRF

Submission ID. HPA-X2JE-K1349

Start Day	Start Time	End Day	End Time
8/12/2021	2:16:00 AM	8/12/2021	8:34:00 AM

Rain(in.) = 3.14
Waterbody: Detroit River

Outfall **31**

Dilute Raw Sewage (MG)
6.86000

Cause Rain

GLWA WRRF

Submission ID. HPA-X2JE-K1349

Start Day	Start Time	End Day	End Time
8/12/2021	2:23:00 AM	8/12/2021	8:50:00 AM

Rain(in.) = 3.14
Waterbody: Detroit River

Outfall **5**

Dilute Raw Sewage (MG)
0.67000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPA-X2JE-K1349

Start Day	Start Time	End Day	End Time
8/12/2021	2:40:00 AM	8/12/2021	9:09:00 AM

Rain(in.) = 3.14
Waterbody: Detroit River

Outfall **25**

Dilute Raw Sewage (MG)
205.13000

Cause Rain

GLWA WRRF

Submission ID. HPA-X2JE-K1349

Start Day	Start Time	End Day	End Time
8/12/2021	2:58:00 AM	8/12/2021	8:02:00 PM

Rain(in.) = 3.14
Waterbody: Detroit River

Outfall **12**

Dilute Raw Sewage (MG)
0.00100

Cause Rain

GLWA WRRF

Submission ID. HPA-X2JE-K1349

Start Day	Start Time	End Day	End Time
8/12/2021	3:09:00 AM	8/12/2021	9:33:00 AM

Rain(in.) = 3.14
Waterbody: Detroit River

Outfall **38**

Dilute Raw Sewage (MG)
0.00100

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPA-X2JE-K1349

Start Day	Start Time	End Day	End Time
8/12/2021	3:38:00 AM	8/12/2021	7:33:00 AM

Rain(in.) = 3.14

Waterbody: Detroit River

Outfall **40**

Dilute Raw Sewage (MG)

0.00100

Cause Rain

GLWA WRRF

Submission ID. HPA-X2JE-K1349

Start Day	Start Time	End Day	End Time
8/12/2021	3:52:00 AM	8/12/2021	3:14:00 PM

Rain(in.) = 3.14

Waterbody: Detroit River

Outfall **9**

Dilute Raw Sewage (MG)

22.76000

Cause Rain

GLWA WRRF

Submission ID. HPA-X2JE-K1349

Start Day	Start Time	End Day	End Time
8/12/2021	5:30:00 AM	8/12/2021	8:00:00 AM

Rain(in.) = 3.14

Waterbody: River Rouge

Outfall **107**

Dilute Raw Sewage (MG)

4.50000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPA-X2JE-K1349

Start Day	Start Time	End Day	End Time
8/12/2021	7:06:00 AM	8/12/2021	7:43:00 AM

Rain(in.) = 3.14
Waterbody: Detroit River

Outfall **43**

Dilute Raw Sewage (MG)
0.00100

Cause Rain

GLWA WRRF

Submission ID. HPB-7QYY-7NRGG

Start Day	Start Time	End Day	End Time
8/24/2021	6:45:00 PM	8/24/2021	7:15:00 PM

Rain(in.) = 0.42
Waterbody: Rouge River

Outfall **59**

Dilute Raw Sewage (MG)
0.67000

Cause Rain

GLWA WRRF

Submission ID. HPB-9J3D-QKZCJ

Start Day	Start Time	End Day	End Time
8/27/2021	11:22:00 AM	8/27/2021	12:20:00 PM

Rain(in.) = 0.22
Waterbody: Rouge River

Outfall **68**

Dilute Raw Sewage (MG)
0.13000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time
8/27/2021	11:22:00 AM	8/27/2021	12:27:00 PM

Rain(in.) = 0.22
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.07000

Cause Rain

Submission ID. HPB-9J3D-QKZCJ

Outfall **75**

GLWA WRRF

Start Day	Start Time	End Day	End Time
8/27/2021	11:26:00 AM	8/27/2021	2:42:00 PM

Rain(in.) = 0.22
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.38000

Cause Rain

Submission ID. HPB-9J3D-QKZCJ

Outfall **63**

GLWA WRRF

Start Day	Start Time	End Day	End Time
8/27/2021	11:26:00 AM	8/27/2021	12:05:00 PM

Rain(in.) = 0.22
Waterbody: Rouge River

Dilute Raw Sewage (MG)
2.55000

Cause Rain

Submission ID. HPB-9J3D-QKZCJ

Outfall **79**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPB-9J3D-QKZCJ

Start Day	Start Time	End Day	End Time
8/27/2021	11:28:00 AM	8/27/2021	12:12:00 PM

Rain(in.) = 0.22
Waterbody: Rouge River

Outfall **59**

Dilute Raw Sewage (MG)
0.87000

Cause Rain

GLWA WRRF

Submission ID. HPB-9J3D-QKZCJ

Start Day	Start Time	End Day	End Time
8/27/2021	11:29:00 AM	8/27/2021	2:14:00 PM

Rain(in.) = 0.22
Waterbody: Rouge River

Outfall **62**

Dilute Raw Sewage (MG)
8.22000

Cause Rain

GLWA WRRF

Submission ID. HPB-9J3D-QKZCJ

Start Day	Start Time	End Day	End Time
8/27/2021	11:40:00 AM	8/27/2021	1:02:00 PM

Rain(in.) = 0.22
Waterbody: Rouge River

Outfall **77**

Dilute Raw Sewage (MG)
3.68000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time
8/27/2021	11:42:00 AM	8/27/2021	12:13:00 PM

Rain(in.) = 0.22
Waterbody: Rouge River

Dilute Raw Sewage (MG)
6.63000

Cause Rain

Submission ID. HPB-9J3D-QKZCJ

Outfall **60**

GLWA WRRF

Start Day	Start Time	End Day	End Time
8/27/2021	11:43:00 AM	8/27/2021	12:39:00 PM

Rain(in.) = 0.22
Waterbody: Rouge River

Dilute Raw Sewage (MG)
8.34000

Cause Rain

Submission ID. HPB-9J3D-QKZCJ

Outfall **61**

GLWA WRRF

Start Day	Start Time	End Day	End Time
8/27/2021	11:50:00 AM	8/27/2021	2:01:00 PM

Rain(in.) = 0.22
Waterbody: Rouge River

Dilute Raw Sewage (MG)
45.58000

Cause Rain

Submission ID. HPB-9J3D-QKZCJ

Outfall **74**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time
8/27/2021	12:17:00 PM	8/27/2021	2:36:00 PM

Rain(in.) = 0.22
Waterbody: Rouge River

Dilute Raw Sewage (MG)
5.92000

Cause Rain

Submission ID. HPB-9J3D-QKZCJ

Outfall **65**

GLWA WRRF

Start Day	Start Time	End Day	End Time
8/27/2021	12:19:00 PM	8/27/2021	1:52:00 PM

Rain(in.) = 0.22
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.00100

Cause Rain

Submission ID. HPB-9J3D-QKZCJ

Outfall **69**

GLWA WRRF

Start Day	Start Time	End Day	End Time
8/27/2021	12:35:00 PM	8/27/2021	3:15:00 PM

Rain(in.) = 0.22
Waterbody: Detroit River

Dilute Raw Sewage (MG)
0.49000

Cause Rain

Submission ID. HPB-9J3D-QKZCJ

Outfall **5**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPB-9J3D-QKZCJ

Start Day	Start Time	End Day	End Time
8/27/2021	12:35:00 PM	8/27/2021	3:22:00 PM

Rain(in.) = 0.22
Waterbody: Detroit River

Outfall **7**

Dilute Raw Sewage (MG)
7.29000

Cause Rain

GLWA WRRF

Submission ID. HPB-9J3D-QKZCJ

Start Day	Start Time	End Day	End Time
8/27/2021	12:42:00 PM	8/27/2021	4:32:00 PM

Rain(in.) = 0.22
Waterbody: Detroit River

Outfall **11**

Dilute Raw Sewage (MG)
8.87000

Cause Rain

GLWA WRRF

Submission ID. HPB-9J3D-QKZCJ

Start Day	Start Time	End Day	End Time
8/27/2021	12:42:00 PM	8/27/2021	4:32:00 PM

Rain(in.) = 0.22
Waterbody: Detroit River

Outfall **12**

Dilute Raw Sewage (MG)
0.00100

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPB-9J3D-QKZCJ

Start Day	Start Time	End Day	End Time
8/27/2021	12:43:00 PM	8/27/2021	1:03:00 PM

Rain(in.) = 0.22
Waterbody: Detroit River

Outfall **19**

Dilute Raw Sewage (MG)
0.00100

Cause Rain

GLWA WRRF

Submission ID. HPB-9J3D-QKZCJ

Start Day	Start Time	End Day	End Time
8/27/2021	12:57:00 PM	8/27/2021	2:44:00 PM

Rain(in.) = 0.22
Waterbody: Detroit River

Outfall **23**

Dilute Raw Sewage (MG)
0.00100

Cause Rain

GLWA WRRF

Submission ID. HPB-9J3D-QKZCJ

Start Day	Start Time	End Day	End Time
8/27/2021	12:57:00 PM	8/27/2021	3:57:00 PM

Rain(in.) = 0.22
Waterbody: Detroit River

Outfall **24**

Dilute Raw Sewage (MG)
0.00100

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time
8/27/2021	12:58:00 PM	8/27/2021	3:21:00 PM

Rain(in.) = 0.22
Waterbody: Detroit River

Dilute Raw Sewage (MG)
0.00100

Cause Rain

Submission ID. HPB-9J3D-QKZCJ

Outfall **22**

GLWA WRRF

Start Day	Start Time	End Day	End Time
8/27/2021	1:11:00 PM	8/27/2021	3:57:00 PM

Rain(in.) = 0.22
Waterbody: Detroit River

Dilute Raw Sewage (MG)
0.00100

Cause Rain

Submission ID. HPB-9J3D-QKZCJ

Outfall **25**

GLWA WRRF

Start Day	Start Time	End Day	End Time
8/27/2021	1:25:00 PM	8/27/2021	3:08:00 PM

Rain(in.) = 0.22
Waterbody: Detroit River

Dilute Raw Sewage (MG)
0.00100

Cause Rain

Submission ID. HPB-9J3D-QKZCJ

Outfall **38**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time
8/27/2021	1:39:00 PM	8/27/2021	1:59:00 PM

Rain(in.) = 0.22
Waterbody: Detroit River

Dilute Raw Sewage (MG)
0.48000

Cause Rain

Submission ID. HPB-9J3D-QKZCJ

Outfall **9**

GLWA WRRF

Start Day	Start Time	End Day	End Time
8/27/2021	11:25:00 PM	8/27/2021	2:03:00 PM

Rain(in.) = 0.22
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.71000

Cause Rain

Submission ID. HPB-9J3D-QKZCJ

Outfall **67**

GLWA WRRF

Start Day	Start Time	End Day	End Time
8/27/2021	11:36:00 PM	8/27/2021	3:17:00 PM

Rain(in.) = 0.22
Waterbody: Rouge River

Dilute Raw Sewage (MG)
21.21000

Cause Rain

Submission ID. HPB-9J3D-QKZCJ

Outfall **64**

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs..

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPB-BB9G-
QTWWH

Start Day	Start Time	End Day	End Time
8/29/2021	6:46:00 PM	8/29/2021	7:56:00 PM

Rain(in.) = 0.75
Waterbody: Rouge River

Outfall **67**

Dilute Raw Sewage (MG)
0.31000

Cause Rain

GLWA WRRF

Submission ID. HPB-BB9G-
QTWWH

Start Day	Start Time	End Day	End Time
8/29/2021	6:47:00 PM	8/29/2021	7:02:00 PM

Rain(in.) = 0.75
Waterbody: Rouge River

Outfall **68**

Dilute Raw Sewage (MG)
0.06000

Cause Rain

GLWA WRRF

Submission ID. HPB-BB9G-
QTWWH

Start Day	Start Time	End Day	End Time
8/29/2021	6:48:00 PM	8/29/2021	8:38:00 PM

Rain(in.) = 0.75
Waterbody: Rouge River

Outfall **63**

Dilute Raw Sewage (MG)
0.23000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPB-BB9G-
QTWWH

Start Day	Start Time	End Day	End Time
8/29/2021	6:49:00 PM	8/29/2021	8:15:00 PM

Rain(in.) = 0.75
Waterbody: Rouge River

Outfall **59**

Dilute Raw Sewage (MG)
1.90000

Cause Rain

GLWA WRRF

Submission ID. HPB-BB9G-
QTWWH

Start Day	Start Time	End Day	End Time
8/29/2021	7:01:00 PM	8/29/2021	8:15:00 PM

Rain(in.) = 0.75
Waterbody: Rouge River

Outfall **62**

Dilute Raw Sewage (MG)
6.64000

Cause Rain

GLWA WRRF

Submission ID. HPB-BB9G-
QTWWH

Start Day	Start Time	End Day	End Time
8/29/2021	7:09:00 PM	8/29/2021	7:44:00 PM

Rain(in.) = 0.75
Waterbody: Detroit River

Outfall **19**

Dilute Raw Sewage (MG)
0.91000

Cause Rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs..

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPB-BB9G-
QTWWH

Start Day	Start Time	End Day	End Time
8/29/2021	7:09:00 PM	8/29/2021	9:06:00 PM

Rain(in.) = 0.75
Waterbody: Rouge River

Outfall **64**

Dilute Raw Sewage (MG)
1.28000

Cause Rain

GLWA WRRF

Submission ID. HPB-BB9G-
QTWWH

Start Day	Start Time	End Day	End Time
8/29/2021	7:10:00 PM	8/29/2021	10:06:00 PM

Rain(in.) = 0.75
Waterbody: Detroit River

Outfall **7**

Dilute Raw Sewage (MG)
8.02000

Cause Rain

GLWA WRRF

Submission ID. HPB-BB9G-
QTWWH

Start Day	Start Time	End Day	End Time
8/29/2021	7:12:00 PM	8/29/2021	7:47:00 PM

Rain(in.) = 0.75
Waterbody: Detroit River

Outfall **18**

Dilute Raw Sewage (MG)
0.00100

Cause Rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs..

Appendix E Page 339 of 480

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPB-BB9G-
QTWWH

Start Day	Start Time	End Day	End Time
8/29/2021	7:17:00 PM	8/29/2021	9:28:00 PM

Rain(in.) = 0.75
Waterbody: Detroit River

Outfall **11**

Dilute Raw Sewage (MG)
2.75000

Cause Rain

GLWA WRRF

Submission ID. HPB-BB9G-
QTWWH

Start Day	Start Time	End Day	End Time
8/29/2021	7:17:00 PM	8/29/2021	7:43:00 PM

Rain(in.) = 0.75
Waterbody: Rouge River

Outfall **79**

Dilute Raw Sewage (MG)
2.33000

Cause Rain

GLWA WRRF

Submission ID. HPB-BB9G-
QTWWH

Start Day	Start Time	End Day	End Time
8/29/2021	7:20:00 PM	8/29/2021	10:00:00 PM

Rain(in.) = 0.75
Waterbody: Detroit River

Outfall **5**

Dilute Raw Sewage (MG)
0.49000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPB-BB9G-
QTWWH

Start Day	Start Time	End Day	End Time
8/29/2021	7:28:00 PM	8/29/2021	9:39:00 PM

Rain(in.) = 0.75
Waterbody: Detroit River

Outfall **22**

Dilute Raw Sewage (MG)
0.00100

Cause Rain

GLWA WRRF

Submission ID. HPB-BB9G-
QTWWH

Start Day	Start Time	End Day	End Time
8/29/2021	7:34:00 PM	8/29/2021	9:58:00 PM

Rain(in.) = 0.75
Waterbody: Rouge River

Outfall **61**

Dilute Raw Sewage (MG)
6.35000

Cause Rain

GLWA WRRF

Submission ID. HPB-BB9G-
QTWWH

Start Day	Start Time	End Day	End Time
8/29/2021	7:38:00 PM	8/29/2021	10:38:00 PM

Rain(in.) = 0.75
Waterbody: Rouge River

Outfall **60**

Dilute Raw Sewage (MG)
43.64000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPB-BB9G-
QTWWH

Start Day	Start Time	End Day	End Time
8/29/2021	7:41:00 PM	8/29/2021	11:12:00 PM

Rain(in.) = 0.75
Waterbody: Rouge River

Outfall **74**

Dilute Raw Sewage (MG)
18.86000

Cause Rain

GLWA WRRF

Submission ID. HPB-BB9G-
QTWWH

Start Day	Start Time	End Day	End Time
8/29/2021	7:44:00 PM	8/29/2021	8:59:00 PM

Rain(in.) = 0.75
Waterbody: Detroit River

Outfall **12**

Dilute Raw Sewage (MG)
0.00100

Cause Rain

GLWA WRRF

Submission ID. HPB-BB9G-
QTWWH

Start Day	Start Time	End Day	End Time
8/29/2021	7:48:00 PM	8/29/2021	9:26:00 PM

Rain(in.) = 0.75
Waterbody: Detroit River

Outfall **24**

Dilute Raw Sewage (MG)
0.00100

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPB-BB9G-
QTWWH

Start Day	Start Time	End Day	End Time
8/29/2021	7:48:00 PM	8/29/2021	9:26:00 PM

Rain(in.) = 0.75
Waterbody: Detroit River

Outfall **25**

Dilute Raw Sewage (MG)
34.15000

Cause Rain

GLWA WRRF

Submission ID. HPB-BB9G-
QTWWH

Start Day	Start Time	End Day	End Time
8/29/2021	7:58:00 PM	8/29/2021	8:36:00 PM

Rain(in.) = 0.75
Waterbody: Detroit River

Outfall **23**

Dilute Raw Sewage (MG)
4.32000

Cause Rain

GLWA WRRF

Submission ID. HPB-BB9G-
QTWWH

Start Day	Start Time	End Day	End Time
8/29/2021	8:07:00 PM	8/29/2021	8:22:00 PM

Rain(in.) = 0.75
Waterbody: Detroit River

Outfall **9**

Dilute Raw Sewage (MG)
1.34000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPB-BB9G-
QTWWH

Start Day	Start Time	End Day	End Time
8/29/2021	8:46:00 PM	8/29/2021	9:43:00 PM

Rain(in.) = 0.75
Waterbody: Detroit River

Outfall **38**

Dilute Raw Sewage (MG)
0.00100

Cause Rain

GLWA WRRF

Submission ID. HPB-JE6T-KYDVH

Start Day	Start Time	End Day	End Time
9/7/2021	7:46:00 PM	9/8/2021	12:31:00 AM

Rain(in.) = 0.34
Waterbody: Rouge River

Outfall **79**

Dilute Raw Sewage (MG)
7.50000

Cause Rain

GLWA WRRF

Submission ID. HPB-JE6T-KYDVH

Start Day	Start Time	End Day	End Time
9/7/2021	8:05:00 PM	9/8/2021	12:10:00 AM

Rain(in.) = 0.34
Waterbody: Rouge River

Outfall **67**

Dilute Raw Sewage (MG)
0.22000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPB-JE6T-KYDVH

Start Day	Start Time	End Day	End Time
9/7/2021	11:33:00 PM	9/7/2021	11:43:00 PM

Rain(in.) = 0.34
Waterbody: Rouge River

Outfall **68**

Dilute Raw Sewage (MG)
0.02000

Cause Rain

GLWA WRRF

Submission ID. HPB-JE6T-KYDVH

Start Day	Start Time	End Day	End Time
9/7/2021	11:42:00 PM	9/8/2021	12:22:00 AM

Rain(in.) = 0.34
Waterbody: Rouge River

Outfall **63**

Dilute Raw Sewage (MG)
0.08000

Cause Rain

GLWA WRRF

Submission ID. HPB-QWT0-GPQG3

Start Day	Start Time	End Day	End Time
9/14/2021	7:34:00 PM	9/14/2021	7:40:00 PM

Rain(in.) = 0.29
Waterbody: Rouge River

Outfall **68**

Dilute Raw Sewage (MG)
0.01000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPB-QWT0-GPQG3

Start Day	Start Time	End Day	End Time
9/14/2021	7:42:00 PM	9/14/2021	8:03:00 PM

Rain(in.) = 0.29

Waterbody: Rouge River

Outfall **67**

Dilute Raw Sewage (MG)
0.09000

Cause Rain

GLWA WRRF

Submission ID. HPB-QWT0-GPQG3

Start Day	Start Time	End Day	End Time
9/14/2021	7:44:00 PM	9/14/2021	8:14:00 PM

Rain(in.) = 0.29

Waterbody: Rouge River

Outfall **63**

Dilute Raw Sewage (MG)
0.08000

Cause Rain

GLWA WRRF

Submission ID. HPB-QWT0-GPQG3

Start Day	Start Time	End Day	End Time
9/14/2021	7:48:00 PM	9/14/2021	9:14:00 PM

Rain(in.) = 0.29

Waterbody: Detroit River

Outfall **18**

Dilute Raw Sewage (MG)
0.00100

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPB-QWT0-GPQG3

Start Day	Start Time	End Day	End Time
9/14/2021	7:51:00 PM	9/14/2021	8:01:00 PM

Rain(in.) = 0.29

Waterbody: Rouge River

Outfall **59**

Dilute Raw Sewage (MG)

0.22000

Cause Rain

GLWA WRRF

Submission ID. HPB-QWT0-GPQG3

Start Day	Start Time	End Day	End Time
9/14/2021	7:55:00 PM	9/14/2021	8:34:00 PM

Rain(in.) = 0.29

Waterbody: Detroit River

Outfall **11**

Dilute Raw Sewage (MG)

1.91000

Cause Rain

GLWA WRRF

Submission ID. HPB-QWT0-GPQG3

Start Day	Start Time	End Day	End Time
9/14/2021	7:56:00 PM	9/14/2021	8:12:00 PM

Rain(in.) = 0.29

Waterbody: Detroit River

Outfall **20**

Dilute Raw Sewage (MG)

0.00100

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPB-QWT0-GPQG3

Start Day	Start Time	End Day	End Time
9/14/2021	7:57:00 PM	9/14/2021	8:20:00 PM

Rain(in.) = 0.29

Waterbody: Detroit River

Outfall **19**

Dilute Raw Sewage (MG)

1.62000

Cause Rain

GLWA WRRF

Submission ID. HPB-QWT0-GPQG3

Start Day	Start Time	End Day	End Time
9/14/2021	7:57:00 PM	9/14/2021	8:17:00 PM

Rain(in.) = 0.29

Waterbody: Detroit River

Outfall **23**

Dilute Raw Sewage (MG)

3.08000

Cause Rain

GLWA WRRF

Submission ID. HPB-QWT0-GPQG3

Start Day	Start Time	End Day	End Time
9/14/2021	8:00:00 PM	9/14/2021	8:29:00 PM

Rain(in.) = 0.29

Waterbody: Detroit River

Outfall **31**

Dilute Raw Sewage (MG)

0.50000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPB-QWT0-GPQG3

Start Day	Start Time	End Day	End Time
9/14/2021	8:01:00 PM	9/14/2021	8:56:00 PM

Rain(in.) = 0.29

Waterbody: Detroit River

Outfall **7**

Dilute Raw Sewage (MG)

1.80000

Cause Rain

GLWA WRRF

Submission ID. HPB-QWT0-GPQG3

Start Day	Start Time	End Day	End Time
9/14/2021	8:04:00 PM	9/14/2021	9:45:00 PM

Rain(in.) = 0.29

Waterbody: Rouge River

Outfall **64**

Dilute Raw Sewage (MG)

0.27000

Cause Rain

GLWA WRRF

Submission ID. HPB-WXVH-Y94XF

Start Day	Start Time	End Day	End Time
9/14/2021	8:34:00 PM	9/15/2021	12:59:00 AM

Rain(in.) = 0.29

Waterbody: Detroit River

Outfall **22**

Dilute Raw Sewage (MG)

0.00100

Cause rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time
9/21/2021	7:27:00 PM	9/22/2021	12:37:00 AM

Rain(in.) = 4.64
Waterbody: Rouge River

Dilute Raw Sewage (MG)
5.07000

Cause RAIN

Submission ID. HPC-3E48-03ZZT

Outfall **64**

GLWA WRRF

Start Day	Start Time	End Day	End Time
9/21/2021	7:37:00 PM	9/23/2021	4:22:00 AM

Rain(in.) = 4.64
Waterbody: Detroit River

Dilute Raw Sewage (MG)
46.28000

Cause RAIN

Submission ID. HPC-3E48-03ZZT

Outfall **7**

GLWA WRRF

Start Day	Start Time	End Day	End Time
9/21/2021	7:37:00 PM	9/23/2021	4:22:00 AM

Rain(in.) = 4.64
Waterbody: Detroit River

Dilute Raw Sewage (MG)
0.00100

Cause RAIN

Submission ID. HPC-3E48-03ZZT

Outfall **8**

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs..

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time
9/21/2021	8:15:00 PM	9/23/2021	2:26:00 AM

Rain(in.) = 4.64
Waterbody: Rouge River

Dilute Raw Sewage (MG)
1.24000

Cause RAIN

Submission ID. HPC-3E48-03ZZT

Outfall **63**

GLWA WRRF

Start Day	Start Time	End Day	End Time
9/21/2021	8:26:00 PM	9/23/2021	3:16:00 AM

Rain(in.) = 4.64
Waterbody: Detroit River

Dilute Raw Sewage (MG)
0.75000

Cause RAIN

Submission ID. HPC-3E48-03ZZT

Outfall **5**

GLWA WRRF

Start Day	Start Time	End Day	End Time
9/21/2021	8:30:00 PM	9/21/2021	11:00:00 PM

Rain(in.) = 4.64
Waterbody: Rouge River

Dilute Raw Sewage (MG)
3.36000

Cause RAIN

Submission ID. HPC-3E48-03ZZT

Outfall **59**

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs..

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time
9/21/2021	8:35:00 PM	9/21/2021	8:48:00 PM

Rain(in.) = 4.64
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.03000

Cause RAIN

Submission ID. HPC-3E48-03ZZT

Outfall **68**

GLWA WRRF

Start Day	Start Time	End Day	End Time
9/21/2021	8:36:00 PM	9/22/2021	3:40:00 PM

Rain(in.) = 4.64
Waterbody: Rouge River

Dilute Raw Sewage (MG)
2.51000

Cause RAIN

Submission ID. HPC-3E48-03ZZT

Outfall **67**

GLWA WRRF

Start Day	Start Time	End Day	End Time
9/21/2021	8:39:00 PM	9/23/2021	1:12:00 PM

Rain(in.) = 4.64
Waterbody: Detroit River

Dilute Raw Sewage (MG)
0.00100

Cause RAIN

Submission ID. HPC-3E48-03ZZT

Outfall **22**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPC-3E48-03ZZT

Start Day	Start Time	End Day	End Time
9/21/2021	8:40:00 PM	9/23/2021	2:23:00 AM

Rain(in.) = 4.64

Waterbody: Detroit River

Outfall **31**

Dilute Raw Sewage (MG)

8.29000

Cause RAIN

GLWA WRRF

Submission ID. HPC-3E48-03ZZT

Start Day	Start Time	End Day	End Time
9/21/2021	8:46:00 PM	9/22/2021	12:27:00 AM

Rain(in.) = 4.64

Waterbody: Rouge River

Outfall **79**

Dilute Raw Sewage (MG)

14.39000

Cause RAIN

GLWA WRRF

Submission ID. HPC-3E48-03ZZT

Start Day	Start Time	End Day	End Time
9/21/2021	8:50:00 PM	9/23/2021	1:54:00 AM

Rain(in.) = 4.64

Waterbody: Detroit River

Outfall **19**

Dilute Raw Sewage (MG)

14.75000

Cause RAIN

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPC-3E48-03ZZT

Start Day	Start Time	End Day	End Time
9/21/2021	8:54:00 PM	9/22/2021	9:37:00 AM

Rain(in.) = 4.64

Waterbody: Detroit River

Outfall **23**

Dilute Raw Sewage (MG)

89.37000

Cause RAIN

GLWA WRRF

Submission ID. HPC-3E48-03ZZT

Start Day	Start Time	End Day	End Time
9/21/2021	8:54:00 PM	9/23/2021	2:48:00 AM

Rain(in.) = 4.64

Waterbody: Detroit River

Outfall **24**

Dilute Raw Sewage (MG)

0.00100

Cause RAIN

GLWA WRRF

Submission ID. HPC-3E48-03ZZT

Start Day	Start Time	End Day	End Time
9/21/2021	9:08:00 PM	9/23/2021	2:48:00 AM

Rain(in.) = 4.64

Waterbody: Detroit River

Outfall **25**

Dilute Raw Sewage (MG)

440.33000

Cause RAIN

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPC-3E48-03ZZT

Start Day	Start Time	End Day	End Time
9/21/2021	9:08:00 PM	9/23/2021	2:48:00 AM

Rain(in.) = 4.64
Waterbody: Detroit River

Outfall **26**

Dilute Raw Sewage (MG)
0.00100

Cause RAIN

GLWA WRRF

Submission ID. HPC-3E48-03ZZT

Start Day	Start Time	End Day	End Time
9/21/2021	9:10:00 PM	9/22/2021	12:02:00 AM

Rain(in.) = 4.64
Waterbody: Rouge River

Outfall **74**

Dilute Raw Sewage (MG)
22.44000

Cause RAIN

GLWA WRRF

Submission ID. HPC-3E48-03ZZT

Start Day	Start Time	End Day	End Time
9/21/2021	9:12:00 PM	9/23/2021	4:34:00 AM

Rain(in.) = 4.64
Waterbody: Detroit River

Outfall **11**

Dilute Raw Sewage (MG)
27.55000

Cause RAIN

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time
9/21/2021	9:12:00 PM	9/23/2021	4:34:00 AM

Rain(in.) = 4.64
Waterbody: Detroit River

Dilute Raw Sewage (MG)
0.00100

Cause RAIN

Submission ID. HPC-3E48-03ZZT

Outfall **12**

GLWA WRRF

Start Day	Start Time	End Day	End Time
9/21/2021	9:12:00 PM	9/23/2021	1:37:00 AM

Rain(in.) = 4.64
Waterbody: Detroit River

Dilute Raw Sewage (MG)
142.72000

Cause RAIN

Submission ID. HPC-3E48-03ZZT

Outfall **9**

GLWA WRRF

Start Day	Start Time	End Day	End Time
9/21/2021	9:37:00 PM	9/22/2021	1:38:00 AM

Rain(in.) = 4.64
Waterbody: Rouge River

Dilute Raw Sewage (MG)
57.90000

Cause RAIN

Submission ID. HPC-3E48-03ZZT

Outfall **60**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPC-3E48-03ZZT

Start Day	Start Time	End Day	End Time
9/21/2021	9:44:00 PM	9/22/2021	12:35:00 AM

Rain(in.) = 4.64
Waterbody: Detroit River

Outfall **40**

Dilute Raw Sewage (MG)
0.00100

Cause RAIN

GLWA WRRF

Submission ID. HPC-3E48-03ZZT

Start Day	Start Time	End Day	End Time
9/21/2021	10:15:00 PM	9/22/2021	12:57:00 AM

Rain(in.) = 4.64
Waterbody: Rouge River

Outfall **61**

Dilute Raw Sewage (MG)
12.88000

Cause RAIN

GLWA WRRF

Submission ID. HPC-3E48-03ZZT

Start Day	Start Time	End Day	End Time
9/21/2021	10:55:00 PM	9/21/2021	11:25:00 PM

Rain(in.) = 4.64
Waterbody: Detroit River

Outfall **20**

Dilute Raw Sewage (MG)
0.00100

Cause RAIN

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPC-3E48-03ZZT

Start Day	Start Time	End Day	End Time
9/21/2021	10:58:00 PM	9/22/2021	12:19:00 AM

Rain(in.) = 4.64
Waterbody: Detroit River

Outfall **43**

Dilute Raw Sewage (MG)
0.00100

Cause RAIN

GLWA WRRF

Submission ID. HPC-3E48-03ZZT

Start Day	Start Time	End Day	End Time
9/21/2021	11:17:00 PM	9/23/2021	12:42:00 AM

Rain(in.) = 4.64
Waterbody: Rouge River

Outfall **77**

Dilute Raw Sewage (MG)
0.83000

Cause RAIN

GLWA WRRF

Submission ID. HPC-3E48-03ZZT

Start Day	Start Time	End Day	End Time
9/21/2021	11:19:00 PM	9/21/2021	11:34:00 PM

Rain(in.) = 4.64
Waterbody: Rouge River

Outfall **75**

Dilute Raw Sewage (MG)
0.01000

Cause RAIN

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time
9/21/2021	11:21:00 PM	9/21/2021	11:27:00 PM

Rain(in.) = 4.64
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.08000

Cause RAIN

Submission ID. HPC-3E48-03ZZT

Outfall **69**

GLWA WRRF

Start Day	Start Time	End Day	End Time
9/21/2021	11:26:00 PM	9/21/2021	11:31:00 PM

Rain(in.) = 4.64
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.06000

Cause RAIN

Submission ID. HPC-3E48-03ZZT

Outfall **62**

GLWA WRRF

Start Day	Start Time	End Day	End Time
9/22/2021	6:52:00 AM	9/23/2021	5:14:00 AM

Rain(in.) = 4.64
Waterbody: Detroit River

Dilute Raw Sewage (MG)
0.00100

Cause RAIN

Submission ID. HPC-3E48-03ZZT

Outfall **38**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPC-CVBM-4CSD8

Start Day	Start Time	End Day	End Time
10/8/2021	12:23:00 PM	10/8/2021	12:53:00 PM

Rain(in.) = 0.36
Waterbody: Rouge River

Outfall **63**

Dilute Raw Sewage (MG)
0.07000

Cause Rain

GLWA WRRF

Submission ID. HPC-CVBM-4CSD8

Start Day	Start Time	End Day	End Time
10/8/2021	12:29:00 PM	10/8/2021	12:55:00 PM

Rain(in.) = 0.36
Waterbody: Rouge River

Outfall **67**

Dilute Raw Sewage (MG)
0.12000

Cause Rain

GLWA WRRF

Submission ID. HPC-CVBM-4CSD8

Start Day	Start Time	End Day	End Time
10/8/2021	12:40:00 PM	10/8/2021	2:01:00 PM

Rain(in.) = 0.36
Waterbody: Rouge River

Outfall **59**

Dilute Raw Sewage (MG)
1.63000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time
10/14/2021	5:32:00 PM	10/16/2021	3:10:00 AM

Rain(in.) = 0.88
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.06000

Cause Rain

Submission ID. HPC-FD5G-RQT0V

Outfall **63**

GLWA WRRF

Start Day	Start Time	End Day	End Time
10/14/2021	5:40:00 PM	10/14/2021	6:05:00 PM

Rain(in.) = 0.88
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.11000

Cause Rain

Submission ID. HPC-FD5G-RQT0V

Outfall **67**

GLWA WRRF

Start Day	Start Time	End Day	End Time
10/15/2021	10:04:00 AM	10/15/2021	10:09:00 AM

Rain(in.) = 0.88
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.09000

Cause Rain

Submission ID. HPC-FD5G-RQT0V

Outfall **59**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPC-MG96-D7C25

Start Day	Start Time	End Day	End Time
10/21/2021	6:20:00 AM	10/21/2021	6:56:00 AM

Rain(in.) = 0.32
Waterbody: Rouge River

Outfall **67**

Dilute Raw Sewage (MG)
0.16000

Cause Rain

GLWA WRRF

Submission ID. HPC-MG96-D7C25

Start Day	Start Time	End Day	End Time
10/21/2021	6:24:00 AM	10/21/2021	6:58:00 AM

Rain(in.) = 0.32
Waterbody: Rouge River

Outfall **63**

Dilute Raw Sewage (MG)
0.02000

Cause Rain

GLWA WRRF

Submission ID. HPC-MG96-D7C25

Start Day	Start Time	End Day	End Time
10/21/2021	6:27:00 AM	10/21/2021	7:07:00 AM

Rain(in.) = 0.32
Waterbody: Rouge River

Outfall **79**

Dilute Raw Sewage (MG)
5.40000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPC-MG96-D7C25

Start Day	Start Time	End Day	End Time
10/21/2021	6:36:00 AM	10/21/2021	7:11:00 AM

Rain(in.) = 0.32
Waterbody: Rouge River

Outfall **59**

Dilute Raw Sewage (MG)
0.79000

Cause Rain

GLWA WRRF

Submission ID. HPC-QCJP-CPX85

Start Day	Start Time	End Day	End Time
10/24/2021	9:52:00 PM	10/25/2021	12:40:00 PM

Rain(in.) = 2.13
Waterbody: Rouge River

Outfall **63**

Dilute Raw Sewage (MG)
1.30000

Cause Rain

GLWA WRRF

Submission ID. HPC-QCJP-CPX85

Start Day	Start Time	End Day	End Time
10/24/2021	9:55:00 PM	10/25/2021	1:09:00 PM

Rain(in.) = 2.13
Waterbody: Rouge River

Outfall **59**

Dilute Raw Sewage (MG)
3.58000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPC-QCJP-CPX85

Start Day	Start Time	End Day	End Time
10/24/2021	9:58:00 PM	10/25/2021	1:41:00 PM

Rain(in.) = 2.13
Waterbody: Rouge River

Outfall **67**

Dilute Raw Sewage (MG)
2.94000

Cause Rain

GLWA WRRF

Submission ID. HPC-QCJP-CPX85

Start Day	Start Time	End Day	End Time
10/24/2021	10:08:00 PM	10/25/2021	3:00:00 AM

Rain(in.) = 2.13
Waterbody: Rouge River

Outfall **64**

Dilute Raw Sewage (MG)
2.78000

Cause Rain

GLWA WRRF

Submission ID. HPC-QCJP-CPX85

Start Day	Start Time	End Day	End Time
10/24/2021	11:29:00 PM	10/25/2021	6:55:00 AM

Rain(in.) = 2.13
Waterbody: Rouge River

Outfall **74**

Dilute Raw Sewage (MG)
19.59000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPC-YSEA-FXRZW

Start Day	Start Time	End Day	End Time
10/25/2021	12:12:00 AM	10/25/2021	2:54:00 PM

Rain(in.) = 2.13

Waterbody: Detroit River

Outfall **12**

Dilute Raw Sewage (MG)

0.00100

Cause Rain

GLWA WRRF

Submission ID. HPC-QCJP-CPX85

Start Day	Start Time	End Day	End Time
10/25/2021	12:14:00 AM	10/25/2021	3:19:00 PM

Rain(in.) = 2.13

Waterbody: Rouge River

Outfall **61**

Dilute Raw Sewage (MG)

7.81000

Cause Rain

GLWA WRRF

Submission ID. HPC-QCJP-CPX85

Start Day	Start Time	End Day	End Time
10/25/2021	12:17:00 AM	10/25/2021	3:20:00 PM

Rain(in.) = 2.13

Waterbody: Detroit River

Outfall **7**

Dilute Raw Sewage (MG)

8.70000

Cause Rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs..

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time
10/25/2021	12:17:00 AM	10/26/2021	9:53:00 AM

Rain(in.) = 2.13
Waterbody: Detroit River

Dilute Raw Sewage (MG)
0.00100

Cause Rain

Submission ID. HPC-YSEA-FXRZW

Outfall **8**

GLWA WRRF

Start Day	Start Time	End Day	End Time
10/25/2021	12:32:00 AM	10/25/2021	5:33:00 AM

Rain(in.) = 2.13
Waterbody: Rouge River

Dilute Raw Sewage (MG)
62.05000

Cause Rain

Submission ID. HPC-QCJP-CPX85

Outfall **60**

GLWA WRRF

Start Day	Start Time	End Day	End Time
10/25/2021	9:40:00 AM	10/25/2021	5:31:00 PM

Rain(in.) = 2.13
Waterbody: Detroit River

Dilute Raw Sewage (MG)
0.00100

Cause Rain

Submission ID. HPC-YSEA-FXRZW

Outfall **38**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time
10/25/2021	11:24:00 AM	10/25/2021	3:53:00 PM

Rain(in.) = 2.13

Waterbody: Detroit River

Dilute Raw Sewage (MG)

33.15000

Cause Rain

Submission ID. HPC-QCJP-CPX85

Outfall **23**

GLWA WRRF

Start Day	Start Time	End Day	End Time
10/25/2021	11:24:00 AM	10/25/2021	3:53:00 PM

Rain(in.) = 2.13

Waterbody: Detroit River

Dilute Raw Sewage (MG)

0.00100

Cause Rain

Submission ID. HPC-YSEA-FXRZW

Outfall **24**

GLWA WRRF

Start Day	Start Time	End Day	End Time
10/25/2021	11:30:00 AM	10/26/2021	9:53:00 AM

Rain(in.) = 2.13

Waterbody: Detroit River

Dilute Raw Sewage (MG)

11.92000

Cause Rain

Submission ID. HPC-QCJP-CPX85

Outfall **9**

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs..

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time
10/25/2021	11:54:00 AM	10/25/2021	3:45:00 PM

Rain(in.) = 2.13
Waterbody: Detroit River

Dilute Raw Sewage (MG)
5.56000

Cause Rain

Submission ID. HPC-QCJP-CPX85

Outfall **11**

GLWA WRRF

Start Day	Start Time	End Day	End Time
10/25/2021	12:37:00 PM	10/25/2021	2:36:00 PM

Rain(in.) = 2.13
Waterbody: Detroit River

Dilute Raw Sewage (MG)
0.54000

Cause Rain

Submission ID. HPC-QCJP-CPX85

Outfall **5**

GLWA WRRF

Start Day	Start Time	End Day	End Time
10/26/2021	6:30:00 AM	10/26/2021	6:35:00 AM

Rain(in.) = 2.13
Waterbody: Detroit River

Dilute Raw Sewage (MG)
0.00100

Cause Rain

Submission ID. HPC-YSEA-FXRZW

Outfall **40**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPC-TWVR-W1EH8

Start Day	Start Time	End Day	End Time
10/29/2021	6:51:00 PM	10/29/2021	9:07:00 PM

Rain(in.) = 1.11

Waterbody: Rouge River

Outfall **67**

Dilute Raw Sewage (MG)

0.59000

Cause Rain

GLWA WRRF

Submission ID. HPC-TWVR-W1EH8

Start Day	Start Time	End Day	End Time
10/29/2021	6:58:00 PM	10/29/2021	10:20:00 PM

Rain(in.) = 1.11

Waterbody: Rouge River

Outfall **74**

Dilute Raw Sewage (MG)

4.24000

Cause Rain

GLWA WRRF

Submission ID. HPC-TWVR-W1EH8

Start Day	Start Time	End Day	End Time
10/29/2021	10:08:00 PM	10/30/2021	2:27:00 AM

Rain(in.) = 1.11

Waterbody: Detroit River

Outfall **7**

Dilute Raw Sewage (MG)

9.59000

Cause Rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs..

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPC-TWVR-W1EH8

Start Day	Start Time	End Day	End Time
10/29/2021	10:08:00 PM	10/30/2021	2:27:00 AM

Rain(in.) = 1.11
Waterbody: Detroit River

Outfall **8**

Dilute Raw Sewage (MG)
0.00100

Cause Rain

GLWA WRRF

Submission ID. HPC-TWVR-W1EH8

Start Day	Start Time	End Day	End Time
10/29/2021	10:36:00 PM	10/30/2021	2:56:00 AM

Rain(in.) = 1.11
Waterbody: Detroit River

Outfall **5**

Dilute Raw Sewage (MG)
2.35000

Cause Rain

GLWA WRRF

Submission ID. HPD-5EX0-7EPT8

Start Day	Start Time	End Day	End Time
11/11/2021	3:49:00 PM	11/11/2021	10:28:00 PM

Rain(in.) = 0.33
Waterbody: Rouge River

Outfall **59**

Dilute Raw Sewage (MG)
8.34000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPD-5EX0-7EPT8

Start Day	Start Time	End Day	End Time
11/11/2021	7:20:00 PM	11/11/2021	9:33:00 PM

Rain(in.) = 0.33
Waterbody: Rouge River

Outfall **63**

Dilute Raw Sewage (MG)
0.59000

Cause Rain

GLWA WRRF

Submission ID. HPD-5EX0-7EPT8

Start Day	Start Time	End Day	End Time
11/11/2021	8:02:00 PM	11/11/2021	10:21:00 PM

Rain(in.) = 0.33
Waterbody: Rouge River

Outfall **64**

Dilute Raw Sewage (MG)
0.12000

Cause Rain

GLWA WRRF

Submission ID. HPD-5EX0-7EPT8

Start Day	Start Time	End Day	End Time
11/11/2021	8:04:00 PM	11/11/2021	8:34:00 PM

Rain(in.) = 0.33
Waterbody: Rouge River

Outfall **67**

Dilute Raw Sewage (MG)
0.13000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPD-R93A-W8S8W

Start Day	Start Time	End Day	End Time
12/5/2021	6:03:00 PM	12/5/2021	9:54:00 PM

Rain(in.) = 0.66
Waterbody: Rouge River

Outfall **67**

Dilute Raw Sewage (MG)
0.78000

Cause Rain

GLWA WRRF

Submission ID. HPD-R93A-W8S8W

Start Day	Start Time	End Day	End Time
12/5/2021	6:24:00 PM	12/5/2021	10:21:00 PM

Rain(in.) = 0.66
Waterbody: Rouge River

Outfall **64**

Dilute Raw Sewage (MG)
1.35000

Cause Rain

GLWA WRRF

Submission ID. HPD-R93A-W8S8W

Start Day	Start Time	End Day	End Time
12/5/2021	6:25:00 PM	12/5/2021	10:06:00 PM

Rain(in.) = 0.66
Waterbody: Rouge River

Outfall **59**

Dilute Raw Sewage (MG)
4.74000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPD-R93A-W8S8W

Start Day	Start Time	End Day	End Time
12/5/2021	6:26:00 PM	12/5/2021	9:47:00 PM

Rain(in.) = 0.66
Waterbody: Rouge River

Outfall **63**

Dilute Raw Sewage (MG)
0.42000

Cause Rain

GLWA WRRF

Submission ID. HPD-R93A-W8S8W

Start Day	Start Time	End Day	End Time
12/5/2021	6:47:00 PM	12/5/2021	7:22:00 PM

Rain(in.) = 0.66
Waterbody: Detroit River

Outfall **7**

Dilute Raw Sewage (MG)
0.39000

Cause Rain

GLWA WRRF

Submission ID. HPD-R93A-W8S8W

Start Day	Start Time	End Day	End Time
12/5/2021	6:59:00 PM	12/5/2021	11:25:00 PM

Rain(in.) = 0.66
Waterbody: Rouge River

Outfall **74**

Dilute Raw Sewage (MG)
6.76000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPD-R93A-W8S8W

Start Day	Start Time	End Day	End Time
12/5/2021	9:20:00 PM	12/6/2021	12:22:00 AM

Rain(in.) = 0.66
Waterbody: Rouge River

Outfall **60**

Dilute Raw Sewage (MG)
39.37000

Cause Rain

GLWA WRRF

Submission ID. HPE-OT7P-20DR4

Start Day	Start Time	End Day	End Time
12/10/2021	8:42:00 PM	12/11/2021	3:28:00 AM

Rain(in.) = 1.38
Waterbody: Rouge River

Outfall **59**

Dilute Raw Sewage (MG)
4.98000

Cause Rain

GLWA WRRF

Submission ID. HPE-OT7P-20DR4

Start Day	Start Time	End Day	End Time
12/10/2021	9:31:00 PM	12/11/2021	8:00:00 AM

Rain(in.) = 1.38
Waterbody: Rouge River

Outfall **63**

Dilute Raw Sewage (MG)
2.10000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPE-OT7P-20DR4

Start Day	Start Time	End Day	End Time
12/10/2021	10:03:00 PM	12/11/2021	4:44:00 AM

Rain(in.) = 1.38
Waterbody: Rouge River

Outfall **67**

Dilute Raw Sewage (MG)
0.87000

Cause Rain

GLWA WRRF

Submission ID. HPE-OT7P-20DR4

Start Day	Start Time	End Day	End Time
12/11/2021	2:23:00 AM	12/11/2021	3:35:00 AM

Rain(in.) = 1.38
Waterbody: Rouge River

Outfall **68**

Dilute Raw Sewage (MG)
0.05000

Cause Rain

GLWA WRRF

Submission ID. HPE-OT7P-20DR4

Start Day	Start Time	End Day	End Time
12/11/2021	2:24:00 AM	12/11/2021	4:29:00 AM

Rain(in.) = 1.38
Waterbody: Rouge River

Outfall **79**

Dilute Raw Sewage (MG)
0.00100

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPE-OT7P-20DR4

Start Day	Start Time	End Day	End Time
12/11/2021	2:34:00 AM	12/11/2021	4:48:00 AM

Rain(in.) = 1.38
Waterbody: Rouge River

Outfall **62**

Dilute Raw Sewage (MG)
1.50000

Cause Rain

GLWA WRRF

Submission ID. HPE-OT7P-20DR4

Start Day	Start Time	End Day	End Time
12/11/2021	2:38:00 AM	12/11/2021	3:28:00 AM

Rain(in.) = 1.38
Waterbody: Rouge River

Outfall **75**

Dilute Raw Sewage (MG)
0.07000

Cause Rain

GLWA WRRF

Submission ID. HPE-OT7P-20DR4

Start Day	Start Time	End Day	End Time
12/11/2021	2:39:00 AM	12/11/2021	6:04:00 AM

Rain(in.) = 1.38
Waterbody: Rouge River

Outfall **74**

Dilute Raw Sewage (MG)
9.18000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPE-OT7P-20DR4

Start Day	Start Time	End Day	End Time
12/11/2021	2:41:00 AM	12/11/2021	3:57:00 AM

Rain(in.) = 1.38
Waterbody: Rouge River

Outfall **77**

Dilute Raw Sewage (MG)
1.07000

Cause Rain

GLWA WRRF

Submission ID. HPE-OT7P-20DR4

Start Day	Start Time	End Day	End Time
12/11/2021	2:44:00 AM	12/11/2021	5:33:00 AM

Rain(in.) = 1.38
Waterbody: Rouge River

Outfall **61**

Dilute Raw Sewage (MG)
30.41000

Cause Rain

GLWA WRRF

Submission ID. HPE-OSCW-AD7PJ

Start Day	Start Time	End Day	End Time
12/11/2021	2:47:00 AM	12/11/2021	8:28:00 AM

Rain(in.) = 1.38
Waterbody: Detroit River

Outfall **7**

Dilute Raw Sewage (MG)
15.12000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPE-OT7P-20DR4

Start Day	Start Time	End Day	End Time
12/11/2021	2:58:00 AM	12/11/2021	5:43:00 AM

Rain(in.) = 1.38
Waterbody: Rouge River

Outfall **60**

Dilute Raw Sewage (MG)
27.61000

Cause Rain

GLWA WRRF

Submission ID. HPE-OSCW-AD7PJ

Start Day	Start Time	End Day	End Time
12/11/2021	2:59:00 AM	12/11/2021	3:25:00 AM

Rain(in.) = 1.38
Waterbody: Detroit River

Outfall **20**

Dilute Raw Sewage (MG)
0.00100

Cause Rain

GLWA WRRF

Submission ID. HPE-OSCW-AD7PJ

Start Day	Start Time	End Day	End Time
12/11/2021	2:59:00 AM	12/11/2021	7:55:00 AM

Rain(in.) = 1.38
Waterbody: Detroit River

Outfall **5**

Dilute Raw Sewage (MG)
0.44000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time
12/11/2021	3:02:00 AM	12/11/2021	4:38:00 AM

Rain(in.) = 1.38
Waterbody: Detroit River

Dilute Raw Sewage (MG)
2.25000

Cause Rain

Submission ID. HPE-OSCW-AD7PJ

Outfall **31**

GLWA WRRF

Start Day	Start Time	End Day	End Time
12/11/2021	3:04:00 AM	12/11/2021	11:05:00 AM

Rain(in.) = 1.38
Waterbody: Detroit River

Dilute Raw Sewage (MG)
12.16000

Cause Rain

Submission ID. HPE-OSCW-AD7PJ

Outfall **11**

GLWA WRRF

Start Day	Start Time	End Day	End Time
12/11/2021	3:04:00 AM	12/11/2021	11:05:00 AM

Rain(in.) = 1.38
Waterbody: Detroit River

Dilute Raw Sewage (MG)
0.00100

Cause Rain

Submission ID. HPE-OSCW-AD7PJ

Outfall **12**

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs..

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPE-OTZ0-HEV7B

Start Day	Start Time	End Day	End Time
12/11/2021	3:06:00 AM	12/11/2021	8:49:00 AM

Rain(in.) = 1.38
Waterbody: Detroit River

Outfall **22**

Dilute Raw Sewage (MG)
0.00100

Cause Rain

GLWA WRRF

Submission ID. HPE-OT7P-20DR4

Start Day	Start Time	End Day	End Time
12/11/2021	3:09:00 AM	12/11/2021	4:28:00 AM

Rain(in.) = 1.38
Waterbody: Rouge River

Outfall **69**

Dilute Raw Sewage (MG)
3.02000

Cause Rain

GLWA WRRF

Submission ID. HPE-OSCW-AD7PJ

Start Day	Start Time	End Day	End Time
12/11/2021	3:16:00 AM	12/11/2021	6:52:00 AM

Rain(in.) = 1.38
Waterbody: Detroit River

Outfall **9**

Dilute Raw Sewage (MG)
3.28000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPE-OSCW-AD7PJ

Start Day	Start Time	End Day	End Time
12/11/2021	3:18:00 AM	12/11/2021	3:43:00 AM

Rain(in.) = 1.38
Waterbody: Detroit River

Outfall **19**

Dilute Raw Sewage (MG)
0.40000

Cause Rain

GLWA WRRF

Submission ID. HPE-OSCW-AD7PJ

Start Day	Start Time	End Day	End Time
12/11/2021	3:20:00 AM	12/11/2021	9:24:00 AM

Rain(in.) = 1.38
Waterbody: Detroit River

Outfall **25**

Dilute Raw Sewage (MG)
0.00100

Cause Rain

GLWA WRRF

Submission ID. HPE-OSCW-AD7PJ

Start Day	Start Time	End Day	End Time
12/11/2021	3:49:00 AM	12/11/2021	8:37:00 AM

Rain(in.) = 1.38
Waterbody: Detroit River

Outfall **38**

Dilute Raw Sewage (MG)
0.00100

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPE-OSCW-AD7PJ

Start Day	Start Time	End Day	End Time
12/11/2021	4:04:00 AM	12/11/2021	4:57:00 AM

Rain(in.) = 1.38
Waterbody: Detroit River

Outfall **40**

Dilute Raw Sewage (MG)
0.00100

Cause Rain

GLWA WRRF

Submission ID. HPE-OSCW-AD7PJ

Start Day	Start Time	End Day	End Time
12/11/2021	6:43:00 AM	12/11/2021	7:19:00 AM

Rain(in.) = 1.38
Waterbody: Detroit River

Outfall **47**

Dilute Raw Sewage (MG)
0.00100

Cause Rain

GLWA WRRF

Submission ID. HPE-OT7P-20DR4

Start Day	Start Time	End Day	End Time
12/11/2021	3:07:00 PM	12/11/2021	5:02:00 AM

Rain(in.) = 1.38
Waterbody: Rouge River

Outfall **65**

Dilute Raw Sewage (MG)
2.59000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPE-0T7P-20DR4

Start Day	Start Time	End Day	End Time
12/11/2021	3:09:00 PM	12/11/2021	4:59:00 AM

Rain(in.) = 1.38
Waterbody: Rouge River

Outfall **64**

Dilute Raw Sewage (MG)
6.88000

Cause Rain

GLWA WRRF

Submission ID. HPE-25XM-AMN3P

Start Day	Start Time	End Day	End Time
12/18/2021	8:50:00 AM	12/18/2021	1:21:00 PM

Rain(in.) = 0.32
Waterbody: Rouge River

Outfall **63**

Dilute Raw Sewage (MG)
1.21000

Cause Rain

GLWA WRRF

Submission ID. HPE-7AW2-YFVG4

Start Day	Start Time	End Day	End Time
12/25/2021	5:30:00 AM	12/25/2021	8:23:00 AM

Rain(in.) = 0.38
Waterbody: Rouge River

Outfall **63**

Dilute Raw Sewage (MG)
0.78000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPE-7AW2-YFVG4

Start Day	Start Time	End Day	End Time
12/25/2021	6:52:00 AM	12/25/2021	7:37:00 AM

Rain(in.) = 0.38

Waterbody: Rouge River

Outfall **59**

Dilute Raw Sewage (MG)

1.01000

Cause Rain

GLWA WRRF

Submission ID. HPE-7AW2-YFVG4

Start Day	Start Time	End Day	End Time
12/25/2021	6:52:00 AM	12/25/2021	7:12:00 AM

Rain(in.) = 0.38

Waterbody: Rouge River

Outfall **67**

Dilute Raw Sewage (MG)

0.09000

Cause Rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Totals GLWA WRRF

Dilute Raw Sewage (MG)

5908.12100

SOC: The NPDES Permit requires elimination of all high priority CSO outfalls by 2037.

EGLE Action: Long-term Control Program being implemented; controls include retention/treatment basins (6 on-line), CSO Screening/Disinfection Facilities (3 on-line), and 13 in-system storage dams in the collection system sewers (on-line) for temporary storing and subsequent transport of combined flow to the wastewater treatment plant; expansion of primary treatment capacity at the WWTP to 1700 MGD (on-line). To date, 14 CSOs have been eliminated, and construction of the Oakwood RTB has been completed. In addition to these 14 outfalls, 5 untreated Rouge River CSOs downstream of the turning basin are now controlled. An amended LTCP was submitted in late 2008 that proposed control projects and associated schedules for 3 untreated CSOs to the Old Channel of the Rouge River, and the 39 remaining untreated CSOs to the Detroit River. However in 2009, due to its deteriorating financial condition, Detroit terminated construction of the Upper Rouge CSO Capture Tunnel (URT). A financial capability assessment (FCA) was submitted and approved by the Department. The alternative LTCP was included in the 2011 permit modification. Another FCA was submitted by Detroit in 2012 as required by the Permit. The FCA again documented that costs associated with continued implementation of the CSO correction program were a high burden to the City of Detroit residents. Reflecting the 2012 FCA and updated costs for effectively operating the WWTP and other facilities, and taking into account opportunities to use Green Infrastructure and apply adaptive management, the permit again revised the LTCP.

Inkster/Dearborn Heights CSO

Inkster/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
3/26/2021	4:00:00 AM	3/29/2021	4:00:00 AM

Rain(in.) = 1.2

Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)

0.30000

Submission ID. HP7-G6Z4-5EPE0
Permit MI0051837
Outfall **11**

Cause Untreated Combined Sewer Overflow resulting from precipitation which exceeded one inch, resulting in overflow of regulator into receiving stream

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Inkster/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
6/21/2021	4:00:00 AM	6/21/2021	2:00:00 PM

Rain(in.) = 1.1
Waterbody: Lower Rouge River

Submission ID. HP9-MJP5-VQ200
Permit MI0051837
Outfall **11**

Dilute Raw Sewage (MG)
0.78000

Cause Untreated Combined Sewer Overflow resulting from precipitation which exceeded one inch, resulting in overflow of regulator into receiving stream

Inkster/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
6/25/2021	5:00:00 PM	6/28/2021	12:00:00 PM

Rain(in.) = 5.38
Waterbody: Lower Rouge River

Submission ID. HP9-R88N-B7RF0
Permit MI0051837
Outfall **11**

Dilute Raw Sewage (MG)
0.58000

Cause Untreated Combined Sewer Overflow resulting from precipitation which exceeded one inch resulting in overflow of regulator into receiving stream

Inkster/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
7/16/2021	10:00:00 AM	7/18/2021	7:00:00 AM

Rain(in.) = 2.94
Waterbody: Lower Rouge River

Submission ID. HPA-8G9B-F7KK9
Permit MI0051837
Outfall **11**

Dilute Raw Sewage (MG)
3.08000

Cause Untreated Combined Sewer Overflow resulting from precipitation which exceeded one inch resulting in overflow of regulator into receiving stream

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Inkster/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
7/24/2021	9:30:00 PM	7/25/2021	11:00:00 AM

Rain(in.) = 1.58
Waterbody: Lower Rouge River

Submission ID. HPA-F2VR-SA301
Permit MI0051837
Outfall **11**

Dilute Raw Sewage (MG)
0.62000

Cause Untreated Combined sewer overflow resulting from precipitation which exceeded one inch resulting in overflow of regulator into receiving stream

Inkster/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
8/12/2021	12:45:00 AM	8/14/2021	12:00:00 PM

Rain(in.) = 3.21
Waterbody: Lower Rouge River

Submission ID. HPB-ORG0-62FAA
Permit MI0051837
Outfall **11**

Dilute Raw Sewage (MG)
0.23708

Cause Untreated Combined sewer overflow resulting from precipitation which exceeded one inch resulting in overflow of regulator into receiving stream

Inkster/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
9/21/2021	11:00:00 PM	9/25/2021	9:30:00 AM

Rain(in.) = 4.33
Waterbody: Lower Rouge River

Submission ID. HPB-XGF7-FR9XE
Permit MI0051837
Outfall **11**

Dilute Raw Sewage (MG)
0.35724

Cause Untreated Combined Sewer Overflow resulting from precipitation which exceeded one inch, resulting in overflow of regulator into receiving stream

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Inkster/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
10/25/2021	2:36:00 AM	10/26/2021	11:45:00 PM

Rain(in.) = 2.05
Waterbody: Lower Rouge River

Submission ID. HPC-QM79-F1J1D
Permit MI0051837
Outfall **11**

Dilute Raw Sewage (MG)
0.11264

Cause Untreated combined sewer overflow resulting from precipitation which exceeded one inch resulting in overflow of regulator into receiving stream

Inkster/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
12/11/2021	2:00:00 AM	12/12/2021	12:00:00 AM

Rain(in.) = 1.09
Waterbody: Lower Rouge River

Submission ID. HPD-WJRF-CN234
Permit MI0051837
Outfall **11**

Dilute Raw Sewage (MG)
0.00966

Cause Untreated Combined Sewer Overflow resulting from precipitation which exceeded one inch resulting in overflow of regulator into receiving stream

Totals Inkster/Dearborn Heights CSO

Dilute Raw Sewage (MG)
6.07662

SOC: The reissued NPDES permit will include a revised LTCP schedule

EGLE Action: Long-term Control Program has been modified; the program addresses one "uncontrolled" (i.e., untreated) CSO outfall; permit requires completion of construction of an approved program for facilities to meet criteria for elimination of raw sewage discharges & protection of public health, and to assure compliance with Water Quality Standards. The Department agreed to a revised correction schedule for this outfall based on the City of Inkster's financial capability demonstration. It's the Departments intent to negotiate a revised schedule for implementation of the remaining LTCP in the reissued permit in 2022

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Redford Twp CSO

Redford Twp CSO

Start Day	Start Time	End Day	End Time
3/26/2021	3:50:00 AM	3/26/2021	6:17:00 AM

Rain(in.) = 1.25
Waterbody: Ashcroft Drain

Dilute Raw Sewage (MG)
0.04375

Cause Diluted, combined sewer overflow due to recent rain event

Submission ID. HP7-JQHH-N33MV
Permit M10051829
Outfall **45A**

Redford Twp CSO

Start Day	Start Time	End Day	End Time
5/23/2021	7:20:00 PM	5/23/2021	7:39:00 PM

Rain(in.) = 0.3
Waterbody: Ashcroft-Sherwood Drain

Dilute Raw Sewage (MG)
0.07000

Cause Diluted, combined sewer overflow due to Heavy Rain

Submission ID. HP8-YBS4-HC87F
Permit MI0051829
Outfall **45A**

Redford Twp CSO

Start Day	Start Time	End Day	End Time
6/21/2021	8:00:00 AM	6/21/2021	8:21:00 AM

Rain(in.) = 1.03
Waterbody: Ashcroft-Sherwood Drain

Dilute Raw Sewage (MG)
0.40000

Cause Diluted raw sewerage due to heavy rain

Submission ID. HP9-MTZR-ZD5X5
Permit MI0051829
Outfall **45A**

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs..

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Redford Twp CSO

Start Day	Start Time	End Day	End Time
6/25/2021	7:45:00 PM	6/26/2021	2:32:00 PM

Rain(in.) = 2.4
Waterbody: Ashcroft-Sherwood Drain

Submission ID. HP9-R8A3-SGXBC
Permit MI0051829
Outfall **45A**

Dilute Raw Sewage (MG)
2.56000

Cause diluted raw sewerage due to heavy rain

Redford Twp CSO

Start Day	Start Time	End Day	End Time
6/28/2021	9:22:00 PM	6/28/2021	11:46:00 PM

Rain(in.) = 0.13
Waterbody: Ashcroft-Sherwood Drain

Submission ID. HP9-TMH7-38E8D
Permit MI0051829
Outfall **45A**

Dilute Raw Sewage (MG)
0.73000

Cause Diluted raw sewage due to heavy rain

Redford Twp CSO

Start Day	Start Time	End Day	End Time
7/16/2021	11:22:00 AM	7/17/2021	7:28:00 PM

Rain(in.) = 1.64
Waterbody: Ashcroft-Sherwood Drain

Submission ID. HPA-8HTD-5J2M9
Permit MI0051829
Outfall **45A**

Dilute Raw Sewage (MG)
3.90000

Cause Diluted Raw sewage due to heavy rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Redford Twp CSO

Start Day	Start Time	End Day	End Time
7/24/2021	9:21:00 PM	7/25/2021	7:30:00 AM

Rain(in.) = 1.5

Waterbody: Ashcroft-Sherwood Drain

Dilute Raw Sewage (MG)

3.20000

Cause diluted raw sewage due to heavy rain

Submission ID. HPA-F5WX-1F9PS

Permit MI0051829

Outfall **45A**

Redford Twp CSO

Start Day	Start Time	End Day	End Time
8/12/2021	6:00:00 AM	8/12/2021	3:40:00 PM

Rain(in.) = 2.48

Waterbody: Ashcroft-Sherwood Drain

Dilute Raw Sewage (MG)

0.14000

Cause diluted raw sewage due to heavy rain

Submission ID. HPA-XNQT-B74NR

Permit MI0051829

Outfall **45A**

Redford Twp CSO

Start Day	Start Time	End Day	End Time
8/27/2021	12:56:00 PM	8/27/2021	6:25:00 PM

Rain(in.) = 2

Waterbody: Ashcroft-Sherwood Drain

Dilute Raw Sewage (MG)

1.80000

Cause diluted raw sewage due to heavy rain

Submission ID. HPB-9JDW-PT3PZ

Permit MI0051829

Outfall **45A**

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs..

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Redford Twp CSO

Start Day	Start Time	End Day	End Time
9/21/2021	10:50:00 PM	9/22/2021	5:00:00 PM

Rain(in.) = 3

Waterbody: Ashcroft-Sherwood Drain

Dilute Raw Sewage (MG)

5.40000

Cause Diluted raw sewage due to heavy rain

Submission ID. HPB-XRDF-FKTCX

Permit MI0051829

Outfall **45A**

Redford Twp CSO

Start Day	Start Time	End Day	End Time
10/25/2021	9:19:00 AM	10/25/2021	1:25:00 PM

Rain(in.) = 1.96

Waterbody: Ashcroft-Sherwood Drain

Dilute Raw Sewage (MG)

1.80000

Cause Diluted raw sewerage due to heavy rain

Submission ID. HPC-RFKY-28QH7

Permit MI0051829

Outfall **45A**

Redford Twp CSO

Start Day	Start Time	End Day	End Time
10/29/2021	7:30:00 PM	10/30/2021	8:58:00 AM

Rain(in.) = 1.07

Waterbody: Ashcroft-Sherwood Drain

Dilute Raw Sewage (MG)

0.95000

Cause Diluted raw sewage due to heavy rain

Submission ID. HPC-VZM3-5G8C8

Permit MI0051535

Outfall **45A**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Redford Twp CSO

Start Day	Start Time	End Day	End Time
12/11/2021	3:14:00 AM	12/11/2021	6:18:00 AM

Rain(in.) = 1.38
Waterbody: Ashcroft-Sherwood Drain

Submission ID. HPD-XK7H-DM5GK
Permit MI0051829
Outfall **45A**

Dilute Raw Sewage (MG)
0.78000

Cause Diluted raw sewage due to heavy rains

Totals Redford Twp CSO

Dilute Raw Sewage (MG)
21.77375

SOC: NPDES permit require elimination/adequate treatment by 2025

EGLE Action: Long-term Control Program being implemented. The reissued permit will require independent control of the remaining untreated outfall or alternatively work with GLWA on a regional plan by 2025.

Southgate-Wyandotte CSO RTF

Southgate-Wyandotte CSO RTF

Start Day	Start Time	End Day	End Time
3/26/2021	3:35:00 AM	3/26/2021	4:52:00 AM

Rain(in.) = 1.25
Waterbody: Detroit River

Submission ID. HP7-G6QK-KNBC4
Permit MI0036072
Outfall **2**

Dilute Raw Sewage (MG)
9.96300

Cause rain

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Southgate-Wyandotte CSO RTF

Start Day	Start Time	End Day	End Time
6/25/2021	11:22:00 PM	6/26/2021	12:08:00 AM

Rain(in.) = 1.82
Waterbody: Detroit River

Dilute Raw Sewage (MG)
19.93000

Cause rain

Submission ID. HP9-RBRZ-RBWA6
Permit MI0036072
Outfall **2**

Southgate-Wyandotte CSO RTF

Start Day	Start Time	End Day	End Time
6/29/2021	3:40:00 PM	6/29/2021	4:07:00 PM

Rain(in.) = 1.82
Waterbody: Detroit River

Dilute Raw Sewage (MG)
7.97000

Cause rain

Submission ID. HP9-TMZ5-X1HQT
Permit MI0036072
Outfall **2**

Southgate-Wyandotte CSO RTF

Start Day	Start Time	End Day	End Time
7/8/2021	3:30:00 PM	7/8/2021	4:05:00 PM

Rain(in.) = 0
Waterbody: Detroit River

Dilute Raw Sewage (MG)
4.98000

Cause rain

Submission ID. HPA-2EYG-6CCHQ
Permit MI0036072
Outfall **2**

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs..

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Southgate-Wyandotte CSO RTF

Start Day	Start Time	End Day	End Time
7/16/2021	10:15:00 AM	7/16/2021	3:29:00 PM

Rain(in.) = 1.79
Waterbody: Detroit River

Dilute Raw Sewage (MG)
22.91000

Cause rain

Submission ID. HPA-8EJW-4JT1X
Permit MI0036072
Outfall **2**

Southgate-Wyandotte CSO RTF

Start Day	Start Time	End Day	End Time
7/24/2021	9:45:00 PM	7/24/2021	11:15:00 AM

Rain(in.) = 1.77
Waterbody: Detroit River

Dilute Raw Sewage (MG)
53.80000

Cause rain

Submission ID. HPA-F2W3-812A8
Permit MI0036072
Outfall **2**

Southgate-Wyandotte CSO RTF

Start Day	Start Time	End Day	End Time
8/12/2021	3:25:00 AM	8/12/2021	10:58:00 AM

Rain(in.) = 2.27
Waterbody: Detroit River

Dilute Raw Sewage (MG)
65.75000

Cause rain

Submission ID. HPA-XERY-3H4KM
Permit MI0036072
Outfall **2**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Southgate-Wyandotte CSO RTF

Start Day	Start Time	End Day	End Time
8/24/2021	8:50:00 PM	8/24/2021	11:12:00 PM

Rain(in.) = 1.01
Waterbody: Detroit River

Dilute Raw Sewage (MG)
32.80000

Cause rain

Submission ID. HPB-7DP1-1A40H
Permit MI0036072
Outfall **2**

Southgate-Wyandotte CSO RTF

Start Day	Start Time	End Day	End Time
8/29/2021	9:01:00 PM	8/29/2021	9:25:00 PM

Rain(in.) = 0.67
Waterbody: Detroit River

Dilute Raw Sewage (MG)
3.98000

Cause Rain

Submission ID. HPB-BBXS-5RX0B
Outfall **NUL**

Southgate-Wyandotte CSO RTF

Start Day	Start Time	End Day	End Time
9/21/2021	10:36:00 PM	10/23/2021	2:53:00 AM

Rain(in.) = 2.11
Waterbody: Detroit River

Dilute Raw Sewage (MG)
43.83700

Cause rain

Submission ID. HPB-XEH6-WDQS1
Permit MI0036072
Outfall **2**

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs..

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Southgate-Wyandotte CSO RTF

Start Day	Start Time	End Day	End Time
10/25/2021	1:07:00 AM	10/25/2021	1:57:00 AM

Rain(in.) = 2.33
Waterbody: Detroit River

Dilute Raw Sewage (MG)
10.90000

Submission ID. HPC-QMMC-ED8EA
Permit MI0036072
Outfall **2**

Cause rain

Southgate-Wyandotte CSO RTF

Start Day	Start Time	End Day	End Time
12/5/2021	8:17:00 PM	12/5/2021	8:58:00 PM

Rain(in.) = 1.11
Waterbody: Detroit River - Trenton Channel

Dilute Raw Sewage (MG)
1.99260

Submission ID. HPD-RVYS-W68VD
Permit MI0036072
Outfall **2**

Cause Wet weather event exceeded capacity of this CSO station dewatering pumps to the system and required discharge to the Detroit River. Rainfall locally totaled 1.11".

Southgate-Wyandotte CSO RTF

Start Day	Start Time	End Day	End Time
12/11/2021	3:15:00 AM	12/11/2021	4:29:00 AM

Rain(in.) = 1.61
Waterbody: Detroit River - Trenton Channel

Dilute Raw Sewage (MG)
9.96300

Submission ID. HPD-WJW2-YY15Z
Permit MI0036072
Outfall **2**

Cause Rain event of 1.61" exceeded the capacity of the local sewer.

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Totals Southgate-Wyandotte CSO RTF

Dilute Raw Sewage (MG)

288.77560

SOC: Long-term Control Program being implemented (existing retention/treatment facility); reissued permit requires a Water Quality Study for a determination of whether the facility provides adequate treatment of all overflows; Long-term Control Program for f

EGLE Action: Long-term Control Program being implemented (existing retention/treatment facility); reissued permit requires a Water Quality Study for a determination of whether the facility provides adequate treatment of all overflows; Long-term Control Program for facility upgrade and provisions for adequate treatment may be required in the future. The NPDES permit also requires the permittee to submit a Hydraulic Capacity Study for the Pine St PS. The study will be used to determine if any improvements can be made to eliminate CSO discharges from the Pine St PS.

Wayne Co/Dearborn Heights CSO

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.33 Waterbody: Lower Rouge River
3/26/2021	2:35:00 AM	3/26/2021	4:00:00 AM	

Dilute Raw Sewage (MG)

0.10000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP7-G71Q-4PG5Y
Permit MI0051489
Outfall **L43**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
3/26/2021	2:35:00 AM	3/26/2021	4:00:00 AM

Rain(in.) = 1.33
Waterbody: Middle Rouge River

Dilute Raw Sewage (MG)
0.20000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP7-G71Q-4PG5Y
Permit MI0051489
Outfall **M13**

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
3/26/2021	2:35:00 AM	3/26/2021	4:00:00 AM

Rain(in.) = 1.33
Waterbody: Middle Rouge River

Dilute Raw Sewage (MG)
0.20000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP7-G71Q-4PG5Y
Permit MI0051489
Outfall **M14**

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
3/26/2021	2:35:00 AM	3/26/2021	4:00:00 AM

Rain(in.) = 1.33
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.20000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP7-G71Q-4PG5Y
Permit MI0051489
Outfall **U1**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
3/28/2021	2:16:00 AM	3/28/2021	2:40:00 AM

Rain(in.) = 0.72
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.10000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP7-HVP6-BVKCH
Permit MI0051489
Outfall **L43**

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
3/28/2021	2:16:00 AM	3/28/2021	2:40:00 AM

Rain(in.) = 0.72
Waterbody: Middle Rouge River

Dilute Raw Sewage (MG)
0.20000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP7-HVP6-BVKCH
Permit MI0051489
Outfall **M13**

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
3/28/2021	2:16:00 AM	3/28/2021	2:40:00 AM

Rain(in.) = 0.72
Waterbody: Middle Rouge River

Dilute Raw Sewage (MG)
0.20000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP7-HVP6-BVKCH
Permit MI0051489
Outfall **M14**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
3/28/2021	2:16:00 AM	3/28/2021	2:40:00 AM

Rain(in.) = 0.72
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.20000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP7-HVP6-BVKCH
Permit MI0051489
Outfall **U1**

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
5/23/2021	6:25:00 PM	5/23/2021	6:52:00 PM

Rain(in.) = 0.82
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.10000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP8-Y7NX-EVE93
Permit MI0051489
Outfall **L43**

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
5/23/2021	6:25:00 PM	5/23/2021	6:52:00 PM

Rain(in.) = 0.82
Waterbody: Middle Rouge River

Dilute Raw Sewage (MG)
0.30000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP8-Y7NX-EVE93
Permit MI0051489
Outfall **M13**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
5/23/2021	6:25:00 PM	5/23/2021	6:52:00 PM

Rain(in.) = 0.82
Waterbody: Middle Rouge River

Dilute Raw Sewage (MG)
0.20000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP8-Y7NX-EVE93
Permit MI0051489
Outfall **M14**

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
5/23/2021	6:25:00 PM	5/23/2021	6:52:00 PM

Rain(in.) = 0.82
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.20000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP8-Y7NX-EVE93
Permit MI0051489
Outfall **U1**

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
6/2/2021	9:00:00 PM	6/2/2021	9:15:00 PM

Rain(in.) = 0.61
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.10000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-65M8-HW8EZ
Permit MI0051489
Outfall **L43**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
6/2/2021	9:00:00 PM	6/2/2021	9:15:00 PM

Rain(in.) = 0.61
Waterbody: Middle Rouge River

Dilute Raw Sewage (MG)
0.10000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-65M8-HW8EZ
Permit MI0051489
Outfall **M13**

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
6/2/2021	9:00:00 PM	6/2/2021	9:15:00 PM

Rain(in.) = 0.61
Waterbody: Middle Rouge River

Dilute Raw Sewage (MG)
0.10000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-65M8-HW8EZ
Permit MI0051489
Outfall **M14**

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
6/2/2021	9:00:00 PM	6/2/2021	9:15:00 PM

Rain(in.) = 0.61
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.10000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-65M8-HW8EZ
Permit MI0051489
Outfall **U1**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
6/20/2021	11:00:00 PM	6/21/2021	11:30:00 PM

Rain(in.) = 1.2

Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)

0.10000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-MCW4-C62Z7

Permit MI0051489

Outfall **L43**

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
6/20/2021	11:00:00 PM	6/21/2021	11:30:00 PM

Rain(in.) = 1.2

Waterbody: Middle Rouge River

Dilute Raw Sewage (MG)

0.20000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-MCW4-C62Z7

Permit MI0051489

Outfall **M13**

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
6/20/2021	11:00:00 PM	6/21/2021	11:30:00 PM

Rain(in.) = 1.2

Waterbody: Middle Rouge River

Dilute Raw Sewage (MG)

0.20000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-MCW4-C62Z7

Permit MI0051489

Outfall **M14**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
6/20/2021	11:00:00 PM	6/21/2021	11:30:00 PM

Rain(in.) = 1.2
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.20000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-MCW4-C62Z7
Permit MI0051489
Outfall **U1**

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
6/25/2021	11:18:00 AM	6/26/2021	2:00:00 PM

Rain(in.) = 5.15
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
3.90000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-QY0D-6PS0N
Permit MI0051489
Outfall **L43**

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
6/25/2021	11:18:00 AM	6/26/2021	2:00:00 PM

Rain(in.) = 5.15
Waterbody: Middle Rouge River

Dilute Raw Sewage (MG)
9.30000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-QY0D-6PS0N
Permit MI0051489
Outfall **M13**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
6/25/2021	11:18:00 AM	6/26/2021	2:00:00 PM

Rain(in.) = 5.15
Waterbody: Middle Rouge River

Dilute Raw Sewage (MG)
7.80000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-QY0D-6PS0N
Permit MI0051489
Outfall **M14**

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
6/25/2021	11:18:00 AM	6/26/2021	2:00:00 PM

Rain(in.) = 5.15
Waterbody: Rouge River

Dilute Raw Sewage (MG)
8.10000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-QY0D-6PS0N
Permit MI0051489
Outfall **U1**

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
7/16/2021	11:25:00 AM	7/17/2021	1:48:00 PM

Rain(in.) = 3.29
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.80000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-8ENA-KAMAP
Permit MI0051489
Outfall **L43**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
7/16/2021	11:25:00 AM	7/17/2021	1:48:00 PM

Rain(in.) = 3.29
Waterbody: Middle Rouge River

Dilute Raw Sewage (MG)
2.00000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-8ENA-KAMAP
Permit MI0051489
Outfall **M13**

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
7/16/2021	11:25:00 AM	7/17/2021	1:48:00 PM

Rain(in.) = 3.29
Waterbody: Middle Rouge River

Dilute Raw Sewage (MG)
1.70000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-8ENA-KAMAP
Permit MI0051489
Outfall **M14**

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
7/16/2021	11:25:00 AM	7/17/2021	1:48:00 PM

Rain(in.) = 3.29
Waterbody: Rouge River

Dilute Raw Sewage (MG)
1.70000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-8ENA-KAMAP
Permit MI0051489
Outfall **U1**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
7/24/2021	9:10:00 PM	7/25/2021	7:35:00 AM

Rain(in.) = 1.71

Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)

0.50000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-F18T-RPBF6

Permit MI0051489

Outfall **L43**

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
7/24/2021	9:10:00 PM	7/25/2021	7:35:00 AM

Rain(in.) = 1.71

Waterbody: Middle Rouge River

Dilute Raw Sewage (MG)

1.30000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-F18T-RPBF6

Permit MI0051489

Outfall **M13**

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
7/24/2021	9:10:00 PM	7/25/2021	7:35:00 AM

Rain(in.) = 1.71

Waterbody: Middle Rouge River

Dilute Raw Sewage (MG)

1.10000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-F18T-RPBF6

Permit MI0051489

Outfall **M14**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
7/24/2021	9:10:00 PM	7/25/2021	7:35:00 AM

Rain(in.) = 1.71
Waterbody: Rouge River

Dilute Raw Sewage (MG)
1.10000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-F18T-RPBF6
Permit MI0051489
Outfall **U1**

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
8/9/2021	3:20:00 PM	8/9/2021	3:40:00 PM

Rain(in.) = 0.4
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.04000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-VEES-5QHGZ
Permit MI0051489
Outfall **L43**

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
8/9/2021	3:20:00 PM	8/9/2021	3:40:00 PM

Rain(in.) = 0.4
Waterbody: Middle Rouge River

Dilute Raw Sewage (MG)
0.10000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-VEES-5QHGZ
Permit MI0051489
Outfall **M13**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
8/9/2021	3:20:00 PM	8/9/2021	3:40:00 PM

Rain(in.) = 0.4
Waterbody: Middle Rouge River

Dilute Raw Sewage (MG)
0.10000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-VEES-5QHGZ
Permit MI0051489
Outfall **M14**

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
8/9/2021	3:20:00 PM	8/9/2021	3:40:00 PM

Rain(in.) = 0.4
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.10000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-VEES-5QHGZ
Permit MI0051489
Outfall **U1**

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
8/12/2021	3:00:00 AM	8/12/2021	7:30:00 PM

Rain(in.) = 2.4
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.50000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-XF5C-9HGR2
Permit MI0051489
Outfall **L43**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
8/12/2021	3:00:00 AM	8/12/2021	7:30:00 PM

Rain(in.) = 2.4

Waterbody: Middle Rouge River

Dilute Raw Sewage (MG)

1.10000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-XF5C-9HGR2

Permit MI0051489

Outfall **M13**

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
8/12/2021	3:00:00 AM	8/12/2021	7:30:00 PM

Rain(in.) = 2.4

Waterbody: Middle Rouge River

Dilute Raw Sewage (MG)

1.00000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-XF5C-9HGR2

Permit MI0051489

Outfall **M14**

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
8/12/2021	3:00:00 AM	8/12/2021	7:30:00 PM

Rain(in.) = 2.4

Waterbody: Rouge River

Dilute Raw Sewage (MG)

1.00000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-XF5C-9HGR2

Permit MI0051489

Outfall **U1**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
8/27/2021	2:24:00 PM	8/28/2021	3:09:00 AM

Rain(in.) = 2.19
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.20000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPB-9H7K-8AZRR
Permit MI0051489
Outfall **L43**

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
8/27/2021	2:24:00 PM	8/28/2021	3:09:00 PM

Rain(in.) = 2.19
Waterbody: Middle River Rouge

Dilute Raw Sewage (MG)
0.50000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPB-9H7K-8AZRR
Permit MI0051489
Outfall **M13**

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
8/27/2021	2:24:00 PM	8/28/2021	3:09:00 AM

Rain(in.) = 2.19
Waterbody: Middle River Rouge

Dilute Raw Sewage (MG)
0.40000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPB-9H7K-8AZRR
Permit MI0051489
Outfall **M14**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
8/27/2021	2:24:00 PM	8/28/2021	3:09:00 AM

Rain(in.) = 2.19
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.40000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPB-9H7K-8AZRR
Permit MI0051489
Outfall **U1**

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
9/21/2021	11:45:00 PM	9/23/2021	1:00:00 PM

Rain(in.) = 4.41
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.90000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPB-XFTA-1YPJP
Permit MI0051489
Outfall **L43**

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
9/21/2021	11:45:00 PM	9/23/2021	1:00:00 PM

Rain(in.) = 4.41
Waterbody: Middle Rouge River

Dilute Raw Sewage (MG)
2.10000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPB-XFTA-1YPJP
Permit MI0051489
Outfall **M13**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
9/21/2021	11:45:00 PM	9/23/2021	1:00:00 PM

Rain(in.) = 4.41
Waterbody: Middle Rouge River

Dilute Raw Sewage (MG)
1.80000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPB-XFTA-1YPJP
Permit MI0051489
Outfall **M14**

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
9/21/2021	11:45:00 PM	9/23/2021	1:00:00 PM

Rain(in.) = 4.41
Waterbody: Rouge River

Dilute Raw Sewage (MG)
1.80000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPB-XFTA-1YPJP
Permit MI0051489
Outfall **U1**

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
10/25/2021	12:05:00 AM	10/25/2021	12:17:00 PM

Rain(in.) = 2.18
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.20000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPC-QMS6-H7EH3
Permit MI0051489
Outfall **L43**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
10/25/2021	12:05:00 AM	10/25/2021	12:17:00 PM

Rain(in.) = 2.18
Waterbody: Middle Rouge River

Dilute Raw Sewage (MG)
0.50000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPC-QMS6-H7EH3
Permit MI0051489
Outfall **M13**

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
10/25/2021	12:05:00 AM	10/25/2021	12:17:00 PM

Rain(in.) = 2.18
Waterbody: Middle Rouge River

Dilute Raw Sewage (MG)
0.40000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPC-QMS6-H7EH3
Permit MI0051489
Outfall **M14**

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
10/25/2021	12:05:00 AM	10/25/2021	12:17:00 PM

Rain(in.) = 2.18
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.40000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPC-QMS6-H7EH3
Permit MI0051489
Outfall **U1**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
10/29/2021	1:00:00 PM	10/30/2021	5:38:00 AM

Rain(in.) = 1.12
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.04000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPC-WESN-RTYA5
Permit MI0051489
Outfall **L43**

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
10/29/2021	1:00:00 PM	10/30/2021	5:38:00 AM

Rain(in.) = 1.12
Waterbody: Middle Rouge River

Dilute Raw Sewage (MG)
0.10000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPC-WESN-RTYA5
Permit MI0051489
Outfall **M13**

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
10/29/2021	1:00:00 PM	10/30/2021	5:38:00 AM

Rain(in.) = 1.12
Waterbody: Middle Rouge River

Dilute Raw Sewage (MG)
0.10000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPC-WESN-RTYA5
Permit MI0051489
Outfall **M14**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
10/29/2021	1:00:00 PM	10/30/2021	5:38:00 AM

Rain(in.) = 1.12
Waterbody: Rouge River

Dilute Raw Sewage (MG)
0.10000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPC-WESN-RTYA5
Permit MI0051489
Outfall **U1**

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
12/11/2021	3:10:00 AM	12/11/2021	4:51:00 PM

Rain(in.) = 1.06
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.10000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPD-WJQP-CVG23
Permit MI0051489
Outfall **L43**

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
12/11/2021	3:10:00 AM	12/11/2021	4:51:00 PM

Rain(in.) = 1.06
Waterbody: Middle Rouge River

Dilute Raw Sewage (MG)
0.30000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPD-WJQP-CVG23
Permit MI0051489
Outfall **M13**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
12/11/2021	3:10:00 AM	12/11/2021	4:51:00 PM

Rain(in.) = 1.06
Waterbody: Middle Rouge River

Submission ID. HPD-WJQP-CVG23
Permit MI0051489
Outfall **M14**

Dilute Raw Sewage (MG)
0.30000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time
12/11/2021	3:10:00 AM	12/11/2021	4:51:00 PM

Rain(in.) = 1.06
Waterbody: Rouge River

Submission ID. HPD-WJQP-CVG23
Permit MI0051489
Outfall **U1**

Dilute Raw Sewage (MG)
0.30000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Totals Wayne Co/Dearborn Heights CSO

Dilute Raw Sewage (MG)
57.48000

SOC: The reissued NPDES permit will include a revised LTCP schedule

EGLE Action: Long-term Control Program revised in reissued permit; construction of retention/treatment basin is complete & facility is "on-line" and the Department agrees that the RTB protects public health, eliminates raw sewage, protects the physical characteristics standard, and does not impact biological communities. An evaluation of the RTB discharges on the dissolved oxygen standard has been submitted and is under Department review. Outfalls M18 & M19 have been eliminated and certified by December, 2005 (flow has been directed to the existing RTB). It's the Departments intent to negotiate a revised schedule for implementation of the remaining LTCP in the reissued permit in 2022

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Inkster CSO

Wayne Co/Inkster CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.32
3/26/2021	2:30:00 AM	3/26/2021	7:23:00 AM	Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)

2.60000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP7-G4AW-TSVB6
Permit MI0051471
Outfall **10**

Wayne Co/Inkster CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.81
3/27/2021	11:40:00 PM	3/28/2021	10:55:00 AM	Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)

1.80000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP7-HVGR-4TFK5
Permit MI0051471
Outfall **10**

Wayne Co/Inkster CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.57
6/2/2021	10:00:00 PM	6/2/2021	10:35:00 AM	Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)

0.60000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-66KE-78BV2
Permit MI0051471
Outfall **10**

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs..

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Inkster CSO

Start Day	Start Time	End Day	End Time
6/20/2021	11:28:00 PM	6/21/2021	10:12:00 AM

Rain(in.) = 1.2
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
2.10000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-MD8Q-14D3N
Permit MI0051471
Outfall **10**

Wayne Co/Inkster CSO

Start Day	Start Time	End Day	End Time
6/25/2021	11:22:00 AM	6/27/2021	12:34:00 PM

Rain(in.) = 5.92
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
39.50000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-QY7M-R8F39
Permit MI0051471
Outfall **10**

Wayne Co/Inkster CSO

Start Day	Start Time	End Day	End Time
7/16/2021	9:42:00 AM	7/17/2021	1:48:00 PM

Rain(in.) = 3.29
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
18.70000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-CG3D-1QWCQ
Permit MI0051471
Outfall **10**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Inkster CSO

Start Day	Start Time	End Day	End Time
7/24/2021	9:20:00 PM	7/25/2021	4:23:00 AM

Rain(in.) = 1.71
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
7.20000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-F2B4-NX44J
Permit MI0051471
Outfall **10**

Wayne Co/Inkster CSO

Start Day	Start Time	End Day	End Time
8/9/2021	3:40:00 PM	8/9/2021	4:05:00 PM

Rain(in.) = 0.4
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
1.20000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-R8BH-GBN9Y
Permit MI0051471
Outfall **10**

Wayne Co/Inkster CSO

Start Day	Start Time	End Day	End Time
8/12/2021	2:17:00 AM	8/12/2021	10:18:00 PM

Rain(in.) = 2.4
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
12.40000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-XE8R-ZWE83
Permit MI0051471
Outfall **10**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Inkster CSO

Start Day	Start Time	End Day	End Time
8/27/2021	2:10:00 PM	8/27/2021	2:25:00 PM

Rain(in.) = 2.19
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.50000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPB-9H2Y-HCDVV
Permit MI0051471
Outfall **10**

Wayne Co/Inkster CSO

Start Day	Start Time	End Day	End Time
9/21/2021	9:55:00 PM	9/23/2021	4:00:00 PM

Rain(in.) = 4.53
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
9.30000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPB-XDQV-22PEJ
Permit MI0051471
Outfall **10**

Wayne Co/Inkster CSO

Start Day	Start Time	End Day	End Time
10/24/2021	10:40:00 PM	10/25/2021	9:06:00 AM

Rain(in.) = 2.11
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
5.60000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPC-QN02-
Permit WQQWC
MI0051471
Outfall **10**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Inkster CSO

Start Day	Start Time	End Day	End Time
10/29/2021	1:40:00 PM	10/30/2021	6:12:00 AM

Rain(in.) = 1.02

Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)

0.60000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPC-WE9V-
Permit MZAVM
MI0051471
Outfall **10**

Wayne Co/Inkster CSO

Start Day	Start Time	End Day	End Time
12/11/2021	2:38:00 AM	12/11/2021	4:10:00 PM

Rain(in.) = 1.04

Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)

2.90000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPD-WP0R-PMRGX
Permit MI0051471
Outfall **10**

Wayne Co/Inkster CSO

Start Day	Start Time	End Day	End Time
12/25/2021	8:14:00 AM	12/25/2021	8:26:00 AM

Rain(in.) = 0.48

Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)

0.50000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPE-7NH7-ATB6H
Permit MI0051471
Outfall **10**

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs..

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Totals Wayne Co/Inkster CSO

Dilute Raw Sewage (MG)

105.50000

SOC: The reissued NPDES permit will include a revised LTCP schedule

EGLE Action: Long-term Control Program revised in permit; construction of retention/treatment basin is complete & facility is "on-line" and the Department agrees that the RTB protects public health, eliminates raw sewage, protects the physical characteristics standard, and does not impact biological communities. An evaluation of the RTB discharges on the dissolved oxygen standard has been submitted and is under Department review. 5 CSOs have been eliminated/bulkheaded following sewer separation. The City recently constructed an RTB to address two west side CSOs. A revised financial demonstration has been submitted and it's the Departments intent to negotiate a revised schedule for implementation of the remaining LTCP in the reissued permit in 2022

Wayne Co/Inkster/Drbrn Hts CSO

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
2/23/2021	1:25:00 PM	2/23/2021	3:40:00 PM

Rain(in.) = 0

Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)

0.00250

Cause Significant snow melt occurred which caused the flow rate in the sewer to overflow the weir to the outfall.

Submission ID. HP6-R7SZ-18ENR

Permit MI0051462

Outfall **L42**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
2/24/2021	1:40:00 PM	2/24/2021	4:00:00 PM

Rain(in.) = 0

Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)

0.00170

Cause Significant snow melt occurred which caused the flow rate in the sewer to overflow the weir to the outfall.

Submission ID. HP6-TBSH-GOX0K

Permit MI0051462

Outfall **L42**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
2/27/2021	2:25:00 AM	2/27/2021	3:10:00 AM

Rain(in.) = 0.16

Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)

0.00380

Cause Significant snow melt and rain caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP6-WYNJ-GADX0

Permit MI0051462

Outfall **L42**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
3/26/2021	2:30:00 AM	3/26/2021	7:23:00 AM

Rain(in.) = 1.33

Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)

3.90000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP7-G4E2-V3EVC

Permit MI0051462

Outfall **L41**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
3/26/2021	2:30:00 AM	3/26/2021	7:23:00 AM

Rain(in.) = 1.33
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.30000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP7-G4E2-V3EVC
Permit MI0051462
Outfall **L42**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
3/27/2021	11:40:00 PM	3/28/2021	10:55:00 AM

Rain(in.) = 0.81
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
2.90000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP7-HVK9-8WVOT
Permit MI0051462
Outfall **L41**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
3/27/2021	11:40:00 PM	3/28/2021	10:55:00 AM

Rain(in.) = 0.81
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.20000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP7-HVK9-8WVOT
Permit MI0051462
Outfall **L42**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
4/3/2021	2:55:00 AM	4/3/2021	10:00:00 AM

Rain(in.) = 0

Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)

0.08000

Cause Flow rate in the sewer exceeded the regulator capacity.

Submission ID. HP7-RE8H-XQ4QZ

Permit MI0051462

Outfall **L42**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
4/5/2021	10:55:00 AM	4/5/2021	12:25:00 PM

Rain(in.) = 0.13

Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)

0.00210

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP7-VDC1-ES19W

Permit MI0051462

Outfall **L42**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
4/6/2021	3:20:00 PM	4/6/2021	3:30:00 PM

Rain(in.) = 0.13

Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)

0.00060

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP7-VDQ8-BDXBD

Permit MI0051462

Outfall **L42**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
4/8/2021	3:50:00 PM	4/9/2021	12:25:00 AM

Rain(in.) = 0.25
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.02000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP7-VDXX-SYVFZ
Permit MI0051462
Outfall **L42**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
4/10/2021	8:10:00 PM	4/11/2021	2:05:00 AM

Rain(in.) = 0.5
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.10000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP7-YFJN-35A3V
Permit MI0051462
Outfall **L42**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
5/23/2021	6:25:00 PM	5/23/2021	6:52:00 PM

Rain(in.) = 0.82
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.80000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP8-Y7SM-D8QGN
Permit MI0051462
Outfall **L41**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
5/23/2021	6:25:00 PM	5/23/2021	6:52:00 PM

Rain(in.) = 0.82
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.30000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP8-Y7SM-D8QGN
Permit MI0051462
Outfall **L42**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
5/26/2021	8:20:00 AM	5/26/2021	9:30:00 AM

Rain(in.) = 0.3
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.03000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-OCTV-4FNZQ
Permit MI0051462
Outfall **L42**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
5/28/2021	2:30:00 AM	5/28/2021	1:20:00 PM

Rain(in.) = 0.86
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.10000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-224P-SVYN9
Permit MI0051462
Outfall **L42**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
6/2/2021	9:00:00 PM	6/2/2021	10:35:00 PM

Rain(in.) = 0.61
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
1.20000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-65RT-BYCTQ
Permit MI0051462
Outfall **L41**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
6/2/2021	9:00:00 PM	6/2/2021	10:35:00 PM

Rain(in.) = 0.61
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.20000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-65RT-BYCTQ
Permit MI0051462
Outfall **L42**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
6/11/2021	8:00:00 PM	6/11/2021	8:45:00 PM

Rain(in.) = 0.27
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.02000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-F5WN-4E9RK
Permit MI0051462
Outfall **L42**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
6/18/2021	5:40:00 AM	6/18/2021	9:30:00 AM

Rain(in.) = 0.46
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.06000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-JSAJ-120C0
Permit MI0051462
Outfall **L42**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
6/20/2021	11:00:00 PM	6/21/2021	10:12:00 AM

Rain(in.) = 1.2
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
3.30000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-MD5J-R99Z0
Permit MI0051462
Outfall **L41**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
6/20/2021	11:00:00 PM	6/21/2021	10:12:00 AM

Rain(in.) = 1.2
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.30000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-MD5J-R99Z0
Permit MI0051462
Outfall **L42**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
6/25/2021	11:18:00 AM	6/27/2021	12:34:00 PM

Rain(in.) = 5.92
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
78.00000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-QY5Q-QZ2WC
Permit MI0051462
Outfall **L41**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
6/25/2021	11:18:00 AM	6/27/2021	12:34:00 PM

Rain(in.) = 5.92
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
11.20000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-QY5Q-QZ2WC
Permit MI0051462
Outfall **L42**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
6/27/2021	10:50:00 PM	6/28/2021	2:25:00 AM

Rain(in.) = 0.05
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.01000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-VQN6-DTS72
Permit MI0051462
Outfall **L42**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
6/28/2021	7:40:00 PM	6/28/2021	9:45:00 PM

Rain(in.) = 0.22
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.03000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-VSDJ-C7J5X
Permit MI0051462
Outfall **L42**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
6/29/2021	2:00:00 PM	6/29/2021	3:15:00 PM

Rain(in.) = 0.3
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.07000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-VST5-B5QJB
Permit MI0051462
Outfall **L42**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
7/8/2021	5:05:00 AM	7/8/2021	5:55:00 AM

Rain(in.) = 0.08
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.03000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-2HD2-HQ7XJ
Permit MI0051462
Outfall **L42**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
7/8/2021	5:40:00 PM	7/8/2021	6:00:00 PM

Rain(in.) = 0.06
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.00060

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-2HGN-96EFD
Permit MI0051462
Outfall **L42**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
7/11/2021	7:00:00 AM	7/11/2021	7:50:00 AM

Rain(in.) = 0.35
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.00500

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-65K9-6YZAC
Permit MI0051462
Outfall **L42**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
7/13/2021	12:40:00 PM	7/13/2021	1:35:00 PM

Rain(in.) = 0.37
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.05000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-6S25-V5Q02
Permit MI0051462
Outfall **L42**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
7/16/2021	9:42:00 AM	7/17/2021	1:48:00 PM

Rain(in.) = 3.29
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
29.40000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-8F0J-XMF42
Permit MI0051462
Outfall **L41**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
7/16/2021	9:42:00 AM	7/17/2021	1:48:00 PM

Rain(in.) = 3.29
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
2.50000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-8F0J-XMF42
Permit MI0051462
Outfall **L42**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
7/20/2021	7:05:00 PM	7/20/2021	8:15:00 PM

Rain(in.) = 0.55
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.06000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-CH1J-ED7FR
Permit MI0051462
Outfall **L42**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
7/24/2021	8:00:00 PM	7/26/2021	11:50:00 PM

Rain(in.) = 1.71
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
2.30000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-GZYJ-JQA74
Permit MI0051462
Outfall **L42**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
7/24/2021	9:10:00 PM	7/25/2021	7:35:00 AM

Rain(in.) = 1.71
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
12.80000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-F1G4-YK7X3
Permit MI0051462
Outfall **L41**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
7/24/2021	9:10:00 PM	7/25/2021	7:35:00 AM

Rain(in.) = 1.71
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
1.50000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-F1G4-YK7X3
Permit MI0051462
Outfall **L42**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
8/9/2021	3:20:00 PM	8/9/2021	4:05:00 PM

Rain(in.) = 0.4
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
1.80000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-VEK7-7F1SA
Permit MI0051462
Outfall **L41**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
8/9/2021	3:20:00 PM	8/9/2021	4:05:00 PM

Rain(in.) = 0.4
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.10000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-VEK7-7F1SA
Permit MI0051462
Outfall **L42**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
8/12/2021	2:17:00 AM	8/12/2021	10:18:00 PM

Rain(in.) = 2.4
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
19.00000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-XEGQ-8Z1MM
Permit MI0051462
Outfall **L41**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
8/12/2021	2:17:00 AM	8/12/2021	10:18:00 PM

Rain(in.) = 2.4

Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)

19.00000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-XEGQ-8Z1MM

Permit MI0051462

Outfall **L42**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
8/24/2021	6:50:00 PM	8/24/2021	7:40:00 PM

Rain(in.) = 0.56

Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)

0.03000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPB-9CAK-E8D13

Permit MI0051462

Outfall **L42**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
8/25/2021	12:05:00 PM	8/25/2021	12:15:00 PM

Rain(in.) = 0.56

Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)

0.00030

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPB-9CPF-HYVQF

Permit MI0051462

Outfall **L42**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
8/27/2021	2:10:00 PM	8/28/2021	3:09:00 AM

Rain(in.) = 2.19
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
2.10000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPB-9H5F-9G97Q
Permit MI0051462
Outfall **L41**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
8/27/2021	2:10:00 PM	8/28/2021	3:09:00 AM

Rain(in.) = 2.19
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.60000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPB-9H5F-9G97Q
Permit MI0051462
Outfall **L42**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
8/29/2021	7:00:00 AM	8/29/2021	8:00:00 PM

Rain(in.) = 0.13
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.04000

Cause Small rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPB-BY1R-YG4NN
Permit MI0051462
Outfall **L42**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
9/7/2021	8:15:00 PM	9/8/2021	12:25:00 AM

Rain(in.) = 0.51
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.06000

Cause Moderate rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPB-JSBB-NGGA4
Permit MI0051462
Outfall **L42**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
9/21/2021	9:55:00 PM	9/23/2021	4:00:00 PM

Rain(in.) = 4.53
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
18.10000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPB-XDWC-H783W
Permit MI0051462
Outfall **L41**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
9/21/2021	9:55:00 PM	9/23/2021	4:00:00 PM

Rain(in.) = 4.53
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
2.60000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPB-XDWC-H783W
Permit MI0051462
Outfall **L42**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
10/2/2021	10:35:00 PM	10/3/2021	12:10:00 AM

Rain(in.) = 0.35
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.06000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPC-7A7W-T7YTY
Permit MI0051462
Outfall **L42**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
10/3/2021	10:55:00 PM	10/3/2021	11:15:00 PM

Rain(in.) = 0.3
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.00050

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPC-7AFB-9H2CX
Permit MI0051462
Outfall **L42**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
10/4/2021	4:55:00 PM	10/4/2021	6:45:00 PM

Rain(in.) = 0.55
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.04000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPC-8271-35YG6
Permit MI0051462
Outfall **L42**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
10/14/2021	5:35:00 PM	10/14/2021	6:25:00 PM

Rain(in.) = 0.13
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.02000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPC-FVCS-7NFPE
Permit MI0051462
Outfall **L42**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
10/15/2021	9:20:00 AM	10/15/2021	10:40:00 AM

Rain(in.) = 0.44
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.02000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPC-J8QA-QVGXK
Permit MI0051462
Outfall **L42**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
10/16/2021	2:30:00 AM	10/16/2021	6:25:00 AM

Rain(in.) = 0.84
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.02000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPC-JCNK-6Z0H4
Permit MI0051462
Outfall **L42**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
10/21/2021	2:30:00 AM	10/21/2021	6:25:00 AM

Rain(in.) = 0.22
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.02000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPC-MPH0-5QGEX
Permit MI0051462
Outfall **L42**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
10/24/2021	10:40:00 PM	10/25/2021	12:17:00 PM

Rain(in.) = 2.18
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
8.50000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPC-QMXY-Y5H7M
Permit MI0051462
Outfall **L41**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
10/24/2021	10:40:00 PM	10/25/2021	12:17:00 PM

Rain(in.) = 2.18
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.60000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPC-QMXY-Y5H7M
Permit MI0051462
Outfall **L42**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
10/29/2021	1:00:00 PM	10/30/2021	6:12:00 AM

Rain(in.) = 1.12
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
1.00000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPC-WEGV-ZSZTV
Permit MI0051462
Outfall **L41**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
10/29/2021	1:00:00 PM	10/30/2021	6:12:00 AM

Rain(in.) = 1.12
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.10000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPC-WEGV-ZSZTV
Permit MI0051462
Outfall **L42**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
11/17/2021	10:20:00 PM	11/17/2021	10:55:00 PM

Rain(in.) = 0.15
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.00400

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPD-APKB-WGAG1
Permit MI0051462
Outfall **L42**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
11/21/2021	1:55:00 PM	11/21/2021	9:55:00 PM

Rain(in.) = 0.21
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.02000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPD-E5W1-53SDG
Permit MI0051462
Outfall **L42**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
11/25/2021	2:20:00 AM	11/25/2021	5:50:00 PM

Rain(in.) = 0.5
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.01000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPD-KAPB-VZAQH
Permit MI0051462
Outfall **L42**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
12/5/2021	5:25:00 PM	12/5/2021	10:00:00 PM

Rain(in.) = 0.62
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.10000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPD-RXB4-JE3PY
Permit MI0051462
Outfall **L42**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
12/11/2021	2:38:00 AM	12/11/2021	4:51:00 PM

Rain(in.) = 1.06
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
4.60000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPD-WJVD-3N3G9
Permit MI0051462
Outfall **L41**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
12/11/2021	2:38:00 AM	12/11/2021	4:51:00 PM

Rain(in.) = 1.06
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.40000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPD-WJVD-3N3G9
Permit MI0051462
Outfall **L42**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
12/15/2021	7:15:00 AM	12/15/2021	8:25:00 AM

Rain(in.) = 0.12
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.00700

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPE-01R1-2KT70
Permit MI0051462
Outfall **L42**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
12/18/2021	8:40:00 AM	12/18/2021	12:50:00 PM

Rain(in.) = 0.31
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.00900

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPE-3TD3-NDB4J
Permit MI0051462
Outfall **L42**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
12/25/2021	3:05:00 AM	12/25/2021	8:00:00 AM

Rain(in.) = 0.48
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.05000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPE-9D62-V4QNN
Permit MI0051462
Outfall **L42**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
12/25/2021	8:14:00 AM	12/25/2021	8:26:00 AM

Rain(in.) = 0.48
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.60000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPE-7PMJ-RHMTM
Permit MI0051462
Outfall **L41**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
12/25/2021	8:14:00 AM	12/25/2021	8:26:00 AM

Rain(in.) = 0.48
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.00200

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPE-7PMJ-RHMTM
Permit MI0051462
Outfall **L42**

Wayne Co/Inkster/Drbrn Hts CSO

Start Day	Start Time	End Day	End Time
12/27/2021	8:10:00 AM	12/27/2021	11:35:00 AM

Rain(in.) = 0.26
Waterbody: Lower Rouge River

Dilute Raw Sewage (MG)
0.02000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPE-9DAK-XROEE
Permit MI0051462
Outfall **L42**

Totals Wayne Co/Inkster/Drbrn Hts CSO

Dilute Raw Sewage (MG)
231.40910

SOC: The reissued NPDES permit will include a revised LTCP schedule

EGLE Action: Long-term Control Program revised in reissued permit; the program will address the two remaining "uncontrolled" (i.e., untreated) CSO outfalls. The Department agreed to a revised correction schedule for control of the remaining untreated outfalls based on the City of Inkster's financial demonstration. It's the Departments intent to negotiate a revised schedule for implementation of the remaining LTCP in the reissued permit in 2022

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/RDFrd/Livonia CSO

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
3/26/2021	3:50:00 AM	3/26/2021	6:17:00 AM

Rain(in.) = 1.27
Waterbody: Upper Rouge River

Dilute Raw Sewage (MG)

0.20000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP2-EV33-GTVWM
Permit MI0051535
Outfall **U10**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
3/26/2021	3:50:00 AM	3/26/2021	6:17:00 AM

Rain(in.) = 1.27
Waterbody: Tarabusi Creek

Dilute Raw Sewage (MG)

1.00000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP2-EV33-GTVWM
Permit MI0051535
Outfall **U11**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
3/26/2021	3:50:00 AM	3/26/2021	6:17:00 AM

Rain(in.) = 1.27
Waterbody: Ashcroft-Sherwood Drain

Dilute Raw Sewage (MG)

3.60000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP2-EV33-GTVWM
Permit MI0051535
Outfall **U2**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
3/26/2021	3:50:00 AM	3/26/2021	6:17:00 AM

Rain(in.) = 1.27
Waterbody: Bell Branch

Dilute Raw Sewage (MG)
0.10000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP2-EV33-GTVWM
Permit MI0051535
Outfall **U3**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
3/26/2021	3:50:00 AM	3/26/2021	6:17:00 AM

Rain(in.) = 1.27
Waterbody: Bell Branch

Dilute Raw Sewage (MG)
0.05000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP2-EV33-GTVWM
Permit MI0051535
Outfall **U4**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
3/26/2021	3:50:00 AM	3/26/2021	6:17:00 AM

Rain(in.) = 1.27
Waterbody: Bell Branch

Dilute Raw Sewage (MG)
0.20000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP2-EV33-GTVWM
Permit MI0051535
Outfall **U5**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
3/26/2021	3:50:00 AM	3/26/2021	6:17:00 AM

Rain(in.) = 1.27
Waterbody: Tarabusi Creek

Dilute Raw Sewage (MG)
0.40000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP2-EV33-GTVWM
Permit MI0051535
Outfall **U9**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
5/23/2021	7:20:00 PM	5/23/2021	7:39:00 PM

Rain(in.) = 0.82
Waterbody: Upper Rouge River

Dilute Raw Sewage (MG)
0.03000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP8-Y8GE-NRM4T
Permit MI0051535
Outfall **U10**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
5/23/2021	7:20:00 PM	5/23/2021	7:39:00 PM

Rain(in.) = 0.82
Waterbody: Tarabusi Creek

Dilute Raw Sewage (MG)
0.20000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP8-Y8GE-NRM4T
Permit MI0051535
Outfall **U11**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
5/23/2021	7:20:00 PM	5/23/2021	7:39:00 PM

Rain(in.) = 0.82
Waterbody: Ashcroft-Sherwood Drain

Dilute Raw Sewage (MG)
0.60000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP8-Y8GE-NRM4T
Permit MI0051535
Outfall **U2**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
5/23/2021	7:20:00 PM	5/23/2021	7:39:00 PM

Rain(in.) = 0.82
Waterbody: Bell Branch

Dilute Raw Sewage (MG)
0.02000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP8-Y8GE-NRM4T
Permit MI0051535
Outfall **U3**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
5/23/2021	7:20:00 PM	5/23/2021	7:39:00 PM

Rain(in.) = 0.82
Waterbody: Bell Branch

Dilute Raw Sewage (MG)
0.01000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP8-Y8GE-NRM4T
Permit MI0051535
Outfall **U4**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
5/23/2021	7:20:00 PM	5/23/2021	7:39:00 PM

Rain(in.) = 0.82
Waterbody: Bell Branch

Dilute Raw Sewage (MG)
0.04000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP8-Y8GE-NRM4T
Permit MI0051535
Outfall **U5**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
5/23/2021	7:20:00 PM	5/23/2021	7:39:00 PM

Rain(in.) = 0.82
Waterbody: Tarabusi Creek

Dilute Raw Sewage (MG)
0.10000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP8-Y8GE-NRM4T
Permit MI0051535
Outfall **U9**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
6/21/2021	8:00:00 AM	6/21/2021	8:21:00 AM

Rain(in.) = 1.5
Waterbody: Upper Rouge River

Dilute Raw Sewage (MG)
0.20000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-MNPE-8VNC4
Permit MI0051535
Outfall **U10**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
6/21/2021	8:00:00 AM	6/21/2021	8:21:00 AM

Rain(in.) = 1.5

Waterbody: Tarabusi Creek

Dilute Raw Sewage (MG)

1.00000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-MNPE-8VNC4

Permit MI0051535

Outfall **U11**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
6/21/2021	8:00:00 AM	6/21/2021	8:21:00 AM

Rain(in.) = 1.5

Waterbody: Ashcroft-Sherwood Drain

Dilute Raw Sewage (MG)

3.30000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-MNPE-8VNC4

Permit MI0051535

Outfall **U2**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
6/21/2021	8:00:00 AM	6/21/2021	8:21:00 AM

Rain(in.) = 1.5

Waterbody: Bell Branch

Dilute Raw Sewage (MG)

0.10000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-MNPE-8VNC4

Permit MI0051535

Outfall **U3**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
6/21/2021	8:00:00 AM	6/21/2021	8:21:00 AM

Rain(in.) = 1.5
Waterbody: Bell Branch

Dilute Raw Sewage (MG)
0.04000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-MNPE-8VNC4
Permit MI0051535
Outfall **U4**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
6/21/2021	8:00:00 AM	6/21/2021	8:21:00 AM

Rain(in.) = 1.5
Waterbody: Bell Branch

Dilute Raw Sewage (MG)
0.20000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-MNPE-8VNC4
Permit MI0051535
Outfall **U5**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
6/21/2021	8:00:00 AM	6/21/2021	8:21:00 AM

Rain(in.) = 1.5
Waterbody: Tarabusi Creek

Dilute Raw Sewage (MG)
0.40000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-MNPE-8VNC4
Permit MI0051535
Outfall **U9**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
6/25/2021	7:45:00 PM	6/26/2021	2:32:00 PM

Rain(in.) = 2.59
Waterbody: Upper Rouge River

Dilute Raw Sewage (MG)
1.00000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-R6VY-53745
Permit MI0051535
Outfall **U10**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
6/25/2021	7:45:00 PM	6/26/2021	2:32:00 PM

Rain(in.) = 2.59
Waterbody: Tarabusi Creek

Dilute Raw Sewage (MG)
6.10000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-R6VY-53745
Permit MI0051535
Outfall **U11**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
6/25/2021	7:45:00 PM	6/26/2021	2:32:00 PM

Rain(in.) = 2.59
Waterbody: Ashcroft-Sherwood Drain

Dilute Raw Sewage (MG)
21.00000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-R6VY-53745
Permit MI0051535
Outfall **U2**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
6/25/2021	7:45:00 PM	6/26/2021	2:32:00 PM

Rain(in.) = 2.59
Waterbody: Bell Branch

Dilute Raw Sewage (MG)
0.60000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-R6VY-53745
Permit MI0051535
Outfall **U3**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
6/25/2021	7:45:00 PM	6/26/2021	2:32:00 PM

Rain(in.) = 2.59
Waterbody: Bell Branch

Dilute Raw Sewage (MG)
0.30000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-R6VY-53745
Permit MI0051535
Outfall **U4**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
6/25/2021	7:45:00 PM	6/26/2021	2:32:00 PM

Rain(in.) = 2.59
Waterbody: Bell Branch

Dilute Raw Sewage (MG)
1.30000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-R6VY-53745
Permit MI0051535
Outfall **U5**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
6/25/2021	7:45:00 PM	6/26/2021	2:32:00 PM

Rain(in.) = 2.59
Waterbody: Tarabusi Creek

Dilute Raw Sewage (MG)
2.60000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-R6VY-53745
Permit MI0051535
Outfall **U9**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
6/28/2021	9:22:00 PM	6/28/2021	11:46:00 PM

Rain(in.) = 0.76
Waterbody: Upper Rouge River

Dilute Raw Sewage (MG)
0.30000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-TKTF-Z64QH
Permit MI0051535
Outfall **U10**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
6/28/2021	9:22:00 PM	6/28/2021	11:46:00 PM

Rain(in.) = 0.76
Waterbody: Tarabusi Creek

Dilute Raw Sewage (MG)
1.70000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-TKTF-Z64QH
Permit MI0051535
Outfall **U11**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
6/28/2021	9:22:00 PM	6/28/2021	11:46:00 PM

Rain(in.) = 0.76
Waterbody: Ashcroft-Sherwood Drain

Dilute Raw Sewage (MG)
6.00000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-TKTF-Z64QH
Permit MI0051535
Outfall **U2**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
6/28/2021	9:22:00 PM	6/28/2021	11:46:00 PM

Rain(in.) = 0.76
Waterbody: Bell Branch

Dilute Raw Sewage (MG)
0.20000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-TKTF-Z64QH
Permit MI0051535
Outfall **U3**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
6/28/2021	9:22:00 PM	6/28/2021	11:46:00 PM

Rain(in.) = 0.76
Waterbody: Bell Branch

Dilute Raw Sewage (MG)
0.10000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-TKTF-Z64QH
Permit MI0051535
Outfall **U4**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
6/28/2021	9:22:00 PM	6/28/2021	11:46:00 PM

Rain(in.) = 0.76
Waterbody: Bell Branch

Dilute Raw Sewage (MG)
0.40000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-TKTF-Z64QH
Permit MI0051535
Outfall **U5**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
6/28/2021	9:22:00 PM	6/28/2021	11:46:00 PM

Rain(in.) = 0.76
Waterbody: Tarabusi Creek

Dilute Raw Sewage (MG)
0.70000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HP9-TKTF-Z64QH
Permit MI0051535
Outfall **U9**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
7/16/2021	11:22:00 AM	7/17/2021	7:28:00 PM

Rain(in.) = 2.7
Waterbody: Upper Rouge River

Dilute Raw Sewage (MG)
1.50000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-8F2Q-8W82C
Permit MI0051535
Outfall **U10**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
7/16/2021	11:22:00 AM	7/17/2021	7:28:00 PM

Rain(in.) = 2.7
Waterbody: Tarabusi Creek

Dilute Raw Sewage (MG)
9.40000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-8F2Q-8W82C
Permit MI0051535
Outfall **U11**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
7/16/2021	11:22:00 AM	7/17/2021	7:28:00 PM

Rain(in.) = 2.7
Waterbody: Ashcroft-Sherwood Drain

Dilute Raw Sewage (MG)
32.60000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-8F2Q-8W82C
Permit MI0051535
Outfall **U2**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
7/16/2021	11:22:00 AM	7/17/2021	7:28:00 PM

Rain(in.) = 2.7
Waterbody: Bell Branch

Dilute Raw Sewage (MG)
0.90000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-8F2Q-8W82C
Permit MI0051535
Outfall **U3**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
7/16/2021	11:22:00 AM	7/17/2021	7:28:00 PM

Rain(in.) = 2.7
Waterbody: Bell Branch

Dilute Raw Sewage (MG)
0.40000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-8F2Q-8W82C
Permit MI0051535
Outfall **U4**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
7/16/2021	11:22:00 AM	7/17/2021	7:28:00 PM

Rain(in.) = 2.7
Waterbody: Bell Branch

Dilute Raw Sewage (MG)
2.00000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-8F2Q-8W82C
Permit MI0051535
Outfall **U5**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
7/16/2021	11:22:00 AM	7/17/2021	7:28:00 PM

Rain(in.) = 2.7
Waterbody: Tarabusi Creek

Dilute Raw Sewage (MG)
4.00000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-8F2Q-8W82C
Permit MI0051535
Outfall **U9**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
7/24/2021	9:21:00 PM	7/25/2021	7:30:00 AM

Rain(in.) = 1.81

Waterbody: Upper Rouge River

Dilute Raw Sewage (MG)

1.30000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-F230-8CS05

Permit MI0051535

Outfall **U10**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
7/24/2021	9:21:00 PM	7/25/2021	7:30:00 AM

Rain(in.) = 1.81

Waterbody: Tarabusi Creek

Dilute Raw Sewage (MG)

7.80000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-F230-8CS05

Permit MI0051535

Outfall **U11**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
7/24/2021	9:21:00 PM	7/25/2021	7:30:00 AM

Rain(in.) = 1.81

Waterbody: Ashcroft-Sherwood Drain

Dilute Raw Sewage (MG)

27.00000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-F230-8CS05

Permit MI0051535

Outfall **U2**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
7/24/2021	9:21:00 PM	7/25/2021	7:30:00 AM

Rain(in.) = 1.81
Waterbody: Bell Branch

Dilute Raw Sewage (MG)
0.70000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-F230-8CS05
Permit MI0051535
Outfall **U3**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
7/24/2021	9:21:00 PM	7/25/2021	7:30:00 AM

Rain(in.) = 1.81
Waterbody: Bell Branch

Dilute Raw Sewage (MG)
0.30000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-F230-8CS05
Permit MI0051535
Outfall **U4**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
7/24/2021	9:21:00 PM	7/25/2021	7:30:00 AM

Rain(in.) = 1.81
Waterbody: Bell Branch

Dilute Raw Sewage (MG)
1.60000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-F230-8CS05
Permit MI0051535
Outfall **U5**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
7/24/2021	9:21:00 PM	7/25/2021	7:30:00 AM

Rain(in.) = 1.81
Waterbody: Tarabusi Creek

Dilute Raw Sewage (MG)
3.30000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-F230-8CS05
Permit MI0051535
Outfall **U9**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
8/12/2021	3:40:00 AM	8/12/2021	8:37:00 PM

Rain(in.) = 2.36
Waterbody: Upper Rouge River

Dilute Raw Sewage (MG)
0.90000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-XFBT-82RHB
Permit MI0051535
Outfall **U10**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
8/12/2021	3:40:00 AM	8/12/2021	8:37:00 PM

Rain(in.) = 2.36
Waterbody: Tarabusi Creek

Dilute Raw Sewage (MG)
5.30000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-XFBT-82RHB
Permit MI0051535
Outfall **U11**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
8/12/2021	3:40:00 AM	8/12/2021	8:37:00 PM

Rain(in.) = 2.36
Waterbody: Ashcroft-Sherwood Drain

Dilute Raw Sewage (MG)
18.20000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-XFBT-82RHB
Permit MI0051535
Outfall **U2**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
8/12/2021	3:40:00 AM	8/12/2021	8:37:00 PM

Rain(in.) = 2.36
Waterbody: Bell Branch

Dilute Raw Sewage (MG)
0.50000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-XFBT-82RHB
Permit MI0051535
Outfall **U3**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
8/12/2021	3:40:00 AM	8/12/2021	8:37:00 PM

Rain(in.) = 2.36
Waterbody: Bell Branch

Dilute Raw Sewage (MG)
0.20000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-XFBT-82RHB
Permit MI0051535
Outfall **U4**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
8/12/2021	3:40:00 AM	8/12/2021	8:37:00 PM

Rain(in.) = 2.36
Waterbody: Bell Branch

Dilute Raw Sewage (MG)
1.10000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-XFBT-82RHB
Permit MI0051535
Outfall **U5**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
8/12/2021	3:40:00 AM	8/12/2021	8:37:00 PM

Rain(in.) = 2.36
Waterbody: Tarabusi Creek

Dilute Raw Sewage (MG)
2.20000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPA-XFBT-82RHB
Permit MI0051535
Outfall **U9**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
8/27/2021	12:56:00 PM	8/27/2021	6:25:00 PM

Rain(in.) = 2.12
Waterbody: Upper Rouge River

Dilute Raw Sewage (MG)
0.70000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPB-9FMG-FR32Q
Permit MI0051535
Outfall **U10**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
8/27/2021	12:56:00 PM	8/27/2021	6:25:00 PM

Rain(in.) = 2.12
Waterbody: Tarabusi Creek

Dilute Raw Sewage (MG)
4.30000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPB-9FMG-FR32Q
Permit MI0051535
Outfall **U11**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
8/27/2021	12:56:00 PM	8/27/2021	6:25:00 PM

Rain(in.) = 2.12
Waterbody: Ashcroft-Sherwood Drain

Dilute Raw Sewage (MG)
14.90000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPB-9FMG-FR32Q
Permit MI0051535
Outfall **U2**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
8/27/2021	12:56:00 PM	8/27/2021	6:25:00 PM

Rain(in.) = 2.12
Waterbody: Bell Branch

Dilute Raw Sewage (MG)
0.40000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPB-9FMG-FR32Q
Permit MI0051535
Outfall **U3**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
8/27/2021	12:56:00 PM	8/27/2021	6:25:00 PM

Rain(in.) = 2.12
Waterbody: Bell Branch

Dilute Raw Sewage (MG)
0.20000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPB-9FMG-FR32Q
Permit MI0051535
Outfall **U4**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
8/27/2021	12:56:00 PM	8/27/2021	6:25:00 PM

Rain(in.) = 2.12
Waterbody: Bell Branch

Dilute Raw Sewage (MG)
0.90000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPB-9FMG-FR32Q
Permit MI0051535
Outfall **U5**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
8/27/2021	12:56:00 PM	8/27/2021	6:25:00 PM

Rain(in.) = 2.12
Waterbody: Tarabusi Creek

Dilute Raw Sewage (MG)
1.80000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPB-9FMG-FR32Q
Permit MI0051535
Outfall **U9**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
9/21/2021	10:50:00 PM	9/22/2021	5:00:00 PM

Rain(in.) = 4.41
Waterbody: Upper Rouge River

Dilute Raw Sewage (MG)
2.10000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPB-XPPX-Z7A0T
Permit MI0051535
Outfall **U10**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
9/21/2021	10:50:00 PM	9/22/2021	5:00:00 PM

Rain(in.) = 4.41
Waterbody: Tarabusi Creek

Dilute Raw Sewage (MG)
12.90000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPB-XPPX-Z7A0T
Permit MI0051535
Outfall **U11**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
9/21/2021	10:50:00 PM	9/22/2021	5:00:00 PM

Rain(in.) = 4.41
Waterbody: Ashcroft-Sherwood Drain

Dilute Raw Sewage (MG)
44.80000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPB-XPPX-Z7A0T
Permit MI0051535
Outfall **U2**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
9/21/2021	10:50:00 PM	9/22/2021	5:00:00 PM

Rain(in.) = 4.41
Waterbody: Bell Branch

Dilute Raw Sewage (MG)
1.20000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPB-XPPX-Z7A0T
Permit MI0051535
Outfall **U3**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
9/21/2021	10:50:00 PM	9/22/2021	5:00:00 PM

Rain(in.) = 4.41
Waterbody: Bell Branch

Dilute Raw Sewage (MG)
0.60000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPB-XPPX-Z7A0T
Permit MI0051535
Outfall **U4**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
9/21/2021	10:50:00 PM	9/22/2021	5:00:00 PM

Rain(in.) = 4.41
Waterbody: Bell Branch

Dilute Raw Sewage (MG)
2.70000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPB-XPPX-Z7A0T
Permit MI0051535
Outfall **U5**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
9/21/2021	10:50:00 PM	9/22/2021	5:00:00 PM

Rain(in.) = 4.41
Waterbody: Tarabusi Creek

Dilute Raw Sewage (MG)
5.50000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPB-XPPX-Z7A0T
Permit MI0051535
Outfall **U9**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
10/25/2021	9:19:00 AM	10/25/2021	1:25:00 PM

Rain(in.) = 1.98
Waterbody: Upper Rouge River

Dilute Raw Sewage (MG)
0.70000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPC-TY6W-7R097
Permit MI0051535
Outfall **U10**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
10/25/2021	9:19:00 AM	10/25/2021	1:25:00 PM

Rain(in.) = 1.98
Waterbody: Tarabusi Creek

Dilute Raw Sewage (MG)
4.30000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPC-TY6W-7R097
Permit MI0051535
Outfall **U11**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
10/25/2021	9:19:00 AM	10/25/2021	1:25:00 PM

Rain(in.) = 1.98
Waterbody: Ashcroft-Sherwood Drain

Dilute Raw Sewage (MG)
15.00000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPC-TY6W-7R097
Permit MI0051535
Outfall **U2**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
10/25/2021	9:19:00 AM	10/25/2021	1:25:00 PM

Rain(in.) = 1.98
Waterbody: Bell Branch

Dilute Raw Sewage (MG)
0.40000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPC-TY6W-7R097
Permit MI0051535
Outfall **U3**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
10/25/2021	9:19:00 AM	10/25/2021	1:25:00 PM

Rain(in.) = 1.98
Waterbody: Bell Branch

Dilute Raw Sewage (MG)
0.20000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPC-TY6W-7R097
Permit MI0051535
Outfall **U4**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
10/25/2021	9:19:00 AM	10/25/2021	1:25:00 PM

Rain(in.) = 1.98
Waterbody: Bell Branch

Dilute Raw Sewage (MG)
0.90000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPC-TY6W-7R097
Permit MI0051535
Outfall **U5**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
10/25/2021	9:19:00 AM	10/25/2021	1:25:00 PM

Rain(in.) = 1.98
Waterbody: Tarabusi Creek

Dilute Raw Sewage (MG)
1.90000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPC-TY6W-7R097
Permit MI0051535
Outfall **U9**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
10/29/2021	7:30:00 PM	10/30/2021	8:58:00 AM

Rain(in.) = 1.2
Waterbody: Upper Rouge River

Dilute Raw Sewage (MG)
0.40000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPC-WEXV-9HE2G
Permit MI0051535
Outfall **U10**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
10/29/2021	7:30:00 PM	10/30/2021	8:58:00 AM

Rain(in.) = 1.2
Waterbody: Tarabusi Creek

Dilute Raw Sewage (MG)
2.20000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPC-WEXV-9HE2G
Permit MI0051535
Outfall **U11**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
10/29/2021	7:30:00 PM	10/30/2021	8:58:00 AM

Rain(in.) = 1.2
Waterbody: Ashcroft-Sherwood Drain

Dilute Raw Sewage (MG)
7.80000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPC-WEXV-9HE2G
Permit MI0051535
Outfall **U2**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
10/29/2021	7:30:00 PM	10/30/2021	8:58:00 AM

Rain(in.) = 1.2
Waterbody: Bell Branch

Dilute Raw Sewage (MG)
0.20000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPC-WEXV-9HE2G
Permit MI0051535
Outfall **U3**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
10/29/2021	7:30:00 PM	10/30/2021	8:58:00 AM

Rain(in.) = 1.2
Waterbody: Bell Branch

Dilute Raw Sewage (MG)
0.10000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPC-WEXV-9HE2G
Permit MI0051535
Outfall **U4**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
10/29/2021	7:30:00 PM	10/30/2021	8:58:00 AM

Rain(in.) = 1.2
Waterbody: Bell Branch

Dilute Raw Sewage (MG)
0.50000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPC-WEXV-9HE2G
Permit MI0051535
Outfall **U5**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
10/29/2021	7:30:00 PM	10/30/2021	8:58:00 AM

Rain(in.) = 1.2
Waterbody: Tarabusi Creek

Dilute Raw Sewage (MG)
1.00000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPC-WEXV-9HE2G
Permit MI0051535
Outfall **U9**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
12/11/2021	3:14:00 AM	12/11/2021	6:18:00 AM

Rain(in.) = 1.25
Waterbody: Upper Rouge River

Dilute Raw Sewage (MG)
0.30000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPE-1JW4-SCCBK
Permit MI0051535
Outfall **U10**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
12/11/2021	3:14:00 AM	12/11/2021	6:18:00 AM

Rain(in.) = 1.25
Waterbody: Tarabusi Creek

Dilute Raw Sewage (MG)
1.90000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPE-1JW4-SCCBK
Permit MI0051535
Outfall **U11**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
12/11/2021	3:14:00 AM	12/11/2021	6:18:00 AM

Rain(in.) = 1.25
Waterbody: Ashcroft-Sherwood Drain

Dilute Raw Sewage (MG)
6.50000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPE-1JW4-SCCBK
Permit MI0051535
Outfall **U2**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
12/11/2021	3:14:00 AM	12/11/2021	6:18:00 AM

Rain(in.) = 1.25
Waterbody: Bell Branch

Dilute Raw Sewage (MG)
0.20000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPE-1JW4-SCCBK
Permit MI0051535
Outfall **U3**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
12/11/2021	3:14:00 AM	12/11/2021	6:18:00 AM

Rain(in.) = 1.25
Waterbody: Bell Branch

Dilute Raw Sewage (MG)
0.10000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPE-1JW4-SCCBK
Permit MI0051535
Outfall **U4**

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
12/11/2021	3:14:00 AM	12/11/2021	6:18:00 AM

Rain(in.) = 1.25
Waterbody: Bell Branch

Dilute Raw Sewage (MG)
0.40000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Submission ID. HPE-1JW4-SCCBK
Permit MI0051535
Outfall **U5**

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
12/11/2021	3:14:00 AM	12/11/2021	6:18:00 AM

Rain(in.) = 1.25
Waterbody: Tarabusi Creek

Submission ID. HPE-1JW4-SCCBK
Permit MI0051535
Outfall **U9**

Dilute Raw Sewage (MG)
0.80000

Cause Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Totals Wayne Co/RDFrd/Livonia CSO

Dilute Raw Sewage (MG)
314.09000

SOC: The NPDES permit requires independent control of the remaining untreated outfall or alternatively work with GLWA on a regional plan by 2025

EGLE Action: Long-term Control Program being implemented; construction of retention/treatment basin (for elimination of raw sewage & protection of public health) complete & facility is "on-line". The Department agrees that the RTB eliminates raw sewage, protects public health, and protects the physical characteristics standard. A report has been submitted to verify that the RTB protects the dissolved oxygen standard, and is currently under review by the Department. The reissued permit will require independent control of the remaining untreated outfall or alternatively work with GLWA on a regional plan by 2025.

County Totals Wayne

Dilute Raw Sewage (MG)
8428.27607

'Combined Sewer Overflow' Detail Report January 1 - December 31, 2021

Report Totals

Dilute Raw Sewage (MG)
8805.00557

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Bay

Bay City WWTP

Bay City WWTP

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.41
6/26/2021	4:45:00 PM	6/27/2021	8:00:00 AM	Waterbody: Saginaw River

RTB (MG)
6.800

Cause: Heavy Rain over 3 day period

Submission ID. HP9-V3KF-296ME
Permit MI0022284
Outfall 48

Bay City WWTP

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.86
9/23/2021	10:50:00 AM	9/24/2021	2:00:00 PM	Waterbody: Saginaw River

RTB (MG)
24.900

Cause: Heavy Rain over a 4 day period

Submission ID. HPC-1RGR-2PH90
Permit MI0022284
Outfall 48

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report January 1 - December 31, 2021

Totals	Bay City WWTP
--------	---------------

RTB (MG)
31.70

Long-term Control Program being implemented; currently collecting flow and rain fall data to conduct an evaluation study (Submitted) and model collection system for each of the 5 retention/treatment basins to determine whether adequate treatment is provided for the discharges; improvements to the retention/treatment basins may be required in the future pending the results of the evaluation studies. The study will evaluate basin 4 as a representative of basins 1 thru 4, and basin 5 separately. Evaluations currently under review for determination of adequate treatment.

County Totals	Bay
---------------	-----

RTB (MG)
31.70

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Dickinson

Iron Mountain-Kingsford WWTP

Iron Mountain-Kingsford WWTP

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.58
6/28/2021	10:20:00 PM	6/29/2021	12:27:00 AM	Waterbody: Menominee River

Submission ID. HP9-TYS9-GJSCZ
Permit MI0023205
Outfall 002

RTB (MG)
0.875

Cause: Rain event 0.58"

Iron Mountain-Kingsford WWTP

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.65
6/30/2021	2:35:00 PM	6/30/2021	4:07:00 PM	Waterbody: Menominee River

Submission ID. HP9-W11P-YKEGZ
Permit MI0023205
Outfall 002

RTB (MG)
0.845

Cause: Heavy Rain 0.65"

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

Iron Mountain-Kingsford WWTP

Start Day	Start Time	End Day	End Time
9/7/2021	6:14:00 AM	9/7/2021	7:35:00 AM

Waterbody: Menominee River

Submission ID. HPB-HZYS-7DSEQ
Permit MI0023205
Outfall 002

RTB (MG)
0.410

Cause: Small flow discharge, 0.56" rain

Totals Iron Mountain-Kingsford WWTP

RTB (MG)
2.13

Long-term Control Program considered complete (an existing retention/treatment basin)

County Totals Dickinson

RTB (MG)
2.13

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Houghton

North Houghton Co W&SA CSO

North Houghton Co W&SA CSO

Start Day	Start Time	End Day	End Time
3/22/2021	4:00:00 PM	4/27/2021	2:00:00 AM

Waterbody: St Louis Creek

RTB (MG)

17.470

Cause: permitted CSO discharge due to snow melt

Submission ID. HP7-DDTH-0AX7B
Permit MI0043982
Outfall 001

North Houghton Co W&SA CSO

Start Day	Start Time	End Day	End Time
3/22/2021	4:00:00 PM	5/3/2021	8:05:00 AM

Waterbody: Douglas Creek

RTB (MG)

25.880

Cause: Permitted CSO discharge due to snow melt

Submission ID. HP7-DE1S-4S7QM
Permit MI0043982
Outfall 001

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

North Houghton Co W&SA CSO

Start Day	Start Time	End Day	End Time
12/16/2021	12:00:00 PM	12/16/2021	3:00:00 AM

Rain(in.) = 0.47

Waterbody: st louis creek

Submission ID. HPE-0S61-C7JBP

Permit MI0043982

Outfall 001

RTB (MG)

0.011

Cause: CSO, due to train and snow melt

Totals North Houghton Co W&SA CSO

RTB (MG)

43.36

Long-term Control Program completed

County Totals Houghton

RTB (MG)

43.36

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Ingham

East Lansing WRRF

East Lansing WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 3.7
6/26/2021	6:25:00 PM	6/27/2021	5:30:00 AM	Waterbody: Red Cedar River

Submission ID. HP9-S0D6-YQAD4
Permit MI0022853
Outfall 15

RTB (MG)
13.200

Cause: RTB discharge due to heavy rain.

East Lansing WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 4.74
8/12/2021	1:30:00 AM	8/12/2021	3:00:00 PM	Waterbody: Red Cedar River

Submission ID. HPA-XE5F-VPRJX
Permit MI0022853
Outfall 15

RTB (MG)
65.090

Cause: RTB discharge due to heavy rain.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

East Lansing WRRF

Start Day	Start Time	End Day	End Time
9/13/2021	1:50:00 PM	9/13/2021	4:00:00 PM

Rain(in.) = 1.23

Waterbody: Red Cedar River

Submission ID. HPB-PZKD-T916M

Permit MI0022853

Outfall 15

RTB (MG)

6.220

Cause: RTB discharge due to heavy rain in a very short period of time.

Totals East Lansing WRRF

RTB (MG)

84.51

Long-term Control Program complete; controls included both sewer separation and construction of a retention treatment basin (RTB) and tunnel.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Lansing WWTP

Lansing WWTP

Start Day	Start Time	End Day	End Time
8/12/2021	8:15:00 AM	8/12/2021	4:15:00 PM

Rain(in.) = 3.72

Waterbody: Grand River

Submission ID. HPA-XMFT-0Z8BT

Permit MI0023400

Outfall 003

RTB (MG)

3.980

Cause: CSO Discharge--South Retention Basin 003 (discharges through the outfall for Regulator 008). Overflow was due to a heavy rainfall event which lead to a high influent flow to the plant. Discharge was disinfected with sodium hypochlorite. Only the surface w

Totals Lansing WWTP

RTB (MG)

3.98

Long-term Control Program being implemented; an Administrative Consent Order (ACO) with integrated plan requirements to correct CSO and SSO discharges. The ACO requires that core CSO correction be completed by December 31, 2032. The remaining CSO correction will be completed under the adaptive management approach. Adaptive management will consider lessons learned during the previous phase; a recalibrated hydraulic model and Wet Weather Control Plan update in 2023; green infrastructure; and includes appropriate revisions to correction projects specified for subsequent phases.

County Totals Ingham

RTB (MG)

88.49

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Macomb

Chapaton RTB

Chapaton RTB

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.78
3/26/2021	4:50:00 AM	3/26/2021	2:50:00 PM	Waterbody: Lake St. Clair

Submission ID. HP7-GF0T-PM3M9
Permit MI0025585
Outfall 001

RTB (MG)
21.500

Cause: Rain and Runoff

Chapaton RTB

Start Day	Start Time	End Day	End Time	Rain(in.) = 3.61
6/26/2021	1:55:00 AM	6/26/2021	4:00:00 PM	Waterbody: Lake St. Clair

Submission ID. HP9-RD4P-2XXTV
Permit MI0025585
Outfall 001

RTB (MG)
70.900

Cause: Heavy rain and Runoff. Significant rainfall downstream and Conner Pump Station failures resulted in SEMSD/MCPWO having to shutdown Marter Road Booster Pumping Station. All flow was then diverted to Chapaton.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Chapaton RTB

Start Day	Start Time	End Day	End Time
6/26/2021	2:30:00 AM	6/26/2021	7:40:00 AM

Rain(in.) = 3.61

Waterbody: Lake St. Clair

Submission ID. HP9-RGRT-E998K

Permit MI0025585

Outfall 001

RTB (MG)

25.800

Cause: Heavy rain and Runoff. Significant rainfall downstream and Conner Pump Station failures resulted in SEMSD/MCPWO having to shutdown Marter Road Booster Pumping Station. All flow was then diverted to Chapaton.

Chapaton RTB

Start Day	Start Time	End Day	End Time
7/16/2021	1:10:00 PM	7/17/2021	1:00:00 PM

Rain(in.) = 3.23

Waterbody: Lake St. Clair

Submission ID. HPA-8FWK-PZQMD

Permit MI0025585

Outfall 001

RTB (MG)

76.500

Cause: Chapaton RTB discharge due rain fall and downstream conveyance issues.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Chapaton RTB

Start Day	Start Time	End Day	End Time
9/22/2021	1:15:00 AM	9/23/2021	2:00:00 PM

Rain(in.) = 4.62

Waterbody: Lake St. Clair

Submission ID. HPB-XGFA-PAVFN

Permit MI0025585

Outfall 001

RTB (MG)

104.100

Cause: Heavy rain and runoff

Chapaton RTB

Start Day	Start Time	End Day	End Time
10/25/2021	10:30:00 AM	10/26/2021	10:50:00 PM

Rain(in.) = 2.37

Waterbody: Lake St. Clair

Submission ID. HPC-QSCH-HWEBS

Permit MI0025585

Outfall 001

RTB (MG)

47.900

Cause: Rain and runoff

Chapaton RTB

Start Day	Start Time	End Day	End Time
12/11/2021	5:30:00 AM	12/11/2021	9:20:00 AM

Rain(in.) = 1.19

Waterbody: Lake St. Clair

Submission ID. HPD-WJ5M-DJ67K

Permit MI0025585

Outfall 001

RTB (MG)

7.100

Cause: heavy rain and runoff

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

Totals Chapaton RTB

RTB (MG)
353.80

Long-term Control Program has been completed; program & permit required 3-phase sewer construction project designed to reduce wet-weather flow quantities directed to the retention/treatment basin (RTB); permit also required submittal of RTB Evaluation Study to determine whether adequate treatment is provided to meet Water Quality Standards (the results of the study were ultimately approved on Jan. 31, 2007); the actual construction phase of the current project is complete; there are no "uncontrolled" (i.e., untreated) CSO outfalls associated with this permittee/program. The permit required a "Total Residual Chlorine Mixing Zone/Plume Definition Study" which has been submitted and is currently under review by the Department. The report evaluates whether or not the Total Residual Chlorine (TRC) discharges from the RTB cause violations of Water Quality Standards.

Martin RTB

Martin RTB

Start Day	Start Time	End Day	End Time
3/26/2021	5:50:00 AM	3/26/2021	4:05:00 PM

Rain(in.) = 1.85
Waterbody: Lake St. Clair

Submission ID. HP7-GF6R-SDV6R
Permit MI0025453
Outfall 001

RTB (MG)
16.000

Cause: Rain & Runoff

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

Martin RTB

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.6
3/28/2021	12:30:00 PM	3/28/2021	6:00:00 PM	Waterbody: Lake St. Clair

Submission ID. HP7-JONE-A045P
Permit MI0025453
Outfall 001

RTB (MG)
7.100

Cause: Rain & Runoff. The system has not been able to completely dewater from the previous rain event on 3/26/21.
GLWA requested stoppage of dewatering for 3 hours on 3/27/2021.

Martin RTB

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.46
6/25/2021	10:40:00 PM	6/26/2021	4:30:00 PM	Waterbody: Lake St. Clair

Submission ID. HP9-R96X-Y0GE3
Permit MI0025453
Outfall 001

RTB (MG)
48.500

Cause: Heavy rain and runoff.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Martin RTB

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.68
7/16/2021	1:50:00 PM	7/17/2021	3:05:00 PM	Waterbody: Lake St. Clair

Submission ID. HPA-8GAY-V7M3K
Permit MI0025453
Outfall 001

RTB (MG)
62.900

Cause: Martin RTB discharge due to rain fall and downstream conveyance issues.

Martin RTB

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.57
7/25/2021	12:35:00 AM	7/25/2021	5:50:00 AM	Waterbody: Lake St. Clair

Submission ID. HPA-F5BV-FTPGW
Permit MI0025453
Outfall 001

RTB (MG)
4.400

Cause: Heavy rain and runoff

Martin RTB

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.07
8/12/2021	6:15:00 AM	8/12/2021	9:15:00 PM	Waterbody: Lake St. Clair

Submission ID. HPA-G8GM-2RNNT
Permit MI0025453
Outfall 001

RTB (MG)
56.500

Cause: Heavy rain and runoff

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Martin RTB

Start Day	Start Time	End Day	End Time	Rain(in.) = 4.87
9/22/2021	1:05:00 AM	9/24/2021	2:30:00 AM	Waterbody: Lake St. Clair

Submission ID. HPB-XGXS-WFQ45
Permit MI0025453
Outfall 001

RTB (MG)
118.200

Cause: Rain and runoff

Martin RTB

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.34
10/25/2021	8:15:00 AM	10/26/2021	2:45:00 AM	Waterbody: Lake St. Clair

Submission ID. HPC-QP4K-W8895
Permit MI0025453
Outfall 001

RTB (MG)
50.400

Cause: Rain and runoff

Martin RTB

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.02
10/29/2021	8:10:00 PM	10/30/2021	1:45:00 PM	Waterbody: Lake Saint Clair

Submission ID. HPC-V7AG-31YQY
Permit MI0025453
Outfall 001

RTB (MG)
23.294

Cause: heavy rain and runoff

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Martin RTB

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.15
12/11/2021	5:05:00 AM	12/11/2021	4:15:00 PM	Waterbody: Lake St Clair

Submission ID. HPD-WHV3-50SVJ
Permit MI0025453
Outfall 001

RTB (MG)
18.400

Cause: heavy rain and runoff

Totals Martin RTB

RTB (MG)
405.69

Long-term Control Program has been completed; program & permit required 3-phase sewer construction project designed to reduce wet-weather flow quantities directed to the retention/treatment basin (RTB); permit also required submittal of RTB Evaluation Study to determine whether adequate treatment is provided to meet Water Quality Standards (the results of the study were ultimately approved on Jan. 31, 2007); the actual construction phase of the ; current project is complete; there are no "uncontrolled" (i.e., untreated) CSO outfalls associated with this permittee/program. Now considered a discharge from a separate sanitary sewer system subject to Federal Secondary Treatment Requirements.

County Totals

Macomb

RTB (MG)
759.49

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

Oakland

Birmingham CSO RTB

Birmingham CSO RTB

Start Day	Start Time	End Day	End Time	Rain(in.) = 3.82
6/25/2021	6:20:00 PM	6/27/2021	9:15:00 AM	Waterbody: Rouge River

Submission ID. HP2-KZ8X-75304
Permit MI0025534
Outfall 101

RTB (MG)

31.900

Cause: A Permitted Treated Discharge has occurred due to rainfall and surcharged sewer levels. This discharge has been fine screened, settled, and disinfected in order to meet NPDES permitted requirements.

Birmingham CSO RTB

Start Day	Start Time	End Day	End Time	Waterbody: Rouge River
7/24/2021	9:10:00 PM	7/25/2021	11:40:00 PM	

Submission ID. HP9-V6J5-H3A3V
Permit MI0025534
Outfall 101

RTB (MG)

11.000

Cause: A Permitted Treated Discharge has occurred due to rainfall and surcharged sewer levels. This discharge has been fine screened, settled, and disinfected in order to meet NPDES permitted requirements.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

Birmingham CSO RTB

Start Day	Start Time	End Day	End Time
9/21/2021	7:30:00 PM	9/24/2021	6:30:00 PM

Rain(in.) = 6.2

Waterbody: Rouge River

Submission ID. HPA-JQQ1-XFPM3

Permit MI0025534

Outfall 101

RTB (MG)

36.539

Cause: A Permitted Treated Discharge has occurred due to rainfall and surcharged sewer levels. This discharge has been fine screened, settled, and disinfected in order to meet NPDES permitted requirements.

Totals

Birmingham CSO RTB

RTB (MG)

79.44

Long-term Control Program complete; Permittee has successfully demonstrated that the Birmingham CSO RTB effectively provides adequate treatment of combined sewage discharges and complies with Water Quality Standards at times of discharge (i.e., meets in-stream dissolved oxygen standard, eliminates raw sewage, protects public health, satisfies the biosurvey requirement, and satisfies the TRC requirement without the need for dechlorination equipment).

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

Bloomfield Village CSO RTB

Bloomfield Village CSO RTB

Start Day	Start Time	End Day	End Time	Rain(in.) = 3.82
6/25/2021	6:10:00 PM	6/27/2021	5:45:00 AM	Waterbody: Rouge River

Submission ID. HP2-KZ9F-2CTWG
Permit MI0048046
Outfall 102

RTB (MG)
45.630

Cause: A Permitted Treated Discharge has occurred due to rainfall and surcharged sewer levels. This discharge has been fine screened, settled, and disinfected in order to meet NPDES permitted requirements.

Bloomfield Village CSO RTB

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.93
7/24/2021	9:15:00 PM	7/25/2021	3:32:00 PM	Waterbody: Rouge River

Submission ID. HP9-V6KP-7QYNJ
Permit MI0048046
Outfall 102

RTB (MG)
13.884

Cause: A Permitted Treated Discharge has occurred due to rainfall and surcharged sewer levels. This discharge has been fine screened, settled, and disinfected in order to meet NPDES permitted requirements.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

Bloomfield Village CSO RTB

Start Day	Start Time	End Day	End Time
8/12/2021	6:38:00 AM	8/12/2021	10:26:00 PM

Rain(in.) = 2.43

Waterbody: Rouge River

Submission ID. HPA-JQNP-11X45

Permit MI0048046

Outfall 102

RTB (MG)

3.690

Cause: A Permitted Treated Discharge has occurred due to rainfall and surcharged sewer levels. This discharge has been fine screened, settled, and disinfected in order to meet NPDES permitted requirements.

Bloomfield Village CSO RTB

Start Day	Start Time	End Day	End Time
9/21/2021	7:25:00 PM	9/23/2021	11:25:00 PM

Rain(in.) = 6.18

Waterbody: Rouge River

Submission ID. HPB-1GFD-2PB8F

Permit MI0048046

Outfall 102

RTB (MG)

48.290

Cause: A Permitted Treated Discharge has occurred due to rainfall and surcharged sewer levels. This discharge has been fine screened, settled, and disinfected in order to meet NPDES permitted requirements.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

Bloomfield Village CSO RTB

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.98
10/25/2021	2:20:00 PM	10/26/2021	12:20:00 AM	Waterbody: Rouge River

Submission ID. HPC-2HHJ-ZZZN3
Permit MI0048046
Outfall 102

RTB (MG)
13.690

Cause: A Permitted Treated Discharge has occurred due to rainfall and surcharged sewer levels. This discharge has been fine screened, settled, and disinfected in order to meet NPDES permitted requirements.

Bloomfield Village CSO RTB

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.54
10/30/2021	2:00:00 AM	10/30/2021	5:00:00 PM	Waterbody: Rouge River

Submission ID. HPC-SF8P-HQWPW
Permit MI0048046
Outfall 102

RTB (MG)
3.190

Cause: A Permitted Treated Discharge has occurred due to rainfall and surcharged sewer levels. This discharge has been fine screened, settled, and disinfected in order to meet NPDES permitted requirements.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

Totals Bloomfield Village CSO RTB

RTB (MG)
128.37

Long-term Control Program complete; Permittee has successfully demonstrated that the Birmingham CSO RTB effectively provides adequate treatment of combined sewage discharges and complies with Water Quality Standards at times of discharge (i.e., meets in-stream dissolved oxygen standard, eliminates raw sewage, protects public health, satisfies the biosurvey requirement, and satisfies the TRC requirement without the need for dechlorination equipment).

George W Kuhn Dr Dist CSO RTB

George W Kuhn Dr Dist CSO RTB

Start Day	Start Time	End Day	End Time
3/26/2021	4:35:00 AM	3/26/2021	10:50:00 AM

Rain(in.) = 1.31
Waterbody: Red Run Drain

Submission ID. HP2-KZAP-DNGDW
Permit MI0026115
Outfall 001

RTB (MG)
69.400

Cause: A Permitted Treated Discharge has occurred due to rainfall and surcharged sewer levels. This discharge has been fine screened, settled, and disinfected in an attempt to meet NPDES permitted requirements.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

George W Kuhn Dr Dist CSO RTB

Start Day	Start Time	End Day	End Time
6/21/2021	6:00:00 AM	6/21/2021	9:25:00 AM

Rain(in.) = 0.91

Waterbody: Red Run Drain

Submission ID. HP7-R8AK-5MTWZ

Permit MI0026115

Outfall 001

RTB (MG)

37.400

Cause: A Permitted Treated Discharge has occurred due to rainfall and surcharged sewer levels. This discharge has been fine screened, settled, and disinfected in order to meet NPDES permitted requirements.

George W Kuhn Dr Dist CSO RTB

Start Day	Start Time	End Day	End Time
6/25/2021	3:58:00 PM	6/26/2021	3:18:00 PM

Rain(in.) = 2.29

Waterbody: Red Run Drain

Submission ID. HP9-NJPD-9WXB7

Permit MI0026115

Outfall 001

RTB (MG)

519.790

Cause: A Permitted Treated Discharge has occurred due to rainfall and surcharged sewer levels. This discharge has been fine screened, settled, and disinfected in order to meet NPDES permitted requirements.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

George W Kuhn Dr Dist CSO RTB

Start Day	Start Time	End Day	End Time
7/16/2021	12:55:00 PM	7/17/2021	8:45:00 AM

Rain(in.) = 1.85

Waterbody: Red Run Drain

Submission ID. HP9-V6DN-QSXZJ

Permit MI0026115

Outfall 001

RTB (MG)

433.900

Cause: A Permitted Treated Discharge has occurred due to rainfall and surcharged sewer levels. This discharge has been fine screened, settled, and disinfected in order to meet NPDES permitted requirements.

George W Kuhn Dr Dist CSO RTB

Start Day	Start Time	End Day	End Time
7/24/2021	9:35:00 PM	7/25/2021	6:30:00 AM

Rain(in.) = 1.83

Waterbody: Red Run Drain

Submission ID. HPA-BM6N-ZXJ9M

Permit MI0026115

Outfall 001

RTB (MG)

406.060

Cause: A Permitted Treated Discharge has occurred due to rainfall and surcharged sewer levels. This discharge has been fine screened, settled, and disinfected in order to meet NPDES permitted requirements.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

George W Kuhn Dr Dist CSO RTB

Start Day	Start Time	End Day	End Time
8/12/2021	5:57:00 AM	8/12/2021	3:45:00 PM

Rain(in.) = 2.4

Waterbody: Red Run Drain

Submission ID. HPA-JQJE-DBFTS
Permit MI0026115
Outfall 001

RTB (MG)

535.340

Cause: A Permitted Treated Discharge has occurred due to rainfall and surcharged sewer levels. This discharge has been fine screened, settled, and disinfected in order to meet NPDES permitted requirements.

George W Kuhn Dr Dist CSO RTB

Start Day	Start Time	End Day	End Time
8/27/2021	2:06:00 PM	8/27/2021	5:40:00 PM

Rain(in.) = 1.55

Waterbody: Red Run Drain

Submission ID. HPB-1GGR-5CJBK
Permit MI0026115
Outfall 001

RTB (MG)

70.000

Cause: A Permitted Treated Discharge has occurred due to rainfall and surcharged sewer levels. This discharge has been fine screened, settled, and disinfected in order to meet NPDES permitted requirements.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

George W Kuhn Dr Dist CSO RTB

Start Day	Start Time	End Day	End Time	Rain(in.) = 4.36
9/21/2021	11:05:00 PM	9/23/2021	11:35:00 PM	Waterbody: Red Run

Submission ID. HPB-BRDA-P6V11
Permit MI0026115
Outfall 001

RTB (MG)

637.100

Cause: A Permitted Treated Discharge has occurred due to rainfall and surcharged sewer levels. This discharge has been fine screened, settled, and disinfected in order to meet NPDES permitted requirements.

George W Kuhn Dr Dist CSO RTB

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.06
10/25/2021	7:45:00 AM	10/26/2021	12:35:00 AM	Waterbody: Red Run Drain

Submission ID. HPC-QPRR-AKGV3
Permit MI0026115
Outfall 001

RTB (MG)

199.900

Cause: A Permitted Treated Discharge has occurred due to rainfall and surcharged sewer levels. This discharge has been fine screened, settled, and disinfected in order to meet NPDES permitted requirements.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

George W Kuhn Dr Dist CSO RTB

Start Day	Start Time	End Day	End Time
10/29/2021	8:14:00 PM	10/30/2021	8:15:00 AM

Rain(in.) = 1.32

Waterbody: Red Run Drain

Submission ID. HPC-SF76-K55P3

Permit MI0026115

Outfall 001

RTB (MG)

92.600

Cause: A Permitted Treated Discharge has occurred due to rainfall and surcharged sewer levels. This discharge has been fine screened, settled, and disinfected in order to meet NPDES permitted requirements.

George W Kuhn Dr Dist CSO RTB

Start Day	Start Time	End Day	End Time
12/11/2021	3:50:00 AM	12/11/2021	1:35:00 PM

Rain(in.) = 1.09

Waterbody: Red Run Drain

Submission ID. HPC-X9CK-ERE8X

Permit MI0026115

Outfall 001

RTB (MG)

99.800

Cause: A Permitted Treated Discharge has occurred due to rainfall and surcharged sewer levels. This discharge has been fine screened, settled, and disinfected in order to meet NPDES permitted requirements.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Totals George W Kuhn Dr Dist CSO RTB

RTB (MG)

3101.29

Long-term Control Program has been completed; permit & program required construction project to upgrade the George W. Kuhn (formerly "12 Towns") Retention Treatment Facility to assure facility provides adequate treatment of discharges; upgrades included capacity/volume increase and disinfection improvements; construction of facility upgrades was completed on Dec. 22, 2005; presumptive basin; there are no "uncontrolled" (i.e., untreated) CSO outfalls associated with this permittee/program.

Oakland Co-Acacia Park CSO RTB

Oakland Co-Acacia Park CSO RTB

Start Day	Start Time	End Day	End Time
6/25/2021	6:30:00 PM	6/27/2021	3:10:00 AM

Rain(in.) = 3.82

Waterbody: Rouge River

RTB (MG)

20.530

Submission ID. HP9-V6GP-S27PF
Permit MI0037427
Outfall 103

Cause: A Permitted Treated Discharge has occurred due to rainfall and surcharged sewer levels. This discharge has been fine screened, settled, and disinfected in order to meet NPDES permitted requirements.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

Oakland Co-Acacia Park CSO RTB

Start Day	Start Time	End Day	End Time
7/16/2021	1:00:00 PM	7/17/2021	2:34:00 AM

Rain(in.) = 1.99
Waterbody: Rouge River

Submission ID. HP9-WPHH-PT8K9
Permit MI0037427
Outfall 103

RTB (MG)

5.910

Cause: A Permitted Treated Discharge has occurred due to rainfall and surcharged sewer levels. This discharge has been fine screened, settled, and disinfected in order to meet NPDES permitted requirements.

Oakland Co-Acacia Park CSO RTB

Start Day	Start Time	End Day	End Time
7/24/2021	9:08:00 PM	7/25/2021	7:20:00 AM

Rain(in.) = 1.93
Waterbody: Rouge River

Submission ID. HPA-BM87-FFGA4
Permit MI0037427
Outfall 103

RTB (MG)

10.070

Cause: A Permitted Treated Discharge has occurred due to rainfall and surcharged sewer levels. This discharge has been fine screened, settled, and disinfected in order to meet NPDES permitted requirements.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

Oakland Co-Acacia Park CSO RTB

Start Day	Start Time	End Day	End Time
8/12/2021	5:56:00 AM	8/12/2021	3:30:00 PM

Rain(in.) = 2.43
Waterbody: Rouge River

Submission ID. HPA-JQM1-7VA6Q
Permit MI0037427
Outfall 103

RTB (MG)
6.720

Cause: A Permitted Treated Discharge has occurred due to rainfall and surcharged sewer levels. This discharge has been fine screened, settled, and disinfected in order to meet NPDES permitted requirements.

Oakland Co-Acacia Park CSO RTB

Start Day	Start Time	End Day	End Time
9/21/2021	7:10:00 PM	9/24/2021	4:19:00 AM

Rain(in.) = 6.2
Waterbody: Rouge River

Submission ID. HPB-1GCW-4R8R5
Permit MI0037427
Outfall 103

RTB (MG)
43.200

Cause: A Permitted Treated Discharge has occurred due to rainfall and surcharged sewer levels. This discharge has been fine screened, settled, and disinfected in order to meet NPDES permitted requirements.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

Oakland Co-Acacia Park CSO RTB

Start Day	Start Time	End Day	End Time
10/25/2021	12:38:00 PM	10/25/2021	6:30:00 PM

Rain(in.) = 1.98
Waterbody: Rouge River

Submission ID. HPC-2HJR-OHM18
Permit MI0037427
Outfall 103

RTB (MG)
3.260

Cause: A Permitted Treated Discharge has occurred due to rainfall and surcharged sewer levels. This discharge has been fine screened, settled, and disinfected in order to meet NPDES permitted requirements.

Oakland Co-Acacia Park CSO RTB

Start Day	Start Time	End Day	End Time
10/29/2021	10:20:00 PM	10/30/2021	4:35:00 AM

Rain(in.) = 1.52
Waterbody: Rouge River

Submission ID. HPC-S934-X5WBM
Permit MI0037427
Outfall 103

RTB (MG)
2.510

Cause: A Permitted Treated Discharge has occurred due to rainfall and surcharged sewer levels. This discharge has been fine screened, settled, and disinfected in order to meet NPDES permitted requirements.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

Oakland Co-Acacia Park CSO RTB

Start Day	Start Time	End Day	End Time
12/11/2021	3:50:00 AM	12/11/2021	8:35:00 AM

Rain(in.) = 1.14
Waterbody: Rouge River

Submission ID. HPC-X9BF-J5DMA
Permit MI0037427
Outfall 103

RTB (MG)

1.940

Cause: A Permitted Treated Discharge has occurred due to rainfall and surcharged sewer levels. This discharge has been fine screened, settled, and disinfected in order to meet NPDES permitted requirements.

Totals Oakland Co-Acacia Park CSO RTB

RTB (MG)

94.14

Long-term Control Program complete; Permittee has successfully demonstrated that the Acacia Park CSO RTB effectively provides adequate treatment of combined sewage discharges and complies with Water Quality Standards at times of discharge (i.e., meets in-stream dissolved oxygen standard, eliminates raw sewage, protects public health, satisfies the biosurvey requirement, and satisfies the TRC requirement without the need for dechlorination equipment). The goal of the approved TRC Minimization Program is operation of the CSO RTB in a manner which will provide consistent, effective disinfection while minimizing the discharge of TRC.

County Totals Oakland

RTB (MG)

3403.24

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Saginaw

Saginaw Twp WWTP

Saginaw Twp WWTP

Start Day	Start Time	End Day	End Time	Rain(in.) = 3.26
6/26/2021	6:30:00 AM	6/27/2021	4:00:00 PM	Waterbody: Tittabawasee River

Submission ID. HP9-T7HE-11MET
Permit MI0023973
Outfall 003

RTB (MG)
17.334

Cause: Heavy Rain

Saginaw Twp WWTP

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.74
7/8/2021	7:48:00 AM	7/8/2021	6:00:00 PM	Waterbody: Tittabawasee River

Submission ID. HPA-2YZW-Z715E
Permit MI0023973
Outfall 003

RTB (MG)
6.228

Cause: Intense Rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Saginaw Twp WWTP

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.58
8/27/2021	11:15:00 AM	8/30/2021	2:00:00 AM	Waterbody: Tittabawassee River

Submission ID. HPB-BVXY-TVFQY
Permit MI0023973
Outfall 003

RTB (MG)
12.080

Cause: 3 intense rain storm came through the area starting Friday morning, then late Saturday afternoon, and again Saturday evening.

Saginaw Twp WWTP

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.76
9/7/2021	6:02:00 PM	9/9/2021	6:00:00 AM	Waterbody: Tittabawassee River

Submission ID. HPB-KSAP-6X0JN
Permit MI0023973
Outfall 003

RTB (MG)
9.077

Cause: Intense rain late Tuesday afternoon, combine sewer system, RTB quality outfall

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

Saginaw Twp WWTP

Start Day	Start Time	End Day	End Time	Rain(in.) = 3.36
9/23/2021	7:00:00 AM	9/27/2021	7:00:00 AM	Waterbody: Tittabawassee River

Submission ID. HPC-1V60-DMWS6
Permit MI0023973
Outfall 003

RTB (MG)
34.691

Cause: RTB discharge, because of the significant rainfall that has fallen in our service area.

Saginaw Twp WWTP

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.98
10/4/2021	11:50:00 PM	10/5/2021	8:00:00 PM	Waterbody: Tittabawassee River

Submission ID. HPC-ACH5-D85ZW
Permit MI0023973
Outfall 003

RTB (MG)
5.096

Cause: Intense rain in our already wet service area.

Saginaw Twp WWTP

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.03
10/9/2021	12:05:00 AM	10/13/2021	2:00:00 AM	Waterbody: Tittabawassee River

Submission ID. HPC-G3KQ-KXASJ
Permit MI0023973
Outfall 003

RTB (MG)
8.711

Cause: Normal RTB discharge, intense rain in our already soaked service area.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

Saginaw Twp WWTP

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.8
10/30/2021	6:00:00 AM	11/1/2021	7:00:00 AM	Waterbody: Tittabawassee River

Submission ID. HPC-YV1B-HQHVV
Permit MI0023973
Outfall 003

RTB (MG)
8.456

Cause: Normal discharge up to RTB standards. Basin not fully empty, more rain on already soaked service area,

Totals Saginaw Twp WWTP

RTB (MG)
101.67

Long-term Control Program complete; existing retention/treatment basin provides adequate treatment to meet Water Quality Standards at times of discharge.

Saginaw WWTP

Saginaw WWTP

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.75
6/8/2021	5:12:00 PM	6/8/2021	6:08:00 PM	Waterbody: Saginaw River

Submission ID. HP9-ATYB-PHBXS
Permit MI0025577
Outfall R06

RTB (MG)
0.160

Cause: RTB Discharge, of partially treated water, was discharged due to rain totals of .75. Water had floatables and settleable solids removed and was chlorinated prior to discharge

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Saginaw WWTP

Start Day	Start Time	End Day	End Time
6/25/2021	6:20:00 PM	6/27/2021	6:10:00 AM

Rain(in.) = 2.62

Waterbody: Saginaw River

Submission ID. HP9-R89R-HSZPJ

Permit MI0025577

Outfall R03

RTB (MG)

49.800

Cause: RTB discharge, of partially treated water, was discharged due to rain totals approaching 3.0 inches. Water had floatable and settleable solids removed and was chlorinated prior to discharge.

Saginaw WWTP

Start Day	Start Time	End Day	End Time
6/25/2021	6:42:00 PM	6/27/2021	12:10:00 AM

Rain(in.) = 2.88

Waterbody: Saginaw River

Submission ID. HP9-R89R-HSZPJ

Permit MI0025577

Outfall R05

RTB (MG)

5.070

Cause: RTB discharge, of partially treated water, was discharged due to rain totals approaching 3.0 inches. Water had floatable and settleable solids removed and was chlorinated prior to discharge.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Saginaw WWTP

Start Day	Start Time	End Day	End Time
6/26/2021	9:58:00 PM	6/27/2021	12:42:00 AM

Rain(in.) = 2.95

Waterbody: Saginaw River

Submission ID. HP9-R89R-HSZPJ

Permit MI0025577

Outfall R37

RTB (MG)

6.440

Cause: RTB discharge, of partially treated water, was discharged due to rain totals approaching 3.0 inches. Water had floatable and settleable solids removed and was chlorinated prior to discharge.

Saginaw WWTP

Start Day	Start Time	End Day	End Time
6/26/2021	10:52:00 PM	6/27/2021	1:44:00 AM

Rain(in.) = 3.32

Waterbody: Saginaw River

Submission ID. HP9-R89R-HSZPJ

Permit MI0025577

Outfall R06

RTB (MG)

4.900

Cause: RTB discharge, of partially treated water, was discharged due to rain totals approaching 3.5 inches. Water had floatable and settleable solids removed and was chlorinated prior to discharge.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Saginaw WWTP

Start Day	Start Time	End Day	End Time
6/26/2021	11:15:00 PM	6/27/2021	5:20:00 AM

Rain(in.) = 2.67

Waterbody: Saginaw River

Submission ID. HP9-R89R-HSZPJ

Permit MI0025577

Outfall R07

RTB (MG)

6.870

Cause: RTB discharge, of partially treated water, was discharged due to rain totals approaching 3.0 inches. Water had floatable and settleable solids removed and was chlorinated prior to discharge.

Saginaw WWTP

Start Day	Start Time	End Day	End Time
6/26/2021	11:30:00 PM	6/27/2021	3:20:00 AM

Rain(in.) = 2.59

Waterbody: Saginaw River

Submission ID. HP9-R89R-HSZPJ

Permit MI0025577

Outfall R04

RTB (MG)

6.660

Cause: RTB discharge, of partially treated water, was discharged due to rain totals approaching 2.5 inches. Water had floatable and settleable solids removed and was chlorinated prior to discharge.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Saginaw WWTP

Start Day	Start Time	End Day	End Time
7/24/2021	5:40:00 PM	7/24/2021	8:31:00 PM

Rain(in.) = 2.18

Waterbody: Saginaw River

Submission ID. HPA-FOJV-GPPBN

Permit MI0025577

Outfall R11

RTB (MG)

2.170

Cause: RTB discharge, of partially treated water, was discharged due to rain totals nearing 2.0 inches. Water had floatable and settleable solids removed and was chlorinated prior to discharge.

Saginaw WWTP

Start Day	Start Time	End Day	End Time
7/24/2021	6:04:00 PM	7/24/2021	9:34:00 PM

Rain(in.) = 2.24

Waterbody: Saginaw River

Submission ID. HPA-FOJV-GPPBN

Permit MI0025577

Outfall R07

RTB (MG)

16.190

Cause: RTB discharge, of partially treated water, was discharged due to rain totals nearing 2.0 inches. Water had floatable and settleable solids removed and was chlorinated prior to discharge.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Saginaw WWTP

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.44
7/24/2021	6:05:00 PM	7/24/2021	10:10:00 PM	Waterbody: Saginaw River

Submission ID. HPA-FOJV-GPPBN
Permit MI0025577
Outfall R04

RTB (MG)
3.640

Cause: RTB discharge, of partially treated water, was discharged due to rain totals nearing 2.0 inches. Water had floatable and settleable solids removed and was chlorinated prior to discharge.

Saginaw WWTP

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.89
7/24/2021	6:10:00 PM	7/24/2021	10:55:00 PM	Waterbody: Saginaw River

Submission ID. HPA-FOJV-GPPBN
Permit MI0025577
Outfall R03

RTB (MG)
17.580

Cause: RTB discharge, of partially treated water, was discharged due to rain totals nearing 2.0 inches. Water had floatable and settleable solids removed and was chlorinated prior to discharge.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Saginaw WWTP

Start Day	Start Time	End Day	End Time
7/24/2021	6:22:00 PM	7/24/2021	7:50:00 PM

Rain(in.) = 1.77

Waterbody: Saginaw River

Submission ID. HPA-FOJV-GPPBN

Permit MI0025577

Outfall R37

RTB (MG)

7.500

Cause: RTB discharge, of partially treated water, was discharged due to rain totals nearing 2.0 inches. Water had floatable and settleable solids removed and was chlorinated prior to discharge.

Saginaw WWTP

Start Day	Start Time	End Day	End Time
7/24/2021	6:38:00 PM	7/24/2021	9:37:00 PM

Rain(in.) = 1.77

Waterbody: Saginaw River

Submission ID. HPA-FOJV-GPPBN

Permit MI0025577

Outfall R06

RTB (MG)

9.160

Cause: RTB discharge, of partially treated water, was discharged due to rain totals nearing 2.0 inches. Water had floatable and settleable solids removed and was chlorinated prior to discharge.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Saginaw WWTP

Start Day	Start Time	End Day	End Time
7/24/2021	6:41:00 PM	7/24/2021	9:15:00 PM

Rain(in.) = 1.54

Waterbody: Saginaw River

Submission ID. HPA-FOJV-GPPBN

Permit MI0025577

Outfall R05

RTB (MG)

1.270

Cause: RTB discharge, of partially treated water, was discharged due to rain totals nearing 2.0 inches. Water had floatable and settleable solids removed and was chlorinated prior to discharge.

Saginaw WWTP

Start Day	Start Time	End Day	End Time
8/1/2021	2:14:00 AM	8/1/2021	5:45:00 AM

Rain(in.) = 0.8

Waterbody: Saginaw River

Submission ID. HPA-MPXC-3JP0Q

Permit MI0025577

Outfall R03

RTB (MG)

14.980

Cause: RTB discharge of partially treated water, was discharged due to rain totals of .80 inches. Water had floatable and settleable solids removed and was chlorinated prior to discharge.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

Saginaw WWTP

Start Day	Start Time	End Day	End Time
8/27/2021	8:30:00 AM	8/27/2021	10:18:00 AM

Rain(in.) = 2.2

Waterbody: Saginaw River

Submission ID. HPB-9EGE-57F0G

Permit MI0025577

Outfall R11

RTB (MG)

1.620

Cause: RTB discharge of partially treated water, was discharged due to rain totals of 2.5 inches. Water had floatable and settleable solids removed and was chlorinated prior to discharge.

Saginaw WWTP

Start Day	Start Time	End Day	End Time
8/27/2021	8:55:00 AM	8/27/2021	2:28:00 PM

Rain(in.) = 2.28

Waterbody: Saginaw River

Submission ID. HPB-9EGE-57F0G

Permit MI0025577

Outfall R03

RTB (MG)

29.350

Cause: RTB discharge of partially treated water, was discharged due to rain totals of 2.5 inches. Water had floatable and settleable solids removed and was chlorinated prior to discharge.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

Saginaw WWTP

Start Day	Start Time	End Day	End Time
8/27/2021	9:00:00 AM	8/27/2021	1:05:00 PM

Rain(in.) = 1.82

Waterbody: Saginaw River

Submission ID. HPB-9EGE-57F0G

Permit MI0025577

Outfall R04

RTB (MG)

2.100

Cause: RTB discharge of partially treated water, was discharged due to rain totals of 2.5 inches. Water had floatable and settleable solids removed and was chlorinated prior to discharge.

Saginaw WWTP

Start Day	Start Time	End Day	End Time
8/27/2021	9:25:00 AM	8/27/2021	2:28:00 PM

Rain(in.) = 2.51

Waterbody: Saginaw River

Submission ID. HPB-9EGE-57F0G

Permit MI0025577

Outfall R07

RTB (MG)

13.270

Cause: RTB discharge of partially treated water, was discharged due to rain totals of 2.5 inches. Water had floatable and settleable solids removed and was chlorinated prior to discharge.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

Saginaw WWTP

Start Day	Start Time	End Day	End Time
8/27/2021	9:47:00 AM	8/27/2021	12:45:00 PM

Rain(in.) = 1.98

Waterbody: Saginaw River

Submission ID. HPB-9EGE-57F0G

Permit MI0025577

Outfall R05

RTB (MG)

4.170

Cause: RTB discharge of partially treated water, was discharged due to rain totals of 2.5 inches. Water had floatable and settleable solids removed and was chlorinated prior to discharge.

Saginaw WWTP

Start Day	Start Time	End Day	End Time
8/27/2021	11:18:00 AM	8/27/2021	1:50:00 PM

Rain(in.) = 1.77

Waterbody: Saginaw River

Submission ID. HPB-9EGE-57F0G

Permit MI0025577

Outfall R37

RTB (MG)

2.620

Cause: RTB discharge of partially treated water, was discharged due to rain totals of 2.5 inches. Water had floatable and settleable solids removed and was chlorinated prior to discharge.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Saginaw WWTP

Start Day	Start Time	End Day	End Time
8/28/2021	7:34:00 PM	8/28/2021	8:50:00 PM

Rain(in.) = 0.94

Waterbody: Saginaw River

Submission ID. HPB-AJNN-9VPZ5

Permit MI0025577

Outfall R11

RTB (MG)

1.030

Cause: RTB discharge, of partially treated water, was discharged due to rain totals approaching .75inches after over 2inches of rain the previous day. Water had floatable and settleable solids removed and was chlorinated prior to discharge.

Saginaw WWTP

Start Day	Start Time	End Day	End Time
8/28/2021	8:05:00 PM	8/28/2021	11:44:00 PM

Rain(in.) = 0.75

Waterbody: Saginaw River

Submission ID. HPB-AJNN-9VPZ5

Permit MI0025577

Outfall R03

RTB (MG)

12.180

Cause: RTB discharge, of partially treated water, was discharged due to rain totals approaching .75inches after over 2inches of rain the previous day. Water had floatable and settleable solids removed and was chlorinated prior to discharge.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Saginaw WWTP

Start Day	Start Time	End Day	End Time
8/28/2021	8:18:00 PM	8/28/2021	10:25:00 PM

Rain(in.) = 0.62

Waterbody: Saginaw River

Submission ID. HPB-AJNN-9VPZ5

Permit MI0025577

Outfall R05

RTB (MG)

1.580

Cause: RTB discharge, of partially treated water, was discharged due to rain totals approaching .75inches after over 2inches of rain the previous day. Water had floatable and settleable solids removed and was chlorinated prior to discharge.

Saginaw WWTP

Start Day	Start Time	End Day	End Time
8/28/2021	9:30:00 PM	8/28/2021	10:02:00 PM

Rain(in.) = 0.2

Waterbody: Saginaw River

Submission ID. HPB-AJNN-9VPZ5

Permit MI0025577

Outfall R06

RTB (MG)

0.480

Cause: RTB discharge, of partially treated water, was discharged due to rain totals approaching .75inches after over 2inches of rain the previous day. Water had floatable and settleable solids removed and was chlorinated prior to discharge.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Saginaw WWTP

Start Day	Start Time	End Day	End Time
8/29/2021	5:36:00 PM	8/29/2021	6:20:00 PM

Rain(in.) = 0.75

Waterbody: Saginaw River

Submission ID. HPB-BAAX-VVPNC

Permit MI0025577

Outfall R37

RTB (MG)

1.310

Cause: RTB discharge of partially treated water, was discharged due to rain totals near .75 inches plus system being full from past 2 days rain events., reaching near 3.5 inches across the system.

Saginaw WWTP

Start Day	Start Time	End Day	End Time
8/29/2021	6:40:00 PM	8/29/2021	7:40:00 PM

Rain(in.) = 0.69

Waterbody: Saginaw River

Submission ID. HPB-BAAX-VVPNC

Permit MI0025577

Outfall R06

RTB (MG)

0.620

Cause: RTB discharge of partially treated water, was discharged due to rain totals near .75 inches plus system being full from past 2 days rain events., reaching near 3.5 inches across the system.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Saginaw WWTP

Start Day	Start Time	End Day	End Time
9/7/2021	6:15:00 PM	9/7/2021	10:32:00 PM

Rain(in.) = 1.66

Waterbody: Saginaw River

Submission ID. HPB-JCYJ-OKD4B

Permit MI0025577

Outfall R11

RTB (MG)

1.190

Cause: RTB discharge of partially treated water, was discharged due to rain totals approaching 2.25inches. Water had floatable and settleable solids removed and was disinfected prior to discharge.

Saginaw WWTP

Start Day	Start Time	End Day	End Time
9/7/2021	6:18:00 PM	9/8/2021	9:00:00 AM

Rain(in.) = 2.02

Waterbody: Saginaw River

Submission ID. HPB-JCYJ-OKD4B

Permit MI0025577

Outfall R03

RTB (MG)

35.220

Cause: RTB discharge of partially treated water, was discharged due to rain totals approaching 2.25inches. Water had floatable and settleable solids removed and was disinfected prior to discharge.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Saginaw WWTP

Start Day	Start Time	End Day	End Time
9/7/2021	6:20:00 PM	9/7/2021	10:10:00 PM

Rain(in.) = 1.54

Waterbody: Saginaw River

Submission ID. HPB-JCYJ-OKD4B

Permit MI0025577

Outfall R05

RTB (MG)

5.320

Cause: RTB discharge of partially treated water, was discharged due to rain totals approaching 2.25inches. Water had floatable and settleable solids removed and was disinfected prior to discharge.

Saginaw WWTP

Start Day	Start Time	End Day	End Time
9/7/2021	6:21:00 PM	9/7/2021	11:15:00 PM

Rain(in.) = 2.69

Waterbody: Saginaw River

Submission ID. HPB-JCYJ-OKD4B

Permit MI0025577

Outfall R07

RTB (MG)

9.730

Cause: RTB discharge of partially treated water, was discharged due to rain totals approaching 2.25inches. Water had floatable and settleable solids removed and was disinfected prior to discharge.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Saginaw WWTP

Start Day	Start Time	End Day	End Time
9/7/2021	6:30:00 PM	9/7/2021	10:45:00 PM

Rain(in.) = 1.31
Waterbody: Saginaw River

Submission ID. HPB-JCYJ-OKD4B
Permit MI0025577
Outfall R04

RTB (MG)
3.660

Cause: RTB discharge of partially treated water, was discharged due to rain totals approaching 2.25inches. Water had floatable and settleable solids removed and was disinfected prior to discharge.

Saginaw WWTP

Start Day	Start Time	End Day	End Time
9/7/2021	6:30:00 PM	9/7/2021	10:08:00 PM

Rain(in.) = 1.45
Waterbody: Saginaw River

Submission ID. HPB-JCYJ-OKD4B
Permit MI0025577
Outfall R37

RTB (MG)
3.220

Cause: RTB discharge of partially treated water, was discharged due to rain totals approaching 2.25inches. Water had floatable and settleable solids removed and was disinfected prior to discharge.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Saginaw WWTP

Start Day	Start Time	End Day	End Time
9/7/2021	6:43:00 PM	9/7/2021	8:49:00 PM

Rain(in.) = 1.66
Waterbody: Saginaw River

Submission ID. HPB-JCYJ-OKD4B
Permit MI0025577
Outfall R06

RTB (MG)
3.540

Cause: RTB discharge of partially treated water, was discharged due to rain totals approaching 2.25inches. Water had floatable and settleable solids removed and was disinfected prior to discharge.

Saginaw WWTP

Start Day	Start Time	End Day	End Time
9/23/2021	6:20:00 AM	9/24/2021	1:38:00 AM

Rain(in.) = 1.79
Waterbody: Saginaw River

Submission ID. HPB-YJJ1-BX4FR
Permit MI0025577
Outfall R05

RTB (MG)
7.300

Cause: RTB discharge of partially treated water, was discharged due to rain totals of 2.0 inches over the past 3 days. Water had floatable and settleable solids removed and was chlorinated prior to discharge

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

Saginaw WWTP

Start Day	Start Time	End Day	End Time
9/23/2021	6:38:00 AM	9/23/2021	9:05:00 PM

Rain(in.) = 1.05

Waterbody: Saginaw River

Submission ID. HPB-YJJ1-BX4FR

Permit MI0025577

Outfall R07

RTB (MG)

10.020

Cause: RTB discharge of partially treated water, was discharged due to rain totals of 2.0 inches over the past 3 days.
Water had floatable and settleable solids removed and was chlorinated prior to discharge

Saginaw WWTP

Start Day	Start Time	End Day	End Time
9/23/2021	7:00:00 AM	9/24/2021	1:28:00 PM

Rain(in.) = 1.4

Waterbody: Saginaw River

Submission ID. HPB-YJJ1-BX4FR

Permit MI0025577

Outfall R03

RTB (MG)

63.710

Cause: RTB discharge of partially treated water, was discharged due to rain totals of 2.0 inches over the past 3 days.
Water had floatable and settleable solids removed and was chlorinated prior to discharge

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

Saginaw WWTP

Start Day	Start Time	End Day	End Time
9/23/2021	7:00:00 AM	9/23/2021	1:47:00 PM

Rain(in.) = 1.76
Waterbody: Saginaw River

Submission ID. HPB-YJJ1-BX4FR
Permit MI0025577
Outfall R06

RTB (MG)
4.150

Cause: RTB discharge of partially treated water, was discharged due to rain totals of 2.0 inches over the past 3 days.
Water had floatable and settleable solids removed and was chlorinated prior to discharge

Saginaw WWTP

Start Day	Start Time	End Day	End Time
9/23/2021	7:27:00 AM	9/24/2021	1:20:00 AM

Rain(in.) = 1.11
Waterbody: Saginaw River

Submission ID. HPB-YJJ1-BX4FR
Permit MI0025577
Outfall R04

RTB (MG)
8.630

Cause: RTB discharge of partially treated water, was discharged due to rain totals of 2.0 inches over the past 3 days.
Water had floatable and settleable solids removed and was chlorinated prior to discharge

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Saginaw WWTP

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.94
9/23/2021	8:13:00 AM	9/23/2021	2:20:00 PM	Waterbody: Saginaw River

Submission ID. HPB-YJJ1-BX4FR
Permit MI0025577
Outfall R37

RTB (MG)
17.980

Cause: RTB discharge of partially treated water, was discharged due to rain totals of 2.0 inches over the past 3 days.
Water had floatable and settleable solids removed and was chlorinated prior to discharge

Totals Saginaw WWTP

RTB (MG)
396.39

The permittee has implemented a Long-term Control Program to provide for treatment of all combined sewage discharges from the City of Saginaw's Retention Treatment Basins (RTB's). The data provided by the City indicated that two of the 7 RTB's (Weiss Street and 14th Street RTBs) are sized to meet the State's presumptive definition, and thus provide adequate treatment to meet water quality standards at times of discharge. The City has provided enough data to indicate that the other five RTB's facilities located provide adequate treatment of combined sewage discharges and comply with Water Quality Standards at times of discharge for the following criteria; meets in-stream dissolved oxygen standard, protects public health. The City will be conducting a study to determine if all seven RTBs can effectively eliminate identifiable sanitary trash across the range of events monitored and meet the physical characteristics rule (Rule 50 of Michigan's Part 4 WQS). This is the last criteria needed to be demonstrated to ensure that the seven RTBs provide adequate treatment.

'Retention Teatment Basin' Detail Report January 1 - December 31, 2021

County Totals

Saginaw

RTB (MG)

498.06

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Wayne

Dearborn CSO

Dearborn CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 7.57
6/25/2021	11:39:00 PM	6/27/2021	6:20:00 PM	Waterbody: Rouge River

Submission ID. HP9-RR86-C9304
Permit MI0025542
Outfall 106

RTB (MG)

40.320

Cause: Rain fall volumes caused combined sewers to overflow into Outer Drive CSO facility. RTB discharge was screened and disinfected with chlorine.

Dearborn CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 7.28
6/25/2021	11:40:00 PM	6/27/2021	12:45:00 AM	Waterbody: Rouge River

Submission ID. HP9-RR86-C9304
Permit MI0025542
Outfall 117

RTB (MG)

112.509

Cause: Rain fall volumes caused combined sewers to overflow into Prospect CSO facility. RTB discharge was screened and disinfected with chlorine.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
6/25/2021	11:55:00 PM	6/26/2021	4:50:00 PM

Rain(in.) = 7.57

Waterbody: Rouge River

Submission ID. HP9-RR86-C9304

Permit MI0025542

Outfall 108

RTB (MG)

40.620

Cause: Rain fall volumes caused combined sewers to overflow into Military CSO facility. RTB discharge was screened and disinfected with chlorine.

Dearborn CSO

Start Day	Start Time	End Day	End Time
7/16/2021	10:40:00 AM	7/17/2021	10:00:00 AM

Rain(in.) = 3.73

Waterbody: Rouge River

Submission ID. HPA-8FM8-YX9PQ

Permit MI0025542

Outfall 117

RTB (MG)

120.360

Cause: RTB facility screens and treats combined sewer system. Due to high volumes of rain, the facility discharged to the river.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
7/16/2021	11:10:00 AM	7/18/2021	9:00:00 AM

Rain(in.) = 4.41
Waterbody: Rouge River

Submission ID. HPA-8GRE-27ZBZ
Permit MI0025542
Outfall 106

RTB (MG)
20.920

Cause: RTB Facility screens and treats combined sewer system. Due to high volumes of rain, the facility discharged to river.

Dearborn CSO

Start Day	Start Time	End Day	End Time
7/16/2021	11:10:00 AM	7/17/2021	12:00:00 AM

Rain(in.) = 4.41
Waterbody: Rouge River

Submission ID. HPA-8H9Q-ZTP54
Permit MI0025542
Outfall 108

RTB (MG)
11.460

Cause: RTB Facility screens and treats combined sewer system. Due to high volumes of rain, the facility discharged to river.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
7/24/2021	9:30:00 PM	7/25/2021	5:38:00 AM

Rain(in.) = 1.92
Waterbody: Rouge River

Submission ID. HPA-F4VC-P1W9S
Permit MI0025542
Outfall 117

RTB (MG)
51.270

Cause: RTB facility screens and treats rain water in the combined sewer system where it discharges to the river in compliance with the City of Dearborn permit

Dearborn CSO

Start Day	Start Time	End Day	End Time
7/24/2021	9:50:00 PM	7/25/2021	8:15:00 AM

Rain(in.) = 2.8
Waterbody: Rouge River

Submission ID. HPA-F4VC-P1W9S
Permit MI0025542
Outfall 108

RTB (MG)
7.430

Cause: RTB facility screens and treats rain water in the combined sewer system where it discharges to the river in compliance with the City of Dearborn permit

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.8
7/24/2021	10:15:00 PM	7/25/2021	6:30:00 PM	Waterbody: Rouge River

Submission ID. HPA-F4VC-P1W9S
Permit MI0025542
Outfall 106

RTB (MG)
4.650

Cause: RTB facility screens and treats rain water in the combined sewer system where it discharges to the river in compliance with the City of Dearborn permit

Dearborn CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.51
8/12/2021	3:20:00 AM	8/12/2021	4:50:00 PM	Waterbody: Rouge River

Submission ID. HPA-XH9C-5E65M
Permit MI0025542
Outfall 117

RTB (MG)
71.250

Cause: Rain fall caused combined sewer to overflow into CSO facility per city of Dearborn permit.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 3.52
8/12/2021	4:00:00 AM	8/12/2021	7:00:00 PM	Waterbody: Rouge River

Submission ID. HPA-XH9C-5E65M
Permit MI0025542
Outfall 106

RTB (MG)
11.090

Cause: Rain fall caused combined sewer to overflow into CSO facility per city of Dearborn permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 3.52
8/12/2021	4:00:00 AM	8/12/2021	5:53:00 PM	Waterbody: Rouge River

Submission ID. HPA-XH9C-5E65M
Permit MI0025542
Outfall 108

RTB (MG)
42.340

Cause: Rain fall caused combined sewer to overflow into CSO facility per city of Dearborn permit.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time
8/27/2021	1:30:00 PM	8/27/2021	7:35:00 PM

Rain(in.) = 0.53
Waterbody: Rouge River

Submission ID. HPB-9JDQ-T05MJ
Permit MI0025544
Outfall 117

RTB (MG)
61.121

Cause: RTB Facility screens and treats rain water in the combined sewer system where it discharges to the river in compliance with the City of Dearborn Permit

Dearborn CSO

Start Day	Start Time	End Day	End Time
8/27/2021	2:35:00 PM	8/27/2021	4:45:00 PM

Rain(in.) = 1.04
Waterbody: Rouge River

Submission ID. HPB-9JDQ-T05MJ
Permit MI0025543
Outfall 108

RTB (MG)
1.010

Cause: RTB Facility screens and treats rain water in the combined sewer system where it discharges to the river in compliance with the City of Dearborn Permit

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 4.47
9/21/2021	10:05:00 PM	9/23/2021	8:55:00 PM	Waterbody: Rouge River

Submission ID. HPB-XERN-XY1YE
Permit MI0025542
Outfall 117

RTB (MG)
119.470

Cause: Rain fall exceeded storage capacity of RTB facility and facility discharged to Rouge River per city of Dearborn permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 4.97
9/22/2021	8:00:00 AM	9/23/2021	11:10:00 PM	Waterbody: Rouge River

Submission ID. HPB-XERN-XY1YE
Permit MI0025542
Outfall 106

RTB (MG)
13.810

Cause: Rain fall exceeded storage capacity of RTB facility and facility discharged to Rouge River per city of Dearborn permit.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 4.97
9/22/2021	8:15:00 AM	9/23/2021	10:15:00 PM	Waterbody: Rouge River

Submission ID. HPB-XERN-XY1YE
Permit MI0025542
Outfall 108

RTB (MG)
12.530

Cause: Rain fall exceeded storage capacity of RTB facility and facility discharged to Rouge River per city of Dearborn permit.

Dearborn CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.96
10/25/2021	3:00:00 AM	10/25/2021	8:45:00 PM	Waterbody: Rouge River

Submission ID. HPC-QTMK-5JSVP
Permit MI0025542
Outfall 117

RTB (MG)
43.280

Cause: RTB facility screens and treats rain water in the combined sewer system where it discharges to the river in compliance with the City of Dearborn permit

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

Dearborn CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.21
10/25/2021	2:35:00 PM	10/25/2021	7:00:00 PM	Waterbody: Rouge River

Submission ID. HPC-QXAY-NVBAC
Permit MI0025542
Outfall 108

RTB (MG)
0.910

Cause: RTB facility screens and treats combined sewer system. Due to high volumes of rain, facility discharged to river.

Dearborn CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.2
12/11/2021	3:00:00 AM	12/11/2021	10:50:00 AM	Waterbody: Rouge River

Submission ID. HPD-WK5V-
Permit XAWGW
MI0025542
Outfall 117

RTB (MG)
23.550

Cause: RTB facility screens and treats rain water in the combined sewer system where it discharges to the river in compliance with City of Dearborn permit.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Totals Dearborn CSO

RTB (MG)
809.90

Long-term Control Program being implemented; the Department reissued a permit that recognizes a modified LTCP. The permittee submitted a revised basis of design report in late 2009 followed by a financial capability assessment. The City requested a modified LTCP (and NPDES permit), to extend the construction schedule due to economic hardship. The modified LTCP will 1) correct existing construction issues with some shafts by using sewer separation and/or reconfigured use of shafts, and 2) revise some of the additional shaft projects to sewer separation projects. The Department approved the City's request and issued a schedule in the modified permit requiring elimination of all untreated overflow outfalls by December 31, 2027; several outfalls and the associated overflows have already been eliminated.

GLWA WRRF

GLWA WRRF

Submission ID. HP6-REF0-5W8XP

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.02
2/23/2021	9:01:00 PM	2/25/2021	4:16:00 AM	Waterbody: Detroit River

Outfall 49

RTB (MG)
32.400

Cause: Snow melting

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.1
3/26/2021	2:51:00 AM	3/29/2021	7:32:00 AM	Waterbody: Detroit River

Submission ID. HP7-G5JP-9EXB9

Outfall 49

RTB (MG)
704.400

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.1
3/26/2021	3:15:00 AM	3/26/2021	5:30:00 AM	Waterbody: Detroit River

Submission ID. HP7-G5JP-9EXB9

Outfall 106

RTB (MG)
2.400

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.1
3/26/2021	3:40:00 AM	3/26/2021	4:05:00 AM	Waterbody: Detroit River

Submission ID. HP7-G5JP-9EXB9

Outfall 108

RTB (MG)
0.300

Cause: Rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.1
3/26/2021	3:52:00 AM	3/29/2021	12:28:00 AM	Waterbody: Detroit River

Submission ID. HP7-G5JP-9EXB9

Outfall 104

RTB (MG)
375.900

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.1
3/26/2021	4:16:00 AM	3/26/2021	8:57:00 AM	Waterbody: Rouge River

Submission ID. HP7-G5JP-9EXB9

Outfall 50

RTB (MG)
25.600

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.1
3/26/2021	4:30:00 AM	3/28/2021	1:30:00 PM	Waterbody: Rouge River

Submission ID. HP7-G5JP-9EXB9

Outfall 101

RTB (MG)
382.000

Cause: Rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time
3/26/2021	11:00:00 AM	3/28/2021	11:45:00 PM

Rain(in.) = 2.1

Waterbody: Rouge River

Submission ID. HP7-G5JP-9EXB9

Outfall 109

RTB (MG)

11.800

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time
4/8/2021	10:27:00 PM	4/9/2021	7:36:00 AM

Rain(in.) = 0.28

Waterbody: Detroit River

Submission ID. HP7-TXCC-CPP1Z

Outfall 49

RTB (MG)

33.000

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time
4/11/2021	1:36:00 AM	4/11/2021	2:00:00 PM

Rain(in.) = 0.66

Waterbody: Detroit River

Submission ID. HP7-WS0Z-CWF99

Outfall 49

RTB (MG)

76.500

Cause: Rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.01
5/8/2021	1:25:00 AM	5/8/2021	5:20:00 AM	Waterbody: Detroit River

Submission ID. HP8-JOAD-DBE89

Outfall 49

RTB (MG)
13.800

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.3
5/23/2021	11:18:00 PM	5/24/2021	4:45:00 AM	Waterbody: Detroit River

Submission ID. HP8-YEPF-SNJT7

Outfall 49

RTB (MG)
20.800

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.49
5/28/2021	10:36:00 AM	5/28/2021	11:24:00 PM	Waterbody: Detroit River

Submission ID. HP9-1XRQ-4X0VE

Outfall 49

RTB (MG)
141.700

Cause: Rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.53
6/2/2021	8:26:00 PM	6/3/2021	7:24:00 AM	Waterbody: Detroit River

Submission ID. HP9-66J3-50FJV

Outfall 49

RTB (MG)

106.700

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.37
6/8/2021	3:35:00 PM	6/8/2021	4:15:00 PM	Waterbody: Detroit River

Submission ID. HP9-ATDD-2233N

Outfall 108

RTB (MG)

0.500

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.37
6/8/2021	5:29:00 PM	6/8/2021	9:50:00 PM	Waterbody: Detroit River

Submission ID. HP9-ATDD-2233N

Outfall 49

RTB (MG)

31.900

Cause: Rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.51
6/18/2021	10:37:00 AM	6/18/2021	5:06:00 PM	Waterbody: Detroit River

Submission ID. HP9-JEZ2-FC628

Outfall 49

RTB (MG)
47.800

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.1
6/20/2021	10:15:00 PM	6/21/2021	7:00:00 AM	Waterbody: Detroit River

Submission ID. HP9-R8MN-7KGPD

Outfall 106

RTB (MG)
1.000

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.1
6/20/2021	10:38:00 PM	6/21/2021	9:04:00 PM	Waterbody: Detroit River

Submission ID. HP9-R8MN-7KGPD

Outfall 49

RTB (MG)
367.200

Cause: Rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time
6/21/2021	1:50:00 AM	6/21/2021	12:45:00 AM

Rain(in.) = 1.1

Waterbody: Detroit River

Submission ID. HP9-R8MN-7KGPD

Outfall 104

RTB (MG)

125.400

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time
6/21/2021	8:15:00 AM	6/21/2021	8:05:00 PM

Rain(in.) = 1.1

Waterbody: Rouge River

Submission ID. HP9-R8MN-7KGPD

Outfall 109

RTB (MG)

5.300

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time
6/21/2021	3:30:00 PM	6/21/2021	10:15:00 AM

Rain(in.) = 1.1

Waterbody: Rouge River

Submission ID. HP9-R8MN-7KGPD

Outfall 101

RTB (MG)

335.000

Cause: Rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.52
6/25/2021	1:05:00 PM	7/1/2021	2:17:00 AM	Waterbody: Detroit River

Submission ID. HPA-1FVF-M1NGY

Outfall 49

RTB (MG)
1652.400

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.52
6/25/2021	7:30:00 PM	6/26/2021	4:50:00 PM	Waterbody: Detroit River

Submission ID. HPA-1FVF-M1NGY

Outfall 106

RTB (MG)
20.400

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.52
6/25/2021	8:10:00 PM	6/27/2021	4:28:00 AM	Waterbody: Rouge River

Submission ID. HPA-1FVF-M1NGY

Outfall 107

RTB (MG)
640.500

Cause: Rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.52
6/25/2021	10:00:00 PM	6/27/2021	9:00:00 PM	Waterbody: Rouge River

RTB (MG)
1083.300

Cause: Rain

Submission ID. HPA-1FVF-M1NGY

Outfall 101

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.52
6/25/2021	10:10:00 PM	7/1/2021	2:17:00 AM	Waterbody: Detroit River

RTB (MG)
1524.800

Cause: Rain

Submission ID. HPA-1FVF-M1NGY

Outfall 104

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.52
6/25/2021	10:10:00 PM	6/26/2021	9:10:00 PM	Waterbody: Detroit River

RTB (MG)
7.600

Cause: Rain

Submission ID. HPA-1FVF-M1NGY

Outfall 108

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.52
6/25/2021	11:00:00 PM	6/28/2021	4:00:00 AM	Waterbody: Rouge River

Submission ID. HPA-1FVF-M1NGY

Outfall 109

RTB (MG)

44.500

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.52
6/25/2021	11:23:00 PM	6/26/2021	1:50:00 AM	Waterbody: Rouge River

Submission ID. HPA-1FVF-M1NGY

Outfall 50

RTB (MG)

4.000

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.52
6/26/2021	12:50:00 AM	6/26/2021	11:10:00 AM	Waterbody: Detroit River

Submission ID. HPA-1FVF-M1NGY

Outfall 105

RTB (MG)

96.700

Cause: Rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 7
7/1/2021	2:17:00 AM	7/1/2021	8:35:00 PM	Waterbody: Conner Creek

Submission ID. HPA-W1CG-SEHXV
Permit MI0022802
Outfall 104

RTB (MG)
9.400

Cause: The collection system was full. The discharge was disinfected.

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.28
7/8/2021	5:39:00 AM	7/8/2021	9:36:00 AM	Waterbody: Detroit River

Submission ID. HPA-2KCV-83HN1
Outfall 49

RTB (MG)
8.100

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.32
7/13/2021	5:15:00 PM	7/13/2021	11:19:00 PM	Waterbody: Detroit River

Submission ID. HPA-5DA3-41WV2
Outfall 49

RTB (MG)
21.700

Cause: Rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.37
7/16/2021	9:29:00 AM	7/18/2021	9:40:00 PM	Waterbody: Detroit River

RTB (MG)
999.100

Cause: Rain

Submission ID. HPA-E6TJ-5YA3N

Outfall 49

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.37
7/16/2021	9:50:00 AM	7/16/2021	11:25:00 PM	Waterbody: Detroit River

RTB (MG)
7.600

Cause: Rain

Submission ID. HPA-E6TJ-5YA3N

Outfall 106

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.37
7/16/2021	10:05:00 AM	7/17/2021	8:00:00 PM	Waterbody: Detroit River

RTB (MG)
9.900

Cause: Rain

Submission ID. HPA-E6TJ-5YA3N

Outfall 108

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time
7/16/2021	10:30:00 AM	7/16/2021	10:05:00 PM

Rain(in.) = 2.37
Waterbody: Rouge River

Submission ID. HPA-E6TJ-5YA3N

Outfall 107

RTB (MG)
267.000

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time
7/16/2021	10:30:00 AM	7/17/2021	4:20:00 PM

Rain(in.) = 2.37
Waterbody: Rouge River

Submission ID. HPA-E6TJ-5YA3N

Outfall 109

RTB (MG)
40.100

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time
7/16/2021	10:33:00 AM	7/16/2021	9:40:00 PM

Rain(in.) = 2.37
Waterbody: Rouge River

Submission ID. HPA-E6TJ-5YA3N

Outfall 50

RTB (MG)
48.300

Cause: Rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.37
7/16/2021	10:50:00 AM	7/18/2021	9:40:00 PM	Waterbody: Detroit River

Submission ID. HPA-E6TJ-5YA3N

Outfall 104

RTB (MG)
959.800

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.37
7/16/2021	10:50:00 AM	7/16/2021	11:25:00 PM	Waterbody: Detroit River

Submission ID. HPA-E6TJ-5YA3N

Outfall 105

RTB (MG)
165.800

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.37
7/16/2021	11:00:00 AM	7/18/2021	2:00:00 AM	Waterbody: Rouge River

Submission ID. HPA-E6TJ-5YA3N

Outfall 101

RTB (MG)
2455.000

Cause: Rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.56
7/20/2021	6:35:00 PM	7/20/2021	10:35:00 PM	Waterbody: Detroit River

Submission ID. HPA-BVR5-F8NKX

Outfall 104

RTB (MG)

15.600

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.04
7/24/2021	8:35:00 PM	7/25/2021	4:30:00 AM	Waterbody: Detroit River

Submission ID. HPA-NT49-1QVQY

Outfall 105

RTB (MG)

24.000

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.04
7/24/2021	8:45:00 PM	7/25/2021	5:45:00 AM	Waterbody: Detroit River

Submission ID. HPA-NT49-1QVQY

Outfall 106

RTB (MG)

0.600

Cause: Rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.04
7/24/2021	8:56:00 PM	7/26/2021	9:09:00 PM	Waterbody: Detroit River

Submission ID. HPA-NT49-1QVQY

Outfall 49

RTB (MG)
705.800

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.04
7/24/2021	9:20:00 PM	7/26/2021	9:05:00 PM	Waterbody: Detroit River

Submission ID. HPA-NT49-1QVQY

Outfall 104

RTB (MG)
298.600

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.04
7/24/2021	9:20:00 PM	7/25/2021	3:20:00 AM	Waterbody: Rouge River

Submission ID. HPA-NT49-1QVQY

Outfall 107

RTB (MG)
142.600

Cause: Rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time
7/24/2021	9:30:00 PM	7/25/2021	6:10:00 PM

Rain(in.) = 0.04

Waterbody: Rouge River

Submission ID. HPA-NT49-1QVQY

Outfall 101

RTB (MG)

1188.000

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time
7/24/2021	9:38:00 PM	7/25/2021	8:57:00 AM

Rain(in.) = 0.04

Waterbody: Detroit River

Submission ID. HPA-NT49-1QVQY

Outfall 50

RTB (MG)

31.100

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time
7/24/2021	11:00:00 PM	7/25/2021	3:30:00 PM

Rain(in.) = 0.04

Waterbody: Rouge River

Submission ID. HPA-NT49-1QVQY

Outfall 109

RTB (MG)

29.100

Cause: Rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.04
7/24/2021	11:20:00 PM	7/25/2021	12:50:00 PM	Waterbody: Detroit River

Submission ID. HPA-NT49-1QVQY

Outfall 108

RTB (MG)
0.800

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time	Waterbody: Detroit River
7/30/2021	5:00:00 AM	7/30/2021	10:30:00 PM	

Submission ID. HPA-KAV0-9RXJE

Outfall 104

RTB (MG)
65.700

Cause: High levels in the eastside collection system due to flow capacity issues at the Fairview pumping station.

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.72
8/9/2021	3:06:00 PM	8/10/2021	2:17:00 AM	Waterbody: Detroit River

Submission ID. HPB-0Q08-3X1GW

Outfall 49

RTB (MG)
139.800

Cause: Rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.72
8/9/2021	3:30:00 PM	8/9/2021	4:00:00 PM	Waterbody: Detroit River

Submission ID. HPB-0Q08-3X1GW

Outfall 108

RTB (MG)
0.200

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.72
8/9/2021	4:30:00 PM	8/9/2021	6:50:00 PM	Waterbody: Rouge River

Submission ID. HPB-0Q08-3X1GW

Outfall 101

RTB (MG)
98.000

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 3.14
8/12/2021	1:08:00 AM	8/13/2021	10:41:00 PM	Waterbody: Detroit River

Submission ID. HPA-X2JE-K1349

Outfall 49

RTB (MG)
712.200

Cause: Rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time
8/12/2021	2:30:00 AM	8/13/2021	12:00:00 AM

Rain(in.) = 3.14

Waterbody: River Rouge

Submission ID. HPA-X2JE-K1349

Outfall 101

RTB (MG)

1611.400

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time
8/12/2021	2:40:00 AM	8/12/2021	10:10:00 AM

Rain(in.) = 3.14

Waterbody: Detroit River

Submission ID. HPA-X2JE-K1349

Outfall 106

RTB (MG)

9.700

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time
8/12/2021	3:00:00 AM	8/12/2021	8:00:00 PM

Rain(in.) = 3.14

Waterbody: Detroit River

Submission ID. HPA-X2JE-K1349

Outfall 104

RTB (MG)

459.500

Cause: Rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 3.14
8/12/2021	3:15:00 AM	8/13/2021	10:15:00 AM	Waterbody: River Rouge

Submission ID. HPA-X2JE-K1349

Outfall 109

RTB (MG)
4.400

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 3.14
8/12/2021	3:20:00 AM	8/12/2021	10:40:00 AM	Waterbody: River Rouge

Submission ID. HPA-X2JE-K1349

Outfall 107

RTB (MG)
137.200

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 3.14
8/12/2021	4:50:00 AM	8/12/2021	10:35:00 AM	Waterbody: Detroit River

Submission ID. HPA-X2JE-K1349

Outfall 108

RTB (MG)
1.500

Cause: Rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 3.14
8/12/2021	5:00:00 AM	8/12/2021	12:15:00 PM	Waterbody: Detroit River

Submission ID. HPA-X2JE-K1349

Outfall 105

RTB (MG)
20.800

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 3.14
8/12/2021	5:33:00 AM	8/12/2021	11:48:00 AM	Waterbody: River Rouge

Submission ID. HPA-X2JE-K1349

Outfall 50

RTB (MG)
3.700

Cause: Rain

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time
8/27/2021	12:50:00 PM	8/28/2021	2:00:00 AM

Rain(in.) = 0.22

Waterbody: Rouge River

Submission ID. HPB-E7AK-VPBKZ

Outfall 101

RTB (MG)

355.400

Cause: Rain; 101A-HBS discharge began prior to 049A discharge due to localized heavy rainfall.101A-HBS discharge volume is estimated and may be revised.

GLWA WRRF

Start Day	Start Time	End Day	End Time
8/27/2021	1:28:00 PM	8/28/2021	10:33:00 AM

Rain(in.) = 0.22

Waterbody: Detroit River

Submission ID. HPB-E7AK-VPBKZ

Outfall 49

RTB (MG)

293.100

Cause: Rain

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.22
8/27/2021	1:30:00 PM	8/27/2021	3:45:00 PM	Waterbody: Rouge River

Submission ID. HPB-E7AK-VPBKZ

Outfall 107

RTB (MG)
32.400

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.22
8/27/2021	2:00:00 PM	8/28/2021	12:10:00 AM	Waterbody: Detroit River

Submission ID. HPB-E7AK-VPBKZ

Outfall 104

RTB (MG)
95.400

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.22
8/27/2021	2:05:00 PM	8/27/2021	7:05:00 PM	Waterbody: Rouge River

Submission ID. HPB-E7AK-VPBKZ

Outfall 50

RTB (MG)
20.800

Cause: Rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPB-BB9G-
QTWWH

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.75
8/29/2021	7:45:00 PM	8/30/2021	2:10:00 AM	Waterbody: Detroit River

Outfall 106

RTB (MG)
2.900

Cause: Rain

GLWA WRRF

Submission ID. HPB-BB9G-
QTWWH

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.75
8/29/2021	7:50:00 PM	8/30/2021	8:00:00 AM	Waterbody: Detroit River

Outfall 104

RTB (MG)
98.200

Cause: Rain

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPB-BB9G-
QTWWH

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.75
8/29/2021	8:13:00 PM	8/30/2021	10:28:00 AM	Waterbody: Detroit River

Outfall 49

RTB (MG)

157.700

Cause: Rain

GLWA WRRF

Submission ID. HPB-BB9G-
QTWWH

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.75
8/29/2021	8:35:00 PM	8/29/2021	9:10:00 PM	Waterbody: Detroit River

Outfall 108

RTB (MG)

0.100

Cause: Rain

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPB-BB9G-
QTWWH

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.75
8/29/2021	11:15:00 PM	8/30/2021	5:45:00 AM	Waterbody: Rouge River

Outfall 101

RTB (MG)
35.100

Cause: Rain

GLWA WRRF

Submission ID. HPB-JE6T-KYDVH

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.34
9/8/2021	1:00:00 AM	9/8/2021	8:37:00 AM	Waterbody: Detroit River

Outfall 49

RTB (MG)
32.400

Cause: Rain

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.29
9/14/2021	8:35:00 PM	9/15/2021	4:23:00 AM	Waterbody: Detroit River

Submission ID. HPB-QWT0-GPQG3

Outfall 49

RTB (MG)
77.000

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 4.64
9/21/2021	9:51:00 PM	9/26/2021	6:01:00 AM	Waterbody: Detroit River

Submission ID. HPC-3E48-03ZZT

Outfall 49

RTB (MG)
1834.600

Cause: RAIN

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 4.64
9/21/2021	9:55:00 PM	9/23/2021	4:30:00 AM	Waterbody: Rouge River

Submission ID. HPC-3E48-03ZZT

Outfall 107

RTB (MG)
311.200

Cause: RAIN

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 4.64
9/21/2021	10:00:00 PM	9/23/2021	9:50:00 AM	Waterbody: Detroit River

Submission ID. HPC-3E48-03ZZT

Outfall 105

RTB (MG)
91.100

Cause: RAIN

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 4.64
9/21/2021	10:00:00 PM	9/24/2021	7:45:00 AM	Waterbody: Rouge River

Submission ID. HPC-3E48-03ZZT

Outfall 109

RTB (MG)
110.400

Cause: RAIN

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 4.64
9/21/2021	10:05:00 PM	9/23/2021	12:00:00 AM	Waterbody: Detroit River

Submission ID. HPC-3E48-03ZZT

Outfall 108

RTB (MG)
3.600

Cause: RAIN

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 4.64
9/21/2021	10:30:00 PM	9/24/2021	7:45:00 AM	Waterbody: Detroit River

RTB (MG)
1415.000

Cause: RAIN

Submission ID. HPC-3E48-03ZZT

Outfall 104

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 4.64
9/21/2021	11:00:00 PM	9/24/2021	2:30:00 PM	Waterbody: Rouge River

RTB (MG)
816.000

Cause: RAIN

Submission ID. HPC-3E48-03ZZT

Outfall 101

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 4.64
9/21/2021	11:30:00 PM	9/23/2021	7:40:00 AM	Waterbody: Detroit River

RTB (MG)
15.800

Cause: RAIN

Submission ID. HPC-3E48-03ZZT

Outfall 106

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 4.64
9/22/2021	12:34:00 AM	9/23/2021	2:52:00 PM	Waterbody: Rouge River

Submission ID. HPC-3E48-03ZZT

Outfall 50

RTB (MG)
99.900

Cause: RAIN

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.88
10/16/2021	6:38:00 AM	10/16/2021	2:44:00 PM	Waterbody: Detroit River

Submission ID. HPC-FD5G-RQT0V

Outfall 49

RTB (MG)
55.800

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.32
10/21/2021	9:50:00 AM	10/21/2021	3:03:00 PM	Waterbody: Detroit River

Submission ID. HPC-MG96-D7C25

Outfall 49

RTB (MG)
12.800

Cause: Rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time
10/24/2021	11:06:00 PM	10/27/2021	11:08:00 PM

Rain(in.) = 2.13

Waterbody: Detroit River

Submission ID. HPC-QCJP-CPX85

Outfall 49

RTB (MG)

1208.700

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time
10/25/2021	1:40:00 AM	10/25/2021	7:05:00 PM

Rain(in.) = 2.13

Waterbody: Rouge River

Submission ID. HPC-QCJP-CPX85

Outfall 50

RTB (MG)

69.400

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time
10/25/2021	2:00:00 AM	10/26/2021	11:00:00 AM

Rain(in.) = 2.13

Waterbody: Rouge River

Submission ID. HPC-QCJP-CPX85

Outfall 101

RTB (MG)

595.400

Cause: Rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time
10/25/2021	3:30:00 AM	10/26/2021	9:05:00 PM

Rain(in.) = 2.13

Waterbody: Rouge River

Submission ID. HPC-QCJP-CPX85

Outfall 109

RTB (MG)

34.600

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time
10/25/2021	3:45:00 AM	10/26/2021	4:30:00 PM

Rain(in.) = 2.13

Waterbody: Detroit River

Submission ID. HPC-QCJP-CPX85

Outfall 104

RTB (MG)

502.500

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time
10/25/2021	10:00:00 AM	10/25/2021	3:40:00 PM

Rain(in.) = 2.13

Waterbody: Detroit River

Submission ID. HPC-QCJP-CPX85

Outfall 106

RTB (MG)

2.100

Cause: Rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.13
10/25/2021	10:10:00 AM	10/25/2021	1:30:00 PM	Waterbody: Detroit River

Submission ID. HPC-QCJP-CPX85

Outfall 108

RTB (MG)
0.700

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.13
10/25/2021	11:55:00 AM	10/26/2021	7:55:00 AM	Waterbody: Detroit River

Submission ID. HPC-QCJP-CPX85

Outfall 105

RTB (MG)
24.100

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.13
10/25/2021	1:00:00 PM	10/25/2021	5:30:00 PM	Waterbody: Rouge River

Submission ID. HPC-QCJP-CPX85

Outfall 107

RTB (MG)
74.500

Cause: Rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time
10/29/2021	7:23:00 AM	11/1/2021	8:55:00 PM

Rain(in.) = 1.11

Waterbody: Detroit River

Submission ID. HPC-TWVR-W1EH8

Outfall 49

RTB (MG)

1083.500

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time
10/29/2021	3:10:00 PM	10/31/2021	7:40:00 AM

Rain(in.) = 1.11

Waterbody: Detroit River

Submission ID. HPC-TWVR-W1EH8

Outfall 104

RTB (MG)

217.200

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time
10/29/2021	3:55:00 PM	10/30/2021	5:28:00 PM

Rain(in.) = 1.11

Waterbody: Rouge River

Submission ID. HPC-TWVR-W1EH8

Outfall 50

RTB (MG)

39.500

Cause: Rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time
10/29/2021	9:30:00 PM	10/30/2021	10:15:00 AM

Rain(in.) = 1.11
Waterbody: Rouge River

Submission ID. HPC-TWVR-W1EH8

Outfall 101

RTB (MG)
197.400

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time
10/30/2021	5:00:00 AM	10/31/2021	9:30:00 AM

Rain(in.) = 1.11
Waterbody: Rouge River

Submission ID. HPC-TWVR-W1EH8

Outfall 109

RTB (MG)
19.000

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time
11/11/2021	10:23:00 PM	11/12/2021	9:05:00 AM

Rain(in.) = 0.33
Waterbody: Detroit River

Submission ID. HPD-5EX0-7EPT8

Outfall 49

RTB (MG)
62.800

Cause: Rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time
11/25/2021	11:51:00 AM	11/26/2021	12:36:00 AM

Rain(in.) = 0.49

Waterbody: Detroit River

Submission ID. HPD-G736-GCRPF

Outfall 49

RTB (MG)

48.900

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time
12/5/2021	7:56:00 PM	12/6/2021	8:47:00 PM

Rain(in.) = 0.66

Waterbody: Detroit River

Submission ID. HPD-R93A-W8S8W

Outfall 49

RTB (MG)

264.100

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time
12/6/2021	12:00:00 AM	12/6/2021	3:00:00 AM

Rain(in.) = 0.66

Waterbody: Rouge River

Submission ID. HPD-R93A-W8S8W

Outfall 101

RTB (MG)

5.800

Cause: Rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPD-R93A-W8S8W

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.66
12/6/2021	6:00:00 AM	12/6/2021	7:55:00 AM	Waterbody: Rouge River

Outfall 109

RTB (MG)
8.600

Cause: Rain

GLWA WRRF

Submission ID. HPE-0TZ0-HEV7B

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.38
12/11/2021	12:15:00 AM	12/13/2021	9:04:00 AM	Waterbody: Detroit River

Outfall 49

RTB (MG)
632.400

Cause: Rain

GLWA WRRF

Submission ID. HPE-0TZ0-HEV7B

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.38
12/11/2021	3:23:00 AM	12/11/2021	3:32:00 AM	Waterbody: Rouge River

Outfall 50

RTB (MG)
0.500

Cause: Rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time
12/11/2021	3:30:00 AM	12/11/2021	5:45:00 AM

Rain(in.) = 1.38

Waterbody: Detroit River

Submission ID. HPE-OTZ0-HEV7B

Outfall 106

RTB (MG)

0.300

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time
12/11/2021	3:50:00 AM	12/11/2021	5:00:00 AM

Rain(in.) = 1.38

Waterbody: Detroit River

Submission ID. HPE-OTZ0-HEV7B

Outfall 108

RTB (MG)

0.700

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time
12/11/2021	4:00:00 AM	12/11/2021	11:00:00 PM

Rain(in.) = 1.38

Waterbody: Rouge River

Submission ID. HPE-OTZ0-HEV7B

Outfall 101

RTB (MG)

150.400

Cause: Rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time
12/11/2021	4:00:00 AM	12/11/2021	9:00:00 AM

Rain(in.) = 1.38
Waterbody: Rouge River

Submission ID. HPE-OTZ0-HEV7B

Outfall 107

RTB (MG)
65.000

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time
12/11/2021	4:45:00 AM	12/12/2021	1:15:00 PM

Rain(in.) = 1.38
Waterbody: Detroit River

Submission ID. HPE-OTZ0-HEV7B

Outfall 104

RTB (MG)
214.300

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time
12/11/2021	5:00:00 AM	12/11/2021	12:00:00 AM

Rain(in.) = 1.38
Waterbody: Rouge River

Submission ID. HPE-OTZ0-HEV7B

Outfall 109

RTB (MG)
36.200

Cause: Rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Start Day	Start Time	End Day	End Time
12/18/2021	2:12:00 PM	12/18/2021	9:43:00 PM

Rain(in.) = 0.32

Waterbody: Detroit River

Submission ID. HPE-25XM-AMN3P

Outfall 49

RTB (MG)

19.000

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time
12/25/2021	8:04:00 AM	12/25/2021	10:10:00 PM

Rain(in.) = 0.38

Waterbody: Detroit River

Submission ID. HPE-7AW2-YFVG4

Outfall 49

RTB (MG)

103.400

Cause: Rain

GLWA WRRF

Start Day	Start Time	End Day	End Time
12/27/2021	3:51:00 PM	12/28/2021	4:02:00 AM

Rain(in.) = 0.35

Waterbody: Detroit River

Submission ID. HPE-9SY5-HB8DP

Outfall 49

RTB (MG)

62.700

Cause: Rain and snow melt

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

GLWA WRRF

Submission ID. HPE-B87B-93YW9

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.22
12/29/2021	8:37:00 PM	12/30/2021	4:00:00 AM	Waterbody: Detroit River

Outfall 49

RTB (MG)

22.300

Cause: Snowmelt

Totals GLWA WRRF

RTB (MG)

30340.40

Long-term Control Program being implemented; controls include retention/treatment basins (6 on-line), CSO Screening/Disinfection Facilities (3 on-line), and 13 in-system storage dams in the collection system sewers (on-line) for temporary storing and subsequent transport of combined flow to the wastewater treatment plant; expansion of primary treatment capacity at the WWTP to 1700 MGD (on-line). To date, 14 CSOs have been eliminated, and construction of the Oakwood RTB has been completed. In addition to these 14 outfalls, 5 untreated Rouge River CSOs downstream of the turning basin are now controlled. An amended LTCP was submitted in late 2008 that proposed control projects and associated schedules for 3 untreated CSOs to the Old Channel of the Rouge River, and the 39 remaining untreated CSOs to the Detroit River. However in 2009, due to its deteriorating financial condition, Detroit terminated construction of the Upper Rouge CSO Capture Tunnel (URT). A financial capability assessment (FCA) was submitted and approved by the Department. The alternative LTCP was included in the 2011 permit modification. Another FCA was submitted by Detroit in 2012 as required by the Permit. The FCA again documented that costs associated with continued implementation of the CSO correction program were a high burden to the City of Detroit residents. Reflecting the 2012 FCA and updated costs for effectively operating the WWTP and other facilities, and taking into account opportunities to use Green Infrastructure and apply adaptive management, the permit again revised the LTCP.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Milk River CSO RTB

Milk River CSO RTB

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.87
3/26/2021	4:10:00 AM	3/26/2021	6:29:00 AM	Waterbody: Lake Saint Clair

Submission ID. HP7-G776-P2JV8
Permit MI0025500
Outfall 001

RTB (MG)
44.300

Cause: Heavy rain overwhelmed the collection system and RTB capacity forcing a discharge.

Milk River CSO RTB

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.7
3/28/2021	3:40:00 AM	3/28/2021	8:30:00 AM	Waterbody: Lake Saint Clair

Submission ID. HP7-HRX6-TZ3YZ
Permit MI0025500
Outfall 001

RTB (MG)
8.200

Cause: Rainfall overwhelmed the collection system and RTB capacity forcing a treated discharge. RTB and collection system were already full due to another rain event aprox. 36 hours earlier.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Milk River CSO RTB

Start Day	Start Time	End Day	End Time
6/26/2021	12:40:00 AM	6/27/2021	4:11:00 AM

Rain(in.) = 4.71

Waterbody: Lake St. Clair

Submission ID. HP9-REJF-ODD72

Permit MI0025500

Outfall 001

RTB (MG)

239.200

Cause: extremely heavy rain emergency

Milk River CSO RTB

Start Day	Start Time	End Day	End Time
6/29/2021	4:28:00 PM	6/29/2021	5:27:00 PM

Rain(in.) = 1.25

Waterbody: Lake Saint Clair

Submission ID. HP9-VA6W-4P1RX

Permit MI0025500

Outfall 001

RTB (MG)

7.300

Cause: A quick intense rainfall overwhelmed the collection system and RTB capacity, causing a treated, permitted discharge.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Milk River CSO RTB

Start Day	Start Time	End Day	End Time
7/8/2021	5:45:00 PM	7/8/2021	7:55:00 PM

Rain(in.) = 1.98

Waterbody: Lake Saint Clair

Submission ID. HPA-2EHT-J4ZF3

Permit MI0025500

Outfall 001

RTB (MG)

29.000

Cause: A quick intense thunderstorm with heavy rainfall overwhelmed the collection system and RTB capacity, causing a permitted treated discharge.

Milk River CSO RTB

Start Day	Start Time	End Day	End Time
7/16/2021	11:52:00 AM	7/17/2021	9:37:00 AM

Rain(in.) = 3.07

Waterbody: Lake Saint Clair

Submission ID. HPA-8J2T-15WKW

Permit MI0025500

Outfall 001

RTB (MG)

142.250

Cause: Heavy rain overwhelmed the collection system and RTB capacity resulting in a permitted, treated discharge.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

Milk River CSO RTB

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.99
7/24/2021	10:06:00 PM	7/24/2021	11:06:00 PM	Waterbody: Lake Saint Clair

Submission ID. HPA-F3Q3-EVDR1
Permit MI0025500
Outfall 001

RTB (MG)
7.960

Cause: Rainfall overwhelmed the collection system and RTB capacity causing a permitted, treated discharge.

Milk River CSO RTB

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.73
8/12/2021	6:10:00 AM	8/12/2021	11:00:00 AM	Waterbody: Lake Saint Clair

Submission ID. HPA-XHBR-HODPF
Permit MI0025500
Outfall 001

RTB (MG)
50.200

Cause: Heavy, intense rainfall overwhelmed the collection system and RTB capacity forcing a permitted, treated discharge.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Milk River CSO RTB

Start Day	Start Time	End Day	End Time	Rain(in.) = 5.03
9/21/2021	10:38:00 PM	9/23/2021	9:39:00 AM	Waterbody: Lake Saint Clair

Submission ID. HPB-XGGJ-AYNH1
Permit MI0025500
Outfall 001

RTB (MG)
182.250

Cause: Excessive rainfall overwhelmed the collection system and RTB capacity causing a permitted, treated discharge.

Milk River CSO RTB

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.95
10/25/2021	7:25:00 AM	10/25/2021	6:53:00 PM	Waterbody: Lake St. Clair

Submission ID. HPC-QPFQ-EE8B4
Permit MI0025500
Outfall 001

RTB (MG)
44.530

Cause: Rainfall overwhelmed collection system and RTB capacity causing a permitted, treated discharge

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Milk River CSO RTB

Start Day	Start Time	End Day	End Time
10/29/2021	9:00:00 PM	10/30/2021	12:34:00 PM

Rain(in.) = 1.06

Waterbody: Lake Saint Clair

Submission ID. HPC-VAYE-NDQ3J

Permit MI0025500

Outfall 001

RTB (MG)

20.300

Cause: Rainfall, in conjunction with saturated ground conditions, overwhelmed the collection system and RTB capacity causing a permitted, treated discharge.

Milk River CSO RTB

Start Day	Start Time	End Day	End Time
12/11/2021	3:55:00 AM	12/11/2021	6:55:00 AM

Rain(in.) = 1.16

Waterbody: Lake Saint Clair

Submission ID. HPD-WJZ7-N0GQ5

Permit MI0025500

Outfall 001

RTB (MG)

23.590

Cause: Intense rainfall overwhelmed the collection system and RTB capacity forcing a permitted, treated discharge.

Totals Milk River CSO RTB

RTB (MG)

799.08

Long-term Control Program being implemented

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

River Rouge CSO RTB

River Rouge CSO RTB

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.43
3/26/2021	5:00:00 AM	3/26/2021	6:30:00 AM	Waterbody: Detroit River

Submission ID. HP7-GA6C-B484B
Permit MI0028819
Outfall 101

RTB (MG)
1.436

Cause: rain

River Rouge CSO RTB

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.82
6/26/2021	12:00:00 AM	6/26/2021	2:20:00 PM	Waterbody: Detroit River

Submission ID. HP9-RBVD-9FQ4E
Permit MI0028819
Outfall 101

RTB (MG)
7.430

Cause: rain

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

River Rouge CSO RTB

Start Day	Start Time	End Day	End Time
7/16/2021	10:45:00 AM	7/17/2021	7:28:00 PM

Rain(in.) = 1.79
Waterbody: Detroit River

Submission ID. HPA-8EG7-TRSX5
Permit MI0028819
Outfall 101

RTB (MG)
21.660

Cause: rain

River Rouge CSO RTB

Start Day	Start Time	End Day	End Time
7/24/2021	9:45:00 PM	7/25/2021	7:27:00 PM

Rain(in.) = 1.77
Waterbody: Detroit River

Submission ID. HPA-F2Q2-P8CN0
Permit MI0028819
Outfall 101

RTB (MG)
38.300

Cause: rain

River Rouge CSO RTB

Start Day	Start Time	End Day	End Time
9/21/2021	10:30:00 PM	9/23/2021	4:30:00 PM

Rain(in.) = 4.47
Waterbody: Detroit River

Submission ID. HPB-XE6Y-5K1MB
Permit MI0028819
Outfall 101

RTB (MG)
27.900

Cause: rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

River Rouge CSO RTB

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.11
10/25/2021	4:05:00 AM	10/25/2021	10:30:00 PM	Waterbody: Detroit River

Submission ID. HPC-QMQ8-N6T8S
Permit MI0028819
Outfall 101

RTB (MG)
7.100

Cause: rain

River Rouge CSO RTB

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.02
12/11/2021	4:00:00 AM	12/13/2021	11:20:00 AM	Waterbody: Detroit River

Submission ID. HPD-WJMZ-XV7G6
Permit MI0028819
Outfall 101

RTB (MG)
2.740

Cause: rain

Totals River Rouge CSO RTB

RTB (MG)
106.57

Long-term Control Program completed; the program included a retention/treatment basin to provide adequate treatment of all combined sewer overflows (the facility went "on-line" and began treating overflows in 1999); remaining corrective projects have been completed and the project has been certified. The permit required "Total Residual Chlorine Mixing Zone/Plume Definition Study" has been submitted and is currently under review by the Department. The report evaluates whether or not the Total Residual Chlorine (TRC) discharges from the RTB cause violations of Water Quality Standards.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Southgate-Wyandotte CSO RTF

Southgate-Wyandotte CSO RTF

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.25
3/26/2021	3:40:00 AM	3/26/2021	11:00:00 AM	Waterbody: Detroit River

Submission ID. HP7-G6QK-KNBC4
Permit MI0036072
Outfall 001

RTB (MG)
29.685

Cause: rain

Southgate-Wyandotte CSO RTF

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.43
3/28/2021	3:20:00 AM	3/28/2021	4:00:00 PM	Waterbody: Detroit River

Submission ID. HP7-HVD7-N9DEM
Permit MI0036072
Outfall 001

RTB (MG)
19.170

Cause: rain

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

Southgate-Wyandotte CSO RTF

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.42
6/21/2021	12:45:00 AM	6/21/2021	8:00:00 AM	Waterbody: Detroit River

Submission ID. HP9-ME16-2PHYJ
Permit MI0036072
Outfall 001

RTB (MG)
17.040

Cause: Rain

Southgate-Wyandotte CSO RTF

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.82
6/25/2021	11:45:00 PM	6/29/2021	6:30:00 PM	Waterbody: Detroit River

Submission ID. HP9-RBRZ-RBWA6
Permit MI0036072
Outfall 001

RTB (MG)
57.380

Cause: rain

Southgate-Wyandotte CSO RTF

Start Day	Start Time	End Day	End Time	Waterbody: Detroit River
7/8/2021	4:45:00 PM	7/8/2021	6:55:00 PM	

Submission ID. HPA-2EYG-6CCHQ
Permit MI0036072
Outfall 001

RTB (MG)
5.700

Cause: rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Southgate-Wyandotte CSO RTF

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.79
7/16/2021	10:15:00 AM	7/17/2021	10:55:00 AM	Waterbody: Detroit River

Submission ID. HPA-8EJW-4JT1X
Permit MI0036072
Outfall 001

RTB (MG)
85.760

Cause: rain

Southgate-Wyandotte CSO RTF

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.77
7/24/2021	9:40:00 PM	7/25/2021	4:30:00 AM	Waterbody: Detroit River

Submission ID. HPA-F2W3-812A8
Permit MI0036072
Outfall 001

RTB (MG)
52.100

Cause: rain

Southgate-Wyandotte CSO RTF

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.27
8/12/2021	3:15:00 AM	8/12/2021	2:10:00 PM	Waterbody: Detroit River

Submission ID. HPA-XERY-3H4KM
Permit MI0036072
Outfall 001

RTB (MG)
104.200

Cause: rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

Southgate-Wyandotte CSO RTF

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.01
8/24/2021	9:30:00 PM	8/25/2021	8:05:00 AM	Waterbody: Detroit River

Submission ID. HPB-7EDB-DN84V
Permit MI0036072
Outfall 001

RTB (MG)
27.430

Cause: rain

Southgate-Wyandotte CSO RTF

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.67
8/29/2021	10:45:00 AM	8/30/2021	12:00:00 AM	Waterbody: Detroit River

Submission ID. HPB-BBXS-5RX0B
Permit MI0036073
Outfall 001

RTB (MG)
2.430

Cause: Rain

Southgate-Wyandotte CSO RTF

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.11
9/22/2021	12:00:00 AM	9/23/2021	8:30:00 PM	Waterbody: Detroit River

Submission ID. HPB-XEH6-WDQS1
Permit MI0036072
Outfall 001

RTB (MG)
207.630

Cause: rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Southgate-Wyandotte CSO RTF

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.89
10/4/2021	12:30:00 AM	10/4/2021	3:15:00 AM	Waterbody: Detroit River

Submission ID. HPC-8RHQ-9Z6NA
Permit MI0036072
Outfall 001

RTB (MG)
6.750

Cause: Rain

Southgate-Wyandotte CSO RTF

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.27
10/15/2021	5:45:00 PM	10/16/2021	8:05:00 AM	Waterbody: Detroit River

Submission ID. HPC-G6NN-RV3A7
Permit MI0036072
Outfall 001

RTB (MG)
5.400

Cause: rain

Southgate-Wyandotte CSO RTF

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.33
10/25/2021	1:00:00 AM	10/25/2021	11:10:00 PM	Waterbody: Detroit River

Submission ID. HPC-QMMC-ED8EA
Permit MI0036072
Outfall 001

RTB (MG)
120.700

Cause: rain

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Southgate-Wyandotte CSO RTF

Start Day	Start Time	End Day	End Time
10/29/2021	11:45:00 AM	10/30/2021	8:00:00 PM

Rain(in.) = 1.2

Waterbody: Detroit River

Submission ID. HPC-WEKG-VHC71

Permit MI0036072

Outfall 001

RTB (MG)

49.200

Cause: rain

Southgate-Wyandotte CSO RTF

Start Day	Start Time	End Day	End Time
12/5/2021	9:05:00 PM	12/6/2021	6:35:00 AM

Rain(in.) = 1.11

Waterbody: Detroit River - Trenton Channel

Submission ID. HPD-RVYS-W68VD

Permit MI0036072

Outfall 001

RTB (MG)

19.560

Cause: Discharged due to wet weather event. 1.11" rain was rec'd locally. RTB was full and flow maximized to DWTF. Discharge was treated and tested per NPDES permit requirements.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

Southgate-Wyandotte CSO RTF

Start Day	Start Time	End Day	End Time
12/11/2021	3:08:00 AM	12/11/2021	10:00:00 PM

Rain(in.) = 1.61

Waterbody: Detroit River - Trenton Channel

Submission ID. HPD-WJW2-YY15Z

Permit MI0036072

Outfall 001

RTB (MG)

47.640

Cause: Rain Event that began approx. 8:30 PM on 12/10/21 (1.61") exceeded the capacity of the SWRDDD RTB storage.

Totals Southgate-Wyandotte CSO RTF

RTB (MG)

857.78

Long-term Control Program being implemented (existing retention/treatment facility); reissued permit requires a Water Quality Study for a determination of whether the facility provides adequate treatment of all overflows; Long-term Control Program for facility upgrade and provisions for adequate treatment may be required in the future. The NPDES permit also requires the permittee to submit a Hydraulic Capacity Study for the Pine St PS. The study will be used to determine if any improvements can be made to eliminate CSO discharges from the Pine St PS.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

Wayne Co/Dearborn Heights CSO

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 5.15
6/26/2021	1:00:00 AM	6/26/2021	2:00:00 PM	Waterbody: Middle Rouge River

Submission ID. HP9-QY0D-6PS0N
Permit MI0051489
Outfall 001

RTB (MG)
55.630

Cause: Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 3.29
7/16/2021	11:25:00 AM	7/17/2021	1:48:00 PM	Waterbody: Lower Rouge River

Submission ID. HPA-8ENA-KAMAP
Permit MI0051489
Outfall 001

RTB (MG)
9.540

Cause: Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.71
7/24/2021	9:35:00 PM	7/25/2021	3:00:00 AM	Waterbody: Rouge River

Submission ID. HPA-F2J5-8ADG5
Permit MI0051489
Outfall 001

RTB (MG)
4.800

Cause: rain

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.4
8/12/2021	4:55:00 AM	8/12/2021	7:30:00 PM	Waterbody: Lower Rouge River

Submission ID. HPA-XF5C-9HGR2
Permit MI0051489
Outfall 001

RTB (MG)
4.100

Cause: Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Wayne Co/Dearborn Heights CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 4.41
9/22/2021	3:05:00 PM	9/23/2021	1:00:00 PM	Waterbody: Middle Rouge River

Submission ID. HPB-XFTA-1YPJP
Permit MI0051489
Outfall 001

RTB (MG)
10.300

Cause: Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

Totals Wayne Co/Dearborn Heights CSO

RTB (MG)

84.37

Long-term Control Program revised in reissued permit; construction of retention/treatment basin is complete & facility is "on-line" and the Department agrees that the RTB protects public health, eliminates raw sewage, protects the physical characteristics standard, and does not impact biological communities. An evaluation of the RTB discharges on the dissolved oxygen standard has been submitted and is under Department review. Outfalls M18 & M19 have been eliminated and certified by December, 2005 (flow has been directed to the existing RTB). It's the Departments intent to negotiate a revised schedule for implementation of the remaining LTCP in the reissued permit in 2022

Wayne Co/Inkster CSO

Wayne Co/Inkster CSO

Start Day	Start Time	End Day	End Time
3/28/2021	3:05:00 AM	3/28/2021	6:45:00 PM

Rain(in.) = 1.2

Waterbody: Lower Rouge River

Submission ID. HP7-HRSQ-SJYVM
Permit MI0051471
Outfall 002

RTB (MG)

1.200

Cause: Significant precipitation, resulting in Combined Sewer Overflow, in exceedance of the storage capacity of the CSO RTB. The discharge received settling, screening and disinfection

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

Wayne Co/Inkster CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 5.92
6/25/2021	11:22:00 AM	6/27/2021	9:00:00 AM	Waterbody: Lower Rouge River

Submission ID. HP9-QY7M-R8F39
Permit MI0051471
Outfall 001

RTB (MG)

48.830

Cause: Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Wayne Co/Inkster CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 5.38
6/25/2021	7:40:00 PM	6/28/2021	3:20:00 AM	Waterbody: Lower Rouge River

Submission ID. HP9-V81B-YR4PK
Permit MI0051471
Outfall 002

RTB (MG)

7.100

Cause: Significant precipitation, resulting in Combined Sewer Overflow, in exceedance of the storage capacity of the CSO RTB. The discharge received settling screening and disinfection.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Wayne Co/Inkster CSO

Start Day	Start Time	End Day	End Time
6/29/2021	3:30:00 PM	6/30/2021	2:30:00 PM

Rain(in.) = 0.53

Waterbody: Lower Rouge River

Submission ID. HP9-VZBW-7P63Y

Permit MI0051471

Outfall 002

RTB (MG)

1.660

Cause: Significant precipitation, resulting in Combined Sewer Overflow, in exceedance of the storage capacity of the CSO RTB. The discharge received settling, screening and disinfection

Wayne Co/Inkster CSO

Start Day	Start Time	End Day	End Time
7/16/2021	10:30:00 AM	7/18/2021	1:00:00 PM

Rain(in.) = 3.08

Waterbody: Lower Rouge River

Submission ID. HPA-8G55-69TXC

Permit MI0051471

Outfall 002

RTB (MG)

4.100

Cause: Significant precipitation, resulting in Combined Sewer Overflow, in exceedance of the storage capacity of the CSO RTB. The discharge received settling, screening and disinfection

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Wayne Co/Inkster CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 3.29
7/16/2021	10:40:00 AM	7/17/2021	5:45:00 AM	Waterbody: Lower Rouge River

Submission ID. HPA-8EV9-QV4MN
Permit MI0051471
Outfall 001

RTB (MG)
21.450

Cause: rain

Wayne Co/Inkster CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.71
7/24/2021	9:50:00 PM	7/25/2021	3:00:00 AM	Waterbody: Lower Rouge River

Submission ID. HPA-F2B4-NX44J
Permit MI0051471
Outfall 001

RTB (MG)
6.330

Cause: Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Wayne Co/Inkster CSO

Start Day	Start Time	End Day	End Time
7/24/2021	10:00:00 PM	7/25/2021	1:00:00 PM

Rain(in.) = 1.58

Waterbody: Lower Rouge River

Submission ID. HPA-F2RE-MHVQ6

Permit MI0051471

Outfall 002

RTB (MG)

2.200

Cause: Significant precipitation, resulting in Combined Sewer Overflow, in exceedance of the storage capacity of the CSO RTB. The discharge received settling, screening and disinfection

Wayne Co/Inkster CSO

Start Day	Start Time	End Day	End Time
8/12/2021	3:20:00 AM	8/15/2021	2:00:00 AM

Rain(in.) = 3.21

Waterbody: Lower Rouge River

Submission ID. HPB-ORVM-QVJET

Permit MI0051471

Outfall 002

RTB (MG)

4.200

Cause: Significant precipitation, resulting in Combined Sewer Overflow, in exceedance of the storage capacity of the CSO RTB. The discharge received settling, screening and disinfection

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

Wayne Co/Inkster CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.4
8/12/2021	3:35:00 AM	8/12/2021	11:35:00 AM	Waterbody: Lower Rouge River

Submission ID. HPA-XE8R-ZWE83
Permit MI0051471
Outfall 001

RTB (MG)
13.270

Cause: Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Wayne Co/Inkster CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 4.33
9/22/2021	12:45:00 AM	9/24/2021	1:15:00 PM	Waterbody: Lower Rouge River

Submission ID. HPB-XH3Z-S8V4R
Permit MI0051471
Outfall 002

RTB (MG)
5.300

Cause: Significant precipitation, resulting in Combined Sewer Overflow, in exceedance of the storage capacity of the CSO RTB. The discharge received settling, screening and disinfection

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

Wayne Co/Inkster CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 4.53
9/22/2021	5:35:00 AM	9/23/2021	4:00:00 PM	Waterbody: Lower Rouge River

Submission ID. HPB-XDQV-22PEJ
Permit MI0051471
Outfall 001

RTB (MG)
8.760

Cause: Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Wayne Co/Inkster CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.1
10/24/2021	11:40:00 PM	10/25/2021	8:05:00 PM	Waterbody: Lower Rouge River

Submission ID. HPC-QZND-X56XS
Permit MI0051471
Outfall 001

RTB (MG)
4.200

Cause: Rain

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Wayne Co/Inkster CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.05
10/25/2021	5:40:00 AM	10/26/2021	9:30:00 AM	Waterbody: Lower Rouge River

Submission ID. HPC-QMAF-2XFX3
Permit MI0051471
Outfall 002

RTB (MG)
3.050

Cause: Significant precipitation, resulting in combined sewer overflow in exceedance of the storage capacity of the CSO
RTB. The discharge received settling, screening and disinfection

Wayne Co/Inkster CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.89
10/29/2021	9:45:00 PM	10/30/2021	1:30:00 AM	Waterbody: Lower Rouge River

Submission ID. HPC-V9HB-6MZKR
Permit MI0051471
Outfall 002

RTB (MG)
0.150

Cause: Significant precipitation, resulting in Combined Sewer overflow, in exceedance of the storage capacity of the CSO
RTB. The discharge received settling, screening and disinfection

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Wayne Co/Inkster CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.09
12/11/2021	3:30:00 AM	12/11/2021	7:00:00 PM	Waterbody: Lower Rouge River

Submission ID. HPD-WJWX-
Permit 4AMX7
MI0051471
Outfall 002

RTB (MG)

0.002

Cause: Significant precipitation, resulting in Combined Sewer Overflow, in exceedance of the storage capacity of the CSO RTB. The discharge received settling and disinfection

Wayne Co/Inkster CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.04
12/11/2021	4:36:00 AM	12/11/2021	4:42:00 AM	Waterbody: Lower Rouge River

Submission ID. HPD-WPOR-PMRGX
Permit MI0051471
Outfall 001

RTB (MG)

0.714

Cause: rain

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Totals Wayne Co/Inkster CSO

RTB (MG)
132.52

Long-term Control Program revised in permit; construction of retention/treatment basin is complete & facility is "on-line" and the Department agrees that the RTB protects public health, eliminates raw sewage, protects the physical characteristics standard, and does not impact biological communities. An evaluation of the RTB discharges on the dissolved oxygen standard has been submitted and is under Department review. 5 CSOs have been eliminated/bulkheaded following sewer separation. The City recently constructed an RTB to address two west side CSOs. A revised financial demonstration has been submitted and it's the Departments intent to negotiate a revised schedule for implementation of the remaining LTCP in the reissued permit in 2022

Wayne Co/RDFrd/Livonia CSO

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time
6/25/2021	7:45:00 PM	6/26/2021	2:32:00 PM

Rain(in.) = 2.59

Waterbody: Middle River Rouge

Submission ID. HP9-R6VY-53745
Permit MI0051535
Outfall 001

RTB (MG)
2.780

Cause: Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.7
7/16/2021	1:00:00 PM	7/17/2021	7:28:00 PM	Waterbody: Upper Rouge River

Submission ID. HPA-8H5E-36JCC
Permit MI0051535
Outfall 001

RTB (MG)
4.500

Cause: rain

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.81
7/24/2021	10:15:00 PM	7/25/2021	1:30:00 AM	Waterbody: Upper Rouge River

Submission ID. HPA-F230-8CS05
Permit MI0051535
Outfall 001

RTB (MG)
3.370

Cause: Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.36
8/12/2021	6:00:00 AM	8/12/2021	3:40:00 PM	Waterbody: Upper Rouge River

Submission ID. HPA-XFBT-82RHB
Permit MI0051535
Outfall 001

RTB (MG)
1.840

Cause: Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Treatment Basin' Detail Report

January 1 - December 31, 2021

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.17
8/27/2021	3:00:00 PM	8/27/2021	3:30:00 PM	Waterbody: Upper Rouge River

Submission ID. HPB-9M8J-FG6YY
Permit MI0051535
Outfall 001

RTB (MG)
0.798

Cause: rain

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 4.41
9/22/2021	11:00:00 AM	9/22/2021	5:00:00 PM	Waterbody: Upper Rouge River

Submission ID. HPB-XPPX-Z7A0T
Permit MI0051535
Outfall 001

RTB (MG)
6.940

Cause: Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

'Retention Teatment Basin' Detail Report

January 1 - December 31, 2021

Wayne Co/RDFrd/Livonia CSO

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.94
10/25/2021	4:05:00 AM	10/25/2021	5:30:00 PM	Waterbody: Rouge River

Submission ID. HPC-WDWM-
Permit HTXYK
Outfall MI0051535
001

RTB (MG)
1.840

Cause: Rain

Totals Wayne Co/RDFrd/Livonia CSO

RTB (MG)
22.07

Long-term Control Program being implemented; construction of retention/treatment basin (for elimination of raw sewage & protection of public health) complete & facility is "on-line". The Department agrees that the RTB eliminates raw sewage, protects public health, and protects the physical characteristics standard. A report has been submitted to verify that the RTB protects the dissolved oxygen standard, and is currently under review by the Department. The reissued permit will require independent control of the remaining untreated outfall or alternatively work with GLWA on a regional plan by 2025.

County Totals Wayne

RTB (MG)
33152.68

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are classified as SSOs.

'Retention Teatment Basin' Detail Report January 1 - December 31, 2021

Report Totals

RTB (MG)

37979.16

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Allegan

Moline WWTP

Moline WWTP

Submission ID. HPA-4107-6MNFT

Start Day	Start Time	End Day	End Time
7/10/2021	3:00:00 PM	7/10/2021	7:00 PM

Waterbody: no name drainage ditch

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00250

Cause: 12" cleanout on the force main at the west entrance just off 142nd st. ; it appeared the a few of the bolts that hold the megalug on had rotted off and became weak, the normal operating pressure blow it off.

Location: Dorr Exxon truck Stop entrance

EGLE Action: Event reviewed and appears to be remediated. No further action taken at this time.

Totals Moline WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00250

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Windsor Woods Village

Windsor Woods Village

Submission ID. HP5-JE5C-R0NKK

Start Day	Start Time	End Day	End Time
1/5/2021	5:00:00 PM	1/6/2021	8:45 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00030

EGLE Action: The clean out discharged when crew went to check for blockage

Totals Windsor Woods Village

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00030

County Totals Allegan

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00250 0.00030

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Alpena

Alpena CM

Alpena CM

Submission ID. HP7-5DXE-H3PGK

Start Day	Start Time	End Day	End Time
3/11/2021	4:00:00 PM	3/11/2021	4:15 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00003

Cause: Dry weather discharge from manhole caused by sewer main being obstructed by prohibited substance (rags) and the main being pressurized by what is believed to be a sump pump discharge (also prohibited).

Location: Wilson Street

EGLE Action: No further action. The corrective action taken is appropriate to prevent further SSOs in the future.

Alpena CM

Submission ID. HP9-VR0G-CNV4D

Start Day	Start Time	End Day	End Time
6/28/2021	8:30:00 AM	6/28/2021	8:45 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00003

Cause: Bubbler at Long Rapids Road Lift Station failed to activate auto pump operation

EGLE Action: No further action.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Totals Alpena CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00005

Alpena Township CM

Alpena Township CM

Submission ID. HPA-8GD8-5QSC2

Start Day	Start Time	End Day	End Time
7/16/2021	10:10:00 AM	7/16/2021	10:35 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

Cause: sanitary sewer obstruction caused manhole overflow

Location: intersection of Sunset Blvd and St Onge St

EGLE Action: No further action at this time.

Totals Alpena Township CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

County Totals Alpena

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00015

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Antrim

Bellaire WWTP

Bellaire WWTP

Submission ID. HPC-F9ES-TR21Q

Start Day	Start Time	End Day	End Time
10/13/2021	10:00:00 AM	10/13/2021	10:30 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00050

Cause: low rate seepage through a manhole cover onto road surface, A contractor pouring footings at a business broke a service line and filled approximately 45 ft of sewer main with cement completely plugging pipe

Location: Broad st

EGLE Action: Violation Notice sent to address discharge

Totals Bellaire WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00050

County Totals Antrim

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00050

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Barry

Carlton Township CM

Carlton Township CM

Submission ID. HPD-5XAA-78RYP

Start Day	Start Time	End Day	End Time
9/5/2021	1:00:00 AM	9/10/2021	11:00 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00016

Cause: Pipe rupture due to increasing pressures

Location: Oxidation Facility

EGLE Action: On 11/12/2021 EGLE had a meeting with the Township to review required notification and reporting for SSOs. The Township did not make the appropriate notifications within 24 hours. Following the meeting, the Township Supervisor affirmed an understanding of reporting requirements and is prepared for reporting any future releases. No further action at this time.

Totals Carlton Township CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00016

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Southwest Barry Co SWA

Southwest Barry Co SWA

Submission ID. HP7-RCMJ-ZKJCH

Start Day	Start Time	End Day	End Time
4/4/2021	2:30:00 PM	4/4/2021	7:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00030

Cause: The discharge was on the road only. This was caused by a break at a joint in the sewer main.

EGLE Action: No further action taken at this time

Southwest Barry Co SWA

Submission ID. HPD-Z7J7-D1XMD

Start Day	Start Time	End Day	End Time
12/14/2021	1:30:00 PM	12/14/2021	2:15 PM

Waterbody: Pine Lake

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00500

Cause: The contractor broke the 1 1/2" service line with an excavator. He was looking for the line to relocate it around a newly constructed house.

EGLE Action: No further action taken at this time

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Totals Southwest Barry Co SWA

Raw Sewage (MG)	Partially Treated (MG)	Dilute Raw Sewage (MG)
0.00530		

County Totals Barry

Raw Sewage (MG)	Partially Treated (MG)	Dilute Raw Sewage (MG)
0.00530	0.00016	

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Bay

Dow Silicones Corporation-Auburn

Dow Silicones Corporation-Auburn

Submission ID. HP7-TJEX-V3GPG

Start Day	Start Time	End Day	End Time
4/7/2021	2:34:00 PM	4/7/2021	7:30 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00035

Cause: An equipment failure in the main lift station of the Site's sanitary sewer system causing an overflow to the ground of the surrounding area.

Location: Dow Silicones Corporation Auburn Site

EGLE Action: Violation notice issued

Dow Silicones Corporation-Auburn

Submission ID. HP9-6NW8-TB3PY

Start Day	Start Time	End Day	End Time
6/2/2021	3:15:00 PM	6/2/2021	4:25 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00030

Cause: A fitting failure within a line connection at the Site's Module 4 lift station (this lift station is use to transfer wastewater to the Site's Main sanitary sewer lift station)

Location: Dow Silicones Corporation Auburn Site

EGLE Action: Second violation notice to be issued. Pump station failures have led to recurring discharges.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Dow Silicones Corporation-Auburn

Submission ID. HPA-CF3Q-BBGSD

Start Day	Start Time	End Day	End Time
7/20/2021	6:12:00 PM	7/20/2021	7:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00050

Cause: An equipment failure in the Module 6 lift station of the Site's sanitary sewer system causing an overflow to the ground of the surrounding area.

Location: Dow Silicones Corporation Auburn Site

EGLE Action: Violation notice issued. Will follow existing schedule of compliance.

Totals Dow Silicones Corporation-Auburn

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00115

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

West Bay Co Regional WWTP

West Bay Co Regional WWTP

Submission ID. HP6-4B3N-1HP4Q

Start Day	Start Time	End Day	End Time
1/28/2021	12:00:00 PM	1/28/2021	3:30 PM

Waterbody: Tebo Drain

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00100

Cause: Contractors working for the Drain Commission damaged the M-13 sanitary sewer force main that runs along the west side of M-13 under Tebo Drain at approximately 12:00 pm on 1/28/21. This caused approximately 1000 gallons of dilute sanitary sewage to leak i

Location: Tebo Drain

EGLE Action: No further action taken. The discharge was caused by an independent contractor working for the local drain commissioner. The facility is planning to move the forcemain to a greater depth to prevent future damage and discharge.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

West Bay Co Regional WWTP

Submission ID. HP7-JTTY-6QKQT

Start Day	Start Time	End Day	End Time
3/29/2021	9:00:00 AM	3/29/2021	9:10 AM

Waterbody: West Bay County Regional WWTP Storm W

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)

0.05400

Cause: The bubbler system for the downstream Aeration Building wetwell malfunctioned and the back-up high level float was disconnected. This caused the primary tanks to overflow for approximately 10 minutes.

Location: West Bay County Regional WWTP

EGLE Action: Communication with facility superintendent requesting E Coli testing results be provided to the department when the impact stormwater pond discharges. No further action taken, as the event was an isolated incident, and the failed facility component has been repaired. The facility has further committed to regular maintenance checks of this component to prevent future events.

Totals West Bay Co Regional WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)

0.05400

0.00100

County Totals

Bay

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)

0.05400

0.00215

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Berrien

Benton Charter Township CM

Benton Charter Township CM

Submission ID. HP9-NDWX-XA782

Start Day	Start Time	End Day	End Time
6/19/2021	6:00:00 PM	6/19/2021	6:30 PM

Rain(in.) = 1

Waterbody: County drain on side of road

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00050

Cause: The force main for the Pipestone lift station blew causing discharge on the tree lawn and road side.

EGLE Action: Event reviewed and appears to be remediated. No further action taken at this time

Totals Benton Charter Township CM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00050

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Benton Harbor CM

Benton Harbor CM

Submission ID. HPB-773F-JWBA5

Start Day	Start Time	End Day	End Time
8/24/2021	8:30:00 AM	8/24/2021	10:20 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00024

Cause: lift station wetwell overflow due to pump issue

Location: North Crystal Ave lift station

EGLE Action: After initial notification, a final SSO report was not submitted. VN-012294 addressed this. Reviewed report upon submission.

Totals Benton Harbor CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00024

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Bridgman CM

Bridgman CM

Submission ID. HP6-R464-DW95Y

Start Day	Start Time	End Day	End Time
2/23/2021	10:55:00 AM	2/23/2021	11:00 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00001

Cause: Tangled floats and backup float was found to not be working

Location: Manhole near 5234 Lake St

EGLE Action: No Additional Action Taken at this Time

Totals Bridgman CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00001

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Chikaming Township CM

Chikaming Township CM

Submission ID. HPA-X3V3-AM386

Start Day	Start Time	End Day	End Time
8/10/2021	5:00:00 AM	8/10/2021	6:00 AM

Rain(in.) = 6

Waterbody: Lake Michigan

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00250

Cause: Raw sewage discharged due to power outage at lift station.

Location: LS 9

EGLE Action: Discharge event reviewed and processed. Situation appears to have been addressed.

Chikaming Township CM

Submission ID. HPA-X3V3-AM386

Start Day	Start Time	End Day	End Time
8/10/2021	5:00:00 AM	8/10/2021	6:00 AM

Rain(in.) = 6

Waterbody: Creek near LS 9

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00250

Cause: Raw sewage discharged due to power outage at lift station.

Location: LS 9

EGLE Action: Discharge event reviewed and processed. Situation appears to have been addressed.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Chikaming Township CM

Submission ID. HPA-X3V3-AM386

Start Day	Start Time	End Day	End Time
8/10/2021	7:00:00 AM	8/10/2021	8:00 AM

Rain(in.) = 6
Waterbody: Lake Michigan

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00100

Cause: Raw sewage due to lift station overflow. Loss of power at lift station caused overflow.

Location: LS 14

EGLE Action: Discharge event reviewed and processed. Situation appears to have been addressed.

Chikaming Township CM

Submission ID. HPA-X3V3-AM386

Start Day	Start Time	End Day	End Time
8/10/2021	7:00:00 AM	8/10/2021	8:00 AM

Rain(in.) = 6
Waterbody: Painterville Drain

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00100

Cause: Raw sewage due to lift station overflow. Loss of power at lift station caused overflow.

Location: LS 14

EGLE Action: Discharge event reviewed and processed. Situation appears to have been addressed.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Chikaming Township CM

Submission ID. HPA-X3V3-AM386

Start Day	Start Time	End Day	End Time
8/10/2021	4:45:00 PM	8/10/2021	5:15 PM

Rain(in.) = 6

Waterbody: Lake Michigan (potentially)

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00002

Cause: Raw sewage due to lift station overflow. Loss of power at lift station caused overflow.

Location: LS 14

EGLE Action: Discharge event reviewed and processed. Situation appears to have been addressed.

Chikaming Township CM

Submission ID. HPA-X3V3-AM386

Start Day	Start Time	End Day	End Time
8/10/2021	4:45:00 PM	8/10/2021	5:15 PM

Rain(in.) = 6

Waterbody: Painterville Drain (potentially)

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00002

Cause: Raw sewage due to lift station overflow. Loss of power at lift station caused overflow.

Location: LS 14

EGLE Action: Discharge event reviewed and processed. Situation appears to have been addressed.

Totals Chikaming Township CM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00704

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

GRSD Sewer Authority WRRF

GRSD Sewer Authority WRRF

Submission ID. HP5-KY9T-GYW XV

Start Day	Start Time	End Day	End Time
1/8/2021	9:38:00 AM	1/8/2021	10:20 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00005

Cause: Raw sewage from domestic users. Discharge due to backup in sewer line.

Location: MANHOLE NEAR 403 MERCHANT

EGLE Action: Event was reviewed and appears to be remediated.

GRSD Sewer Authority WRRF

Submission ID. HP7-6ATW-WXBOS

Start Day	Start Time	End Day	End Time
3/13/2021	12:32:00 PM	3/13/2021	1:02 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

Cause: Raw sewage discharge caused by backup of sewer lateral at private residence.

EGLE Action: No Additional Action Taken at this Time

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Totals GRSD Sewer Authority WRRF

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00015

Niles WWTP

Niles WWTP

Submission ID. HPA-W05Q-
MSC9Q

Start Day	Start Time	End Day	End Time
8/9/2021	12:00:00 AM	8/9/2021	7:00 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.09450

Cause: Sanitary sewage and process water from Indeck.; Employee error. Employee decided to shut the lift station pumps off.at this time he was unaware that the station was receiving the process water (Indeck did not alert the City that they started discharging)

Location: Progressive Drive lift station

EGLE Action: Called City of Niles to determine difference in discharge estimate for PEAS and SSO report. Evaluated the SSO report for completeness.

Totals Niles WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.09450

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

St Joseph CM

St Joseph CM

Submission ID. HP6-DRPV-GYNB0

Start Day	Start Time	End Day	End Time
2/9/2021	3:55:00 PM	2/9/2021	4:15 PM

Waterbody: Open tributary to the St. Joseph River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00030

Cause: Sanitary sewer main blockage. Sewage discharge was from a sanitary sewer manhole cover.

Location: Lakeview Dr S of St Joseph High School

EGLE Action: No additional action taken at this time

Totals St Joseph CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00030

County Totals

Berrien

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00824 **0.09450**

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Calhoun

Battle Creek CM

Battle Creek CM

Submission ID. HP7-72H0-6ZPGA

Start Day	Start Time	End Day	End Time
3/14/2021	12:42:00 PM	3/14/2021	2:42 PM

Waterbody: Lakeview Square Mall Retention Pond

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00012

Cause: Raw sewage and cause of discharge was a grease plug

Location: Beckley Road

EGLE Action: Event reviewed and appears to be remediated.

Battle Creek CM

Submission ID. HP7-JVET-KHEDG

Start Day	Start Time	End Day	End Time
3/29/2021	8:30:00 AM	3/29/2021	9:30 AM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00050

Cause: Discharge was raw sewage, cause is a broken force main

EGLE Action: Event reviewed and appears to be remediated.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Battle Creek CM

Submission ID. HP9-9YNF-JX8ER

Start Day	Start Time	End Day	End Time
6/7/2021	4:00:00 PM	6/7/2021	5:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00020

Cause: Raw Sewage discharged from Lift Station due to a power outage

Location: Lift Station 72

EGLE Action: Event viewed and submission appears to be complete.

Battle Creek CM

Submission ID. HPD-WW3A-D3556

Start Day	Start Time	End Day	End Time
12/11/2021	11:30:00 AM	12/11/2021	4:30 PM

Rain(in.) = 1

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00100

Cause: Raw Sewage ARV Valve broken before ball valve causing sewage to fill up manhole which caused manhole to overflow into the street.

Location: 308 Wallace Battle Creek MI 49017

EGLE Action: Event reviewed.

Totals Battle Creek CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00182

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Westrock BOD Battle Creek

Westrock BOD Battle Creek

Submission ID. HP6-18G2-R4DY8

Start Day	Start Time	End Day	End Time
1/22/2021	1:48:00 PM	1/22/2021	2:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00150

Cause: Sewer line broke under parking lot

Location: Parking Lot Area

EGLE Action: No Additional Action Taken at this Time

Westrock BOD Battle Creek

Submission ID. HP6-ER7C-W11GY

Start Day	Start Time	End Day	End Time
2/11/2021	6:45:00 AM	2/11/2021	7:20 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00100

Location: Westrock Box on Demand

EGLE Action: Combination of process and sanitary sewer. Process water from corrugating process containing starch adhesive. ; Reason for discharge: sewer overflow Due to pump one impeller jam, and pump two power cable short.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Totals **Westrock BOD Battle Creek**

Raw Sewage (MG)	Partially Treated (MG)	Dilute Raw Sewage (MG)
0.00150		0.00100

County Totals **Calhoun**

Raw Sewage (MG)	Partially Treated (MG)	Dilute Raw Sewage (MG)
0.00332		0.00100

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Cass

Cass Co-Lakes Area SA WWTP

Cass Co-Lakes Area SA WWTP

Submission ID. HPC-G02X-4WH13

Start Day	Start Time	End Day	End Time
10/14/2021	3:30:00 PM	10/14/2021	3:31 PM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00001

Cause: The spill came from MH # B-32 during maintenance on an air release valve that is connected to a pressurized force main. The spill lasted for approximately 60 seconds until staff could reclose the isolation valve on the force main. Powderized lime was sp

Location: Finch Rd Marcellus, MI MH # B-35

EGLE Action: Discharge event reported reviewed. Actions taken appear adequate.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 26 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Cass Co-Lakes Area SA WWTP

Submission ID. HPC-ZTRA-7PNYS

Start Day	Start Time	End Day	End Time
11/3/2021	4:50:00 PM	11/3/2021	5:25 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00450

Cause: At approximately 5:20 PM, staff received a report that there was a possible sewage spill on Hemlock Lake Rd Marcellus, MI. Upon investigation, staff found that sewage was overflowing from a manhole at 53283 Hemlock Lake Rd Marcellus, MI. The overflow re

EGLE Action: Event reviewed and new SOP reviewed. Actions at this time are adequate.

Totals Cass Co-Lakes Area SA WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00451

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Cassopolis CM

Cassopolis CM

Submission ID. HPA-57XM-MWCSJ

Start Day	Start Time	End Day	End Time
7/3/2021	3:30:00 PM	7/3/2021	3:45 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00200

Cause: The pump in a sewer lift station on Railroad St., known as A8, failed. While the Department of Public Works was trying to set up a by-pass pump, the heavy flow from the holiday weekend was too much and overflowed out of a manhole upstream of A8.

Location: Cara Avenue

EGLE Action: Reviewed the SSO report and determined appropriate actions appear to have been taken.

Totals Cassopolis CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00200

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Dowagiac CM

Dowagiac CM

Submission ID. HP8-6E1W-ZZA7A

Start Day	Start Time	End Day	End Time
4/9/2021	11:00:00 AM	4/22/2021	3:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00000

Cause: On April 4th we were made aware of a sink hole forming at 714 N. Front Street, Dowagiac MI 49047. We manage Sewer, Storm, and Water in that area so we began an investigation, but returned no results. We were informed about the sink hole returning on Apr

EGLE Action: Event reviewed. No further action taken at this time

Totals Dowagiac CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00000

County Totals Cass

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00451 **0.00200**

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Chippewa

Kinross Twp WWTP

Kinross Twp WWTP

Submission ID. HPC-E897-VVHR7

Start Day	Start Time	End Day	End Time
10/11/2021	9:00:00 AM	10/11/2021	3:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

Cause: a cleanout lid on a force main was broken (presumably by a lawnmower) and when the lift station was pumping a small amount of raw sewage was pushed out of the hole.

Location: chippewa county central dispatch

EGLE Action: Communicated corrective actions with facility operator for the next time.

Totals Kinross Twp WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Sault Ste Marie WWTP

Sault Ste Marie WWTP

Submission ID. HPA-JQGG-DZ196

Start Day	Start Time	End Day	End Time
7/29/2021	3:00:00 AM	7/29/2021	9:00 AM

Rain(in.) = 2.41

Waterbody: st marys river

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.05000

Cause: SSO resulting from rain event.

Location: Bingham & Water

EGLE Action: Corrective actions in NPDES permit

Sault Ste Marie WWTP

Submission ID. HPA-JPQG-NHV7A

Start Day	Start Time	End Day	End Time
7/29/2021	3:00:00 AM	7/29/2021	9:00 AM

Rain(in.) = 2.41

Waterbody: St Mary's River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.05000

Cause: Storm runoff with some domestic wastewater

Location: Peck & Meredian

EGLE Action: I&I reduction tasks included in NPDES permit.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Totals **Sault Ste Marie WWTP**

Raw Sewage (MG)	Partially Treated (MG)	Dilute Raw Sewage (MG)
		0.10000

County Totals **Chippewa**

Raw Sewage (MG)	Partially Treated (MG)	Dilute Raw Sewage (MG)
0.00010		0.10000

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Clare

Clare WWTP

Clare WWTP

Submission ID. HP9-VYM5-T062T

Start Day	Start Time	End Day	End Time
6/14/2021	11:30:00 PM	6/14/2021	2:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

Cause: While digging bridge footings a sewer main was hit on 6th St. between Jackson Hemlock

Location: E. 6th St. Clare Mi.

EGLE Action: No further action taken. Event was caused by construction crew outside of the control of the facility. Event was promptly responded to and ended.

Totals Clare WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Harrison WWTP

Harrison WWTP

Submission ID. HP9-P50C-5QF3N

Start Day	Start Time	End Day	End Time
6/22/2021	5:45:00 PM	6/22/2021	6:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00020

Cause: A clog in a gravity main caused by a collection of "flushable" wipes caused the main to overflow the manhole lid. Roughly 200 gallons of wastewater flowed onto the roadway as well as the grass and sidewalk along side. The main was unclogged and the area w

Location: Manhole at the intersection of Spruce and 5th st.

EGLE Action: No further action taken. Event was an isolated incident and the facility is committed to preventing future events.

Totals Harrison WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00020

County Totals Clare

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00030

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Clinton

DeWitt Township CM

DeWitt Township CM

Submission ID. HP9-WK4J-A9849

Start Day	Start Time	End Day	End Time
6/25/2021	7:51:00 PM	6/25/2021	10:30 PM

Rain(in.) = 4.5

Waterbody: Prairie gunderman drain

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.02400

Cause: The discharge was caused from an extreme rain event.

Location: Is 102

EGLE Action: No further action taken at this time

DeWitt Township CM

Submission ID. HPA-XNG8-617HW

Start Day	Start Time	End Day	End Time
8/12/2021	5:10:00 AM	8/12/2021	6:28 AM

Rain(in.) = 3.55

Waterbody: Prairie gunderman drain

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.01384

Cause: The discharge was caused from an extreme rain event.

Location: LS 102

EGLE Action: No further action taken at this time

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Totals **DeWitt Township CM**

Raw Sewage (MG)	Partially Treated (MG)	Dilute Raw Sewage (MG)
		0.03784

County Totals **Clinton**

Raw Sewage (MG)	Partially Treated (MG)	Dilute Raw Sewage (MG)
		0.03784

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Eaton

Grand Ledge WWTP

Grand Ledge WWTP

Submission ID. HP9-T5SM-5J2FK

Start Day	Start Time	End Day	End Time	Rain(in.) = 5.23
6/26/2021	6:42:00 PM	6/26/2021	11:32 PM	Waterbody: Grand River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.24276

Cause: Discharge was caused by an excessive amount of rain causing a main sewer line to surcharge which resulted in the opening of a manual bypass valve. The rainfall total for the past 4 days is 5.23"

Location: Manhole #211

EGLE Action: Rain event under investigation for force majeure

Totals Grand Ledge WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.24276

County Totals Eaton

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.24276

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Emmet

Harbor Springs Area Sewage

Harbor Springs Area Sewage

Submission ID. HP7-N6Z2-CQ104

Start Day	Start Time	End Day	End Time
3/31/2021	2:30:00 PM	4/1/2021	8:30 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.01500

Cause: Force Main sewer had a 12 inch lateral crack that was leaking raw sewage to the ditch on the side of the road.

Location: 100 yards South of 8503 Us-31, Alanson MI

EGLE Action: Followed up with the facility to confirm that repairs and replacement of the cracked section of force main were completed to restore service and that any residuals from the event were adequately addressed.

Harbor Springs Area Sewage

Submission ID. HPE-BMV4-QF9WZ

Start Day	Start Time	End Day	End Time
12/29/2021	11:30:00 AM	12/29/2021	12:30 PM

Waterbody: Pennsylvania Ave Ditch

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

Cause: Air Release Valve Malfunction. Small amount of wastewater ran across impervious ground to storm catch basin

Location: Air Release Chamber

EGLE Action: Confirmed with facility that air relief valve has been isolated from force main and has been entered into maintenance schedule for repair.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Totals	Harbor Springs Area Sewage
--------	----------------------------

Raw Sewage (MG)	Partially Treated (MG)	Dilute Raw Sewage (MG)
0.01510		

County Totals	Emmet
---------------	-------

Raw Sewage (MG)	Partially Treated (MG)	Dilute Raw Sewage (MG)
0.01510		

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Genesee

Flint Charter Township CM

Flint Charter Township CM

Submission ID. HPD-X14Q-8WEQX

Start Day	Start Time	End Day	End Time
12/11/2021	3:30:00 PM	12/11/2021	4:45 PM

Waterbody: Swartz Creek

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00300

Cause: Electrical supply failure by Consumers Energy; 2-seperate power sources both failed during a violent wind storm event.

Location: 3321 Miller Road, Flint, MI

EGLE Action: reviewed circumstances of discharge. No further action taken at this time

Totals Flint Charter Township CM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00300

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 40 of 251

contact Dan Beauchamp for further information: beauchampd@michigan.gov

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Flint CM

Flint CM

Submission ID. HP7-GH7C-MVKGP

Start Day	Start Time	End Day	End Time
3/26/2021	1:26:00 PM	3/26/2021	1:26 PM

Rain(in.) = 3

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00010

Cause: Sanitary sewer plugged with grease.

Location: Intersection of Avenue A & Genesee Street

EGLE Action: Violation Notice sent to address discharge

Flint CM

Submission ID. HP7-GJM4-E6XBP

Start Day	Start Time	End Day	End Time
3/26/2021	2:44:00 PM	3/26/2021	3:14 PM

Rain(in.) = 3

Waterbody: Flint River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00090

Cause: Pipe surcharging due to storm event backing up sewage into newly constructed riser of the deep tunnel connection of the NW Pump Station Diversion Project.

Location: Flushing Road - Flint Township- across the Flint River from COF WPCF

EGLE Action: Violation Notice sent to address discharge

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Flint CM

Submission ID. HP7-N365-MDRP7

Start Day	Start Time	End Day	End Time
3/31/2021	5:20:00 PM	3/31/2021	5:21 PM

Rain(in.) = 0.03

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00002

Cause: Sanitary sewer plugged with roots & grease causing sewage to overflow onto the pavement from the manhole while cleaning the line.

EGLE Action: Violation Notice sent to address discharge

Flint CM

Submission ID. HP7-RYNJ-P7AD7

Start Day	Start Time	End Day	End Time
4/5/2021	5:00:00 PM	4/5/2021	5:10 PM

Rain(in.) = 0.35

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00010

Cause: Sanitary sewer plugged with grease and rags causing a backup.

EGLE Action: Violation Notice sent to address discharge

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Flint CM

Submission ID. HP7-SQ4A-TAB47

Start Day	Start Time	End Day	End Time
4/6/2021	4:38:00 PM	4/6/2021	6:30 PM

Waterbody: Carmen Creek

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00030

Cause: Sanitary Sewer Siphon blocked with grease & rags causing sewage to over flow out of sanitary manhole onto the ground next to Carman Creek.

EGLE Action: Violation Notice sent to address discharge

Flint CM

Submission ID. HP9-6H6Y-8W7E5

Start Day	Start Time	End Day	End Time
6/2/2021	2:30:00 PM	6/2/2021	3:30 PM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00010

Cause: Grease, Rags, and Wipes built up in the sanitary sewer.

EGLE Action: Violation notice issued to address discharge

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Flint CM

Submission ID. HP9-GQ7T-E26D5

Start Day	Start Time	End Day	End Time
6/15/2021	1:43:00 PM	6/15/2021	5:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00020

Cause: Grease build up in the sanitary sewer.
Location: Ballenger Park
EGLE Action: Violation notice issued to address discharge

Flint CM

Submission ID. HP9-XAE2-5D4X7

Start Day	Start Time	End Day	End Time
7/1/2021	11:30:00 PM	7/2/2021	12:30 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

Cause: Sanitary line blocked with grease at the intersection of Brookwood Avenue & Brookside Drive.
Location: Brookwood Ave. & Brookside Drive
EGLE Action: Violation notice issued to address discharge

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Flint CM

Submission ID. HPB-E4Z8-KP79C

Start Day	Start Time	End Day	End Time
9/1/2021	1:30:00 AM	9/1/2021	1:50 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)

0.00002

Cause: Sanitary sewer line was plugged with grease causing some sewage to spill onto the ground.

EGLE Action: Violation notice issued to address discharge

Flint CM

Submission ID. HPB-YN27-EADST

Start Day	Start Time	End Day	End Time
9/23/2021	7:00:00 AM	9/24/2021	7:00 AM

Rain(in.) = 1.61

Waterbody: Swartz Creek

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)

0.60000

Cause: Sanitary sewer system overloaded due to high wet weather flow from the past 3 days of rain.

Location: South of the intersection Fenton Road & Barlow Avenue in Flint

EGLE Action: Violation notice issued to address discharge

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Flint CM

Submission ID. HPB-YKKK-FTHW4

Start Day	Start Time	End Day	End Time
9/23/2021	8:30:00 AM	9/24/2021	7:00 PM

Waterbody: Flint River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
5.00000

Cause: This discharge was due to a failure of the connection of the North West Pump Station Diversion pipe to the deep tunnel interceptor. This caused raw sewage and rainwater to over flowed onto the ground and eventually flow down to the Flint River.

Location: Precast manhole near 4413 Flushing Road

EGLE Action: Violation notice issued to address discharge

Flint CM

Submission ID. HPB-ZJZJ-QP48P

Start Day	Start Time	End Day	End Time
9/24/2021	12:00:00 PM	9/25/2021	11:00 AM

Rain(in.) = 1.61

Waterbody: Swartz Creek

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.50000

Cause: Sanitary sewer system overloaded due to high wet weather flow from the past 3 days.

Location: 3rd Sanitary Manhole East of Parkside & Overhill Drive.

EGLE Action: Violation notice issued to address discharge

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Flint CM

Submission ID. HPC-CPBW-JNK9N

Start Day	Start Time	End Day	End Time
10/10/2021	1:00:00 PM	10/10/2021	1:10 PM

Rain(in.) = 0.01

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00030

Cause: Instrumentation failure at City of Flint Station #2

Location: Pavement around 5627 Fleming near City of Flint Pump Station #2

EGLE Action: Violation notice issued to address discharge

Flint CM

Submission ID. HPC-J76C-FJYZ6

Start Day	Start Time	End Day	End Time
10/17/2021	4:15:00 PM	10/17/2021	4:30 PM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00001

Cause: Sanitary sewer back up near 610 East Gracelawn Avenue in Flint and less than 10 gallons spilled onto the pavement while cleaning the sanitary sewer.

Location: Pavement by 610 East Gracelawn Avenue

EGLE Action: Violation notice issued to address discharge

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 47 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Flint CM

Submission ID. HPC-RKNP-905P6

Start Day	Start Time	End Day	End Time
10/25/2021	12:30:00 PM	10/25/2021	5:00 PM

Rain(in.) = 1.06
Waterbody: Flint River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00450

Cause: The discharge was due to an engineering design flaw of the bilco doors at the Northwest Pump Station Diversion Building that caused sewage to flow out of the bilco doors.

Location: Northwest Pump Station Diversion Building

EGLE Action: Violation notice issued to address discharge

Flint CM

Submission ID. HPD-K906-JMQYM

Start Day	Start Time	End Day	End Time
11/29/2021	8:41:00 AM	11/29/2021	8:50 AM

Rain(in.) = 0.21

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00002

Cause: Vactor truck rear tank accidentally opened, raw sewage & a small amount of raw sewage spilled out the back onto the pavement & into a storm catch basin.

Location: Intersection of Bennett Ave & Iowa Ave

EGLE Action: Violation notice issued to address discharge

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 48 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Totals Flint CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
6.10667

Flint WWTP

Flint WWTP

Submission ID. HP7-8FQP-KDWBA

Start Day	Start Time	End Day	End Time
3/12/2021	2:30:00 PM	3/15/2021	1:00 PM

Waterbody: Gilkey Creek

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

Cause: On Friday March 12, 2021, The COF WSC observed a clear intermediate upwelling coming out of the driveway flowing to a storm sewer at 1506 Brookside Drive. The upwelling had no odor and clear. The contact the COF WCs water crew to fix a possible water ma

EGLE Action: Violation Notice sent to address discharge

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Flint WWTP

Submission ID. HP9-WPNM-STE1A

Start Day	Start Time	End Day	End Time
7/1/2021	12:32:00 PM	7/1/2021	5:50 PM

Waterbody: Flint River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.05000

Cause: A major valve @ the Northwest pump station broke. Though most of the incoming wastewater to this pump station was sent to another pump station, some wastewater flowed directly to the Flint river from this pump station while the valve was being repaired.

Location: Northwest pump station

EGLE Action: Violation notice issued to address discharge

Flint WWTP

Submission ID. HPB-FXG5-X3PD1

Start Day	Start Time	End Day	End Time
9/4/2021	1:17:00 PM	9/4/2021	4:30 PM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00020

Cause: Raw sanitary sewage surcharged onto the ground due to the sanitary sewer line being plugged with grease.

Location: Wooded area just East of Parkside Dr. & Overhill Dr. intersection

EGLE Action: Violation notice issued to address discharge

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Totals Flint WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.05030

Goodrich CM

Goodrich CM

Submission ID. HPC-89FB-G358C

Start Day	Start Time	End Day	End Time
10/4/2021	11:00:00 PM	10/5/2021	4:00 AM

Rain(in.) = 2.07
Waterbody: Cartwright Drain

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.06800

Cause: Heavy intense rain moved through the area and sewer system levels were elevated. Wipes & rags were flushed into the station and became embedded into the pump volute. There was a mechanical failure of a couple of fatigued studs holding the motor top flange

Location: 7405 Dutch Road, Goodrich, MI

EGLE Action: reviewed circumstances of discharge. No further action taken at this time

Totals Goodrich CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.06800

County Totals Genesee

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
6.15997 **0.06800**

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Gladwin

Billings Twp WWTP

Billings Twp WWTP

Submission ID. HP7-MGRP-JSAKP

Start Day	Start Time	End Day	End Time
3/31/2021	6:00:00 AM	3/31/2021	11:30 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00500

Cause: Force main pipe broke at the side of a manhole in the parking lot at the Township Hall

Location: Township Hall Station #20

EGLE Action: Violation Notice issued. Request root cause analysis for forcemain failure and an inspection/maintenance schedule.

Totals Billings Twp WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00500

County Totals Gladwin

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00500

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Grand Traverse

Black Bear Farms WWTP

Black Bear Farms WWTP

Submission ID. HPA-6XTZ-JH46B

Start Day	Start Time	End Day	End Time
7/12/2021	10:00:00 PM	7/13/2021	12:00 PM

Rain(in.) = 0.5

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00250

Cause: A 2" grinder pump lead to a vacant lot broke. it was leaking under the road and finally made it to the surface.

EGLE Action: Discussed situation with operator that reported the SSO and asked for clarifications and additions to the SSO report including contacts with the LHD and Record Eagle.

Totals Black Bear Farms WWTP

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00250

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

East Bay Township CM

East Bay Township CM

Submission ID. HPA-H66Q-CK6S2

Start Day	Start Time	End Day	End Time
7/26/2021	6:00:00 PM	7/30/2021	6:00 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00020

Cause: Domestic sewage from a break in a force main; transmission force main from East Bay Township to Traverse City WWTP is showing evidence of a break.

Location: SE Corner of Parsons Road and Hastings Street, Traverse City, MI

EGLE Action: No further action taken at this time

Totals East Bay Township CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00020

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Green Lake Township - Bush Road Community Sewer System

Green Lake Township - Bush Road Community Sewer System

Submission ID. HPA-HBBX-R5P0S

Start Day	Start Time	End Day	End Time
3/14/2021	10:00:00 AM	3/15/2021	12:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00005

Cause: Effluent surfaced by riser of pump chamber. Coupling came apart at the riser. EGLE spoke with the design engineer that responded to the release and made sure that the issue was resolved, F&V, and EGLE determined that the engineer's estimate was that ver

EGLE Action: No further action taken at this time

Totals Green Lake Township - Bush Road Community Sewer System

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00005

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Traverse City CM

Traverse City CM

Submission ID. HP8-B60F-PXGV0

Start Day	Start Time	End Day	End Time
4/29/2021	8:30:00 AM	4/29/2021	10:00 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00005

Cause: Sewage was found seeping out from the manhole cover onto the surrounding grassy area. A large grease plug was found downstream at the next manhole.

Location: Manhole SSM-1619

EGLE Action: Documented event. Actions taken by system owner were appropriate

Traverse City CM

Submission ID. HPA-KFG8-BDVW9

Start Day	Start Time	End Day	End Time
7/24/2021	10:12:00 AM	7/24/2021	12:08 PM

Rain(in.) = 3.8

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00980

Cause: 3.7" rain event overloaded the system causing sewage to discharge from a manhole into an emergency containment basin. The 9800 gallons is pretty accurate based on the number of truck loads hauled to the plant.

Location: South siphon manhole

EGLE Action: Continue to work with the City and assist in any way in helping them with permanent solutions to prevent future events

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Traverse City CM

Submission ID. HPA-SN70-Y5FZ9

Start Day	Start Time	End Day	End Time
8/6/2021	7:10:00 PM	8/6/2021	9:05 PM

Rain(in.) = 0.0025

Waterbody: Boardman River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00005

Cause: The business at 135 E. Front St. has a broken sewer line. Their line was backed up and was coming out of their inspection manhole. A small amount came out of the manhole and went into the city catch basin. From the basin it went into the Boardman River.

EGLE Action: No further action taken at this time

Traverse City CM

Submission ID. HPD-2TNQ-PFRJ5

Start Day	Start Time	End Day	End Time
11/4/2021	11:00:00 AM	11/4/2021	11:00 AM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00005

Cause: Wastewater from the liftstation that came in contact with surrounding grassy area during the bypass pump breakdown process

Location: Front Street Liftstation

EGLE Action: Discussed SSO reporting with City, no further follow up needed from this event

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Traverse City CM

Submission ID. HPE-5GGZ-6YQRP

Start Day	Start Time	End Day	End Time
12/22/2021	1:00:00 PM	12/22/2021	4:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

Cause: Small diameter private sanitary sewer forcemain serving housing units behind 525 S Garfield Ave broke in City Right of Way. Intermittent flow due to pump station operation.

Location: 535 S Garfield Ave, Traverse City, MI 49686

EGLE Action: No additional action taken at this time.

Totals Traverse City CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.01000 **0.00005**

County Totals Grand Traverse

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.01270 **0.00005** **0.00005**

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Hillsdale

Hillsdale CM

Hillsdale CM

Submission ID. HP9-CYNY-QDK83

Start Day	Start Time	End Day	End Time
6/9/2021	12:00:00 PM	6/11/2021	8:30 AM

Waterbody: St. Joe River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.15000

Cause: Sewage out of the manhole in the swamp, mostly effluent from Bob Evans. Grease and rags caused the backup.

Location: Swamp

EGLE Action: A Violation Notice was issued to address the discharge

Totals Hillsdale CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.15000

County Totals Hillsdale

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.15000

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Houghton

Chassell Twp WWSL

Chassell Twp WWSL

Submission ID. HPB-6D0J-DT5QC

Start Day	Start Time	End Day	End Time
8/23/2021	10:00:00 AM	8/26/2021	12:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.11500

Cause: Failure of ductile iron forcemain pipe.

Location: NA

EGLE Action: Compliance Communication sent on 5/15/2018 for an SSO

Totals Chassell Twp WWSL

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.11500

County Totals Houghton

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.11500

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Huron

Bad Axe WWTP

Bad Axe WWTP

Submission ID. HP6-91NC-A2390

Start Day	Start Time	End Day	End Time
2/3/2021	1:10:00 PM	2/3/2021	2:10 PM

Waterbody: Bad Axe Drain

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00075

Cause: Sewage pushing out of manhole lid. Appears to have been caused by trash such as plastic beverage bottles.

Location: Bad Axe Drain

EGLE Action: No further action taken. Event was isolated and the facility s working to prevent further SOS events.

Totals Bad Axe WWTP

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00075

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

MDNR-Port Crescent SP WWSL

MDNR-Port Crescent SP WWSL

Submission ID. HPA-GBQS-F7Q6H

Start Day	Start Time	End Day	End Time
7/26/2021	1:00:00 PM	7/26/2021	1:30 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00005

Cause: Discharge from gravity sewer fed manhole cover. Event occurred after a severe storm event caused a power outage which and caused the lift station to reset. No alarms were triggered on lift station to notify staff.

Location: Port Crescent State Park

EGLE Action: No further action taken. Event was isolated and the facility is committed to preventing future SSO's.

Totals MDNR-Port Crescent SP WWSL

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00005

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Port Austin WWTP

Port Austin WWTP

Submission ID. HPC-1YRF-KPT6X

Start Day	Start Time	End Day	End Time
9/26/2021	5:00:00 PM	9/27/2021	9:30 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.01000

Cause: Main line leak
Location: Pointe Aux Barques Road
EGLE Action: Violation notice issued.

Totals Port Austin WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.01000

County Totals Huron

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.01080

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Ingham

East Lansing WRRF

East Lansing WRRF

Submission ID. HP9-S0T9-0JQ9F

Start Day	Start Time	End Day	End Time
6/26/2021	6:25:00 PM	6/27/2021	2:00 AM

Rain(in.) = 3.7

Waterbody: Red Cedar River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

5.90000

Cause: Sanitary sewer overflow to storm drain caused by heavy infiltration during rain event.

Location: 013 - Wilmarth

EGLE Action: Long-term Control Program complete; controls included both sewer separation and construction of a retention treatment basin (RTB) and tunnel.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 64 of 251

contact Dan Beauchamp for further information: beauchampd@michigan.gov

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

East Lansing WRRF

Submission ID. HPA-XEK3-KP507

Start Day	Start Time	End Day	End Time
8/12/2021	1:30:00 AM	8/12/2021	9:00 PM

Rain(in.) = 4.74

Waterbody: Red Cedar River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

5.85000

Cause: Sanitary sewer overflow to storm drain caused by heavy infiltration during large rain event.

EGLE Action: Long-term Control Program complete; controls included both sewer separation and construction of a retention treatment basin (RTB) and tunnel.

East Lansing WRRF

Submission ID. HPA-XP1Y-3M7FG

Start Day	Start Time	End Day	End Time
8/12/2021	1:40:00 AM	8/12/2021	6:54 AM

Rain(in.) = 4.74

Waterbody: Red Cedar River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.07480

Cause: High discharge flow from the pump station surcharged the sewer causing the first two manholes to discharge onto the street.

Location: 721 Woodingham Drive - Woodingham Pump Station

EGLE Action: reviewed circumstances of event. No further action taken at this time

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Totals East Lansing WRRF

Raw Sewage (MG)	Partially Treated (MG)	Dilute Raw Sewage (MG)
0.07480		11.75000

Lansing WWTP

Lansing WWTP

Submission ID. HP9-TCPK-JC4MQ

Start Day	Start Time	End Day	End Time	Rain(in.) = 5.18
6/26/2021	7:40:00 PM	6/26/2021	8:50 PM	Waterbody: Grand River

Raw Sewage (MG)	Partially Treated (MG)	Dilute Raw Sewage (MG)
		0.12600

Cause: Bypass pumping from a sanitary sewer manhole to a catch basin to alleviate residential basement flooding. Pump station not able to keep up. Conditions exacerbated by inflow and infiltration from excessive rainfall.

Location: Tecumseh River Road West of 2407 Tecumseh River Drive

EGLE Action: Long-term Control Program being implemented; an Administrative Consent Order (ACO) with integrated plan requirements to correct CSO and SSO discharges. The ACO requires that core CSO correction be completed by December 31, 2032. The remaining CSO correction will be completed under the adaptive management approach. Adaptive management will consider lessons learned during the previous phase; a recalibrated hydraulic model and Wet Weather Control Plan update in 2023; green infrastructure; and includes appropriate revisions to correction projects specified for subsequent phases.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Lansing WWTP

Submission ID. HP9-TCPK-JC4MQ

Start Day	Start Time	End Day	End Time	Rain(in.) = 5.18
6/26/2021	8:26:00 PM	6/26/2021	8:57 PM	Waterbody: Grand River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)

0.00900

Cause: Bypass pumping from a sanitary sewer manhole to a catch basin to alleviate residential basement flooding. Pump station not able to keep up. Conditions exacerbated by inflow and infiltration from excessive rainfall.

Location: 1734 Boynton Drive

EGLE Action: Long-term Control Program being implemented; an Administrative Consent Order (ACO) with integrated plan requirements to correct CSO and SSO discharges. The ACO requires that core CSO correction be completed by December 31, 2032. The remaining CSO correction will be completed under the adaptive management approach. Adaptive management will consider lessons learned during the previous phase; a recalibrated hydraulic model and Wet Weather Control Plan update in 2023; green infrastructure; and includes appropriate revisions to correction projects specified for subsequent phases.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 67 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Lansing WWTP

Submission ID. HP9-TCPK-JC4MQ

Start Day	Start Time	End Day	End Time	Rain(in.) = 5.18
6/26/2021	10:15:00 PM	6/27/2021	1:40 AM	Waterbody: Sycamore Creek

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)

0.18360

- Cause:** Bypass pumping from a sanitary sewer manhole to a catch basin to alleviate residential basement flooding. Pump station not able to keep up. Conditions exacerbated by inflow and infiltration from excessive rainfall.
- Location:** The intersection of Lowcroft Ave and W Mason St
- EGLE Action:** Long-term Control Program being implemented; an Administrative Consent Order (ACO) with integrated plan requirements to correct CSO and SSO discharges. The ACO requires that core CSO correction be completed by December 31, 2032. The remaining CSO correction will be completed under the adaptive management approach. Adaptive management will consider lessons learned during the previous phase; a recalibrated hydraulic model and Wet Weather Control Plan update in 2023; green infrastructure; and includes appropriate revisions to correction projects specified for subsequent phases.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 68 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Lansing WWTP

Submission ID. HP9-TCPK-JC4MQ

Start Day	Start Time	End Day	End Time	Rain(in.) = 5.18
6/26/2021	11:25:00 PM	6/27/2021	1:49 AM	Waterbody: Sycamore Creek

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)

0.12960

- Cause:** Bypass pumping from a sanitary sewer manhole to a catch basin to alleviate residential basement flooding. Pump station not able to keep up. Conditions exacerbated by inflow and infiltration from excessive rainfall.
- Location:** The intersection of Lowcroft Ave and Bel Air Lane
- EGLE Action:** Long-term Control Program being implemented; an Administrative Consent Order (ACO) with integrated plan requirements to correct CSO and SSO discharges. The ACO requires that core CSO correction be completed by December 31, 2032. The remaining CSO correction will be completed under the adaptive management approach. Adaptive management will consider lessons learned during the previous phase; a recalibrated hydraulic model and Wet Weather Control Plan update in 2023; green infrastructure; and includes appropriate revisions to correction projects specified for subsequent phases.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 69 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Lansing WWTP

Submission ID. HP9-TCPK-JC4MQ

Start Day	Start Time	End Day	End Time	Rain(in.) = 5.18
6/27/2021	12:15:00 AM	6/27/2021	1:45 AM	Waterbody: Sycamore Creek

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)

0.08100

- Cause:** Bypass pumping from a sanitary sewer manhole to a catch basin to alleviate residential basement flooding. Pump station not able to keep up. Conditions exacerbated by inflow and infiltration from excessive rainfall.
- Location:** West Cavanaugh Road Across From Everett High School
- EGLE Action:** Long-term Control Program being implemented; an Administrative Consent Order (ACO) with integrated plan requirements to correct CSO and SSO discharges. The ACO requires that core CSO correction be completed by December 31, 2032. The remaining CSO correction will be completed under the adaptive management approach. Adaptive management will consider lessons learned during the previous phase; a recalibrated hydraulic model and Wet Weather Control Plan update in 2023; green infrastructure; and includes appropriate revisions to correction projects specified for subsequent phases.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 70 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Lansing WWTP

Submission ID. HPA-XREH-287TM

Start Day	Start Time	End Day	End Time	Rain(in.) = 3.72
8/12/2021	3:39:00 AM	8/12/2021	3:49 AM	Waterbody: Grand River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)

0.81590

Cause: Diluted raw sewage. Due to heavy rainfall, the plant was overwhelmed, and sewage flowed out from the screens in the Screen Building.

Location: 8

EGLE Action: Long-term Control Program being implemented; an Administrative Consent Order (ACO) with integrated plan requirements to correct CSO and SSO discharges. The ACO requires that core CSO correction be completed by December 31, 2032. The remaining CSO correction will be completed under the adaptive management approach. Adaptive management will consider lessons learned during the previous phase; a recalibrated hydraulic model and Wet Weather Control Plan update in 2023; green infrastructure; and includes appropriate revisions to correction projects specified for subsequent phases.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 71 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Lansing WWTP

Submission ID. HPA-XREH-287TM

Start Day	Start Time	End Day	End Time	Rain(in.) = 3.72
8/12/2021	4:41:00 AM	8/12/2021	6:34 AM	Waterbody: Grand River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)

0.03220

- Cause:** Bypass pumping from a sanitary sewer manhole to a catch basin to alleviate residential basement flooding. Pump station not able to keep up. Conditions exacerbated by inflow and infiltration from excessive rainfall.
- Location:** 1734 Boynton Drive
- EGLE Action:** Long-term Control Program being implemented; an Administrative Consent Order (ACO) with integrated plan requirements to correct CSO and SSO discharges. The ACO requires that core CSO correction be completed by December 31, 2032. The remaining CSO correction will be completed under the adaptive management approach. Adaptive management will consider lessons learned during the previous phase; a recalibrated hydraulic model and Wet Weather Control Plan update in 2023; green infrastructure; and includes appropriate revisions to correction projects specified for subsequent phases.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 72 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Lansing WWTP

Submission ID. HPA-XREH-287TM

Start Day	Start Time	End Day	End Time	Rain(in.) = 3.72
8/12/2021	4:45:00 AM	8/12/2021	7:00 AM	Waterbody: Grand River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)

0.24300

- Cause:** Bypass pumping from a sanitary sewer manhole to a catch basin to alleviate residential basement flooding. Pump station not able to keep up. Conditions exacerbated by inflow and infiltration from excessive rainfall.
- Location:** Tecumseh River Road West of 2407 Tecumseh River Road
- EGLE Action:** Long-term Control Program being implemented; an Administrative Consent Order (ACO) with integrated plan requirements to correct CSO and SSO discharges. The ACO requires that core CSO correction be completed by December 31, 2032. The remaining CSO correction will be completed under the adaptive management approach. Adaptive management will consider lessons learned during the previous phase; a recalibrated hydraulic model and Wet Weather Control Plan update in 2023; green infrastructure; and includes appropriate revisions to correction projects specified for subsequent phases.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 73 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Lansing WWTP

Submission ID. HPB-0XZH-M9KNM

Start Day	Start Time	End Day	End Time	Rain(in.) = 3.72
8/12/2021	6:37:00 AM	8/12/2021	8:45 AM	Waterbody: Grand River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)

0.11340

Cause: Bypass pumping from a sanitary sewer manhole to a catch basin to alleviate residential flooding. Conditions exacerbated by inflow and infiltration from excessive rainfall.

Location: West St. Joseph Street, Just West of South Rosemary Street

EGLE Action: Long-term Control Program being implemented; an Administrative Consent Order (ACO) with integrated plan requirements to correct CSO and SSO discharges. The ACO requires that core CSO correction be completed by December 31, 2032. The remaining CSO correction will be completed under the adaptive management approach. Adaptive management will consider lessons learned during the previous phase; a recalibrated hydraulic model and Wet Weather Control Plan update in 2023; green infrastructure; and includes appropriate revisions to correction projects specified for subsequent phases.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 74 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Lansing WWTP

Submission ID. HPA-XREH-287TM

Start Day	Start Time	End Day	End Time	Rain(in.) = 3.72
8/12/2021	7:30:00 AM	8/12/2021	8:50 AM	Waterbody: Grand River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)

0.02280

- Cause:** Bypass pumping from a sanitary sewer manhole to a catch basin to alleviate residential basement flooding. Pump station not able to keep up. Conditions exacerbated by inflow and infiltration from excessive rainfall.
- Location:** 1734 Boynton Drive
- EGLE Action:** Long-term Control Program being implemented; an Administrative Consent Order (ACO) with integrated plan requirements to correct CSO and SSO discharges. The ACO requires that core CSO correction be completed by December 31, 2032. The remaining CSO correction will be completed under the adaptive management approach. Adaptive management will consider lessons learned during the previous phase; a recalibrated hydraulic model and Wet Weather Control Plan update in 2023; green infrastructure; and includes appropriate revisions to correction projects specified for subsequent phases.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 75 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Lansing WWTP

Submission ID. HPB-0XZH-M9KNM

Start Day	Start Time	End Day	End Time
8/12/2021	7:45:00 AM	8/12/2021	11:45 AM

Rain(in.) = 3.72

Waterbody: Sycamore Creek

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.21600

Cause: Bypass pumping from a sanitary sewer manhole to a catch basin to alleviate residential flooding. Conditions exacerbated by inflow and infiltration from excessive rainfall.

Location: The intersection of East Holmes Road and South Cedar Street

EGLE Action: Long-term Control Program being implemented; an Administrative Consent Order (ACO) with integrated plan requirements to correct CSO and SSO discharges. The ACO requires that core CSO correction be completed by December 31, 2032. The remaining CSO correction will be completed under the adaptive management approach. Adaptive management will consider lessons learned during the previous phase; a recalibrated hydraulic model and Wet Weather Control Plan update in 2023; green infrastructure; and includes appropriate revisions to correction projects specified for subsequent phases.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 76 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Lansing WWTP

Submission ID. HPA-XREH-287TM

Start Day	Start Time	End Day	End Time
8/12/2021	8:15:00 AM	8/13/2021	1:50 PM

Rain(in.) = 3.72

Waterbody: Red Cedar River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

11.10900

- Cause:** SSO was due to excess water in the system due to a heavy rainfall event. Discharge is from the Harton Street Equalization Basin. Flow into the basin passes through a swirl concentrator which returns heavier solids to the wet well. The basin also provides
- Location:** Harton Street Equalization Basin 007
- EGLE Action:** Long-term Control Program being implemented; an Administrative Consent Order (ACO) with integrated plan requirements to correct CSO and SSO discharges. The ACO requires that core CSO correction be completed by December 31, 2032. The remaining CSO correction will be completed under the adaptive management approach. Adaptive management will consider lessons learned during the previous phase; a recalibrated hydraulic model and Wet Weather Control Plan update in 2023; green infrastructure; and includes appropriate revisions to correction projects specified for subsequent phases.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 77 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Lansing WWTP

Submission ID. HPD-93FF-BHB76

Start Day	Start Time	End Day	End Time
11/16/2021	8:55:00 AM	11/20/2021	2:00 PM

Waterbody: Grand River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
7.77600

Cause: Combined drinking water and sewage. SSO was due to a surge in the sewer system caused by a water main break concealed from the ground surface (no sink hole). Discharge was not disinfected. Only the surface water was impacted.

Location: 24

EGLE Action: Long-term Control Program being implemented; an Administrative Consent Order (ACO) with integrated plan requirements to correct CSO and SSO discharges. The ACO requires that core CSO correction be completed by December 31, 2032. The remaining CSO correction will be completed under the adaptive management approach. Adaptive management will consider lessons learned during the previous phase; a recalibrated hydraulic model and Wet Weather Control Plan update in 2023; green infrastructure; and includes appropriate revisions to correction projects specified for subsequent phases.

Totals Lansing WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
20.85750

County Totals Ingham

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.07480 32.60750

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 78 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Ionia

Lakewood WW Auth CM

Lakewood WW Auth CM

Submission ID. HP7-YNMCM-D42D7

Start Day	Start Time	End Day	End Time
4/9/2021	11:40:00 AM	4/9/2021	2:00 PM

Waterbody: Tupper Creek

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.05600

Cause: The old 12' pipe failed. We are currently in the process of replacing it with a larger pipe.

Location: Broken 12' Forcemain by 2465 Huddle Road

EGLE Action: No further actions taken at this time.

Lakewood WW Auth CM

Submission ID. HP9-V2QG-7P7DD

Start Day	Start Time	End Day	End Time
6/26/2021	5:25:00 PM	6/26/2021	10:22 PM

Waterbody: Woodland Creek

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.05940

Cause: Due to Heavy Rainfall

Location: Lift Station 11- 5555 Woodland Road, Woodland MI. 48897

EGLE Action: None needed at this time. The LWA is currently undergoing collection improvement to address this capacity issue.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Lakewood WW Auth CM

Submission ID. HPB-32HB-4T6PC

Start Day	Start Time	End Day	End Time
8/17/2021	8:38:00 AM	8/17/2021	5:38 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.04425

Cause: The contractor installing our new 24" sewer line broke the cleanout off the active 12" forcemain. The pipe was quickly turned off at the valves to isolate and reduce the spill. The spill was contained to the construction hole.

Location: On Huddle Road - 75 yards east of the Tupper Creek Crossing

EGLE Action: No further actions taken at this time.

Totals Lakewood WW Auth CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.10025 **0.05940**

County Totals Ionia

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.10025 **0.05940**

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Jackson

Meijer Store 30

Meijer Store 30

Submission ID. HP7-KGPK-3T0R1

Start Day	Start Time	End Day	End Time
3/28/2021	7:00:00 PM	3/29/2021	2:30 PM

Waterbody: Hurd Marvin Drain

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00500

Cause: Sanitary sewer backup led to discharge from sanitary manhole that migrated to a storm sewer catch basin.

Location: Meijer storm sewer

EGLE Action: Violation Notice issued.

Totals Meijer Store 30

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00500

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Napoleon Township Cm

Napoleon Township Cm

Submission ID. HP8-066Z-1MPH9

Start Day	Start Time	End Day	End Time
3/25/2021	10:00:00 AM	3/25/2021	4:00 PM

Rain(in.) = 0.1

Waterbody: Big Olcott Lake

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00040

Cause: Discharge was up through a gravel road edge. Some of the discharge seeped into a storm sewer line to lead to the lake. The 11/2inch pressurized discharge line from the residents grinder can had cracked at the connection point to the 3inch main line causi

EGLE Action: Required cleanup and sewer repairs. No further action taken

Totals Napoleon Township Cm

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00040

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Rives Township CM

Rives Township CM

Submission ID. HPB-SA76-DE04E

Start Day	Start Time	End Day	End Time
9/16/2021	10:15:00 AM	9/20/2021	10:30 AM

Waterbody: Unnamed Marsh

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00056

Cause: 560 Gallons of Raw sewage spilled from clean out chamber on a 8" diameter forcemain impacting both land and water

Location: Rives Township 8" Diameter Force Main

EGLE Action: Violation Notice sent to address discharge

Totals Rives Township CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00056

County Totals Jackson

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00556 **0.00040**

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Kalamazoo

Gull Lake Sewer & Water Authority CM

Gull Lake Sewer & Water Authority CM

Submission ID. HP9-V3YD-E1YYV

Start Day	Start Time	End Day	End Time
6/26/2021	8:00:00 PM	6/27/2021	10:00 AM

Rain(in.) = 6

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.01200

Cause: Force Main failure due to H2S and corrosion. Only occurred when pumps were running between pump and haul from wet well.

EGLE Action: Event reviewed. Repairs made and event remediated.

Totals Gull Lake Sewer & Water Authority CM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.01200

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Kalamazoo CM

Kalamazoo CM

Submission ID. HP6-653T-H8WZD

Start Day	Start Time	End Day	End Time
1/31/2021	11:00:00 AM	1/31/2021	2:00 PM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00180

Cause: Tree roots caused a blockage in the sewer main forcing a sanitary sewer overflow.

Location: Manhole 34-015

EGLE Action: No Additional Action Taken at this Time

Kalamazoo CM

Submission ID. HP7-CJY2-NHZ6Q

Start Day	Start Time	End Day	End Time
3/21/2021	10:15:00 AM	3/21/2021	11:30 AM

Waterbody: Arcadia Creek

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00038

Cause: Grease & Rags plugged sewer line causing an overflow of sewer manhole KC 19 -139.

Location: 4410 Lilac Lane

EGLE Action: Event reviewed and appears to be remediated. No further action taken at this time.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Kalamazoo CM

Submission ID. HPA-N7SY-KJKCF

Start Day	Start Time	End Day	End Time
8/1/2021	3:05:00 PM	8/1/2021	4:00 PM

Waterbody: Spring Valley Lake

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00050

Cause: Rags within the sanitary sewer system created a blockage creating an overflow incident.

Location: KC 11150

EGLE Action: Event reviewed and appears to be remediated. No further action taken at this time.

Kalamazoo CM

Submission ID. HPB-9NSR-2SG2Y

Start Day	Start Time	End Day	End Time
8/27/2021	2:00:00 PM	8/27/2021	3:20 PM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00010

Cause: broken pipe

Location: KC-30-001

EGLE Action: Event reviewed. Actions taken appear to be adequate at this time.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Kalamazoo CM

Submission ID. HPB-JYB4-34SSD

Start Day	Start Time	End Day	End Time
9/8/2021	10:00:00 AM	9/8/2021	10:15 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00018

Cause: Loss of power to the lift station and a generator failed to start up due to a bad battery. Battery was replaced during investigation.

Location: 600 Block of Hay Mac-Parchment - Lift Station

EGLE Action: Event reviewed and appears to be remediated. No further action taken at this time.

Kalamazoo CM

Submission ID. HPB-RFZB-E952F

Start Day	Start Time	End Day	End Time
9/14/2021	10:00:00 AM	9/16/2021	1:30 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00004

Cause: Raw sewage being intermittently released from a broken sewer lateral due to construction activities.

Location: KC 15529

EGLE Action: Event reviewed and appears to be remediated. No further action taken at this time.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Kalamazoo CM

Submission ID. HPC-ZPMJ-F39DY

Start Day	Start Time	End Day	End Time
11/4/2021	9:30:00 AM	11/4/2021	10:30 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00005

Cause: Discharge was caused by tree roots in the sanitary sewer, which plugged the sewer, and caused overflow of manhole.

Location: Manhole KC28085

EGLE Action: Event reviewed and appears to be remediated. No further action taken at this time.

Kalamazoo CM

Submission ID. HPE-1MR4-JHTMZ

Start Day	Start Time	End Day	End Time
12/17/2021	12:09:00 PM	12/17/2021	2:08 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

Cause: Tree roots at immediate downstream pipe of manhole created a blockage creating an overflow incident.

Location: KC 33022

EGLE Action: Event reviewed and appears to be remediated. No further action taken at this time.

Totals Kalamazoo CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00314

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Portage CM

Portage CM

Submission ID. HPA-BMV5-HWREE

Start Day	Start Time	End Day	End Time
7/20/2021	10:00:00 AM	7/20/2021	10:30 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00003

Cause: The overflow occurred from a root mass blocking the pipe and filling up the manhole until it overflowed.

Location: 4503 West Milham Avenue Portag, MI

EGLE Action: Event reviewed and appears to be remediated. No further action taken at this time.

Portage CM

Submission ID. HPA-QE0Z-E20CJ

Start Day	Start Time	End Day	End Time
8/3/2021	3:15:00 PM	8/3/2021	3:45 PM

Waterbody: Private retention basin with no discharge (c

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

Cause: Grease blockage in the gravity sewer main resulted in a sewer back-up that released wastewater from the manhole cover lid.

Location: 545 Romence Road

EGLE Action: Event reviewed and appears to be remediated. No further action taken at this time.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Portage CM

Submission ID. HPB-7W5D-Y5NVQ

Start Day	Start Time	End Day	End Time
8/22/2021	9:30:00 PM	8/25/2021	3:00 PM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00150

Cause: A small hole in the bell of the 20" steel forcemain pipe.

Location: South Westnedge Avenue & Parkland Terrace

EGLE Action: Event reviewed and appears to be remediated. No further action taken at this time.

Portage CM

Submission ID. HPE-3TTQ-2PW36

Start Day	Start Time	End Day	End Time
12/18/2021	6:00:00 PM	12/18/2021	10:30 PM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00950

Cause: There was a root mass in the 8" gravity sewer leading to the pump station that resulted in the sewer back-up and overflowing (seeping) from the manhole cover nearest the pump station.

Location: Quaker Avenue Lift Station

EGLE Action: Event reviewed and appears to be remediated. No further action taken at this time.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Totals **Portage CM**

Raw Sewage (MG)	Partially Treated (MG)	Dilute Raw Sewage (MG)
0.00163		0.00950

County Totals **Kalamazoo**

Raw Sewage (MG)	Partially Treated (MG)	Dilute Raw Sewage (MG)
0.01677		0.00950

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Kent

Ada Township CM

Ada Township CM

Submission ID. HPE-BS4A-GR6MW

Start Day	Start Time	End Day	End Time
12/24/2021	8:00:00 AM	12/24/2021	5:00 PM

Rain(in.) = 2

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00010

Cause: Sewer Forced main under the North side of the roadway cracked and started to surface on the south side of the road.

Location: 5750 Hall Street Se

EGLE Action: No further action taken at this time

Totals Ada Township CM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00010

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 92 of 251

contact Dan Beauchamp for further information: beauchampd@michigan.gov

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Algoma Township CM

Algoma Township CM

Submission ID. HP7-D97R-4B9Y2

Start Day	Start Time	End Day	End Time
3/19/2021	10:00:00 AM	3/19/2021	12:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00005

Cause: This address is equipped with a grinder station. The 1 1/2" force main leaving the grinder station separated under ground about 80 feet from the can and around 20 feet before the main force main.

EGLE Action: Reviewed initial phone notification and final report of discharge. Entity corrective action was satisfactory.

Totals Algoma Township CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00005

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Alpine Meadows MHC

Alpine Meadows MHC

Submission ID. HP9-VXTJ-54M0W

Start Day	Start Time	End Day	End Time
6/29/2021	6:00:00 PM	6/30/2021	8:00 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

Cause: sewer line was backed up to tree roots, grease, and wipes. Sewage spilled out into the yards

EGLE Action: No further action at this time. Facility corrective action satisfactory.

Alpine Meadows MHC

Submission ID. HPA-7HSG-Y3RX3

Start Day	Start Time	End Day	End Time
7/10/2021	10:00:00 AM	7/12/2021	2:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

Cause: The lines were blocked due to grease build up in the pipes.

EGLE Action: Reviewed the entity's corrective action and planned preventative measure to investigate the collection system in the area via camera. Entity's follow up is satisfactory at this point.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Alpine Meadows MHC

Submission ID. HPD-FB33-EXFBQ

Start Day	Start Time	End Day	End Time
11/23/2021	1:00:00 PM	11/23/2021	1:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00002

Cause: Main sewer line was clogged due to heavy grease. plumbers jetted the line out 25ft to clear it

EGLE Action: No further action necessary at this time.

Alpine Meadows MHC

Submission ID. HPD-YCRS-HZ1FK

Start Day	Start Time	End Day	End Time
12/12/2021	2:30:00 PM	12/12/2021	5:40 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

Cause: main sewer line was clogged due to heavy grease,, feminine products, and wipes.

EGLE Action: No further EGLE action at this time.

Totals Alpine Meadows MHC

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00020 **0.00012**

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Alpine Township CM

Alpine Township CM

Submission ID. HP6-RSW7-MG7R9

Start Day	Start Time	End Day	End Time
2/23/2021	1:00:00 PM	2/23/2021	6:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.01200

Cause: A capped standpipe from a lift station force main broke. The standpipe is located off of the roadway. By looking at our metering system, it looks like the leak started after 1:00 pm on 2/23/2021. The SSO was reported to NKSA at 3:00 pm. NKSA staff shut th

Location: South of 3750 Fruit Ridge Ave NW

EGLE Action: Reviewed notification and discharge report. Facility reporting was timely and satisfactory. Follow up and corrective action was satisfactory.

Alpine Township CM

Submission ID. HP7-YHQ9-MWM6K

Start Day	Start Time	End Day	End Time
4/12/2021	6:00:00 PM	4/12/2021	6:30 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00100

Cause: Excessive grease built up in the wet well and caused the transducer not to read the water level in the wet well. The back-up alarm float was stuck on top of the floating grease and did not trigger the high water alarm.

EGLE Action: No further action taken at this time. Proposed corrective action is satisfactory.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Totals Alpine Township CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.01300

Byron Center Village MHC

Byron Center Village MHC

Submission ID. HP7-R7NZ-TYACX

Start Day	Start Time	End Day	End Time
4/3/2021	6:42:00 PM	4/3/2021	9:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

Cause: Sewer main at 8570 Troy and 3 nearby manholes backed up.

EGLE Action: Reviewed the report and discussed with the sewer system owner. No additional actions needed at this time. The sewer system owner has agreed to provide a follow up plan for increased maintenance/surveillance on the system.

Totals Byron Center Village MHC

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Caledonia Township CM-Kent Co

Caledonia Township CM-Kent Co

Submission ID. HPA-KJG7-9WWA4

Start Day	Start Time	End Day	End Time
7/30/2021	2:15:00 PM	7/30/2021	2:35 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00009

Cause: Excel Excavating was working on the site for the development of a new commercial facility. While excavating adjacent to a sewer manhole, they came in contact with the 10" HDPE force-main. The force-main was taken out of service in September of 2015. Once

EGLE Action: No further action necessary.

Totals Caledonia Township CM-Kent Co

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00009

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Grand Rapids CM

Grand Rapids CM

Submission ID. HP6-1ERZ-HCCWP

Start Day	Start Time	End Day	End Time
1/25/2021	1:47:00 PM	1/25/2021	2:10 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00001

Cause: Sewer line developed a blockage which backed up flow in the line enough for it to seep out of the pick hole in the cover of the manhole. About ten gallons were released. The CSAT was able to clean the manhole and jet the line to relieve the blockage and

Location: 16177

EGLE Action: None at this time

Grand Rapids CM

Submission ID. HP8-FZ9M-9E1EJ

Start Day	Start Time	End Day	End Time
5/5/2021	2:20:00 PM	5/5/2021	3:40 PM

Waterbody: Discharged directly to creek

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00050

Cause: Sanitary main broke

Location: 1731 Acacia Dr NW

EGLE Action: None needed at this time.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Grand Rapids CM

Submission ID. HP9-WQQ6-7S6M0

Start Day	Start Time	End Day	End Time
7/1/2021	10:09:00 AM	7/1/2021	11:07 AM

Waterbody: catch basin

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00100

Cause: Bypass pumping hose failed to contain sewage

EGLE Action: None needed at this time

Grand Rapids CM

Submission ID. HPA-1FKE-43H35

Start Day	Start Time	End Day	End Time
7/7/2021	1:20:00 PM	7/7/2021	3:05 PM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00000

Cause: Sanitary main was backed up due to debris.

Location: 3250 N. Evergreen Drive

EGLE Action: None needed at this time

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 100 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Grand Rapids CM

Submission ID. HPB-40SW-ZEHPC

Start Day	Start Time	End Day	End Time
8/20/2021	10:37:00 AM	8/20/2021	11:50 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00006

Cause: Obstruction in sewer. Jetted sanitary main and broke through blockage. Cleaned main. Removed 8" plug wedged in main (possibly left in by contractors at time of construction) at downstream side of Manhole 2628937. This was the cause of the SSO. Lime has

Location: 3924 Shaffer Ave SE

EGLE Action: None needed at this time

Grand Rapids CM

Submission ID. HPB-S700-VQ7SE

Start Day	Start Time	End Day	End Time
9/16/2021	8:33:00 AM	9/16/2021	8:53 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00060

Cause: During routine preventative maintenance of wetwell cleaning at this lift station, the debris body door on the vacor truck failed due to a loose solenoid. Upon the vacuum being shut off the door opened and spilled sewage into the street onto the asphalt.

Location: Bona Vista

EGLE Action: None needed at this time

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Grand Rapids CM

Submission ID. HPC-203A-R9C1Q

Start Day	Start Time	End Day	End Time
9/27/2021	2:40:00 PM	9/27/2021	3:05 PM

Waterbody: pond

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00010

Cause: Per SSO discharge report: Blockage of sewer main due to grease and rags caused 100 gallons of sewage to escape collection system and contaminate a dirt path and pond.

Location: Plaster Creek Trail

EGLE Action: None needed at this time

Grand Rapids CM

Submission ID. HPD-ATZB-1R1FX

Start Day	Start Time	End Day	End Time
11/18/2021	1:40:00 PM	11/18/2021	1:50 PM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00002

Cause: Discharge was caused by stick plugging the gravity sewer and causing a backup in the nearest manhole. The sewage seeped out the pick hole in the lid and made its way through the street to the closest storm drain. The CSAT responded and broke the main fr

Location: Sewer Basin Manhole

EGLE Action: None needed at this time

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 102 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Totals Grand Rapids CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00229

Grattan Township CM

Grattan Township CM

Submission ID. HPB-66EM-CRGVQ

Start Day	Start Time	End Day	End Time
8/12/2021	2:00:00 PM	8/12/2021	2:30 PM

Waterbody: Murray Lake

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00005

Cause: generator issue during 3 day power outage

Location: GV PS#5

EGLE Action: discharge report reviewed. No further action taken at this time

Totals Grattan Township CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00005

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Pinebrook Village MHC

Pinebrook Village MHC

Submission ID. HP7-42CS-RX87D

Start Day	Start Time	End Day	End Time
3/10/2021	10:00:00 AM	3/10/2021	4:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00003

Cause: Sewer line backed up due paper blockage.

EGLE Action: Reviewed Report of Discharge and Initial report to PEAS line. Facility's reporting was timely, initial response/cleanup appeared appropriate, and facility stated plans to send educational notices to residents as a preventative measure. No further EGLE action at this time.

Pinebrook Village MHC

Submission ID. HP7-7VE7-AJ8PF

Start Day	Start Time	End Day	End Time
3/14/2021	4:52:00 PM	3/14/2021	7:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00004

Cause: Roots and wipes at the riser.

EGLE Action: Reviewed the report and found facility follow up to be acceptable. No further action taken at this time

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Totals Pinebrook Village MHC

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00007

Riverview Estates MHC

Riverview Estates MHC

Submission ID. HP6-M7T7-CG4CB

Start Day	Start Time	End Day	End Time
2/11/2021	12:00:00 AM	2/11/2021	12:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.01000

Cause: Down to one pump from previous failures and pump clogged.

Location: Riverview MHC Subsurface Disposal Field

EGLE Action: addressed by Violation Notice

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Riverview Estates MHC

Submission ID. HP6-M7ZX-9R5JN

Start Day	Start Time	End Day	End Time
2/13/2021	12:00:00 AM	2/13/2021	12:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.01000

Cause: The pumps are not keeping up with flow. It appears that the problems lies in the drain field but is unknown at this time. We are waiting for approval from the owners to investigate further. They have hired a third party engineering firm to help troublesho

Location: Riverview MHC Subsurface Disposal Field

EGLE Action: Discussed ongoing issues with contractor and issued VN to owner

Riverview Estates MHC

Submission ID. HP6-RVSD-564MN

Start Day	Start Time	End Day	End Time
2/23/2021	12:00:00 AM	2/23/2021	10:00 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.01000

Cause: Rags had plugged off the selecting valves in the drain field. This caused the effluent chamber to overflow.

Location: Riverview MHC Subsurface Disposal Field

EGLE Action: discussed ongoing discharges and issued VN

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Totals Riverview Estates MHC

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.03000

Southwood Village MHC

Southwood Village MHC

Submission ID. HPE-66XG-H1CSB

Start Day	Start Time	End Day	End Time
12/23/2021	12:00:00 PM	12/23/2021	2:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00001

Cause: Resident had a plumbing issue, and needed to get the damaged plumbing repaired

EGLE Action: No further actions required at this time.

Totals Southwood Village MHC

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00001

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Wyoming CM

Wyoming CM

Submission ID. HPD-DWT1-DA3SK

Start Day	Start Time	End Day	End Time
11/21/2021	3:30:00 PM	11/21/2021	5:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00003

Location: Wilson Ave SW

EGLE Action: A 8" sanitary force main ruptured, causing sewage to bubble up to the surface of Wilson Avenue whenever the wet well pump turned on. Pump turns on every 30 minutes for 4 minute intervals. Estimated 3 cycles prior to discovery and remediation. A minor amount bubbled to surface and ran (2" stream) into the nearest catch basin.

Totals Wyoming CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00003

County Totals Kent

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.01586 0.03003 0.00020

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 108 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Lake

Yates Township CM

Yates Township CM

Submission ID. HPD-OHRD-6AKXD

Start Day	Start Time	End Day	End Time
11/2/2021	10:00:00 AM	11/2/2021	10:30 AM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00002

Location: Duvernay Apartments lift station

EGLE Action: A blown relay caused a breaker to trip resulting in loss of power to pumps and auto dialer.

Totals Yates Township CM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00002

County Totals

Lake

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00002

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 109 of 251

contact Dan Beauchamp for further information: beauchampd@michigan.gov

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Lapeer

Metamora WWSL

Metamora WWSL

Submission ID. HPA-QATD-VR7WA

Start Day	Start Time	End Day	End Time
8/3/2021	4:30:00 PM	8/3/2021	5:30 PM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00010

Cause: Sewage overflowed the manhole due to a grease / rag blockage down stream

Location: Man Hole #46.

EGLE Action: No further actions taken at this time

Totals

Metamora WWSL

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00010

County Totals

Lapeer

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00010

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 110 of 251

contact Dan Beauchamp for further information: beauchampd@michigan.gov

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Leelanau

Leland Township CM

Leland Township CM

Submission ID. HP7-8RY7-0W89Z

Start Day	Start Time	End Day	End Time
3/16/2021	9:15:00 AM	3/17/2021	11:00 AM

Rain(in.) = 3

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00010

Cause: We excavated the area and found that the discharge was seeping from the lid of an air release valve chamber. The lid was approximately 2 inches under the surface of the soil. The air release valve in the chamber is leaking when the pumps at the lift stati

EGLE Action: Follow up with Tom who filed the SSO Report and asked that they contact the LHD to make sure no wells were effected, This was done and no wells were within the minimum isolation distance for the force main. No further action taken at this time.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 111 of 251

contact Dan Beauchamp for further information: beauchampd@michigan.gov

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Leland Township CM

Submission ID. HP8-AC61-33RAW

Start Day	Start Time	End Day	End Time
4/28/2021	10:30:00 AM	4/28/2021	11:30 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)

0.00004

Cause: The discharge occurred when maintenance personnel from the property began working on digging up the curb box because it was a potential tripping hazard. As they were digging, the curb box standpipe was bumped or pried on causing the connection there to be

Location: In gravel walkway of the Cheese Shop at 205 River St.

EGLE Action: EGLE worked with the WWTP operator to make sure that all the important actions were taken and important details are included in the SSO report. No further action taken at this time

Totals Leland Township CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)

0.00004

0.00010

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 112 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Northport Pointe WWTP

Northport Pointe WWTP

Submission ID. HP9-T938-911HA

Start Day	Start Time	End Day	End Time
6/28/2021	10:00:00 AM	6/30/2021	11:15 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00050

Cause: A small amount of partially treated (septic tank effluent) wastewater from the collection system that services Northport Point. The leak was from a new curb stop connection that had a threaded connection that was not fully tightened at the time of constr

EGLE Action: If time permits, EGLE will determine if the incomplete installation was performed under a Part 41 permit and if so EGLE will contact the permittee and advise them that the permit may have been violated if FM was not pressure tested as suggested by the operator.

Totals Northport Pointe WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00050

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Northport/Leelanau Township Utilities Authority CM

Northport/Leelanau Township Utilities Authority CM

Submission ID. HP8-B4CT-YFSZS

Start Day	Start Time	End Day	End Time
4/28/2021	4:00:00 PM	4/29/2021	12:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00050

Cause: See attached letter in additional details.

Location: Public land

EGLE Action: No action is necessary given that the cause of this leak cannot be repeated as the leaking connection was removed and given that the WWTP operator and Northport did all the right things in their response to the leak.

Totals Northport/Leelanau Township Utilities Authority CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00050

County Totals Leelanau

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00050 0.00054 0.00010

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 114 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Lenawee

Adrian WWTP

Adrian WWTP

Submission ID. HPA-HRDF-8M8SG

Start Day	Start Time	End Day	End Time
7/24/2021	11:00:00 PM	7/25/2021	12:00 AM

Rain(in.) = 1.25

Waterbody: South Branch River Raisin

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.02000

Cause: discharge of diluted raw sewage due to equipment failure. Power outage, transfer switch failed at startup of generator.

Location: Broad St pump station

EGLE Action: Violation Notice sent to address discharge

Adrian WWTP

Submission ID. HPB-YHRC-RMB8C

Start Day	Start Time	End Day	End Time
9/23/2021	1:05:00 AM	9/23/2021	2:22 AM

Waterbody: South Branch River Raisin

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00077

Cause: heavy rain event

Location: E04WI011

EGLE Action: Violation Notice sent to address discharge

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Adrian WWTP

Submission ID. HPB-YHRC-RMB8C

Start Day	Start Time	End Day	End Time
9/23/2021	1:36:00 AM	9/23/2021	6:34 AM

Waterbody: South Branch River Raisin

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.03000

Cause: heavy rain event

Location: G03BI006

EGLE Action: Violation Notice sent to address discharge

Totals Adrian WWTP

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.05077

County Totals Lenawee

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.05077

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Livingston

Brighton Twp WWTP

Brighton Twp WWTP

Submission ID. HP5-SCWC-1AN8D

Start Day	Start Time	End Day	End Time
1/14/2021	11:00:00 AM	1/14/2021	3:30 PM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00010

Cause: At 2:00 PM on January 14, 2021, the WWTP received a call from personnel at the business located at 8281 Grand River in Brighton Michigan. They reported that the alarm and light on the grinder station was on and water was coming out of the duplex grinder s

Location: 8281 Grand River

EGLE Action: Issued VN-011470

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 117 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Brighton Twp WWTP

Submission ID. HP6-6PQ0-G9N4P

Start Day	Start Time	End Day	End Time
1/31/2021	8:00:00 AM	1/31/2021	10:00 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00050

Cause: At 8:20 AM, on January 31, 2021, we received a call on the Brighton Township emergency phone from a resident at 8400 block of Woodland Shore Drive in Brighton, Michigan. The resident reported that there was sewage gushing up in his driveway. We responded

EGLE Action: Issued CC-003137

Brighton Twp WWTP

Submission ID. HP7-3RVS-E8ZD6

Start Day	Start Time	End Day	End Time
3/2/2021	9:00:00 PM	3/3/2021	1:30 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00050

Cause: Wastewater was discharged from a cleanout at the Woodland Shore location. A piece of plastic pipe became lodged in the main sewer line at Vista View and Tim. Wastewater that backed up came out of the cleanout.

EGLE Action: reviewed circumstances of event. No further action taken at this time

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 118 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Totals Brighton Twp WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00110

Brighton Village MHP CM

Brighton Village MHP CM

Submission ID. HPD-QDCY-5D9RY

Start Day	Start Time	End Day	End Time
11/29/2021	3:00:00 PM	12/4/2021	10:00 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00070

Cause: sewage discharge to the surface area between the sites due to a clog in the sanitary lateral. The community manager failed to notify their supervisor or his assistant of the issue before leaving on vacation.

EGLE Action: The discharge event is currently under review by the department

Totals Brighton Village MHP CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00070

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Deerfield Township CM

Deerfield Township CM

Submission ID. HPB-BWDX-8T8SW

Start Day	Start Time	End Day	End Time
8/27/2021	8:53:00 PM	8/27/2021	9:30 PM

Rain(in.) = 2.06

Waterbody: Lobdell Lake

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00008

Cause: Heavy intense rain flushed wipes and rags into pump station wet well. Wipes and rags nested around and plugged wetwell level bubbler indicator. Pumps went air bound because the station failed to shut off with level indicator plugged.

Location: 6484 Bennett Lake Road, Linden, MI

EGLE Action: reviewed circumstances of discharge. No further action taken at this time

Totals Deerfield Township CM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00008

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Genoa Twp-Lake Edgewood WWTP

Genoa Twp-Lake Edgewood WWTP

Submission ID. HP8-5KMT-FTC3V

Start Day	Start Time	End Day	End Time
4/21/2021	4:27:00 PM	4/21/2021	8:30 PM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00025

Cause: Facility operator stated a broken line lead to discharge of raw sewage to ground.

Location: Residential Ditch

EGLE Action: No further action taken at this time

Totals Genoa Twp-Lake Edgewood WWTP

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00025

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Hamburg Township CM

Hamburg Township CM

Submission ID. HP6-M93E-YPFCC

Start Day	Start Time	End Day	End Time
2/17/2021	10:00:00 AM	2/17/2021	2:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00200

Cause: A bolt came loose from a valve in a manhole which caused the sewer line to leak. Less than 2000 gallons escaped.

EGLE Action: Violation Notice sent to address discharges

Hamburg Township CM

Submission ID. HP9-7D5S-N9MBJ

Start Day	Start Time	End Day	End Time
6/1/2021	7:00:00 PM	6/2/2021	1:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00001

Cause: Facility operator stated a valve failed in a manhole causing the leak.

Location: Manhole in Elmira St

EGLE Action: Violation Notice sent to address discharges

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Hamburg Township CM

Submission ID. HPA-V70M-7YHTR

Start Day	Start Time	End Day	End Time
8/4/2021	8:00:00 AM	8/4/2021	10:00 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00300

Cause: Facility stated: "Air Relief valve failed in manhole"

Location: Manhole on Rustic Dr.

EGLE Action: Violation Notice sent to address discharges

Hamburg Township CM

Submission ID. HPB-F33G-024BP

Start Day	Start Time	End Day	End Time
8/21/2021	12:00:00 PM	8/23/2021	12:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

Cause: Facility stated: "A failed check valve caused the sewer line to leak when the grinder pump cycled. A small amount of sewage may have gone into; a storm drain that goes to the lake but its not likely"

Location: Broken Check Valve

EGLE Action: Violation Notice sent to address discharges

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Hamburg Township CM

Submission ID. HPC-G2SG-8FK1H

Start Day	Start Time	End Day	End Time
9/29/2021	11:00:00 AM	9/30/2021	11:00 AM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00300

Cause: A failed check valve caused the sewage to leak out of a curb stop

EGLE Action: Violation Notice sent to address discharges

Hamburg Township CM

Submission ID. HPC-NE6X-4N3QT

Start Day	Start Time	End Day	End Time
10/15/2021	9:00:00 AM	10/15/2021	11:00 AM

Rain(in.) = 0.5

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00100

Cause: Failed check valve caused the sewage to leak out of a curb stop

EGLE Action: Violation Notice sent to address discharges

Totals Hamburg Township CM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00311

0.00600

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 124 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Howell CM

Howell CM

Submission ID. HP9-X9NP-XFTTE

Start Day	Start Time	End Day	End Time	Rain(in.) = 4.88
6/28/2021	6:15:00 PM	6/28/2021	9:40 PM	Waterbody: Marion Genoa Drain

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.02100

Cause: The Wastewater Treatment Plant recorded 3.88 inches of rain from Thursday through Sunday. The increase in flow at the plant maxed out our 900,000-gallon storage tank causing a Sanitary Sewer Overflow to occur on Pulford Street. The Plant recorded another

Location: Marion Genoa Drain

EGLE Action: No actions taken

Totals Howell CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.02100

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Howell WWTP

Howell WWTP

Submission ID. HPC-7Y2V-MW6Q4

Start Day	Start Time	End Day	End Time	Rain(in.) = 5.1
8/12/2021	2:00:00 AM	8/13/2021	7:45 AM	Waterbody: Marion Genoa Drain

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.50700

Cause: The Wastewater Treatment Plant recorded 5 inches of rain on Thursday morning. The increase in flow at the plant maxed out our 900,000-gallon storage tank causing a Sanitary Sewer Overflow to occur on Pulford Street. The discharge flowed over the street an

Location: Marion Genoa Drain

EGLE Action: No further action taken at this time

Totals Howell WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.50700

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Livingston County Drain Commission

Livingston County Drain Commission

Submission ID. HP9-7EQE-V06G3

Start Day	Start Time	End Day	End Time
6/2/2021	8:00:00 AM	6/2/2021	11:30 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00030

Cause: Discharge caused by pinhole in bottom of the sewer main.

EGLE Action: No further action taken

Livingston County Drain Commission

Submission ID. HPC-04NC-HJNY3

Start Day	Start Time	End Day	End Time
9/24/2021	10:00:00 AM	9/24/2021	12:30 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00020

Cause: Discharge occurred due to a leak on the valve assembly that resulted from a surge following a power outage.

EGLE Action: Reviewed circumstances of event. No further actions taken at this time.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 127 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Livingston County Drain Commission

Submission ID. HPD-FDK9-W3NJE

Start Day	Start Time	End Day	End Time
11/23/2021	3:30:00 PM	11/23/2021	5:30 PM

Waterbody: wetlands on east and west sides of US-23, s

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.04000

Cause: Discharge resulted from a forcemain cleanout pipe that disconnected from the sewer main. Tributary pump stations were shut down to prevent further sewage from pumping to the location. The LCDC vactor truck and septage haulers pumped out the sewage onsite

Location: Old US-23 and Faussett Rd, Tyrone Township

EGLE Action: EGLE has reviewed the report. No further actions taken at this time.

Totals Livingston County Drain Commission

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.04050

County Totals Livingston

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.04566 0.00600 0.52808

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 128 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Mackinac

Clark Twp WWSL

Clark Twp WWSL

Submission ID. HP6-N1ZQ-3V64E

Start Day	Start Time	End Day	End Time
2/19/2021	12:00:00 AM	2/19/2021	9:00 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00120

Cause: morning of 2/19/21 Lift station pump # 1 motor failed. Pump #2 quit running because of an over heat condition. phone dialer failed to call out. Water filled up the wet well and was flowing out of the man hole of the wet well. Local resident called to let

Location: lift station # 4

EGLE Action: Follow up with facility operator regarding maintenance practices at lift stations.

Totals Clark Twp WWSL

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00120

County Totals Mackinac

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00120

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Macomb

Center Line CM

Center Line CM

Submission ID. HPA-XR3S-GEQ3W

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.9
8/12/2021	6:43:00 AM	8/12/2021	10:51 AM	Waterbody: Lorraine Drain

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
2.38058

Cause: The City of Center Line DPW was notified via SCADA alarm of a high wet well level at the Stephens Sanitary Pump Station which is the outlet for the City's entire sanitary sewer collection system. The high wet well level was in response to a large rain ev

Location: Stephens Drain

EGLE Action: Under Third Amended Administrative Consent Order No. ACO-05493, the city is scheduled to analyze their sewerage system and upgrade it as necessary to comply with the SSO Policy. Under paragraph 3.13 of this ACO, completion of construction is scheduled for March 31, 2028.

Totals Center Line CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
2.38058

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

New Haven CM

New Haven CM

Submission ID. HP7-3ZQK-2Z8FR

Start Day	Start Time	End Day	End Time
3/2/2021	1:00:00 PM	3/4/2021	3:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

Cause: BLOCKAGE IN SEWER LINE. OVERFLOW OF MANHOLE

EGLE Action: Sent a Violation Notice

Totals New Haven CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Warren WWTP

Warren WWTP

Submission ID. HPA-AXA0-47QVZ

Start Day	Start Time	End Day	End Time
7/16/2021	2:30:00 PM	7/16/2021	10:00 PM

Rain(in.) = 2.21

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

2.30000

Cause: New Pipe joint separated under pressure from rain storm.

Location: New Detention Basin

EGLE Action: No further action at this time. City took actions to prevent re-occurrence.

Warren WWTP

Submission ID. HPA-XXHH-89B0G

Start Day	Start Time	End Day	End Time
8/12/2021	7:00:00 AM	8/12/2021	12:00 PM

Rain(in.) = 2.42

Waterbody: schoenner drain

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.12000

Cause: Still investigating. Surge in sewer line. Possible blockage in East trunk. Plan on cleaning sewer line.

Location: 9 mile

EGLE Action: The NPDES permit contains schedule to eliminate blending at the WWTP and collection system SSOs

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 132 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Totals **Warren WWTP**

Raw Sewage (MG)	Partially Treated (MG)	Dilute Raw Sewage (MG)
		2.42000

County Totals **Macomb**

Raw Sewage (MG)	Partially Treated (MG)	Dilute Raw Sewage (MG)
0.00010		4.80058

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Manistee

Manistee CM

Manistee CM

Submission ID. HPA-7QHG-M5422

Start Day	Start Time	End Day	End Time	Rain(in.) = 3.37
7/15/2021	2:00:00 AM	7/15/2021	9:30 AM	Waterbody: Manistee Lake

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.84100

Cause: Hydraulic overload of collection system.

Location: 18

EGLE Action: EGLE is working with City to implement storage/treatment of wet weather flows

Manistee CM

Submission ID. HPA-AW3S-TM23C

Start Day	Start Time	End Day	End Time	Rain(in.) = 3.37
7/15/2021	9:30:00 AM	7/15/2021	10:45 AM	Waterbody: Manistee Lake

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.06750

Cause: Main 36" interceptor that feeds the wastewater treatment plant was undermined on the construction site due to high rains. 36" pipe was exposed and fear was that of losing the pipe to cave-in. Emergency by-pass pumping was set up one block west of the da

Location: Storm sewer intersection of 8th Street and High Street, City of Manistee

EGLE Action: EGLE is working with City to implement storage/treatment of wet weather flows

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Manistee CM

Submission ID. HPB-AANZ-APAEA

Start Day	Start Time	End Day	End Time
8/28/2021	1:20:00 AM	8/28/2021	7:30 PM

Rain(in.) = 2.4

Waterbody: Manistee Lake

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

1.15300

Cause: Hydraulic overload of collection system.

Location: 18

EGLE Action: Plant is constructing wet weather holding tanks to handle hydraulic overloads.

Manistee CM

Submission ID. HPB-AY8Z-GA1TQ

Start Day	Start Time	End Day	End Time
8/29/2021	3:20:00 AM	8/29/2021	11:30 PM

Rain(in.) = 1.1

Waterbody: Manistee Lake

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

1.04000

Cause: Hydraulic overload of collection system.

Location: 18

EGLE Action: Plant is constructing wet weather holding tanks to handle hydraulic overloads.

Totals Manistee CM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

3.10150

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 135 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Manistee Township CM

Manistee Township CM

Submission ID. HPE-EZQC-PGG0J

Start Day	Start Time	End Day	End Time
12/31/2021	11:18:00 AM	12/31/2021	12:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00600

Cause: Force Main Sewer Break at Fusion Coupling 2 areas where sewage surfaced. This point is where the breakage occurred, other area it is our estimation sewage traveled along the pipe and came out 50 south and west along Chippewa Hwy from the fusion coupling b

Location: ROW

EGLE Action: Reviewed SSO event with operator. No further actions taken at this time.

Totals Manistee Township CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00600

County Totals Manistee

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
3.10750

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Marquette

Chocolay Township CM

Chocolay Township CM

Submission ID.

HPD-0K8M-
KNM6H

Start Day	Start Time	End Day	End Time
11/5/2021	3:30:00 PM	11/5/2021	3:31 PM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00002

Cause: The discharge by-pass pipe leaked during the new construction of our Lift Station 5.

Location: Lift Station 5

EGLE Action: Contractor Bypass piping leak was repaired to stop leak.

Totals Chocolay Township CM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00002

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

KI Sawyer WWTP-Marquette Co

KI Sawyer WWTP-Marquette Co

Submission ID. HP6-YDP4-VW1AN

Start Day	Start Time	End Day	End Time
3/2/2021	5:00:00 PM	3/3/2021	12:00 PM

Rain(in.) = 0

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.04000

Cause: Flushable and or non flushable wipes built up on suspected tree roots in sewer main caused a sewer backup.

Location: Sanitary Sewer Overflow Northeast of Little Trout Lake

EGLE Action: Discussed incident with the WWTP / Collection System Superintendent. Investigative actions to be taken are deemed appropriate.

Totals KI Sawyer WWTP-Marquette Co

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.04000

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 138 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Marquette CM

Marquette CM

Submission ID. HP7-P1RM-W4B1E

Start Day	Start Time	End Day	End Time
4/2/2021	11:45:00 AM	4/2/2021	1:30 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00003

Cause: A sewer line became plugged with flushable wipes Sewage backed up out of a manhole in the backyard.

EGLE Action: Discussed flushable wipe PSA campaign with City staff.

Marquette CM

Submission ID. HP8-N8NR-95RCC

Start Day	Start Time	End Day	End Time
5/11/2021	3:52:00 PM	5/11/2021	4:50 PM

Waterbody: Whetstone Brook

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00020

Cause: A large amount of rags, grease, and some roots blocked the sewer allowing manhole #2018 to surcharge.

Location: Marquette Township sewer that passes through the City

EGLE Action: EGLE staff discussed increased frequency of root cutting / jetting this stretch of sewer with City staff. This preventative measure would address concerns for a repeat occurrence and reduces risk given the immediate proximity of sanitary sewer to Whetstone Brook.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Marquette CM

Submission ID. HPC-ZJ09-V09DK

Start Day	Start Time	End Day	End Time
11/3/2021	1:20:00 PM	11/3/2021	2:00 PM

Waterbody: Orianna Brook

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00005

Cause: Sewer Line was plugged with sand and sludge. This allowed 50 gallons to backup out of the manhole. Some of the sewage did get into the storm water collection system.

Location: Corner of Hampton and South Front.

EGLE Action: City to prioritize televising and relining/replacement of this run of sewer in 2022.

Totals Marquette CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00028

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 140 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Richmond Twp WWTP-Marquette Co

Richmond Twp WWTP-Marquette Co

Submission ID. HP6-2VEE-KC28H

Start Day	Start Time	End Day	End Time
1/26/2021	10:00:00 AM	1/26/2021	12:00 AM

Waterbody: Warner Creek

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

Cause: Forced main from the lift station to the lagoons was damaged with sheet pile due to culvert construction on CCI Mine property. The pumps for the lift station were turned off ensuring sewage would stop discharging.

Location: Warner creek

EGLE Action: See NPDES recon report 2021-01-27. Site inspection was performed to assure return to compliance and assess impact. A contractor on CCI property was replacing a culvert and was unaware of the force main location due to lack of record documents. Driven sheet pile longitudinally cracked the force main. The force main location was surveyed by CCI at the point of excavation for future knowledge. Sanitary sewage was "pump and haul" from the lift station until the force main was successfully repaired.

Totals Richmond Twp WWTP-Marquette Co

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

County Totals Marquette

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.04038 0.00002

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 141 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Midland

Dow Silicones Corporation-Midland Site

Dow Silicones Corporation-Midland Site

Submission ID. HPA-6XRQ-RAFMJ

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.25
7/13/2021	3:09:00 PM	7/13/2021	3:19 PM	

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00015

Cause: Process wastewater manhole MH-26-26 was overflowing from the lid into storm sewer catch basin CB-26-4. The flow stopped coming out of the lid on MH-26-26 around 3:19 pm. The overflow was a mix of wastewater and rain water. The estimated flow was around 5-

Location: Wastewater manhole MH-26-26 overflowed from the lid into a storm sewer catch basin CB-26-4

EGLE Action: Violation notice issued

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 142 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Dow Silicones Corporation-Midland Site

Submission ID. HPA-G82C-4KXM2

Start Day	Start Time	End Day	End Time
7/24/2021	6:20:00 PM	7/24/2021	6:44 PM

Rain(in.) = 1.25

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00010

Cause: Process wastewater was overflowing from wastewater sewer manhole at the south end of the 400 block. The overflow was a mix of suspected wastewater and rain water. Was discovered at 6:20 PM on 7/24/21. The co-mingled suspected wastewater/storm water ente

Location: Wastewater sewer manhole overflow at the south end of the 400 block

EGLE Action: Violation notice issued

Dow Silicones Corporation-Midland Site

Submission ID. HPB-DGZ1-EJ5R8

Start Day	Start Time	End Day	End Time
8/29/2021	4:00:00 AM	8/29/2021	6:45 AM

Rain(in.) = 1

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00175

Cause: Due to a rain event of 1 inch in less than 1 hour, storm water levels were elevated onsite. An unplanned site air outage also potentially impacted the scrubber operation and is being investigated for possible corrective actions. Process wastewater was o

Location: Wastewater sewer overflow near 325 building

EGLE Action: Violation Notice issued. Require follow up to progress on long term corrective measures to eliminate wet weather impact on wastewater management and provide a plan for completion.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 143 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Dow Silicones Corporation-Midland Site

Submission ID. HPD-57RN-7MMP5

Start Day	Start Time	End Day	End Time
11/10/2021	2:00:00 PM	11/10/2021	4:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)

0.00001

Cause: During fire truck flow testing at 800 block a manhole down stream in the C street sewer system overflowed on Dow Property to gravel and storm drain. The overflowed wastewater entered the onsite storm sewer, but was diverted before the inlet to the 4705 s

Location: Wastewater sewer overflow on C road near 800 block

EGLE Action: No further action taken. Event was isolated and contained and the facility is committed to preventing future events.

Totals Dow Silicones Corporation-Midland Site

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)

0.00201

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 144 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Midland WWTP

Midland WWTP

Submission ID. HP8-T06Q-GBWVQ

Start Day	Start Time	End Day	End Time
5/17/2021	10:30:00 AM	5/17/2021	3:00 PM

Waterbody: Snake Creek

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00100

Cause: City Sanitary line was flowing slowly (partial plug), a pressurized discharge from a neighboring building caused the line to surcharge and come out of the manhole and flow onto the street.

Location: Snake Creek

EGLE Action: VN to be issued

Midland WWTP

Submission ID. HPC-YQTW-PW4EW

Start Day	Start Time	End Day	End Time
11/1/2021	11:00:00 AM	11/1/2021	1:00 PM

Waterbody: Tittabawasee River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00240

Cause: 2 small perforation leaks in a raw sewage forcemain

Location: Tittabawasee River

EGLE Action: Violation notice issued.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Totals Midland WWTP

Raw Sewage (MG)	Partially Treated (MG)	Dilute Raw Sewage (MG)
0.00340		

County Totals Midland

Raw Sewage (MG)	Partially Treated (MG)	Dilute Raw Sewage (MG)
0.00340		0.00201

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Missaukee

Ebels Family Center

Ebels Family Center

Submission ID. HP7-02QN-CRT5C

Start Day	Start Time	End Day	End Time
3/5/2021	5:15:00 AM	3/5/2021	5:45 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

Cause: One of our pump stations check valves failed, pump #1. This resulted in pump #2 recirculating back through pump #1. Discharge consisted primarily of wash water mixed with animal blood as the animal harvest room was being cleaned at the time.

Location: Storm water basin

EGLE Action: No further action taken at this time

Totals Ebels Family Center

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

County Totals Missaukee

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 147 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Monroe

DECO-Fermi-2 Plt

DECO-Fermi-2 Plt

Submission ID. HP7-MFYW-HGYTG

Start Day	Start Time	End Day	End Time
3/30/2021	10:58:00 AM	3/30/2021	11:00 AM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00015

Cause: During routine pump down activities from the site's equalization basin to a sanitary system manhole there was a backflow from the sanitary system to the environment (nearby grassy area). The overflow, which was approximately 150 gallons, was reportable to

Location: Fermi 2 Power Plant

EGLE Action: Reviewed and closed report. No further action at this time.

Totals DECO-Fermi-2 Plt

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00015

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 148 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Monroe Metro WWTP

Monroe Metro WWTP

Submission ID. HPA-JPNP-VARX3

Start Day	Start Time	End Day	End Time
7/25/2021	1:00:00 PM	7/25/2021	7:15 PM

Rain(in.) = 2.58

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.05000

Cause: Heavy rain (~2.5" in less than 1 hour) impacted the service area causing the station to reach pumping capacity. The collection system upstream of the station was surcharged and diluted raw sewage pushed up around the manhole cover

Location: Sunset Blvd

EGLE Action: E. coli testing and caution tape requested. No further action taken at this time

Totals Monroe Metro WWTP

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.05000

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Rockwood WWTP

Rockwood WWTP

Submission ID. HP9-NEAB-NBZ4X

Start Day	Start Time	End Day	End Time
6/21/2021	4:30:00 AM	6/21/2021	1:00 PM

Rain(in.) = 3.46

Waterbody: Huron River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.73920

Cause: Diluted raw sewage was chlorinated. The reason for the discharge was to prevent basement backups and property damage within the City.

Location: EQ Tank Overflow

EGLE Action: The City of Rockwood submitted a Part 41 permit application to increase the volume of their equalization basin. This is under review by EGLE.

Totals Rockwood WWTP

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.73920

County Totals Monroe

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.78935

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Muskegon

Muskegon Co WWMS Metro WWTP

Muskegon Co WWMS Metro WWTP

Submission ID. HP6-SSH9-XJDE5

Start Day	Start Time	End Day	End Time	Rain(in.) = 1
2/20/2021	8:30:00 AM	2/20/2021	3:08 PM	

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00320

Cause: Raw sewage leaked from an air-vac valve that had malfunctioned and came up from a manhole. The manhole was on the White Lake Pathway trail.

Location: White Lake Pathway (trail) at approximately 43.40915221110049, -86.34947300934107, in Whitehall, MI

EGLE Action: No further action required.

Muskegon Co WWMS Metro WWTP

Submission ID. HPC-K87J-TD7DV

Start Day	Start Time	End Day	End Time
7/12/2021	12:00:00 AM	10/12/2021	4:05 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00030

Cause: Sewage leaked from a broken air-vac valve in a residential lot in the City of Muskegon.

EGLE Action: Noted report and acknowledged future prevented maintenance. No further action taken

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 151 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Totals Muskegon Co WWMS Metro WWTP

Raw Sewage (MG)	Partially Treated (MG)	Dilute Raw Sewage (MG)
0.00350		

County Totals Muskegon

Raw Sewage (MG)	Partially Treated (MG)	Dilute Raw Sewage (MG)
0.00350		

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Newaygo

Hesperia WWTP

Hesperia WWTP

Submission ID. HP9-0D32-7XK57

Start Day	Start Time	End Day	End Time
5/24/2021	7:00:00 AM	5/24/2021	7:30 AM

Rain(in.) = 0.01

Waterbody: White River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00025

Cause: Lift station failure caused manhole to backup at 160 W. Michigan Avenue. the manhole is recessed and between the lift station and the roadway. there is a storm drain located on the far side of the road. Although there was no evidence that the discharge h

Location: 160 W. Michigan Ave Hesperia Michigan

EGLE Action: No further action taken at this time

Totals Hesperia WWTP

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00025

County Totals Newaygo

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00025

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Oakland

Belle-Ann Falls

Belle-Ann Falls

Submission ID. HPA-YJ00-2BWJG

Start Day	Start Time	End Day	End Time
8/13/2021	9:45:00 AM	8/13/2021	1:15 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

Cause: The lift station that collects sanitary flow from six homes pumps the flow to a disposal bed. The pumps were without power due to a power loss most likely caused by the storm on August 11, 2021. We received a call at 9:45 am on August 13, 2021 that flow

Location: Kearsley Creek

EGLE Action: Violation Notice Sent

Totals Belle-Ann Falls

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 154 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Bloomfield Township CM

Bloomfield Township CM

Submission ID. HP5-KA1S-AW39Z

Start Day	Start Time	End Day	End Time
1/7/2021	8:00:00 AM	1/7/2021	10:00 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00050

Cause: Unaffiliated contractor was boring communication lines and bored through sewer in multiple areas. Sewage was discharged to the adjacent land surface. No solids present.

EGLE Action: sewer repairs were completed 01/09/2021

Totals Bloomfield Township CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00050

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

City of Troy

City of Troy

Submission ID. HP9-T7RN-6M8P3

Start Day	Start Time	End Day	End Time
6/25/2021	8:15:00 PM	6/26/2021	2:00 PM

Rain(in.) = 4

Waterbody: Rouge River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.98010

Cause: Evergreen Farmington Sanitary System was surcharged and could accept any flow from the City of Troy sanitary sewer system

Location: Evergreen Farmington sanitary sewer district

EGLE Action: Event exceed remedial design standard

City of Troy

Submission ID. HPA-JNRV-Y9DGV

Start Day	Start Time	End Day	End Time
7/24/2021	10:15:00 PM	7/25/2021	12:15 AM

Rain(in.) = 3

Waterbody: Rouge River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.12000

Cause: Evergreen Farmington sewer was surcharged and provided no capacity to accept flow from the City of Troy

Location: Evergreen Farmington drainage district

EGLE Action: Community Under ACO to address SSO in the EFSDS

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Totals City of Troy

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
1.10010

Commerce Township CM

Commerce Township CM

Submission ID. HP6-RZC6-Z6PS6

Start Day	Start Time	End Day	End Time
2/24/2021	11:30:00 AM	2/24/2021	12:30 PM

Waterbody: Wetland tributary to Minnow Pond drain

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00005

Cause: Private grinder pump (lift station) was clogged with grease. Whenever pump turned on, overflow would occur. Structure # COT100-503

EGLE Action: Compliance action taken to address this SSO. Compliance communication sent on 14 APR 2021

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Commerce Township CM

Submission ID. HPA-8AZ8-AGSWB

Start Day	Start Time	End Day	End Time
7/15/2021	5:00:00 PM	7/16/2021	12:30 PM

Waterbody: Lower Straits Lake

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00005

Cause: The discharge is weeping through the pavement on the east curb of Union Lake Rd south of Bywater. A 2 inch grinder pump line appears to be broken. The discharge appears to be < 5 gallons an hour with intermittent grinder pump use (which nearby resident h

Location: Grinder pump force main

EGLE Action: No further action.

Commerce Township CM

Submission ID. HPA-8AZ8-AGSWB

Start Day	Start Time	End Day	End Time
7/15/2021	5:00:00 PM	7/16/2021	12:30 PM

Waterbody: Middle Straits Lake

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00005

Cause: The discharge is weeping through the pavement on the east curb of Union Lake Rd south of Bywater. A 2 inch grinder pump line appears to be broken. The discharge appears to be < 5 gallons an hour with intermittent grinder pump use (which nearby resident h

Location: Grinder pump force main

EGLE Action: No further action.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Commerce Township CM

Submission ID. HPA-KJGR-58NX1

Start Day	Start Time	End Day	End Time
7/30/2021	1:45:00 PM	7/31/2021	10:15 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)

0.00123

Cause: There is a small stream of sewage running down the road and entering a nearby storm catch basin. Could be due to a leaking sanitary forcemain. Cause has yet to be confirmed.; Cause of SSO was confirmed as a leaking grinder pump.

Location: Sutton Lane

EGLE Action: No further action.

Totals Commerce Township CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)

0.00138

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 159 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Evergreen-Farmington CM (Oakland Co)

Evergreen-Farmington CM (Oakland Co)

Submission ID. HP9-RQ8Q-T7N5Z

Start Day	Start Time	End Day	End Time
6/25/2021	6:30:00 PM	6/25/2021	6:45 PM

Rain(in.) = 3.82

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00500

Cause: This SSO was caused by heavy rain. The SSO was discharged through a manhole then onto the surrounding grassy area.

Location: Manhole in Linden Park in Birmingham

EGLE Action: Event Exceeded Remedial Standard

Evergreen-Farmington CM (Oakland Co)

Submission ID. HP9-RPY5-EZYB5

Start Day	Start Time	End Day	End Time
6/25/2021	8:10:00 PM	6/26/2021	4:50 PM

Rain(in.) = 4.39

Waterbody: Upper Rouge River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

22.75000

Cause: The SSO was caused by heavy rain. Sewage flowed out of the EF Eight Mile Overflow Chamber and into the Eight Mile Drain then into a stream tributary to the Upper Rouge River.

Location: EF Eight Mile Overflow Chamber

EGLE Action: Event Exceeded Remedial design standard

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 160 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Evergreen-Farmington CM (Oakland Co)

Submission ID. HP9-RMQG-7REQY

Start Day	Start Time	End Day	End Time	Rain(in.) = 3.82
6/25/2021	8:12:00 PM	6/26/2021	11:18 PM	Waterbody: Upper Rouge River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.02042

Cause: The discharge was due to heavy rain. The discharge overflowed from a manhole that appeared to have been paved over at the north side of the intersection of Lakeside Drive and Redding Road then into a stream tributary to the upper Rouge.

Location: Manhole at the Intersection of Lakeside Drive and Redding Road in Birmingham.

EGLE Action: Event exceeded design standrad

Evergreen-Farmington CM (Oakland Co)

Submission ID. HP9-RP4N-NB3AC

Start Day	Start Time	End Day	End Time	Rain(in.) = 4.39
6/25/2021	11:25:00 PM	6/26/2021	4:25 PM	Waterbody: Upper Rouge River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
3.36000

Cause: The discharge was the result of heavy rain. The diluted sewage flowed from a vent/manhole on the Middlebelt Tunnel then over land for a short distance then into a stream tributary to the Upper Rouge River.

Location: Middlebelt Tunnel

EGLE Action: Event Exceeded Remedial Standard

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Evergreen-Farmington CM (Oakland Co)

Submission ID. HP9-RQHE-FPQ48

Start Day	Start Time	End Day	End Time
6/26/2021	4:15:00 AM	6/26/2021	3:37 PM

Rain(in.) = 4.39
Waterbody: Upper Rouge River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
1.55677

Cause: Heavy Rains caused the safe wet well level at the Eight Mile Road Pump Station to be exceeded. In order to prevent upstream basement flooding,, WRC staff pumped flow from three manholes located upstream of the pump; station directly to the Rouge River.

Location: 8 Mile Road Pump Station Relief Manholes

EGLE Action: This event exceeded the remedial design standard

Evergreen-Farmington CM (Oakland Co)

Submission ID. HPA-8WD6-CVD1B

Start Day	Start Time	End Day	End Time
7/16/2021	1:30:00 PM	7/17/2021	12:10 AM

Rain(in.) = 1.82
Waterbody: Upper Rouge River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.80000

Cause: The discharge was diluted sanitary sewage from the 8 Mile Overflow Chamber flowing into the 8 Mile Drain west to the Rouge River. The discharge occurred due to heavy rain exceeding the capacity of the 8 Mile Lift Station located at 22430 Eight Mile Road

Location: 8 Mile Pump Station Overflow Chamber Outfall

EGLE Action: EFSDS Under ASO to address all SSOs in the District

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 162 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Evergreen-Farmington CM (Oakland Co)

Submission ID. HPA-FAJM-DSVW0

Start Day	Start Time	End Day	End Time
7/24/2021	7:35:00 PM	7/25/2021	10:40 AM

Rain(in.) = 1.96
Waterbody: Upper Rouge River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.46000

Cause: The SSO was caused by heavy rain. Sewage flowed out of the EF Eight Mile Overflow Chamber and into the Eight Mile Drain; then into a stream tributary to the Upper Rouge River.

Location: EF Eight Mile Overflow Chamber

EGLE Action: EFSDS Under ACO

Evergreen-Farmington CM (Oakland Co)

Submission ID. HPA-FAJM-DSVW0

Start Day	Start Time	End Day	End Time
7/24/2021	11:20:00 PM	7/25/2021	4:20 PM

Rain(in.) = 1.96
Waterbody: Upper Rouge River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.38000

Cause: The discharge was the result of heavy rain. The diluted sewage flowed from a vent/manhole on the Middlebelt Tunnel then over; land for a short distance then into a stream tributary to the Upper Rouge River.

Location: Middlebelt Tunnel

EGLE Action: EFSDS is under an ACO

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Evergreen-Farmington CM (Oakland Co)

Submission ID. HPB-XZM6-TRV44

Start Day	Start Time	End Day	End Time	Rain(in.) = 4.5
9/22/2021	10:10:00 AM	9/22/2021	12:10 PM	Waterbody: Upper Rouge River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.04380

Cause: The SSO was caused by heavy rain. Sewage flowed out of the EF Eight Mile Overflow Chamber and into the Eight Mile Drain; then into a stream tributary to the Upper Rouge River.

Location: EF Eight Mile Overflow Chamber

EGLE Action: EFSDS under ACO to address this SSO

Evergreen-Farmington CM (Oakland Co)

Submission ID. HPB-YW4R-BZFGQ

Start Day	Start Time	End Day	End Time	Rain(in.) = 4.5
9/23/2021	3:25:00 AM	9/23/2021	10:40 AM	Waterbody: Upper Rouge River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
5.55000

Cause: The SSO was caused by heavy rain. Sewage flowed out of the EF Eight Mile Overflow Chamber and into the Eight Mile Drain; then into a stream tributary to the Upper Rouge River.

Location: EF Eight Mile Overflow Chamber

EGLE Action: EFSDS under ACO to address SSOs

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 164 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Evergreen-Farmington CM (Oakland Co)

Submission ID. HPB-YXQY-6D632

Start Day	Start Time	End Day	End Time
9/23/2021	6:25:00 AM	9/23/2021	8:20 AM

Rain(in.) = 4.5

Waterbody: Upper Rouge River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.58000

Cause: The discharge was the result of heavy rain. The diluted sewage flowed from a vent/manhole on the Middlebelt Tunnel then over; land for a short distance then into a stream tributary to the Upper Rouge River.

Location: Middlebelt Tunnel

EGLE Action: EFSDS Under ACO to address SSos

Evergreen-Farmington CM (Oakland Co)

Submission ID. HPB-YWGC-Y6G74

Start Day	Start Time	End Day	End Time
9/23/2021	8:00:00 AM	9/23/2021	6:10 PM

Rain(in.) = 4.5

Waterbody: Evans Branch Rouge River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

1.37000

Cause: The SSO was caused by heavy rain. There was evidence of sanitary trash near several manholes near 8 Mile and Bridge Street

Location: 8 Mile near bridge

EGLE Action: EFSDS is under an Administrative Consent Order to eliminate SSOs by 2023.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 165 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Evergreen-Farmington CM (Oakland Co)

Submission ID. HPC-RGCH-RTQDS

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.8
10/25/2021	1:30:00 PM	10/25/2021	7:55 PM	Waterbody: Middle River Rouge

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.04554

Cause: Eight Mile Lift Station had flows exceeding the pumping capacity. Flow data from the site indicates the SSO volume. SSO paused between 3:30 PM and resumed at 7:30 PM.

Location: Eight Mile Lift Station

EGLE Action: EFSDS under ACO to address SSOs

Totals Evergreen-Farmington CM (Oakland Co)

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.04554 **36.87600**

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 166 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Farmington CM

Farmington CM

Submission ID. HP9-V7DZ-DK1RH

Start Day	Start Time	End Day	End Time
6/26/2021	2:30:00 PM	6/26/2021	7:00 PM

Rain(in.) = 3.6

Waterbody: Upper Rouge River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.07300

Cause: Discharge was relatively clear in nature, odorless and no solids

Location: 32000 W. 9 Mile Road Farmington Environmental Quality Basin

EGLE Action: Event exceed Remedial Standard

Farmington CM

Submission ID. HPB-YPX2-6EZF4

Start Day	Start Time	End Day	End Time
9/22/2021	2:15:00 PM	9/24/2021	5:00 PM

Rain(in.) = 5.25

Waterbody: Upper Rouge River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

5.91500

Cause: 4.1 inches of rain began at 6:00 pm 9/21/21 thru 2:15 pm 9/22/21. Saturated soils causing footing drains to collect the excessive ground water.

Location: Farmington Retention Environmental Quality Basin

EGLE Action: Event exceed Remedial Standard

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 167 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Farmington CM

Submission ID. HPC-Y1V0-S04C3

Start Day	Start Time	End Day	End Time
10/30/2021	7:00:00 AM	10/31/2021	10:00 PM

Rain(in.) = 1

Waterbody: Upper Rouge River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

1.39100

Cause: Discharge was relatively clear in nature, odorless, and no solids. The 3 million gallon storage basin was more than 2/3 full when we received an additional 1 inch of rain. The ground is saturated not allowing rain to absorb, and residential footing drains

Location: 32000 W 9 Mile Road Farmington Environmental Quality Basin

EGLE Action: No further action taken at this time

Totals Farmington CM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

7.37900

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 168 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Franklin CM

Franklin CM

Submission ID. HPA-XRCK-8CJVN

Start Day	Start Time	End Day	End Time
8/12/2021	1:43:00 PM	8/12/2021	6:15 PM

Waterbody: unknown creek that runs mainly north/south

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00513

Cause: The cause of the discharge is due to a broken isolation valve on a 6" diameter forcemain. The discharge rate is 20 to 30 gallons per minute. A temporary patch was made at 4:40 pm on August 12, 2021 and the final repair was made by 6:15 pm. The area sur

Location: Road ditch along north side of 13 Mile Road

EGLE Action: Repair completed. No further action taken at this time

Totals Franklin CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00513

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

George W Kuhn Dr Dist CSO RTB

George W Kuhn Dr Dist CSO RTB

Submission ID. HP9-XDPD-TGENC

Start Day	Start Time	End Day	End Time
6/26/2021	2:00:00 PM	6/26/2021	3:50 PM

Rain(in.) = 2.29

Waterbody: Red Run Drain

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

1.00000

Cause: This SSO was caused by heavy rain. The Dequindre Road interceptor surcharged and backed up into the GWK CSO RTB via an overflow pipe, and the diluted sewage from the interceptor was discharged with the CSO from the RTB into the Red Run Drain.

Location: GWK CSO RTB Outfall to the Red Run Drain

EGLE Action: Violation Notice sent to address discharge

Totals George W Kuhn Dr Dist CSO RTB

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

1.00000

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Highland Hills of Highland

Highland Hills of Highland

Submission ID. HP7-37BA-9PMN7

Start Day	Start Time	End Day	End Time
3/8/2021	4:15:00 PM	3/8/2021	5:30 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00005

Cause: A sewer main had backed up from blockage in pipe. Levels came up in the mainline and overflowed a manhole.

EGLE Action: A VN was issued prior to this reported SSO which required the permittee to provide an update on how they will address future SSOs and ensure proper maintenance occurs to prevent SSOs.

Totals Highland Hills of Highland

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00005

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 171 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Lake Orion CM

Lake Orion CM

Submission ID. HP6-7396-ZNGD1

Start Day	Start Time	End Day	End Time
2/1/2021	7:30:00 PM	2/1/2021	8:00 PM

Waterbody: Paint Creek

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

Cause: Broken lead/cleanout near the street overflowed sewer on the ground. The overflow did spill into a catch basin with outflow to Paint Creek, E.Coli samples were taken. The overflow was caused by a clogged sewer pipe.

Location: 93 South Anderson

EGLE Action: a compliance communication letter CC-003171 was sent to address this SSO

Totals Lake Orion CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Novi CM

Novi CM

Submission ID. HP6-EVZ0-9H5BF

Start Day	Start Time	End Day	End Time
2/10/2021	2:00:00 AM	2/11/2021	7:00 AM

Waterbody: wetland

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.06000

Cause: Area piping has significant elevation changes that trap rags and grease within the pipe causing blockages. It is standard procedure to clean the pipe once every quarter and was last cleaned in December 2020. The SSO was due to blockages in the pipe between

Location: Pointe Park

EGLE Action: No further action taken at this time

Totals Novi CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.06000

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Orchard Lake Village CM

Orchard Lake Village CM

Submission ID. HP8-0856-CZN58

Start Day	Start Time	End Day	End Time
4/14/2021	4:00:00 PM	4/14/2021	6:30 PM

Waterbody: Orchard Lake

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

Cause: The discharge was the result of a plugged sewer. The SSO seeped from the manhole into a French drain of a private residence. The drain discharges into Orchard Lake. No evidence was found of a discharge into the lake but samples were taken as a precaution.

EGLE Action: Compliance Communication - CC-003261 was sent to address this SSO

Orchard Lake Village CM

Submission ID. HP9-TEV7-BFXXM

Start Day	Start Time	End Day	End Time
6/24/2021	3:30:00 PM	6/24/2021	5:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00007

Cause: A pipe fitting at a cleanout location failed. A corroded pipe nipple was leaking sewage at the connection. The sewage leaked from the clean out onto the paved road and shoulder.

Location: Orchard Lake Trail

EGLE Action: Repair completed. No further action taken at this time.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 174 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Totals Orchard Lake Village CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00017

Oxford Township CM

Oxford Township CM

Submission ID. HPA-39SA-W42BH

Start Day	Start Time	End Day	End Time
7/9/2021	4:38:00 PM	7/9/2021	6:48 PM

Waterbody: Lake Dewls

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00020

Cause: Blockage in downstream sewer sewage to head up and come out through top of manhole

EGLE Action: No further action taken at this time

Totals Oxford Township CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00020

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Pontiac CM

Pontiac CM

Submission ID. HP6-WYV2-WE460

Start Day	Start Time	End Day	End Time
3/1/2021	2:00:00 PM	3/1/2021	2:30 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00030

Cause: Sewage coming from undocumented manhole caused by a clog downstream sewer (grease and rags).

Location: Undocumented sanitary manhole between MH110 and MH114

EGLE Action: compliance communication sent to address discharges

Pontiac CM

Submission ID. HP6-XKA1-FWASM

Start Day	Start Time	End Day	End Time
3/1/2021	3:45:00 PM	3/1/2021	5:15 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00135

Cause: Sewage coming from MH 072-180 caused by plugged downstream sewer (grease and rags)

Location: MH 072-180

EGLE Action: compliance communication sent to address discharges

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Pontiac CM

Submission ID. HP7-ODDS-7BARY

Start Day	Start Time	End Day	End Time
3/5/2021	2:45:00 PM	3/5/2021	3:30 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00023

Cause: Discharge was from sump pump over flow. Combined sanitary sewer was plugged resulting in storm lead at 21 Elizabeth Lake Road to back-up.

EGLE Action: compliance communication sent to address discharges

Pontiac CM

Submission ID. HP7-OETD-3BZRJ

Start Day	Start Time	End Day	End Time
3/5/2021	4:15:00 PM	3/5/2021	5:15 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00012

Cause: Discharge was from flooded basement. Sanitary sewer was plugged (40') upstream of MH-119-137 resulting in sanitary lead at 153 153 Mohawk Road to back-up into residents basement

EGLE Action: CC was sent to address discharge

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Pontiac CM

Submission ID. HP7-2A4S-N5D6H

Start Day	Start Time	End Day	End Time
3/7/2021	1:15:00 PM	3/7/2021	3:15 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00060

Cause: Discharge was from flooded basement. Sanitary sewer was plugged (23') upstream of MH 119-136 resulting in sanitary lead at 127 Mohawk Road to back-up into residents basement

EGLE Action: compliance communication sent to address discharges

Pontiac CM

Submission ID. HP7-ZFFE-95QK6

Start Day	Start Time	End Day	End Time
4/14/2021	1:30:00 PM	4/14/2021	1:45 PM

Waterbody: Bartlett Drain

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

Cause: The discharge occurred because of a plugged sewer. Raw sewage flowed out of a sanitary manhole to a nearby catch basin. Samples were taken and submitted for analysis.

EGLE Action: No further action at this time.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 178 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Pontiac CM

Submission ID. HP8-CA6D-PVRZR

Start Day	Start Time	End Day	End Time
4/30/2021	9:00:00 PM	4/30/2021	11:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00020

Cause: A plugged sewer caused sewage to backup into the basement of 715 Emerson Ave., Pontiac, MI 48340 and the homeowner used a pump and hose to discharge sewage down their driveway which led to a storm inlet. The sewer was plugged with grease, the sewer was je

EGLE Action: No further action at this time. CC written.

Pontiac CM

Submission ID. HP9-ZPVB-EEFYP

Start Day	Start Time	End Day	End Time
7/4/2021	1:00:00 AM	7/4/2021	1:30 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00075

Cause: A plugged sanitary sewer caused a sewer backup to a home. The backup went to the sump pit and was discharged from the home to the front yard and entered a storm drain inlet located in front of the home.

EGLE Action: No further action.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 179 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Pontiac CM

Submission ID. HPA-WE7J-RDSN2

Start Day	Start Time	End Day	End Time
8/10/2021	5:20:00 PM	8/10/2021	6:00 PM

Waterbody: Clinton River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00004

Cause: Manhole POT 132121 was overflowing to the street surface. A resident called in the SSO at 5:20 pm. The event stopped at 6:00 pm. The resident informed our personnel that the manhole was leaking for a week. The cause for the discharge was due to a root

Location: Wilson Avenue and Martin Luther King Jr. Blvd

EGLE Action: no further action at this time. will be discussed at semi annual meeting on CM.

Pontiac CM

Submission ID. HPB-RGMW-XXXS4

Start Day	Start Time	End Day	End Time
9/15/2021	11:50:00 AM	9/15/2021	11:52 AM

Waterbody: Pontiac Clinton River #3

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00025

Cause: Contractor on site was cleaning sanitary sewer and vactor truck boiled over with sewage and spilled into nearby catch basin.

EGLE Action: compliance communication sent to address discharges

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Pontiac CM

Submission ID. HPC-DK1D-C664R

Start Day	Start Time	End Day	End Time
10/12/2021	10:30:00 AM	10/12/2021	10:40 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)

0.00015

Cause: A Contractor for WRC is cleaning sanitary sewers in the vicinity of Bagley and Orchard Lake Road, Pontiac, MI. The Vactor truck float malfunctioned which caused the truck to overfill and the Vactor spilled sewage into the roadway. The sewage flowed into a

Location: Bagley St

EGLE Action: compliance communication sent to address discharges

Pontiac CM

Submission ID. HPD-3QK7-Y1M3V

Start Day	Start Time	End Day	End Time
11/9/2021	11:55:00 AM	11/9/2021	12:40 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)

0.00020

Cause: The sewage flowed from Manhole POT072160 located on Sarasota Ave. onto the paved road. The discharge was caused by a plug in the sewer downstream of the discharge manhole, potentially a grease plug.

Location: Sarasota Avenue

EGLE Action: reviewed VN no further action

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 181 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Pontiac CM

Submission ID. HPD-SNYZ-0Z96V

Start Day	Start Time	End Day	End Time
12/7/2021	7:00:00 AM	12/7/2021	8:00 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00003

Cause: WRC staff noticed the sewer manhole overflowing while driving by at 7AM. They investigated and found the sewer to be plugged. The sewer was jetted and was flowing freely at 8AM. The sewage flowed down the curb of Featherstone Ave and into a catch basin. W

Location: POT 106 127

EGLE Action: compliance communication sent to address discharges

Totals Pontiac CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00394 **0.00038**

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 182 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Rochester University

Rochester University

Submission ID. HPC-AEB5-3CHEX

Start Day	Start Time	End Day	End Time
10/1/2021	9:00:00 AM	10/1/2021	6:00 PM

Waterbody: Clinton River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00000

Cause: Plugged Sewer

EGLE Action: No further action is taken

Totals Rochester University

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00000

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Springrove MHC

Springrove MHC

Submission ID. HPA-PN47-2AHNA

Start Day	Start Time	End Day	End Time
7/25/2021	3:00:00 AM	7/25/2021	6:00 AM

Rain(in.) = 2.5

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00050

Cause: Excessive storm water influent due to heavy rain event (2.5"/hr).

Location: Springrove EQ Influent Tank

EGLE Action: The permittee has submitted a plan to upgrade the WWTP which, once implemented, should significantly reduce the risk of future SSOs.

Totals Springrove MHC

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00050

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Staybridge Suites Auburn Hills

Staybridge Suites Auburn Hills

Submission ID. HPA-CEDK-A1YXS

Start Day	Start Time	End Day	End Time
7/19/2021	11:00:00 AM	7/19/2021	2:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00600

Cause: Clogged Sewer Lead

EGLE Action: no further action at this time

Totals Staybridge Suites Auburn Hills

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00600

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Sunrise Senior Living

Sunrise Senior Living

Submission ID. HPC-ZQY9-SQ2T7

Start Day	Start Time	End Day	End Time
11/1/2021	8:00:00 AM	12/1/2021	2:00 PM

Waterbody: Rouge River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00048

Cause: Clogged Sewer

EGLE Action: Facility back to compliance. No further action taken at this time

Totals Sunrise Senior Living

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00048

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

West Bloomfield Township CM

West Bloomfield Township CM

Submission ID. HPA-GBN8-76C4C

Start Day	Start Time	End Day	End Time
7/25/2021	8:45:00 PM	7/26/2021	1:24 PM

Rain(in.) = 4.8

Waterbody: 10th Street ditch

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.30000

Cause: Untreated/diluted domestic sanitary sewage discharged due to failure of dry pit vertical pedestal pumps within dry can. Wet well volume draining directly into dry can infrastructure fouled electrical and all 3 non-submersible pumps inside of vault at 40

Location: Wet Lands

EGLE Action: A new lift station was constructed in accordance with Part 41 Permit # P41002746 and is for;; Complete replacement of the existing pump station at the corner of Pontiac Trail and Haggerty Road with a new 10' by 14' precast concrete box culvert wet well, three new submersible pumps, new building to house the pump discharge header and electrical/controls, Rota mixer, generator, transformer, and air filtration unit

Totals West Bloomfield Township CM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.30000

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Woodlands MHP

Woodlands MHP

Submission ID. HPB-0XBF-BQM8E

Start Day	Start Time	End Day	End Time
8/16/2021	11:30:00 AM	8/16/2021	12:35 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

EGLE Action: The community lost partial power at approx 7:30 am on Friday 8/13/2021 due to storms in the area, Woodlands attempted to locate back up power with not luck. With the help from our operator we obtained a sewage hauler to keep the lift station pumped down to avoid a SSO, The vendor has been onsite all weekend. The sewage vendor visited the site at 4:00 am Monday 8/16/2021 to check the levels on the lift station and pump them down. Our staff checked the stations and manholes at 8:00 am, 9:00 am and 10:00 am on Monday 8/16/2021 to insure not discharge had occurred. The office staff contract the vendor to pump the stations as a precaution. County health department arrived around 12:30 pm to notify us of a complaint, The sewage vendor arrived about the same time to pump down the stations. The health department notified us of the discharge. The resident called the heath department and did not notify the community office of the issue.

Totals Woodlands MHP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00010

County Totals Oakland

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.12398 7.37910 39.27657

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 188 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Oscoda

Big Creek/Mentor Utility Auth

Big Creek/Mentor Utility Auth

Submission ID. HPD-C92D-3XZE5

Start Day	Start Time	End Day	End Time
11/19/2021	1:30:00 PM	11/19/2021	2:15 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00540

Cause: The discharge occurred due to the air release valve inside the manhole breaking off from its attachment to the sewer force main due to corrosion.

Location: First sewer force main air release valve manhole downstream from the lift station located at 5th and Randall Streets.

EGLE Action: Confirmed with the facility that the corroded attachments and isolation valves at all of the two air relief valve locations on the force main have been replaced. Also two new air relief valves will be installed where the old air relief valves were located.

Totals Big Creek/Mentor Utility Auth

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00540

County Totals Oscoda

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00540

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Ottawa

Crockery MHP

Crockery MHP

Submission ID. HP6-JVAP-2F4S0

Start Day	Start Time	End Day	End Time
2/16/2021	10:20:00 AM	2/16/2021	10:45 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00050

Cause: The discharge of untreated sewage was caused by multiple lift station pump HOA switches found in the off position resulting in an overflow.
Location: Jeffrey "J" Lift Station
EGLE Action: ACO entered to address discharge

Crockery MHP

Submission ID. HP8-416Y-TVJWP

Start Day	Start Time	End Day	End Time
4/5/2021	8:30:00 AM	4/9/2021	8:00 AM

Waterbody: Black Creek

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.82000

Cause: The east pond was discharged due to volume of wastewater in the lagoon system. Cell isolation was not being maintained and water had to be discharged to protect infrastructure and bank integrity due to high water levels. Please see the attached letter for
Location: Black Creek
EGLE Action: A Violation Notice will be issued

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Crockery MHP

Submission ID. HP9-T67C-D9R92

Start Day	Start Time	End Day	End Time
6/27/2021	11:45:00 AM	6/27/2021	2:00 PM

Rain(in.) = 5

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00050

Cause: I received a call from maintenance staff that the lift station had overflowed. I had them put the pump in hand position to see if the pumps would operate. The station immediately began pumping down. When I arrived on site the overflow had been removed and

Location: Jeffery ("J") Lift Station

EGLE Action: ACO entered to address discharge

Totals Crockery MHP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00100 0.82000

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 191 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Grand Haven-Spring Lake WWTP

Grand Haven-Spring Lake WWTP

Submission ID. HPE-00D0-A7A8W

Start Day	Start Time	End Day	End Time
12/5/2021	1:00:00 AM	12/15/2021	9:00 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00005

Cause: The leak had been contained to the manhole until final repair was made at 2:15 AM on December 15, 2021

Location: Fulton St. & Albee St. Intersection

EGLE Action: No further action taken at this time

Totals Grand Haven-Spring Lake WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00005

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Holland CM

Holland CM

Submission ID. HPE-1K78-EPVKV

Start Day	Start Time	End Day	End Time
12/17/2021	1:00:00 PM	12/17/2021	1:20 PM

Waterbody: North Branch Macatawa River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00040

Cause: A break in a 12" ductile iron force main occurred approximately 500 feet downstream of HBPW's Lincoln Ave lift station. The discharge was reported to HBPW at 1:00pm on Friday the 17th and staff shut down the lift station pumps and stopped the discharge by

Location: Lincoln Ave & Hedcor St

EGLE Action: No further action taken at this time

Totals Holland CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00040

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Presidential Estates

Presidential Estates

Submission ID. HP7-S25J-K2J5E

Start Day	Start Time	End Day	End Time
4/6/2021	6:54:00 AM	4/6/2021	9:00 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00005

Cause: it was raw sewage caused by flushable wipes blocking the pipes

EGLE Action: No further action taken at this time.

Totals Presidential Estates

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00005

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

River Haven MHP WWTP

River Haven MHP WWTP

Submission ID. HP7-3V0W-T2TBG

Start Day	Start Time	End Day	End Time
3/9/2021	12:30:00 PM	3/9/2021	4:45 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00001

Cause: Wipes were found in the man hole causing a slight back up. Only liquid no raw/solid sewage was found.

EGLE Action: A violation notice will be sent for this SSO and other violations (effluent)

Totals River Haven MHP WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00001

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Waverly Shores Village MHC

Waverly Shores Village MHC

Submission ID. HP7-E5FV-JRK93

Start Day	Start Time	End Day	End Time
3/20/2021	2:00:00 PM	3/20/2021	6:00 PM

Waterbody: decorative pond

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00100

Cause: liquid sewage only. volume of sewage was holding down the manhole cover not allowing the solids to rise. the reason was from grease buildup and wipes.

Location: waverly park road

EGLE Action: None needed at this time

Waverly Shores Village MHC

Submission ID. HPB-2C70-5W9TB

Start Day	Start Time	End Day	End Time
8/17/2021	11:30:00 AM	8/17/2021	2:30 PM

Waterbody: retention/decorative pond

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00100

Cause: on Tuesday august 17th, 2021 we were notified of a manhole back up around and behind 3248 waverly park sit 56. Plummers waste group was dispatched and found apprx 1000 gallons of liquid on the ground, which was holding down the manhole cover and keeping

Location: waverly park road

EGLE Action: None needed at this time

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 196 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Totals **Waverly Shores Village MHC**

Raw Sewage (MG)	Partially Treated (MG)	Dilute Raw Sewage (MG)
0.00200		

County Totals **Ottawa**

Raw Sewage (MG)	Partially Treated (MG)	Dilute Raw Sewage (MG)
0.00345	0.82001	0.00005

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Saginaw

Buena Vista Twp WWTP

Buena Vista Twp WWTP

Submission ID. HP8-P3KC-G9AH0

Start Day	Start Time	End Day	End Time
5/12/2021	12:00:00 PM	5/13/2021	10:00 AM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00300

Cause: Tristate Developers private connection to forced main failed and has been fixed.

Location: Hack road

EGLE Action: No further action taken. Event was caused by failure in privately owned lead. Facility is committed to preventing future events.

Totals Buena Vista Twp WWTP

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00300

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 198 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Frankenmuth WWTP

Frankenmuth WWTP

Submission ID. HP9-HN4R-FV1JZ

Start Day	Start Time	End Day	End Time
6/9/2021	7:00:00 PM	6/10/2021	1:00 PM

Waterbody: Cass River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.02000

Cause: Sanitary sewage overflow due to blockage in the line. Sewage overflowed onto nearby grassy area and then into a drainage ditch approx. 15 feet away. Blockage in the sewer line was determined to have been caused by solids settling out in the line due to un

Location: Harlan Park Drain

EGLE Action: VN to be issued

Totals Frankenmuth WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.02000

County Totals Saginaw

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.02300

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Sanilac

Croswell WWTP

Croswell WWTP

Submission ID. HP7-JQD6-C3Q5X

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.6
3/26/2021	8:45:00 AM	3/26/2021	9:10 AM	Waterbody: Black River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00175

Cause: The diluted raw sewage ran over the top of the grit channels for about 15 - 20 minutes. This occurred following a heavy rain event when a slug of debris blinded off the newly installed manual bar screen. When the operator noticed that the headworks struct

Location: 001, Croswell WWTP

EGLE Action: Correspondence with System Operator on reporting timeline requirements. No further action pursued. Facility is completing upgrades to prevent future events

Totals Croswell WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00175

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Port Sanilac WWSL

Port Sanilac WWSL

Submission ID. HPB-WEJ8-9AQCG

Start Day	Start Time	End Day	End Time
9/20/2021	10:00:00 AM	9/20/2021	3:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00006

Cause: pinhole in sewer force main

Location: East side of M-25

EGLE Action: No further action taken. Event was an isolated incident and the facility is committed to preventing further SSO's.

Totals Port Sanilac WWSL

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00006

County Totals Sanilac

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00006 **0.00175**

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Shiawassee

Durand WWTP

Durand WWTP

Submission ID. HP9-VWXQ-SDSDV

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.64
6/26/2021	7:35:00 PM	6/27/2021	12:50 AM	Waterbody: Holly Drain

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.10000

Cause: Discharge was partially treated sewerage, due to heavy rain fall over 2-3 days. Including 1.60" of rain in a 45 minute time period just prior to the discharge.

Location: Holly Drain

EGLE Action: Referred for escalated enforcement

Totals Durand WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.10000

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Owosso/Mid Shiawassee Co WWTP

Owosso/Mid Shiawassee Co WWTP

Submission ID. HP9-RSZX-A6YVS

Start Day	Start Time	End Day	End Time
6/25/2021	6:30:00 PM	6/25/2021	8:30 PM

Rain(in.) = 1.85

Waterbody: Shiawassee River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00400

Cause: Manhole reached surcharge condition due to inflow/infiltration of collection system significantly impacted by rain event (approx. 1.85" rain in a 14 hour period following 0.73" the prior day).

Location: Manhole A

EGLE Action: No further action taken at this time

Owosso/Mid Shiawassee Co WWTP

Submission ID. HP9-SHJ0-2HJ8D

Start Day	Start Time	End Day	End Time
6/26/2021	6:40:00 PM	6/26/2021	11:00 PM

Rain(in.) = 0.8

Waterbody: Shiawassee River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.01600

Cause: Manhole reached surcharge condition due to inflow/infiltration of the collection system significantly impacted by rain event totaling 0.80" rain on saturated ground which followed 3.20" rain over the previous 2 days.

Location: Manhole A

EGLE Action: No further action taken at this time

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 203 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Totals Owosso/Mid Shiawassee Co WWTP

Raw Sewage (MG)	Partially Treated (MG)	Dilute Raw Sewage (MG)
		0.02000

County Totals Shiawassee

Raw Sewage (MG)	Partially Treated (MG)	Dilute Raw Sewage (MG)
	0.10000	0.02000

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

St. Joseph

Constantine CM

Constantine CM

Submission ID. HP9-F8HG-B6NW8

Start Day	Start Time	End Day	End Time
6/13/2021	2:00:00 PM	6/13/2021	11:30 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00600

Cause: Discharge was from a hole in the force main.

Location: 15000 Block of Gleason Rd., Three Rivers, MI 49093

EGLE Action: Event reviewed and appears to be remediated.

Totals Constantine CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00600

County Totals St. Joseph

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00600

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Van Buren

Bangor WWSL

Bangor WWSL

Submission ID. HP6-8A9W-DKPG8

Start Day	Start Time	End Day	End Time
2/2/2021	9:00:00 AM	2/2/2021	3:15 PM

Waterbody: Marone storm drain

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.01900

Cause: It appears that our sewer pump malfunctioned while Marone manufacturing was discharged their processed wastewater. This caused their wastewater to overflow a manhole.

Location: Manhole

EGLE Action: No further action taken at this time.

Bangor WWSL

Submission ID. HPD-YJJ4-C2B63

Start Day	Start Time	End Day	End Time
12/12/2021	4:00:00 AM	12/14/2021	3:30 PM

Waterbody: Black River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.10000

Cause: pump malfunction

Location: Arlington Street liftstation

EGLE Action: No further action taken at this time.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 206 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Bangor WWSL

Submission ID. HPE-5F48-6QGT4

Start Day	Start Time	End Day	End Time
12/21/2021	5:30:00 PM	12/21/2021	6:30 PM

Waterbody: Black River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00100

Cause: Tree limbs fell on the power lines leading to the pumps. The pumps lost power as a result of this.

Location: Black River

EGLE Action: Event Reviewed. No further action taken.

Totals Bangor WWSL

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.10100

0.01900

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 207 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

South Haven Area Water Sewer Authority WWTP

South Haven Area Water Sewer Authority WWTP

Submission ID. HP9-T97Y-YST1A

Start Day	Start Time	End Day	End Time
6/25/2021	8:30:00 AM	6/27/2021	12:00 AM

Rain(in.) = 7

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.01000

Cause: lift station overwhelmed with flow due to the excessive inflow and infiltration in the collection area. wastewater flowed from wet well lid.

Location: Golf Course lift station

EGLE Action: Event reviewed. Facility making corrective actions.

Totals South Haven Area Water Sewer Authority WWTP

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.01000

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Sunny Brook RV Resort

Sunny Brook RV Resort

Submission ID. HP9-XBN1-WSJYT

Start Day	Start Time	End Day	End Time
6/30/2021	1:20:00 PM	7/2/2021	12:00 PM

Rain(in.) = 10.22

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00190

Cause: Discharge in the drainfield. Rainfall events of 10.22" since July 18, 2021

Location: Sunny Brook RV Resort

EGLE Action: Event reviewed and appears to be remediated. No further action taken at this time.

Totals Sunny Brook RV Resort

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00190

County Totals Van Buren

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.10100

0.00190

0.02900

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 209 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Washtenaw

Ann Arbor CM

Ann Arbor CM

Submission ID. HP6-RX4E-4YN99

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.07
2/22/2021	10:30:00 AM	2/22/2021	2:30 PM	Waterbody: Allen Creek

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.01000

Cause: Mid morning on Monday, February 22, 2021, a Contractor's sanitary sewer by-pass pumping operations failed, causing a release of an estimated 10,000 gallons of sanitary sewage into South Main Street and ran down the gutter into the storm drain, ultimately

Location: Main Street/Madison

EGLE Action: Violation Notice sent to address discharge

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 210 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Ann Arbor CM

Submission ID. HP7-FN22-47YCH

Start Day	Start Time	End Day	End Time
3/24/2021	11:30:00 AM	3/24/2021	12:30 AM

Waterbody: Allen Creek

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00005

Cause: Raw sewage released from bypass pumping pipes that were not fully cleaned and cleared prior to breakdown.; ; Mid morning on Wednesday, March 24, 2021, a contractor's sanitary sewer bypass pumping operation failed, releasing an estimated 50 gallons of sani

Location: Main Street/Madison

EGLE Action: Send Violation Notice.

Ann Arbor CM

Submission ID. HP7-NXVS-7SYXR

Start Day	Start Time	End Day	End Time
4/1/2021	11:00:00 AM	4/1/2021	12:30 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00050

Cause: Late morning on Thursday, April 1, 2021, City Public Works Staff responded to a notification of a sewage overflow near Nichols Drive in the UM Arboretum. Upon inspection, it was found that a root ball had caused the discharge of an estimated 500 gallons

Location: 71-69271

EGLE Action: Violation Notice sent to address discharge

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 211 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Ann Arbor CM

Submission ID. HP7-YK7Y-E71HE

Start Day	Start Time	End Day	End Time
4/12/2021	10:00:00 AM	4/12/2021	12:00 PM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00001

Cause: blockage in private sewer lead.

EGLE Action: No further actions taken at this time.

Ann Arbor CM

Submission ID. HP8-MJN6-8S19C

Start Day	Start Time	End Day	End Time
5/10/2021	8:50:00 AM	5/10/2021	9:40 AM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00060

Cause: an estimated 600 gallons released from manhole 71-70046, caused by tree roots that grew into a root ball just downstream of the overflow point.

Location: 71-70046

EGLE Action: Violation Notice sent to address discharge

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 212 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Ann Arbor CM

Submission ID. HP9-WTN2-H0837

Start Day	Start Time	End Day	End Time
7/1/2021	1:00:00 PM	7/1/2021	2:00 PM

Waterbody: Allen Creek

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00006

Cause: Contractor activities caused a washout of sand backfill, creating a blockage in the pipe.

Location: 71-71681

EGLE Action: Violation Notice sent to address discharge

Ann Arbor CM

Submission ID. HPB-T2YW-VEWBK

Start Day	Start Time	End Day	End Time
8/10/2021	2:00:00 PM	8/11/2021	2:00 PM

Waterbody: Swift Run Drain

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00005

Cause: raw sewage released from a private pumped lead - the cleanout cap was broken.

EGLE Action: Violation Notice sent to address discharge

Totals Ann Arbor CM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.01127

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 213 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Portage-Baseline Lakes WWTP

Portage-Baseline Lakes WWTP

Submission ID. HP6-THNA-1QQNH

Start Day	Start Time	End Day	End Time
2/25/2021	11:00:00 AM	2/25/2021	11:15 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00005

Cause: Sewer main was punctured with probing rod while excavating to connect a new lateral to the main

Location: Sewer main in road

EGLE Action: Violation Notice sent to address discharge

Portage-Baseline Lakes WWTP

Submission ID. HPC-QYZH-ZJ5EQ

Start Day	Start Time	End Day	End Time
8/16/2021	8:00:00 AM	8/17/2021	12:00 PM

Waterbody: Nearby canal that flows into Portage Lake

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00300

Cause: A power problem to the nearby pump station (from severe storms) caused sewage to backup in the gravity line. Sewage overflowed out of a nearby cleanout. A small amount made its way into the nearby canal.

EGLE Action: SSO report was reviewed for permit compliance and response actions taken by facility. Information provided is complete and all required actions were taken by the facility. Violations associated with this discharge will be addressed as part of next scheduled facility inspection.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Portage-Baseline Lakes WWTP

Submission ID. HPD-9886-8C66C

Start Day	Start Time	End Day	End Time
11/11/2021	12:00:00 PM	11/12/2021	1:00 PM

Waterbody: Wetland near manhole

Raw Sewage (MG)

0.00100

Partially Treated (MG)

Dilute Raw Sewage (MG)

Cause: Transfer switch failed at pump station

Location: Manhole 2-5 at 8789 McGregor Rd

EGLE Action: Violation Notice (VN-012577) issued

Totals Portage-Baseline Lakes WWTP

Raw Sewage (MG)

0.00105

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00300

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 215 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Saline WWTP

Saline WWTP

Submission ID. HPA-XM6M-9H5SF

Start Day	Start Time	End Day	End Time
8/12/2021	4:00:00 AM	8/12/2021	5:00 AM

Rain(in.) = 4.5

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00200

Cause: A power failure during heavy rainfall caused influent wet well to backup which led to SSO at manhole on WWTP property.

Location: City of Saline WWTP

EGLE Action: Violation Notice sent to address discharge

Totals Saline WWTP

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00200

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Sylvan Township CM

Sylvan Township CM

Submission ID. HP8-FX2N-N7WTV

Start Day	Start Time	End Day	End Time
5/3/2021	8:00:00 PM	5/5/2021	11:30 AM

Waterbody: Drainage ditch next to the station. The ditch

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.09000

Cause: Contractors were finishing up work at the station but failed to isolate the Kilmer Rd lift station. They did not to close the inlet valve tightly causing the station to over flow. I am estimating about 90,000 gallons total over a 40 hour time span.

Location: Kilmer road Lift Station

EGLE Action: A VN was issued to address discharge

Sylvan Township CM

Submission ID. HP8-MGC8-SG1XT

Start Day	Start Time	End Day	End Time
5/10/2021	7:00:00 PM	5/10/2021	9:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00100

Cause: Contractors for the county struck a valve box while brush hogging along the road side.

Location: ground near 3600 Willis rd

EGLE Action: Violation Notice sent on July 8, 2021

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Sylvan Township CM

Submission ID. HPA-7PBG-W2RTM

Start Day	Start Time	End Day	End Time
7/13/2021	11:00:00 AM	7/15/2021	11:00 AM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00500

Cause: A leaking air relief vavle

Location: 17520 Farhner rd

EGLE Action: Violation Notice sent on August 3, 2021

Sylvan Township CM

Submission ID. HPC-826W-79TZ6

Start Day	Start Time	End Day	End Time
10/4/2021	3:00:00 PM	10/5/2021	9:00 AM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00100

Cause: Discharge of approximately 1,000 gallons of raw sewage over the course of 1 day to ground only. The discharge line between wet well and valve pit separated and discharged to the ground around the lift station.

Location: Sugerloaf Campground

EGLE Action: Violation Notice sent on October 18, 2021

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 218 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Totals **Sylvan Township CM**

Raw Sewage (MG)	Partially Treated (MG)	Dilute Raw Sewage (MG)
0.09700		

County Totals **Washtenaw**

Raw Sewage (MG)	Partially Treated (MG)	Dilute Raw Sewage (MG)
0.10932		0.00500

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Wayne

Allen Park CM

Allen Park CM

Submission ID. HPA-YAF8-0ET4W

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.54
8/12/2021	12:00:00 PM	8/12/2021	5:00 PM	Waterbody: Ecorse Creek

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.48000

Cause: Wet well overflow at Tunnel Pump station caused by Heavy Rainfall and Ecorse Creek overflow.

Location: Tunnel Pump Station

EGLE Action: City is under ACO to address SSOs

Totals Allen Park CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.48000

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Creekside Estates MHC

Creekside Estates MHC

Submission ID. HPB-KQ2D-QWFRX

Start Day	Start Time	End Day	End Time
8/31/2021	12:51:00 PM	9/6/2021	12:30 PM

Raw Sewage (MG)

0.00010

Partially Treated (MG)

Dilute Raw Sewage (MG)

Cause: from trailer, blocked sewer lead

EGLE Action: no further action at this time.

Totals Creekside Estates MHC

Raw Sewage (MG)

0.00010

Partially Treated (MG)

Dilute Raw Sewage (MG)

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Dearborn CSO

Dearborn CSO

Submission ID. HP7-GH5B-TDF7C

Start Day	Start Time	End Day	End Time
3/26/2021	4:57:00 AM	3/26/2021	7:37 AM

Rain(in.) = 1.28

Waterbody: Rouge River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.72706

Cause: Wet weather

Location: Greenfield Pump Station

EGLE Action: Event under review

Dearborn CSO

Submission ID. HP9-R895-PNC7R

Start Day	Start Time	End Day	End Time
6/25/2021	9:04:00 PM	6/27/2021	7:41 AM

Rain(in.) = 7.57

Waterbody: Rouge River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

9.31978

Cause: Detroit's interceptor could not handle city of Dearborn pumping capacity as stated in permit. Thus causing SSO discharge from Greenfield lift station.

Location: Greenfield lift station

EGLE Action: This event exceeded the RDS (7.57 inches of rain). No further action taken at this time

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 222 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Dearborn CSO

Submission ID. HPA-8JHW-ZKXKG

Start Day	Start Time	End Day	End Time
7/16/2021	11:22:00 AM	7/16/2021	9:18 PM

Rain(in.) = 4.41
Waterbody: Rouge River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
2.76395

Cause: The Northwest Interceptor would not allow us to discharge 60+ CFS causing overflow structure to spill to river.

Location: Greenfield Pump Station

EGLE Action: No further action taken at this time

Dearborn CSO

Submission ID. HPA-F531-7AA9G

Start Day	Start Time	End Day	End Time
7/24/2021	10:02:00 PM	7/25/2021	8:16 AM

Rain(in.) = 2.8
Waterbody: Rouge River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
2.75204

Cause: The Northwest Interceptor would not allow Dearborn to discharge 60+ CFS causing structure to overflow to river

Location: Greenfield Pump station

EGLE Action: event is currently under review

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Dearborn CSO

Submission ID. HPA-XG8V-273CZ

Start Day	Start Time	End Day	End Time	Rain(in.) = 3.52
8/12/2021	4:12:00 AM	8/12/2021	2:15 PM	Waterbody: Rouge River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
2.70626

Cause: Detroit interceptor could not accept Dearborns contractual pumping capacity, thus causing SSO.

Location: Greenfield lift station

EGLE Action: Event is currently under review

Dearborn CSO

Submission ID. HPB-9JX6-79PYE

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.04
8/27/2021	2:28:00 PM	8/27/2021	7:07 PM	Waterbody: Rouge River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
1.24677

Cause: The Northwest Interceptor would not allow Dearborn to discharge 60+ CFS causing structure to overflow to river

Location: Greenfield Pump Station

EGLE Action: Event is currently under review

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 224 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Dearborn CSO

Submission ID. HPB-XFX4-0EFEB

Start Day	Start Time	End Day	End Time
9/21/2021	11:48:00 PM	9/23/2021	11:09 AM

Rain(in.) = 4.97
Waterbody: Rouge River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)

8.81003

Cause: Detroit Interceptor could not receive contractual pumping capacity from Greenfield lift station due to high rain volumes, thus causing SSO out of Greenfield lift station

Location: Greenfield lift station

EGLE Action: Event is currently under review

Dearborn CSO

Submission ID. HPC-QTS8-0997J

Start Day	Start Time	End Day	End Time
10/25/2021	9:54:00 AM	10/25/2021	7:06 PM

Rain(in.) = 2.21
Waterbody: Rouge River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)

2.47738

Cause: GLWA Northwest Interceptor would not allow Dearborn to discharge 60+ CFS, approximately 10CFS overflowed manhole in the Sewerage Division's storm drain structure that leads in to the Rouge River

Location: Greenfield Pump Staion

EGLE Action: Event is currently under review

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 225 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Dearborn CSO

Submission ID. HPC-V9K0-D97QC

Start Day	Start Time	End Day	End Time	Rain(in.) = 0.97
10/29/2021	9:53:00 PM	10/29/2021	11:04 PM	Waterbody: Rouge River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.31775

Cause: GLWA Northwest interceptor would not allow Dearborn to discharge 60+ cfs

Location: Greenfield Pump Station

EGLE Action: Event is currently under review

Dearborn CSO

Submission ID. HPD-YEBF-D5Y5X

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.29
12/11/2021	3:41:00 AM	12/11/2021	1:07 PM	Waterbody: Rouge River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
16.15680

Cause: GLWA Northwest interceptor would not allow Dearborn to discharge 60+ CFS

Location: Greenfield Pump Station

EGLE Action: Event is currently under evaluation

Totals Dearborn CSO

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
9.31978 **37.95804**

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 226 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

GM-CPC-Romulus Engine

GM-CPC-Romulus Engine

Submission ID. HPE-ERGX-3KB7B

Start Day	Start Time	End Day	End Time
12/30/2021	3:00:00 PM	12/30/2021	4:00 PM

Rain(in.) = 0

Waterbody: on-site storm water ponds

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00010

Cause: During maintenance activities on 12/30/21 an underground sanitary sewer line was inadvertently breached which resulted in a release of an estimated 100 gallons of sanitary wastewater. The breach in line was immediately blocked to prevent any additional I

Location: storm pond

EGLE Action: Communicated with GM, confirmed repair and clean-up actions completed.

Totals GM-CPC-Romulus Engine

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00010

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Grosse Pointe Shores CM

Grosse Pointe Shores CM

Submission ID. HP9-SGD7-T67TX

Start Day	Start Time	End Day	End Time
6/26/2021	1:39:00 AM	6/26/2021	6:37 AM

Rain(in.) = 5

Waterbody: Lake St. Clair

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

2.38000

Cause: The Cook rd lift station relief gate was opened to lower the level in our interceptor. After unprecedented rainfall, we received reports of sewage back-ups. Inspection of the interceptor showed that it was completely full. With more rain in the forecast a

Location: Cook Road Lift Station

EGLE Action: event exceeded remedial design standard

Grosse Pointe Shores CM

Submission ID. HPA-90KR-X2JQK

Start Day	Start Time	End Day	End Time
7/16/2021	2:10:00 PM	7/16/2021	4:52 PM

Rain(in.) = 4

Waterbody: Lake St. Clair

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

1.37000

Cause: The Cook Rd. lift station relief gate was opened to lower the level in our interceptor. After unprecedented rainfall, we received reports of sewage back-ups. Inspection of the interceptor showed that it was completely full. With more rain in the forecast

Location: Cook Road Lift Station

EGLE Action: Violation Notice issued.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Totals Grosse Pointe Shores CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
3.75000

Lincoln Park CM

Lincoln Park CM

Submission ID. HP9-RRFA-ZV9FA

Start Day	Start Time	End Day	End Time
6/26/2021	7:18:00 AM	6/26/2021	7:00 PM

Rain(in.) = 2.88
Waterbody: North Ecorse Creek

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.32146

Cause: Large rain event

Location: Lincoln Park RTB

EGLE Action: EGLE is currently working on enforcement proceeding with Lincoln Park to address their SSO's

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Lincoln Park CM

Submission ID. HPA-960X-0YFAD

Start Day	Start Time	End Day	End Time
7/16/2021	11:00:00 PM	7/17/2021	2:00 PM

Rain(in.) = 2.38
Waterbody: Ecorse Creek

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
17.00000

Cause: partially treated , due to large rain fall event

Location: Lincoln Park Retention Basin

EGLE Action: EGLE is in the process of seeking an Administrative Consent Order with Lincoln Park to address the SSO's

Lincoln Park CM

Submission ID. HPA-FG42-7VM66

Start Day	Start Time	End Day	End Time
7/25/2021	2:30:00 AM	7/25/2021	1:00 PM

Rain(in.) = 2.1
Waterbody: Ecorse Creek

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
12.60000

Cause: Rapid Rain Event

Location: Lincoln Park RTB

EGLE Action: Pending Enforcement action to address the SSO's

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Lincoln Park CM

Submission ID. HPA-XRAK-GWYFQ

Start Day	Start Time	End Day	End Time
8/12/2021	9:30:00 AM	8/12/2021	7:00 PM

Rain(in.) = 3.14
Waterbody: Ecorse Creek

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
14.30000

Cause: bypass pumping
Location: ecorse creek
EGLE Action: Pending Enforcement action

Lincoln Park CM

Submission ID. HPB-XR5N-SS54X

Start Day	Start Time	End Day	End Time
9/22/2021	4:00:00 AM	9/23/2021	5:00 PM

Rain(in.) = 4.47
Waterbody: Ecorse Creek

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
7.60000

Cause: bypass pumping
Location: ecorse creek
EGLE Action: Current escalated enforcement action pending

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Lincoln Park CM

Submission ID. HPC-QW5A-38YJN

Start Day	Start Time	End Day	End Time
10/25/2021	11:00:00 AM	10/26/2021	8:00 AM

Rain(in.) = 2.313

Waterbody: Ecorse Creek

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

23.10000

Cause: Bypass pumping

Location: ecorse creek

EGLE Action: Enforcement action in pending

Totals Lincoln Park CM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

74.92146

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 232 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Melvindale CM

Melvindale CM

Submission ID. HPA-AY9G-H44M2

Start Day	Start Time	End Day	End Time
7/16/2021	2:15:00 PM	7/16/2021	11:00 PM

Rain(in.) = 2.5

Waterbody: Rouge River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

1.73345

Cause: Heavy rain event caused 1 million gallon overflow tank to be filled quickly which necessitated dumping into the Rouge River

Location: Rouge River

EGLE Action: City is under ACO to address SSOs

Melvindale CM

Submission ID. HPA-GCF7-9NQWV

Start Day	Start Time	End Day	End Time
7/25/2021	2:05:00 AM	7/25/2021	4:00 AM

Rain(in.) = 2.5

Waterbody: Rouge River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.71688

Cause: Heavy rain event 7/24/2021. Million gallon tank filled necessitating overflow to Rouge River.

Location: Rouge River

EGLE Action: City is under ACO to address SSOs

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 233 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Totals Melvindale CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
2.45033

Rouge Valley Sewage Disposal System CM

Rouge Valley Sewage Disposal System CM

Submission ID. HPA-31TB-19KKV

Start Day	Start Time	End Day	End Time
6/25/2021	6:30:00 PM	6/26/2021	2:35 AM

Rain(in.) = 4.43
Waterbody: Middle Rouge River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.10000

Cause: A significant rainfall event occurred which caused the flow rate in the sewer to; exceed the regulator capacity.

Location: Regulator M-25 (CSO 057)

EGLE Action: Wayne County is under 4th Amended AACO-000031 with a construction schedule to eliminate SSOs to the SSO Policy.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Rouge Valley Sewage Disposal System CM

Submission ID. HPA-6SJ8-9JS35

Start Day	Start Time	End Day	End Time	Rain(in.) = 5.92
6/25/2021	7:40:00 PM	6/26/2021	12:00 AM	Waterbody: Middle Rouge River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
3.30000

Cause: Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Location: Manholes between Telegraph Road and Beech Daly Road in the floodplain of the Middle Rouge River

EGLE Action: These floodplain manholes will be addressed as part of the Long Term Corrective Action Plan (LTCAP). The LTCAP is part of the 4th Amended Final Order of Abatement No. AACO-000031. The project plan was submitted dated 6/29/19. Wayne County requested that the ACO be amended, and this is under review by EGLE.

Rouge Valley Sewage Disposal System CM

Submission ID. HPA-S1J0-4AF9Z

Start Day	Start Time	End Day	End Time	Rain(in.) = 5.92
6/25/2021	10:55:00 PM	6/27/2021	5:55 AM	Waterbody: Lower Rouge River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
24.60000

Cause: Significant rainfall event occurred which caused the flow rate in the sewer to exceed the capacity.

Location: Manholes along the Lower Rouge River

EGLE Action: Wayne County is currently under 4th Amended AACO-000031 with schedule to eliminate SSOs in the Rouge Valley Sewage Disposal System to the SSO Policy.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 235 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Rouge Valley Sewage Disposal System CM

Submission ID. HPA-31TB-19KKV

Start Day	Start Time	End Day	End Time	Rain(in.) = 4.43
6/25/2021	11:55:00 PM	6/27/2021	6:55 AM	Waterbody: Middle Rouge River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
4.40000

Cause: A significant rainfall event occurred which caused the flow rate in the sewer to; exceed the regulator capacity.

Location: Regulator M-21 (CSO 056)

EGLE Action: Wayne County is under 4th Amended AACO-000031 with a construction schedule to eliminate SSOs to the SSO Policy.

Rouge Valley Sewage Disposal System CM

Submission ID. HPA-31TB-19KKV

Start Day	Start Time	End Day	End Time	Rain(in.) = 4.43
6/26/2021	12:35:00 AM	6/26/2021	10:15 PM	Waterbody: Middle Rouge River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
8.60000

Cause: A significant rainfall event occurred which caused the flow rate in the sewer to; exceed the regulator capacity.

Location: Regulator M-22 (CSO 055)

EGLE Action: Wayne County is under 4th Amended AACO-000031 with a construction schedule to eliminate SSOs to the SSO Policy.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 236 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Rouge Valley Sewage Disposal System CM

Submission ID. HPA-6S98-QF450

Start Day	Start Time	End Day	End Time
6/26/2021	2:20:00 AM	6/27/2021	1:15 AM

Rain(in.) = 2.59

Waterbody: Bell Branch of the Middle Rouge River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.05000

Cause: A significant rainfall event occurred which caused the sewer to surcharge to; grade

Location: Manholes west of Inkster Road between Rougeway Street and Sunnydale Street in the floodplain of the Bell Branch of the Middle Rouge River

EGLE Action: The floodplain manholes will be addressed as part of the Long Term Corrective Action Program. Wayne County submitted a project plan on 6/29/19 to address 4th Amended AACO-000031. Wayne County is working with EGLE to amend this Order.

Rouge Valley Sewage Disposal System CM

Submission ID. HPA-BQ67-1K06G

Start Day	Start Time	End Day	End Time
7/16/2021	12:05:00 PM	7/18/2021	2:25 PM

Rain(in.) = 2.59

Waterbody: Middle Rouge River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

4.50000

Cause: A significant rainfall event occurred which caused the flow rate in the sewer to; exceed the regulator capacity.

Location: Regulator M-21 (CSO 056)

EGLE Action: This outfall was under terminated NPDES Permit No. MI0051551. This will be addressed as part of the Long Term Corrective Action Program. Wayne County submitted a project plan on 6/29/19 to address 4th Amended AACO-000031. Wayne County is working with EGLE to amend this Order.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 237 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Rouge Valley Sewage Disposal System CM

Submission ID. HPA-BQ67-1K06G

Start Day	Start Time	End Day	End Time
7/16/2021	12:15:00 PM	7/16/2021	9:05 PM

Rain(in.) = 2.59
Waterbody: Middle Rouge River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
3.50000

Cause: A significant rainfall event occurred which caused the flow rate in the sewer to; exceed the regulator capacity.

Location: Regulator M-22 (CSO 055)

EGLE Action: This outfall was under terminated NPDES Permit No. MI0051560. This will be addressed as part of the Long Term Corrective Action Program. Wayne County submitted a project plan on 6/29/19 to address 4th Amended AACO-000031. Wayne County is working with EGLE to amend this Order.

Rouge Valley Sewage Disposal System CM

Submission ID. HPA-BQ67-1K06G

Start Day	Start Time	End Day	End Time
7/16/2021	12:15:00 PM	7/16/2021	9:05 PM

Rain(in.) = 2.59
Waterbody: Middle Rouge River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.10000

Cause: A significant rainfall event occurred which caused the flow rate in the sewer to; exceed the regulator capacity.

Location: Regulator M-25 (CSO 057)

EGLE Action: This outfall was under terminated NPDES Permit No. MI0051551. This will be addressed as part of the Long Term Corrective Action Program. Wayne County submitted a project plan on 6/29/19 to address 4th Amended AACO-000031. Wayne County is working with EGLE to amend this Order.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 238 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Rouge Valley Sewage Disposal System CM

Submission ID. HPA-KH52-TCHVB

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.73
7/24/2021	8:15:00 PM	7/24/2021	9:55 PM	Waterbody: Middle Rouge River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.20000

Cause: A significant rainfall event occurred which caused the flow rate in the sewer to exceed the regulator capacity.

Location: Regulator M-25 (CSO 057)

EGLE Action: This outfall was under terminated NPDES Permit No. MI0051551. This will be addressed as part of the Long Term Corrective Action Program. Wayne County submitted a project plan on 6/29/19 to address 4th Amended AACO-000031. Wayne County is working with EGLE to amend this Order.

Rouge Valley Sewage Disposal System CM

Submission ID. HPA-KH52-TCHVB

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.73
7/24/2021	8:50:00 PM	7/26/2021	9:05 AM	Waterbody: Middle Rouge River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
2.40000

Cause: A significant rainfall event occurred which caused the flow rate in the sewer to exceed the regulator capacity.

Location: Regulator M-21 (CSO 056)

EGLE Action: This outfall was under terminated NPDES Permit No. MI0051551. This will be addressed as part of the Long Term Corrective Action Program. Wayne County submitted a project plan on 6/29/19 to address 4th Amended AACO-000031. Wayne County is working with EGLE to amend this Order.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 239 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Rouge Valley Sewage Disposal System CM

Submission ID. HPA-KH52-TCHVB

Start Day	Start Time	End Day	End Time	Rain(in.) = 1.73
7/25/2021	12:20:00 AM	7/25/2021	2:35 AM	Waterbody: Middle Rouge River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.80000

Cause: A significant rainfall event occurred which caused the flow rate in the sewer to exceed the regulator capacity.

Location: Regulator M-22 (CSO 055)

EGLE Action: This outfall was under terminated NPDES Permit No. MI0051560. This will be addressed as part of the Long Term Corrective Action Program. Wayne County submitted a project plan on 6/29/19 to address 4th Amended AACO-000031. Wayne County is working with EGLE to amend this Order.

Rouge Valley Sewage Disposal System CM

Submission ID. HPC-39H9-3SJR1

Start Day	Start Time	End Day	End Time	Rain(in.) = 2.76
8/12/2021	5:40:00 AM	8/12/2021	3:25 PM	Waterbody: Middle Rouge River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.03000

Cause: A significant rainfall event occurred which caused the flow rate in the sewer to exceed the regulator capacity.

Location: Regulator M-25 (CSO 057)

EGLE Action: It is currently being addressed for elimination under the LTCAP, associated with the 4th Amended AACO-000031, entered 7/29/15, that's in the process of being amended again.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 240 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Rouge Valley Sewage Disposal System CM

Submission ID. HPC-39H9-3SJR1

Start Day	Start Time	End Day	End Time
8/12/2021	5:40:00 AM	8/12/2021	3:25 PM

Rain(in.) = 2.76
Waterbody: Middle Rouge River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
1.40000

Cause: A significant rainfall event occurred which caused the flow rate in the sewer to exceed the regulator capacity.

Location: Regulator M-21 (CSO 056)

EGLE Action: It is currently being addressed for elimination under the LTCAP, associated with the 4th Amended AACO-000031, entered 7/29/15, that's in the process of being amended again.

Rouge Valley Sewage Disposal System CM

Submission ID. HPC-2H0E-FTKP6

Start Day	Start Time	End Day	End Time
9/22/2021	8:55:00 AM	9/24/2021	3:20 AM

Rain(in.) = 4.24
Waterbody: Middle Rouge River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
5.80000

Cause: A significant rainfall event occurred which caused the flow rate in the sewer to exceed the regulator capacity.

Location: Regulator M-21 (CSO 056)

EGLE Action: This stems from NPDES Permit No. MI0051551, which was terminated. It is being addressed under the 4th Amended AACO-000031, entered 7/29/15 that is in the process of being amended again.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 241 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Rouge Valley Sewage Disposal System CM

Submission ID. HPC-2H0E-FTKP6

Start Day	Start Time	End Day	End Time
9/23/2021	3:00:00 AM	9/23/2021	9:05 PM

Rain(in.) = 4.24

Waterbody: Middle Rouge River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

4.70000

Cause: A significant rainfall event occurred which caused the flow rate in the sewer to exceed the regulator capacity.

Location: Regulator M-22 (CSO 055)

EGLE Action: This outfall stems from NPDES Permit No. MI0051560 that was terminated. It will be addressed under 4th Amended AACO-000031, entered 7/29/15 that's in the process of being amended again.

Rouge Valley Sewage Disposal System CM

Submission ID. HPD-KCH6-JYNZ1

Start Day	Start Time	End Day	End Time
10/25/2021	11:50:00 AM	10/25/2021	8:20 PM

Rain(in.) = 2.13

Waterbody: Middle Rouge River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.60000

Cause: A significant rainfall event occurred which caused the flow rate in the sewer to exceed the regulator capacity.

Location: Regulator M-21 (CSO 056)

EGLE Action: Uncontrolled CSO Outfalls M-21 (CSO 56), M-22 (CSO 55) & M-25 (CSO 57) were originally under terminated NPDES Permit Nos. MI0051551 & MI0051560. 4th Amended Final Order of Abatement AACO-000031, entered 7/29/15, is in the process of being amended, to eliminate or control these outfalls.

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 242 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Totals Rouge Valley Sewage Disposal System CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
65.08000

Western Townships Utilities Authority

Western Townships Utilities Authority

Submission ID. HP6-QAKC-HZZJ2

Start Day	Start Time	End Day	End Time
2/22/2021	10:00:00 PM	2/22/2021	11:30 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00001

Cause: An air release valve became plugged up and began leaking a small amount

Location: Michigan Ave at Executive Dr. (#4B)

EGLE Action: Enforcement Discretion

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Western Townships Utilities Authority

Submission ID. HP8-ABVV-VYES6

Start Day	Start Time	End Day	End Time
4/28/2021	9:00:00 AM	4/28/2021	9:45 AM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00001

Cause: During a routine inspection the ARV had a small trickle

Location: ARV #27B

EGLE Action: No further action taken at this time

Western Townships Utilities Authority

Submission ID. HP9-RRAJ-PJ436

Start Day	Start Time	End Day	End Time
6/26/2021	12:30:00 PM	6/26/2021	2:30 PM

Rain(in.) = 6
Waterbody: Lower Rouge River

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.09600

Cause: Due to heavy rainfall, >6", our storage basins (11M gallons) were full and a discharge was needed to protect the facility.

Location: Lower Rouge Pump Station

EGLE Action: Rain event exceeded remedial design standard. No further actions taken at this time

Totals Western Townships Utilities Authority

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00002 **0.09600**

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 244 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Westland CM

Westland CM

Submission ID. HP9-T6CJ-DR8WM

Start Day	Start Time	End Day	End Time
6/26/2021	2:00:00 AM	6/26/2021	11:00 PM

Rain(in.) = 2.36

Waterbody: Lower Rouge River

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

1.96000

Cause: RVSDS Lower Rouge Interceptor backup caused a breach of San MH at the Railroad grade separation. Sanitary Flow gravity drained into grade separation pump station and was then pumped into the storm system.

Location: Sewer Break

EGLE Action: Violation letter sent to address discharge

Totals Westland CM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

1.96000

County Totals

Wayne

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

9.32000

77.37178

109.32404

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 245 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Wexford

Cadillac CM

Cadillac CM

Submission ID. HP8-4ZJ9-T9N3M

Start Day	Start Time	End Day	End Time
4/21/2021	12:01:00 PM	4/21/2021	2:00 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00500

Cause: There was a backup in the sewer on Horbart street. Water filled a manhole that had an abandon force main discharge point in it. Water flowed through the pipe and pushed the plug out of the other end of the pipe and discharged unto the ground.

EGLE Action: SSO report reviewed. No further action taken at this time

Totals Cadillac CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00500

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Lake Mitchell Sewer Authority (former Wexford Co DPW) CM

Lake Mitchell Sewer Authority (former Wexford Co DPW) CM

Submission ID. HP8-35P7-GXJNK

Start Day	Start Time	End Day	End Time
4/17/2021	2:15:00 PM	4/17/2021	2:15 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00001

Cause: The station became inoperable after a component (safe pac) malfunctioned causing the station to fail.

Location: Grinder Pump Station 9A

EGLE Action: Compliance communication and VN sent previously to address SSOs.

Lake Mitchell Sewer Authority (former Wexford Co DPW) CM

Submission ID. HP8-MM6Z-2R9EN

Start Day	Start Time	End Day	End Time
5/10/2021	6:14:00 PM	5/10/2021	6:28 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00003

Cause: LMSA's contractor was making a repair to the discharge lines and check valve. Due to the highwater table surrounding Lake Mitchell, the excavation site became unstable. Ground material fell on the PVC curb valve and check valve and forced it from it ori

Location: 1762 South Lake Mitchell Drive - 15C GPS

EGLE Action: VN-011933 issued

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 247 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Lake Mitchell Sewer Authority (former Wexford Co DPW) CM

Submission ID. HPA-W3R2-VCJ87

Start Day	Start Time	End Day	End Time
8/10/2021	2:15:00 AM	8/10/2021	2:30 AM

Rain(in.) = 3.5

Waterbody: Swamp wetlands directly East of the lift stat

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00030

Cause: The Operation & Maintenance Technician responded to a high water alarm at SPS 1B at 1:50 a.m. on August 10, 2021. Upon arrival at 2:25 a.m, the Technician observed the station discharging. The discharge ended approximately 5 minutes after the Technician

Location: Lift Station 1B

EGLE Action: Review report, refer LMSA to enforcement

Lake Mitchell Sewer Authority (former Wexford Co DPW) CM

Submission ID. HPA-X16E-DK5Q0

Start Day	Start Time	End Day	End Time
8/11/2021	9:15:00 AM	8/11/2021	9:30 AM

Raw Sewage (MG)

Partially Treated (MG)

Dilute Raw Sewage (MG)

0.00020

Cause: Consumer Energy had a power outage that occurred in part of the LMSA sewer system and other areas in Cadillac as well. There was a severe storm with heavy rainfall and strong winds the night before. It was not raining during the time of the discharge.

Location: Lift station 1A

EGLE Action: LMSA referred to EGLE, WRD enforcement section

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 248 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Lake Mitchell Sewer Authority (former Wexford Co DPW) CM

Submission ID. HPA-X452-NFBBS

Start Day	Start Time	End Day	End Time
8/11/2021	5:30:00 PM	8/11/2021	5:45 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00040

Cause: On Wednesday, August 11, 2021, the Lake Mitchell Sewer Authority was affected by a Consumer's Energy power outage due to a severe storm with heavy rainfall/wind. Some of the LMSA sewer customers without power operate portable generators to power their re

Location: Grinder Pump Station 44A

EGLE Action: LMSA referred to WRD enforcement

Lake Mitchell Sewer Authority (former Wexford Co DPW) CM

Submission ID. HPA-XJP6-VCHJ4

Start Day	Start Time	End Day	End Time
8/11/2021	7:25:00 PM	8/11/2021	7:38 PM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00050

Cause: On Wednesday, August 11, 2021, the Lake Mitchell Sewer Authority was affected by a Consumer's Energy power outage due to a severe storm with heavy rainfall in the area from the night before. When the power was restored, at approximately at approximately 7

Location: SPS 2B 3601West 13th Street

EGLE Action: LMSA referred to WRD enforcement unit

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Lake Mitchell Sewer Authority (former Wexford Co DPW) CM

Submission ID. HPA-XNCJ-M5S65

Start Day	Start Time	End Day	End Time
8/11/2021	7:37:00 PM	8/11/2021	8:25 PM

Waterbody: Wetlands directly east of the lift station

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00250

Cause: At approximately 7:40p.m., lift station 1B, that is located on East Lake Mitchell Drive experienced a sewer overflow. This was due to the surge of sewer flow after the power was restored to the upstream grinder and lift pump stations. The lift station int

Location: SPS 1B located at 1754 East Lake Mitchell Drive

EGLE Action: LMSA referred to WRD enforcement section

Totals Lake Mitchell Sewer Authority (former Wexford Co DPW) CM

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.00304 0.00090

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.

Appendix G Page 250 of 251

'Sanitary Sewer Overflow ' Detail Report January 1 - December 31, 2021

Mesick WWTP

Mesick WWTP

Submission ID. HP9-6RDW-V480C

Start Day	Start Time	End Day	End Time
5/24/2021	12:00:00 AM	6/3/2021	12:00 PM

Waterbody: 11 Mile Road Drain

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.04500

Cause: Was notified by a resident on a walk on the evening of June 2, 2021 that he noticed water coming down the hillside. When I arrived I found the water coming from a manhole located half way down the hill, below the level of the road. I checked the next ma

Location: Right-of-way

EGLE Action: No further actions taken at this time

Totals Mesick WWTP

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.04500

County Totals

Wexford

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
0.05304 **0.00090**

Report Totals

Raw Sewage (MG) Partially Treated (MG) Dilute Raw Sewage (MG)
16.60107 **85.70959** **191.16141**

MG = million gallons

CSO/RTB discharges are as a result of wet weather. Dry weather CSO/RTB discharges are also classified as SSOs.