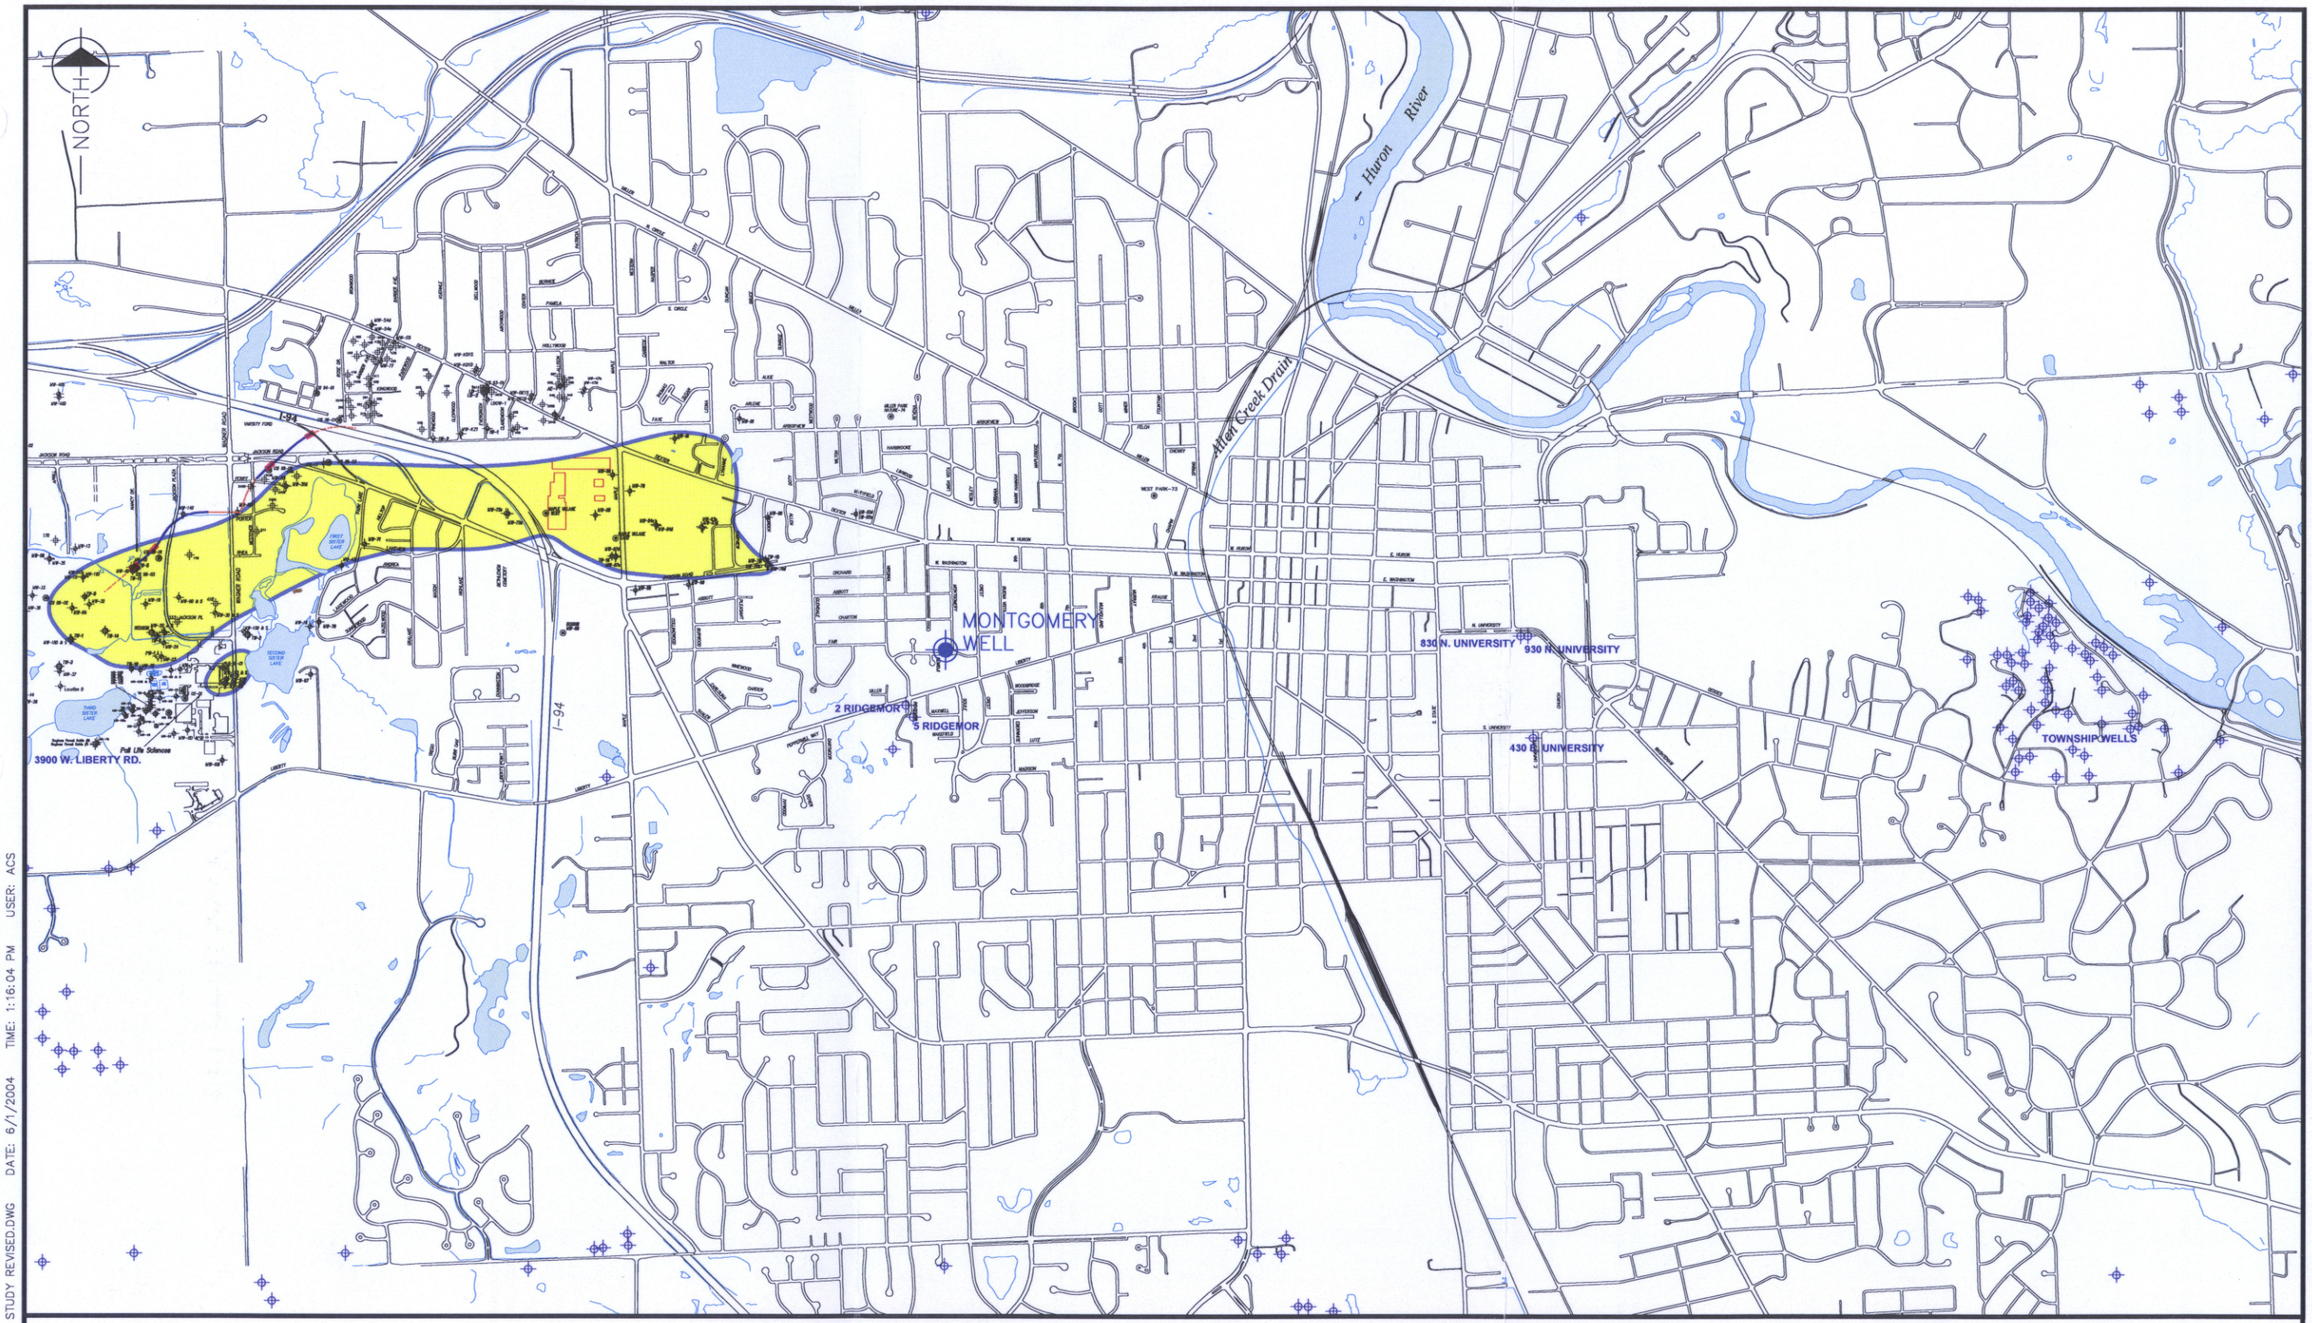

LEGEND

- MONITOR WELL
- RESIDENTIAL WELL
- PURGE WELL
- HYDROGEOLOGIC TEST BORING
- UV/OX. TREATMENT SYSTEM
- TEMPORARY PURGE WELL
- UNIT E AREA WITH 1,4-DIOXANE CONCENTRATIONS EXCEEDING 85 ug/L (ppb) JANUARY-MARCH 2004
- RESIDENTIAL WELL (Water Well Viewer – MDEQ, 2004 & The University of Michigan)

0 2000 4000
FEET

MAP SHOWING FEATURES RELEVANT TO RECEPTOR ANALYSIS

Fishbeck, Thompson, Carr & Huber
Engineers • Scientists • Architects
Kalamazoo, Michigan (269) 375-3824
© Copyright 2004 All Rights Reserved

Pall Life Sciences
Scio Twp., Washtenaw County, Michigan
Final Feasibility Study

PROJECT NO. F96502
FIGURE NO. 3

PLOT INFO: N:\96502\DWG\FEASIBILITY STUDY REVISED.DWG DATE: 6/1/2004 TIME: 1:16:04 PM USER: ACS
N:\96502\RASTER\0103\OSE2.TIF
N:\96502\RASTER\D2710290
N:\96502\RASTER\D2830282_JPG
N:\96502\RASTER\D2950274_JPG