Percentage of Persons Served by Michigan Community Fluoridated Water Systems by County

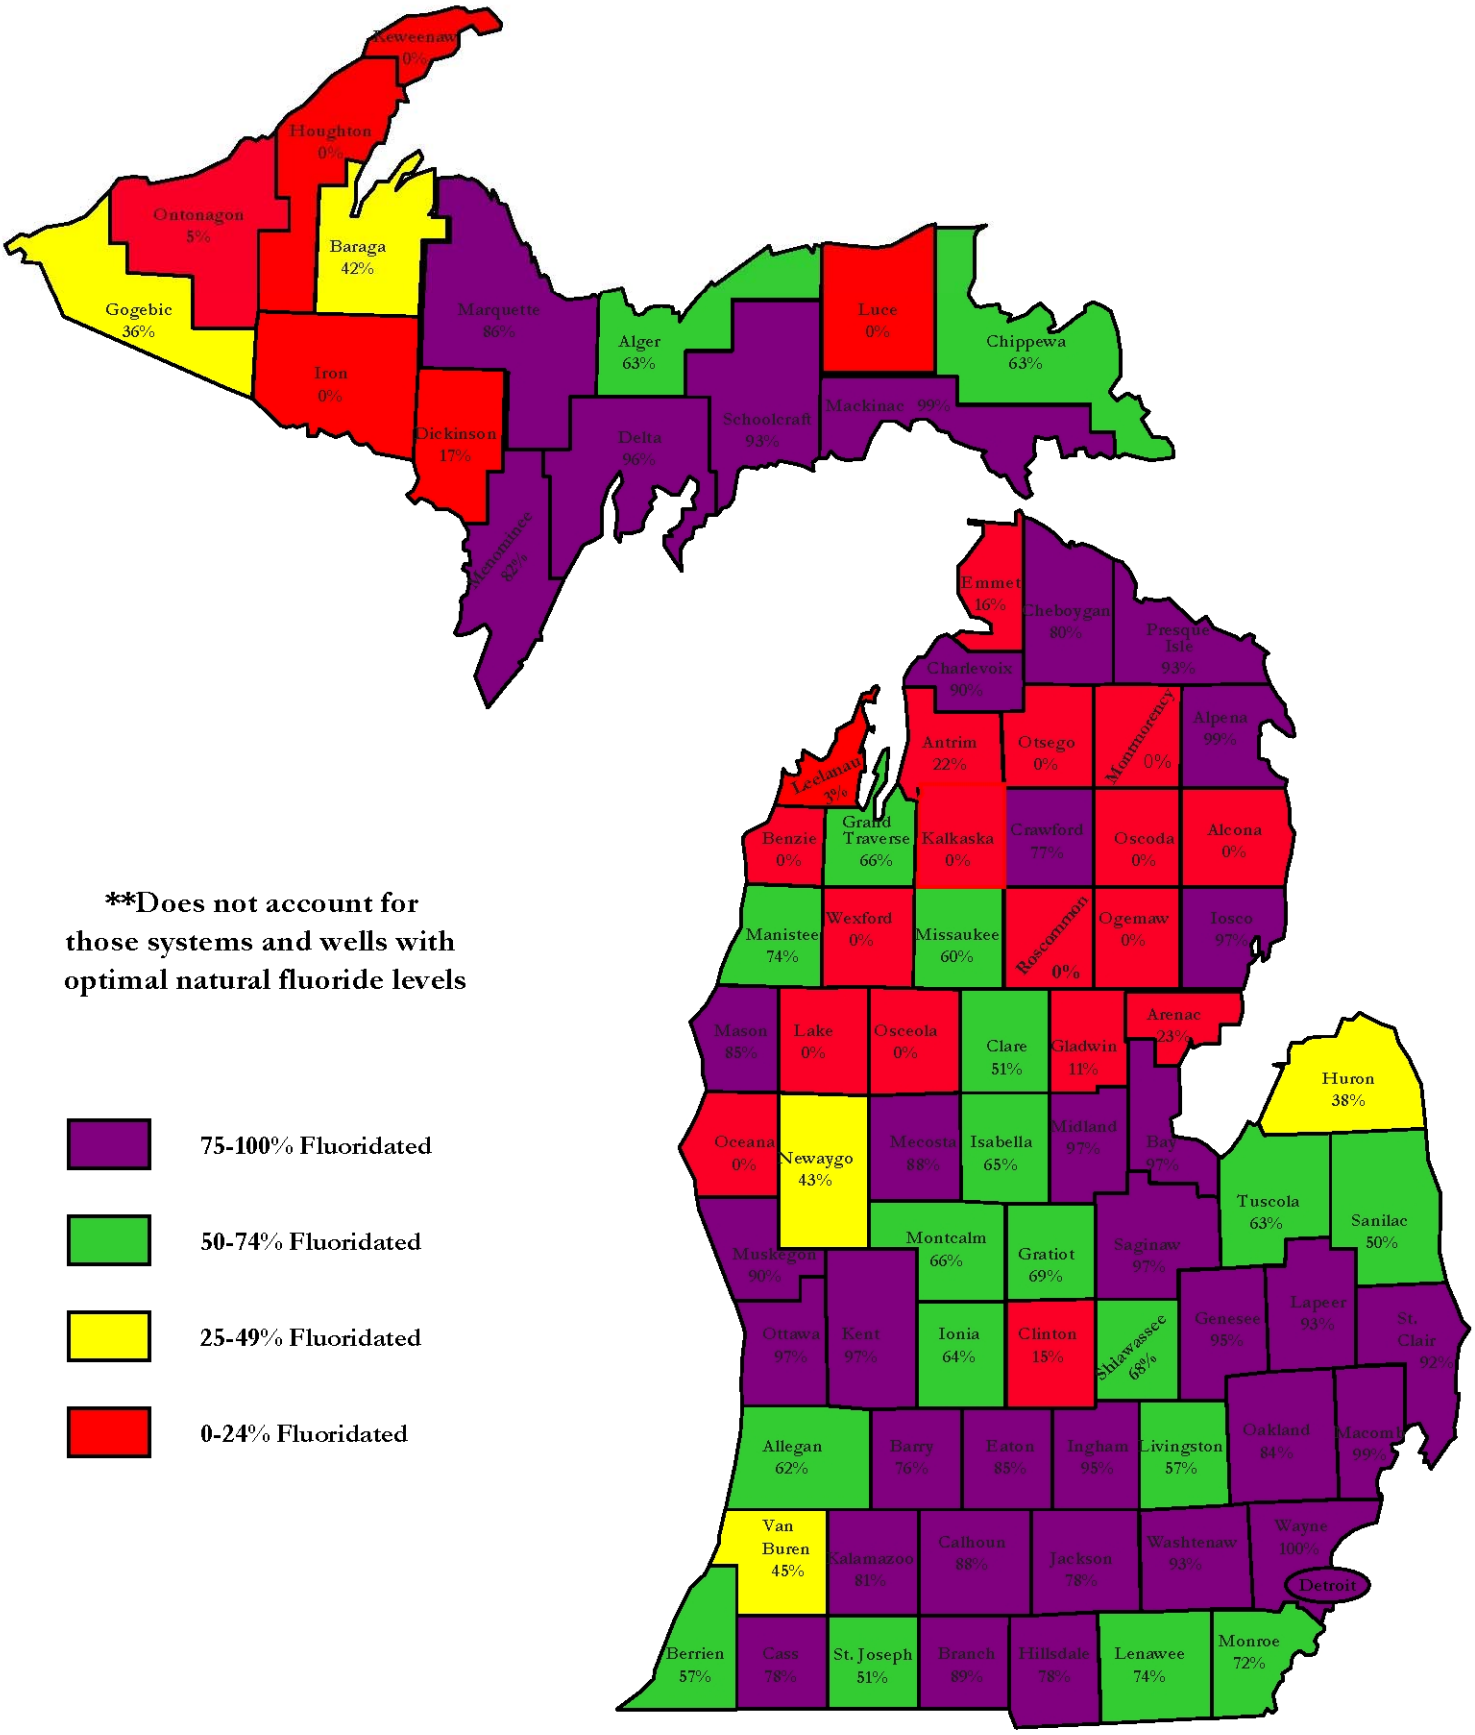

**Does not account for those systems and wells with optimal natural fluoride levels

- 75-100% Fluoridated
- 50-74% Fluoridated
- 25-49% Fluoridated
- 0-24% Fluoridated

Michigan Department of Community Health and Water Fluoridation Reporting System CDC 2009