
Subject

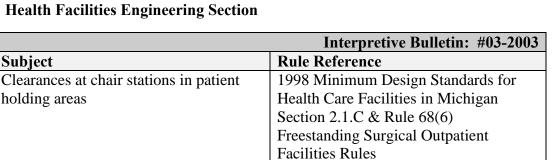

January 29, 2003

Interpretive Bulletins are released by the Health Facilities Engineering Section to clarify sections of the 1998 Michigan Design Standards for Health Care Facilities in Michigan and when research, experience, or technology illustrates present regulations do not adequately address the specific instances or circumstances in the health care environment.

Date

The 1998 Minimum Design Standards require a clearance of at least 4 feet between beds, stretchers or chairs and at least 4 feet between an adjacent wall and the side of a bed, stretcher or chair. In addition, the 1998 Minimum Design Standards and the FSOF rules both require chair stations to provide at least 50 square feet (sf) of clear floor area in patient holding (does not apply to dialysis treatment areas).

We will accept only a 3 foot clearance (versus the above rule which requires a 4 foot clearance) on either side of a chair station in patient holding areas based on:

- 1. In most situations our staff has historically required 3 feet clearances on either side of beds, stretchers, or chairs for equipment, emergency access, and to prevent transmission of disease via droplet nuclei;
- Combining the requirements of 50 s.f. of clear floor area and 4 foot 2. clearances could produce unusably shaped or excessively large cubicles;
- 3. Chair stations are typically assigned only to cases with no expectation of the patient requiring emergency resuscitation;
- 4. Using 3 foot side clearances with additional chair stations on each side will still produce a chair station with minimum dimensions of 6'-0" by 8'-4" deep, which is deemed to be appropriate and usable for the expected functions.