
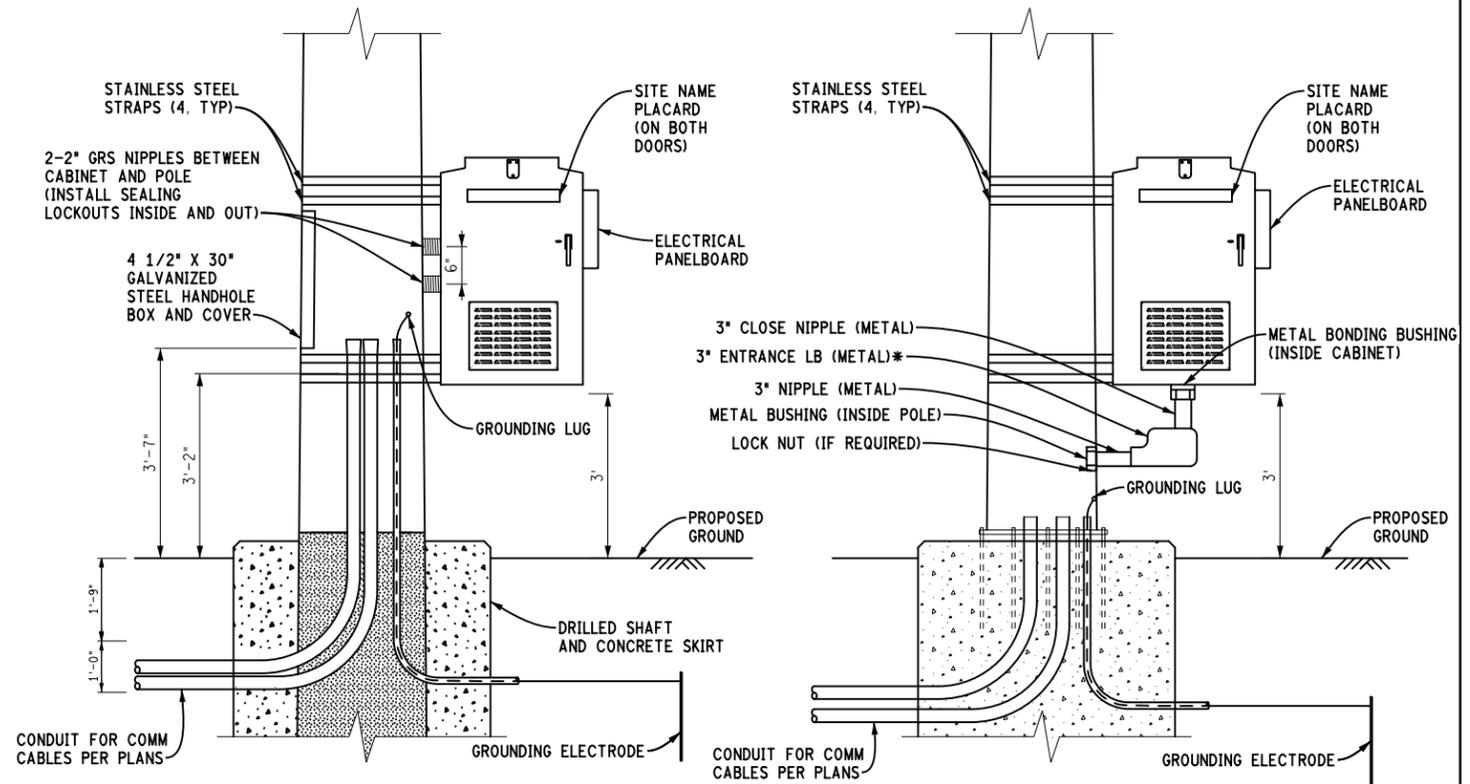


NOTE: REQUIRED SUNSHIELD NOT SHOWN FOR CLARITY

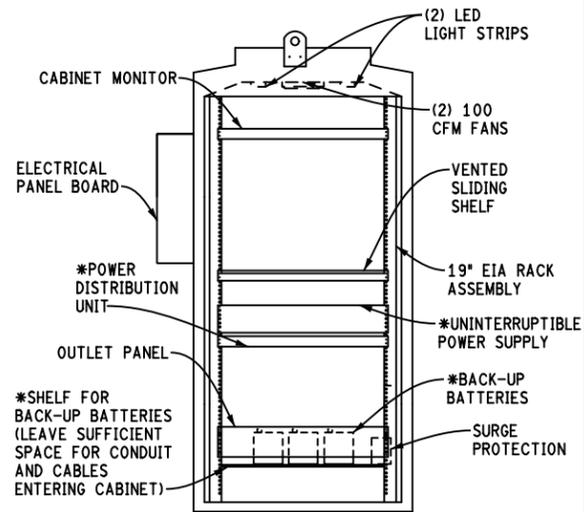


\*DRILL 1/8" MIN. WEEP HOLE IN LOWEST POINT OF LB

**NOTES:**

- INSTALL THE NUMBER, SIZE, AND TYPE OF CONDUIT(S) FOR COMMUNICATIONS AND POWER AS SHOWN IN THE PLANS. DETERMINE THE APPROACH/ENTRY ANGLE TO FOUNDATIONS BASED ON SITE CONDITIONS. THE NUMBER AND LOCATION OF CONDUIT SWEEPS SHOWN IN THIS DRAWING ARE DIAGRAMMATIC.

**CABINET WIRING DIAGRAM**

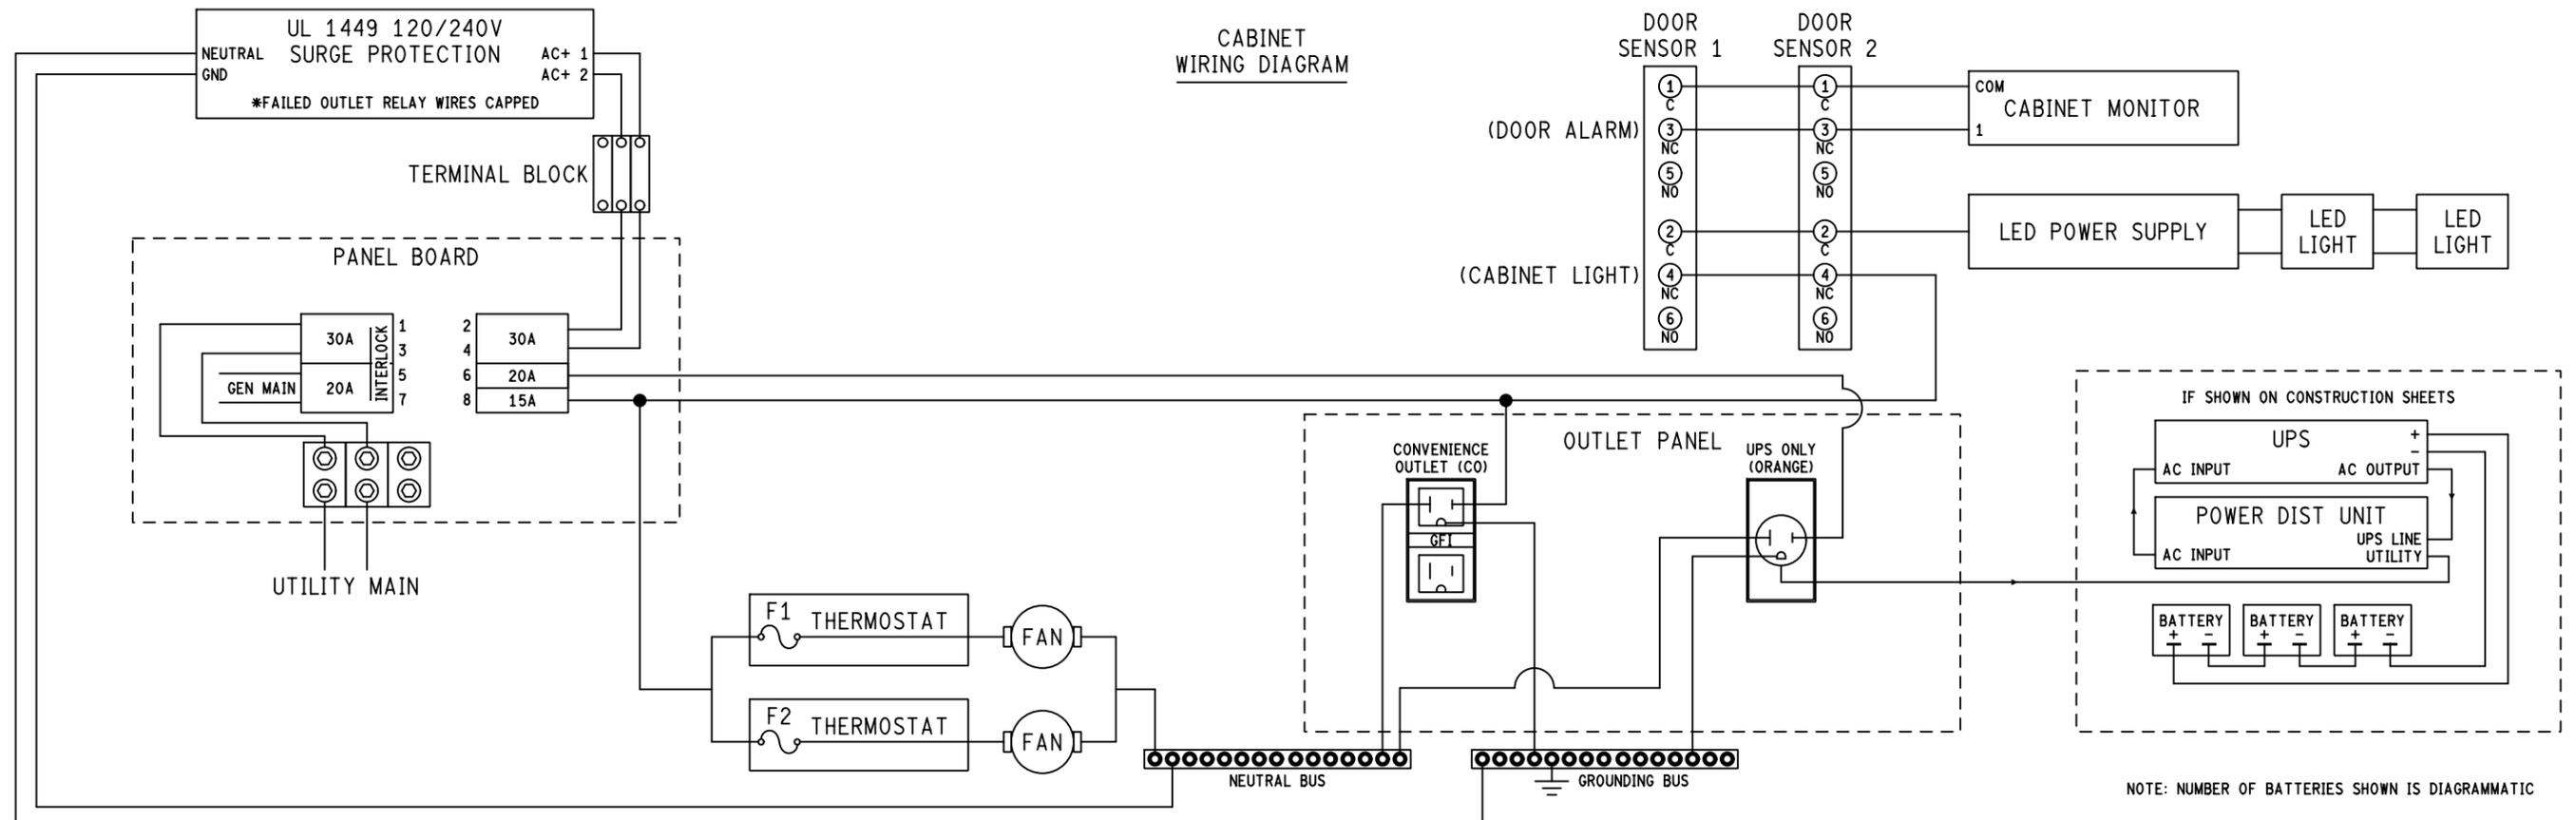

FINAL ROW PLAN REVISIONS				(SUBMITTAL DATE: )			
NO.	DATE	AUTH	DESCRIPTION	NO.	DATE	AUTH	DESCRIPTION



**NO SCALE**

PRINT DATE: 8/1/2014  
FILE: ITS Cabinet, Pole-Mtd.dgn

DATE:  
DESIGN UNIT:  
TSC:

CS:  
JN:

ITS CABINET, POLE-MOUNTED

SHEET 1 OF 1

DRAWING SHEET