FIG1_SitePlan_MPART Figure_2021 / stephenp 3/1/2021

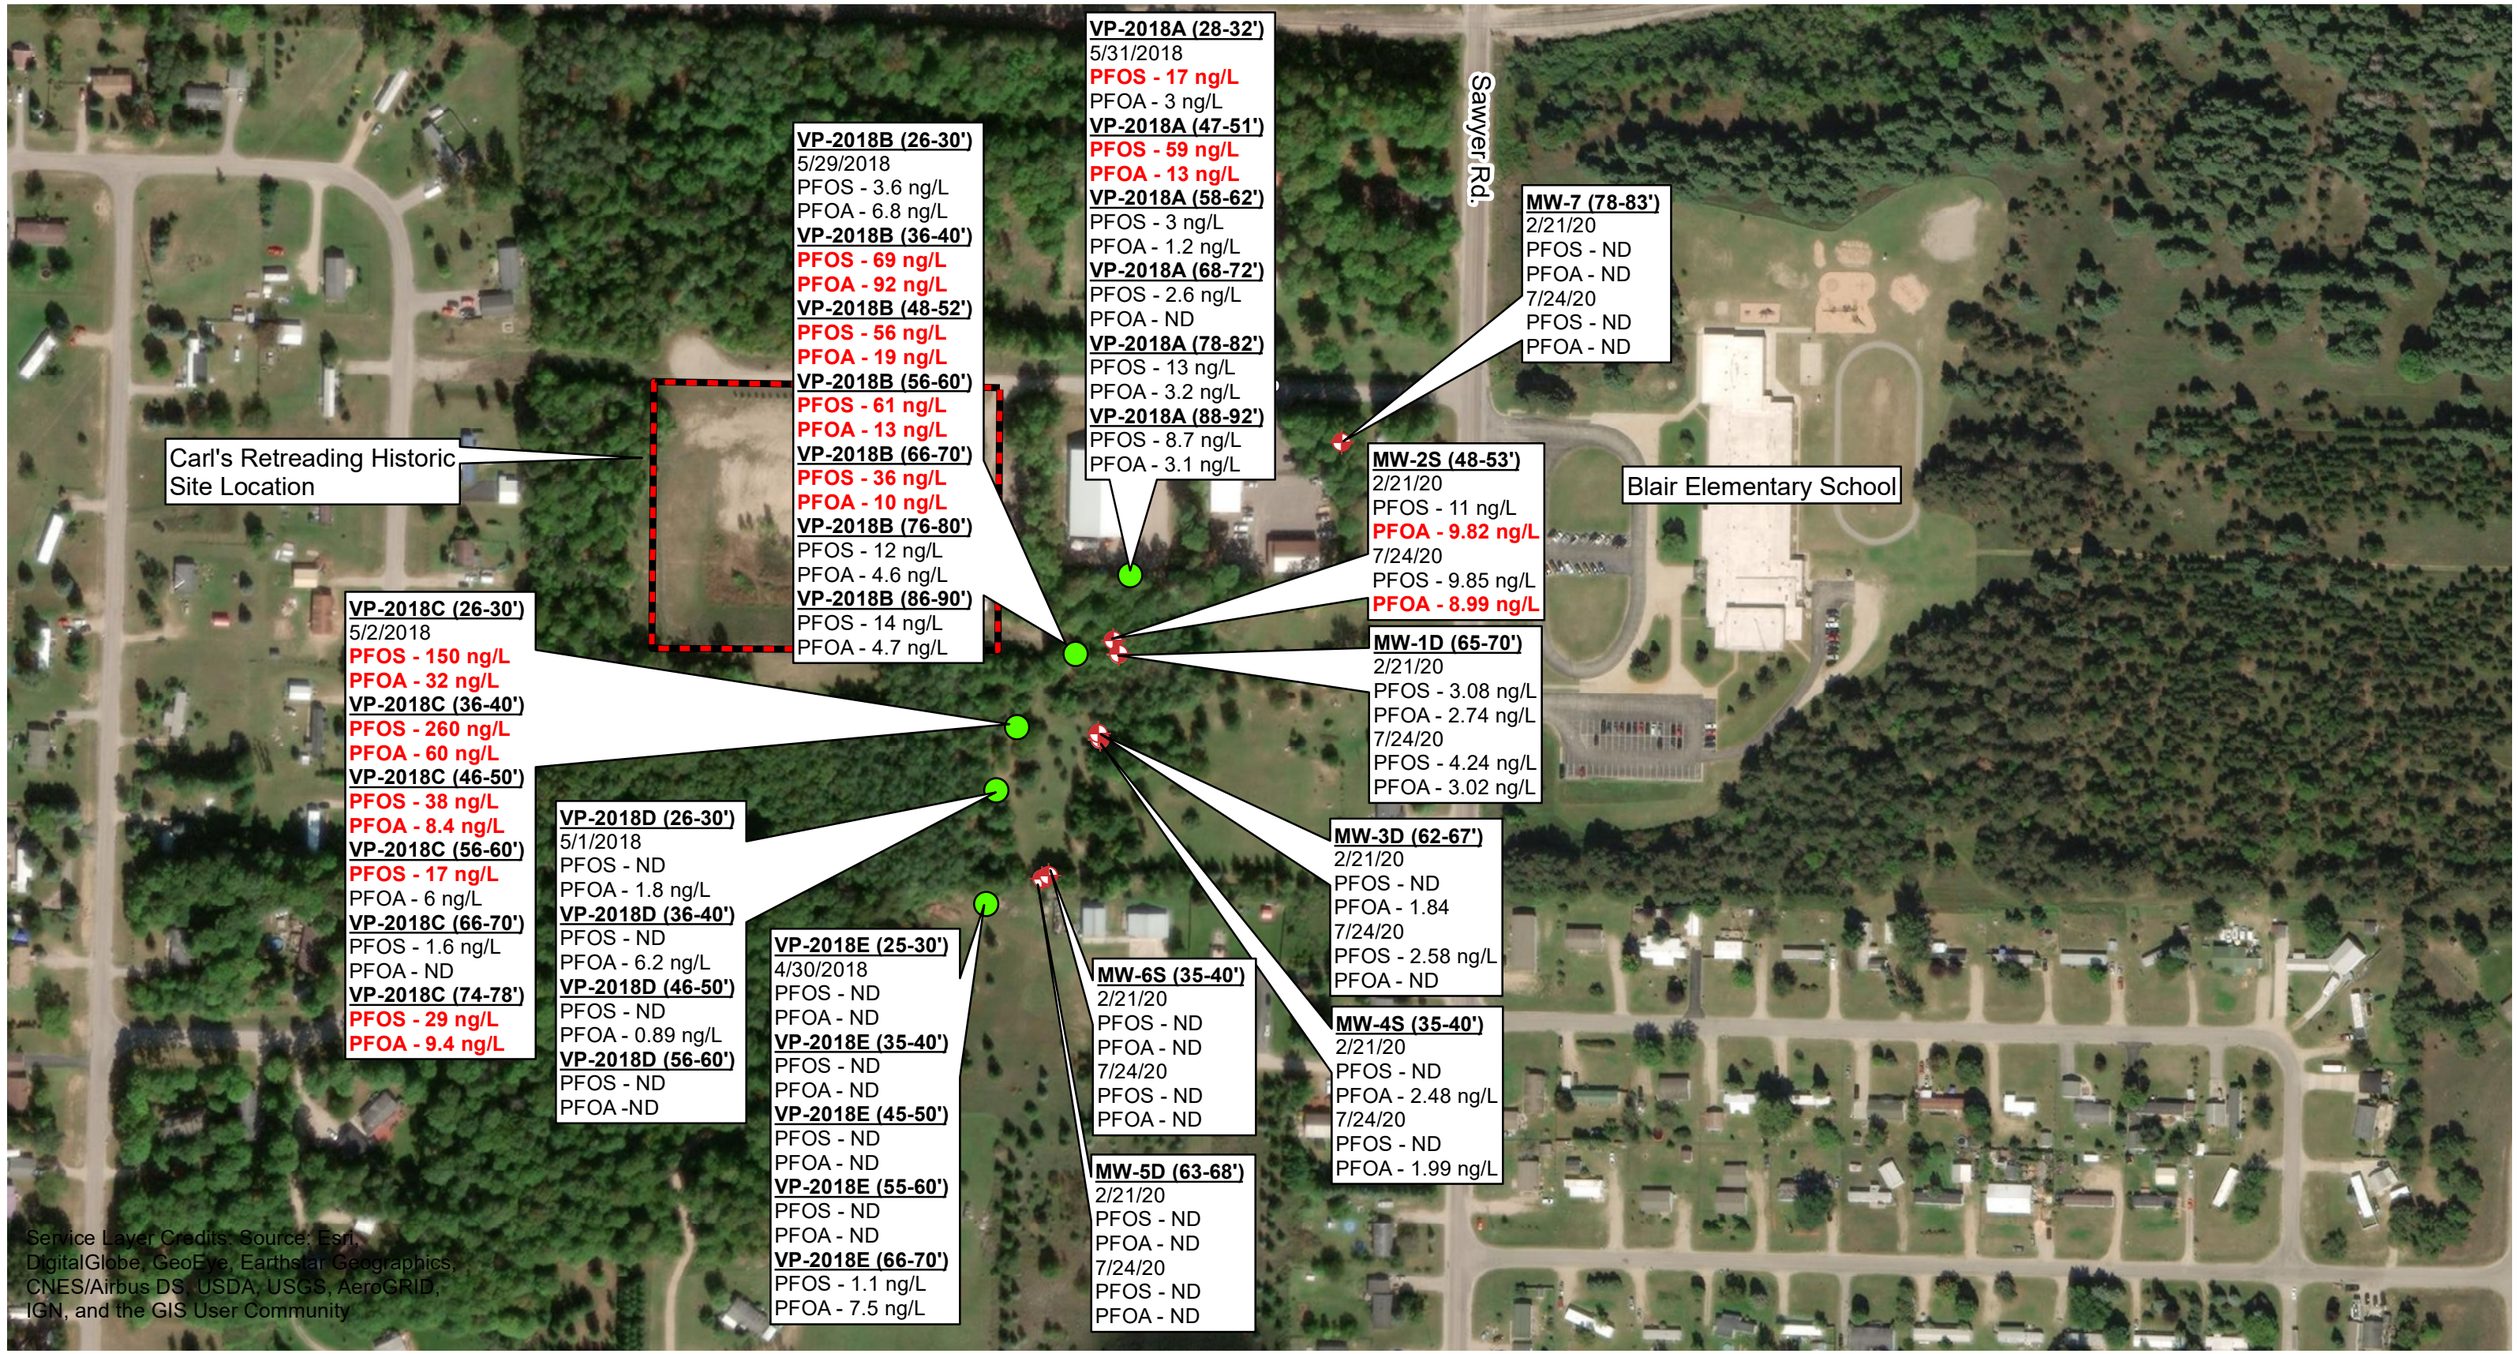

NORTH

0 220 440

SCALE IN FEET

Legend

Monitoring Well Location

EGLE Groundwater Sample Location

ND indicated analyte was Not Detected.

Bold/red concentrations exceed current EGLE Drinking Water Criteria.

PFOA/PFOS concentrations reported in nanograms/liter (parts per trillion).

5175 SAWYER WOODS DR.
GRAWN, GRAND TRAVERSE CO., MI
CARL'S RETREADING

FIGURE 1 - SITE MAP & GW ANALYTICAL

F&V PROJECT NO. 838140

F&V