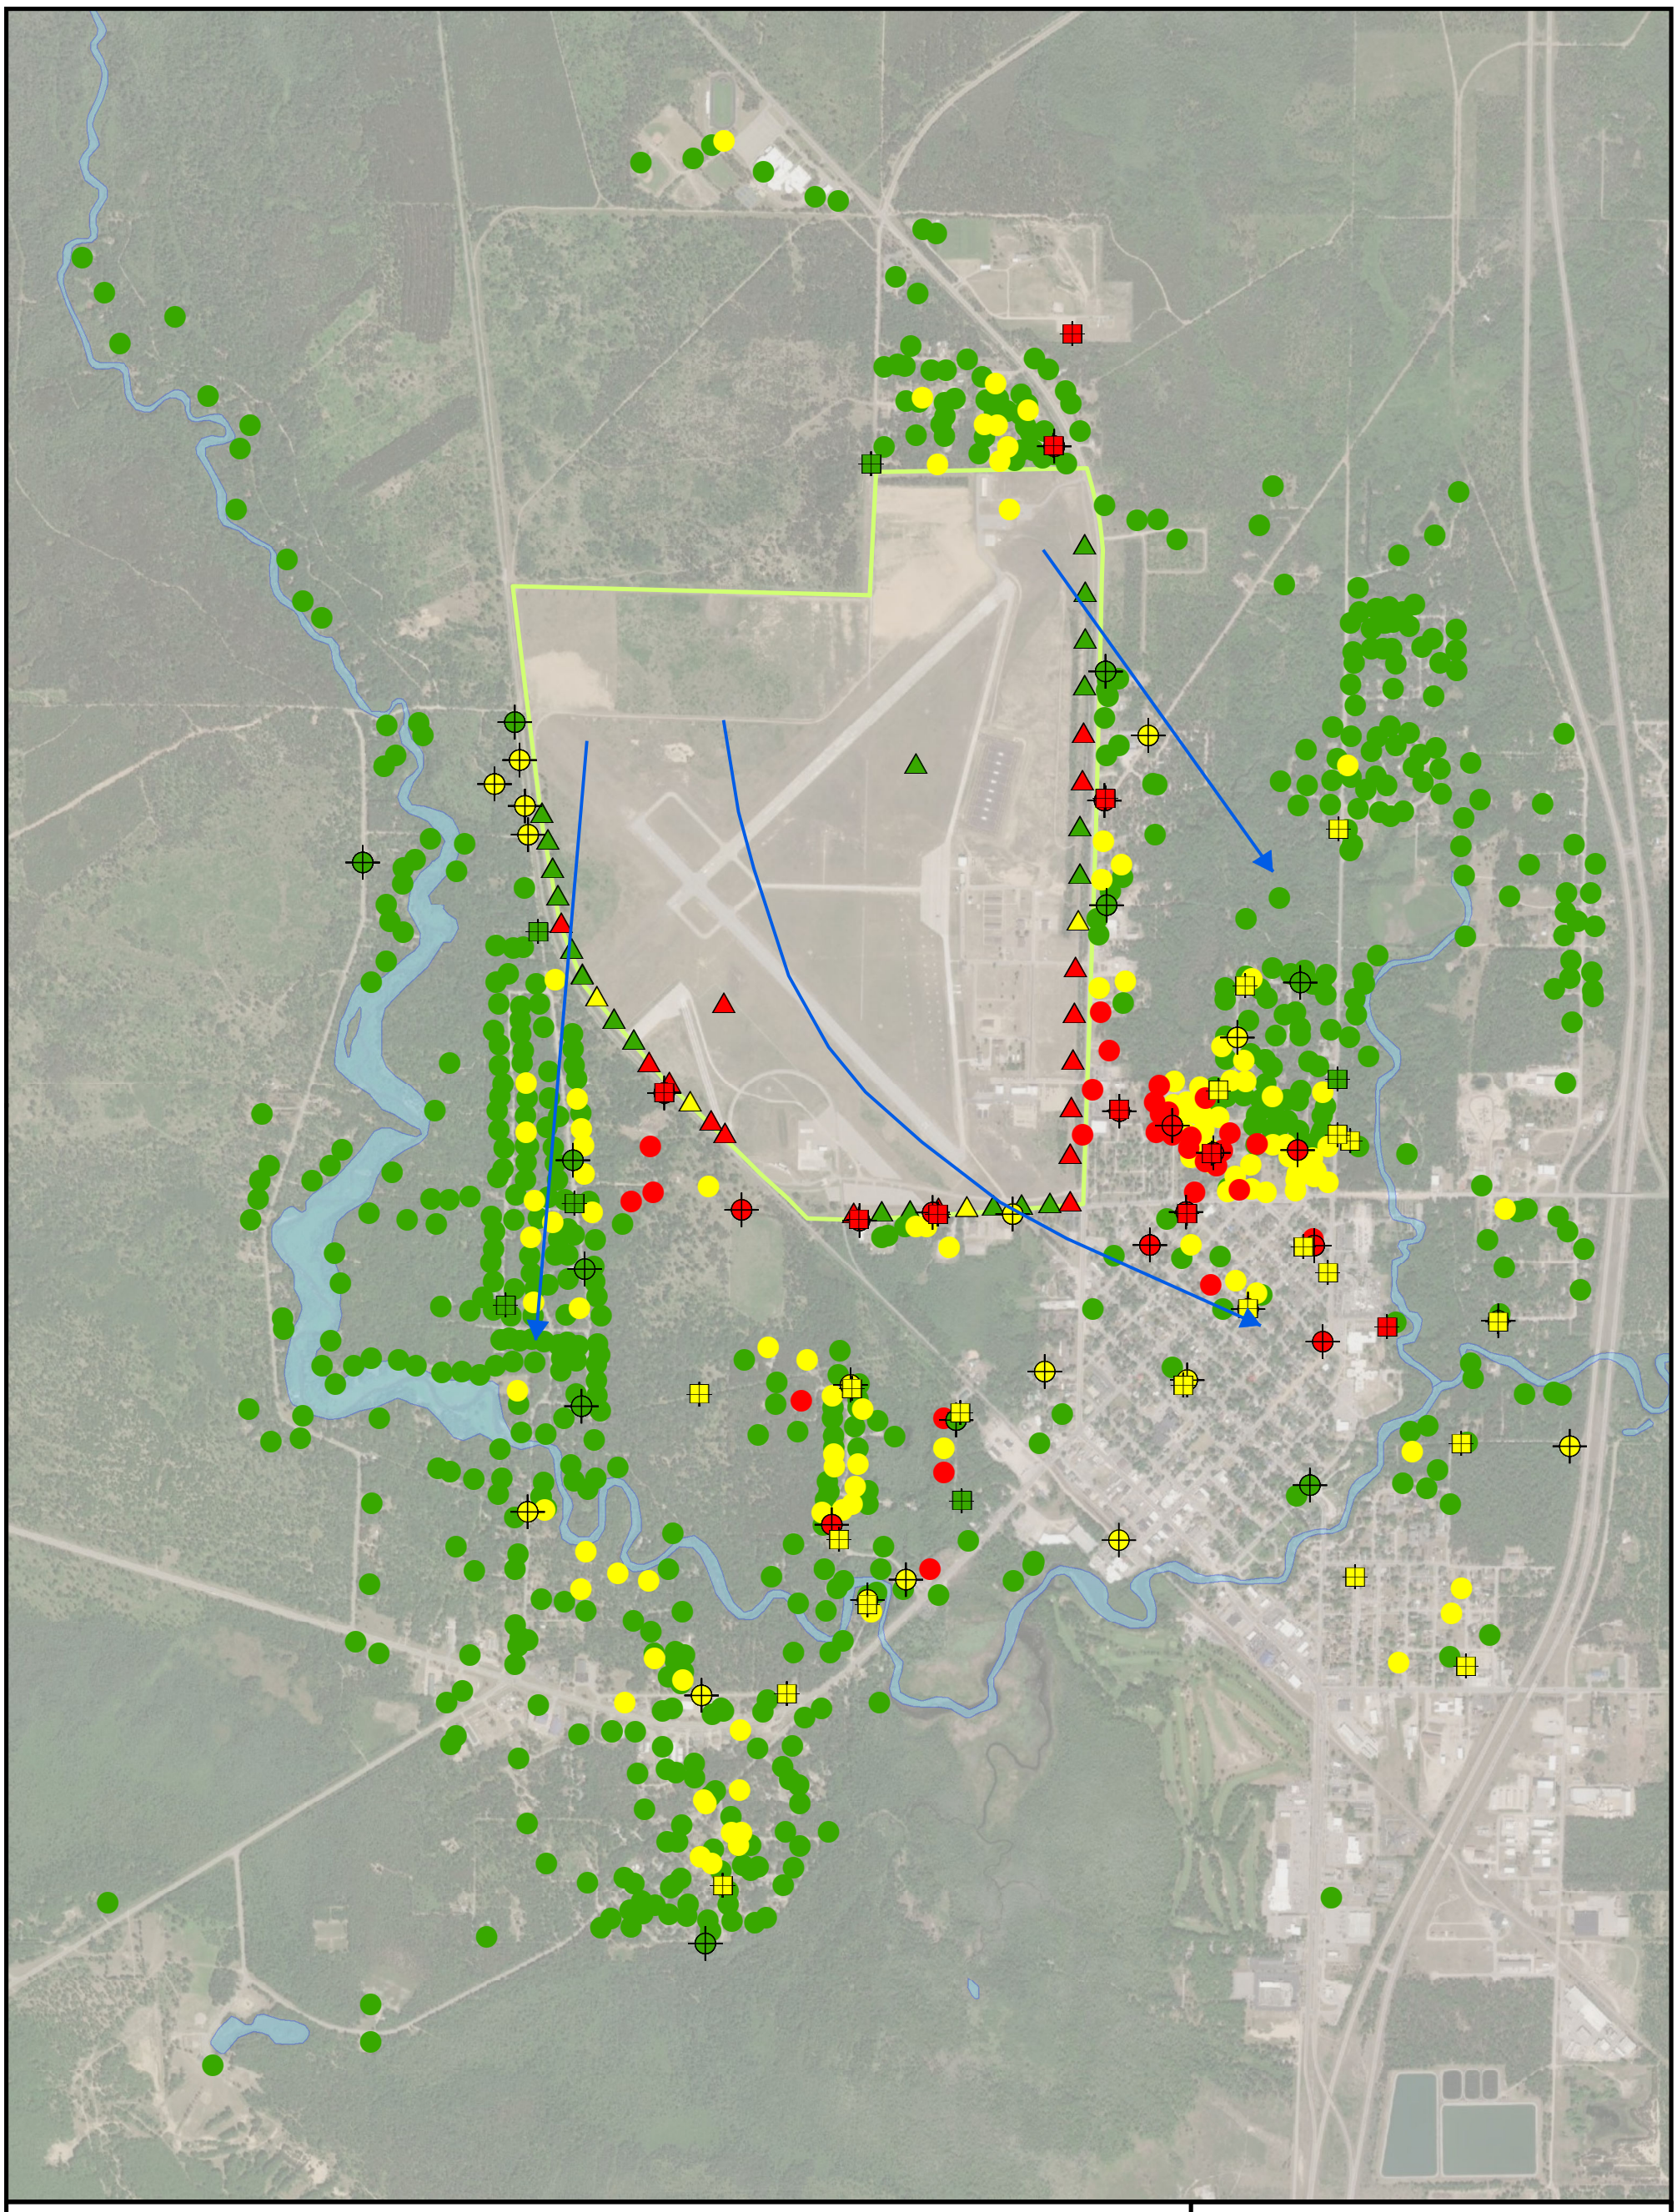

Legend - PFOS (ppt)

Residential Sample (731 Samples)
- Results Pending (0)
- Non-Detect (593)
- > 0 - 16 (109)
- > 16 (29)

*Drinking Water Health-based Value (PFOS = 16 ppt)

Monitoring Well Sample (727 Samples)
- Non-Detect (528)
- > 0 - 16 (122)
- > 16 (77)

VAS Sample (210 Samples)
- Non-Detect (132)
- > 0 - 16 (51)
- > 16 (27)

Previous VAS Sample (120 Samples)
- Non-Detect (78)
- > 0 - 16 (12)
- > 16 (30)

GRAYLING AIRFIELD
SAMPLING RESULTS
PFOS HEAT MAP

GRAYLING AREA PFAS
CRAWFORD COUNTY, MICHIGAN

EGLE

N

0 0.25 0.5 1 Miles

Prepared: 4/7/2021

Y:\DCS\GIS\ArcMap_GeoDB_Projects\ENV\GIS_Data\GIS\Camp_Grayling\MXDs\GAAF_HBV_Heatmaps\Grayling_PFOS_HeatMap_HBV.mxd