


# Public Water Supply PFAS Notification Protocol

Revised January 14, 2019



• Total tested PFAS compounds is limited to the 14 analytes included in US EPA Method 537 Rev. 1.1  
 • The first two categories (green, orange) depict a gradation in monitoring and exposure management, and are not related to public health actions

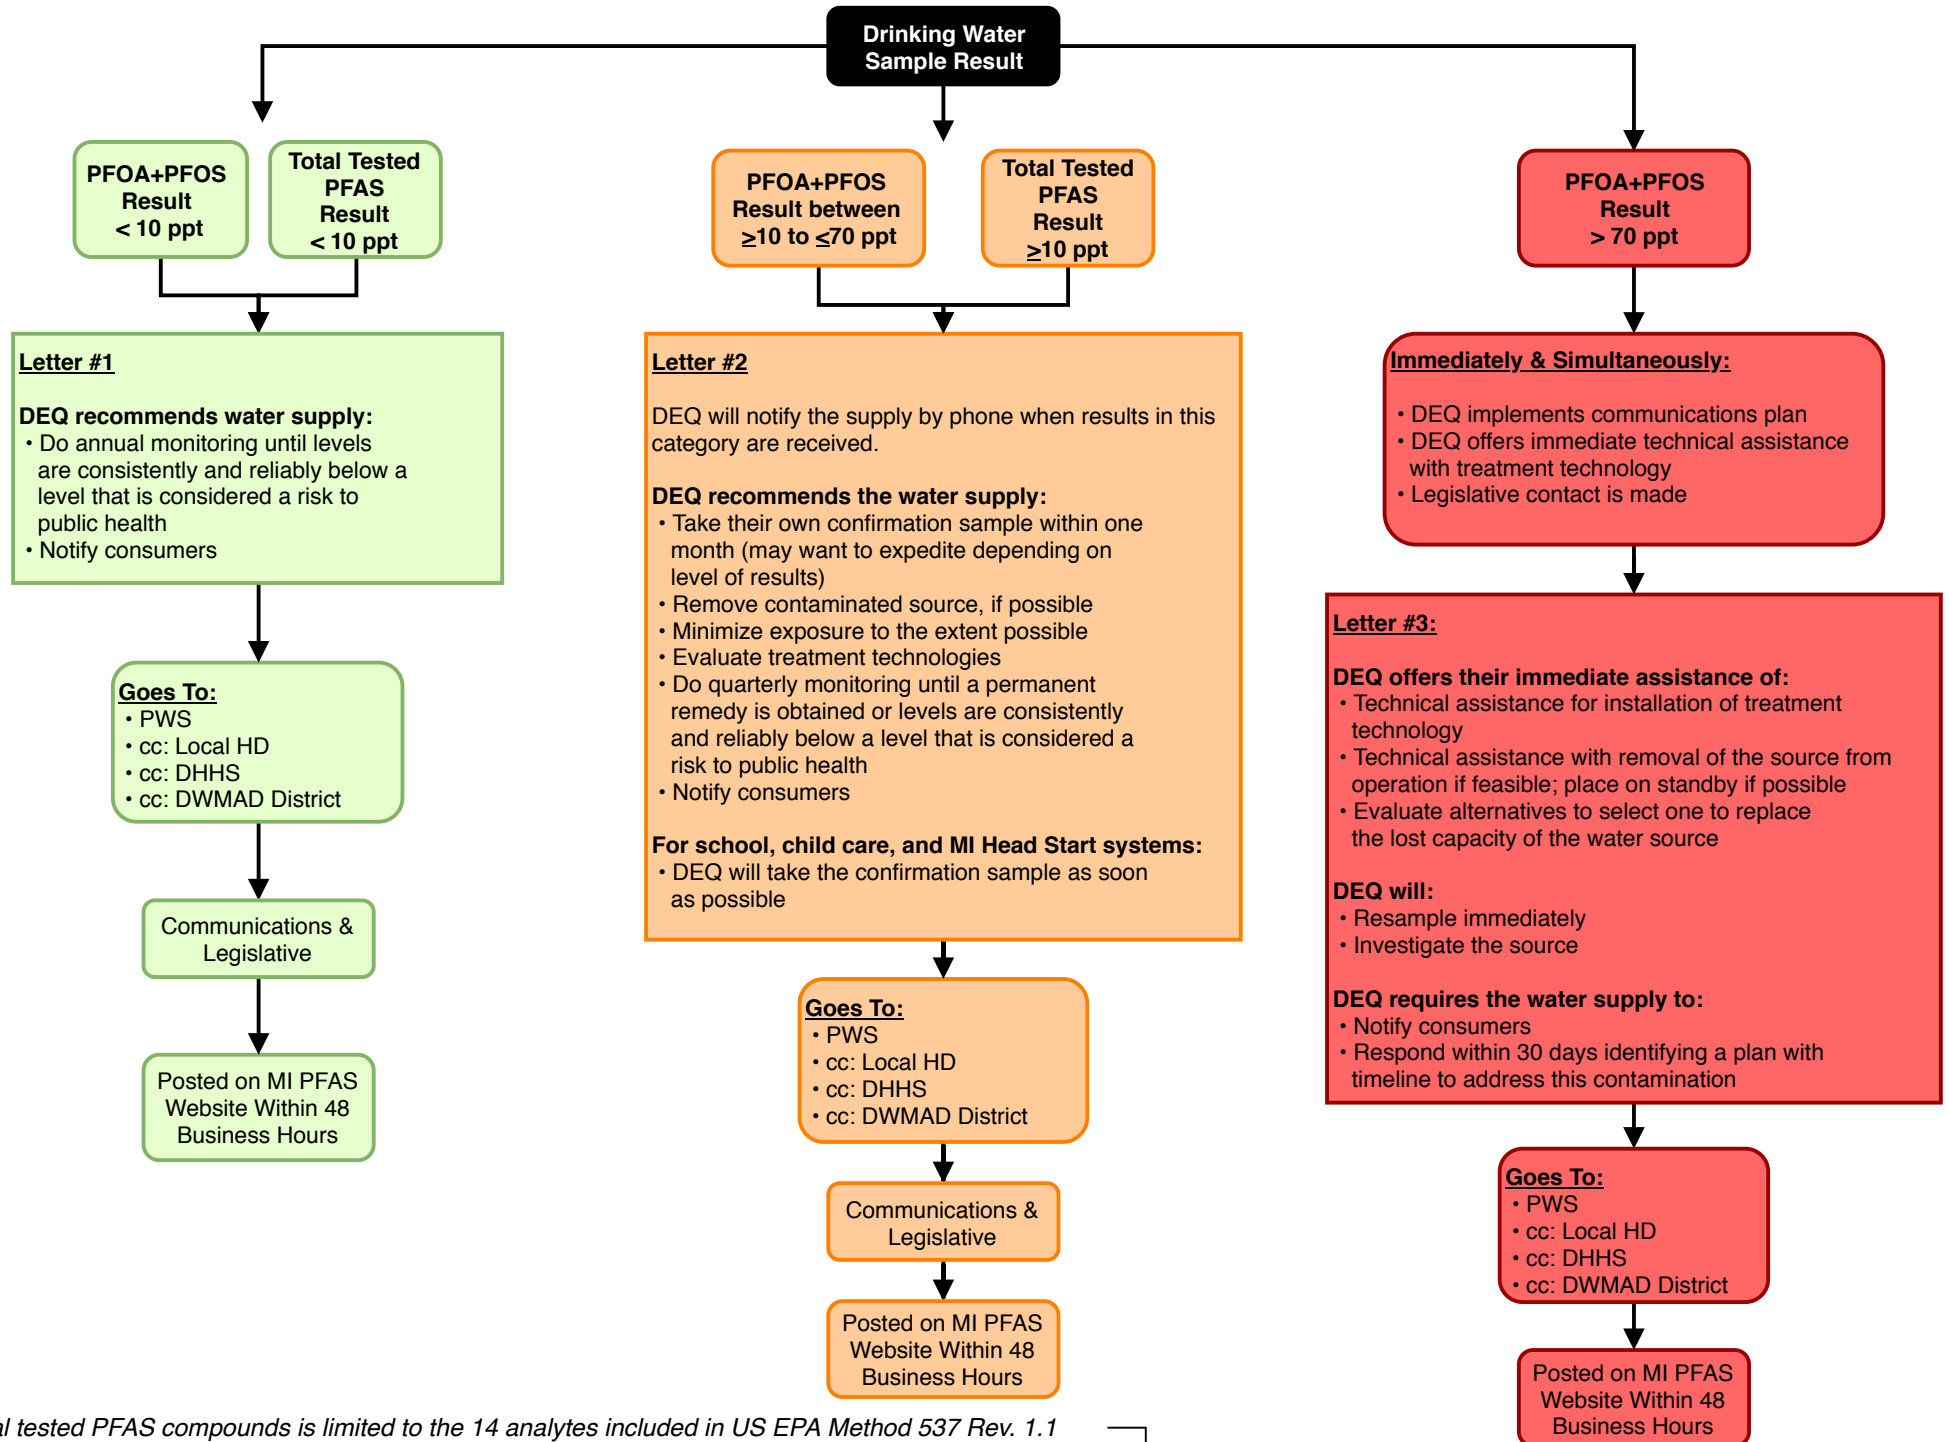