


Plainfield Water Treatment Plant - Filter GAC Pilot Study
FIGURE 1 - PFOS + PFOA, EPA Method 537 vs L402

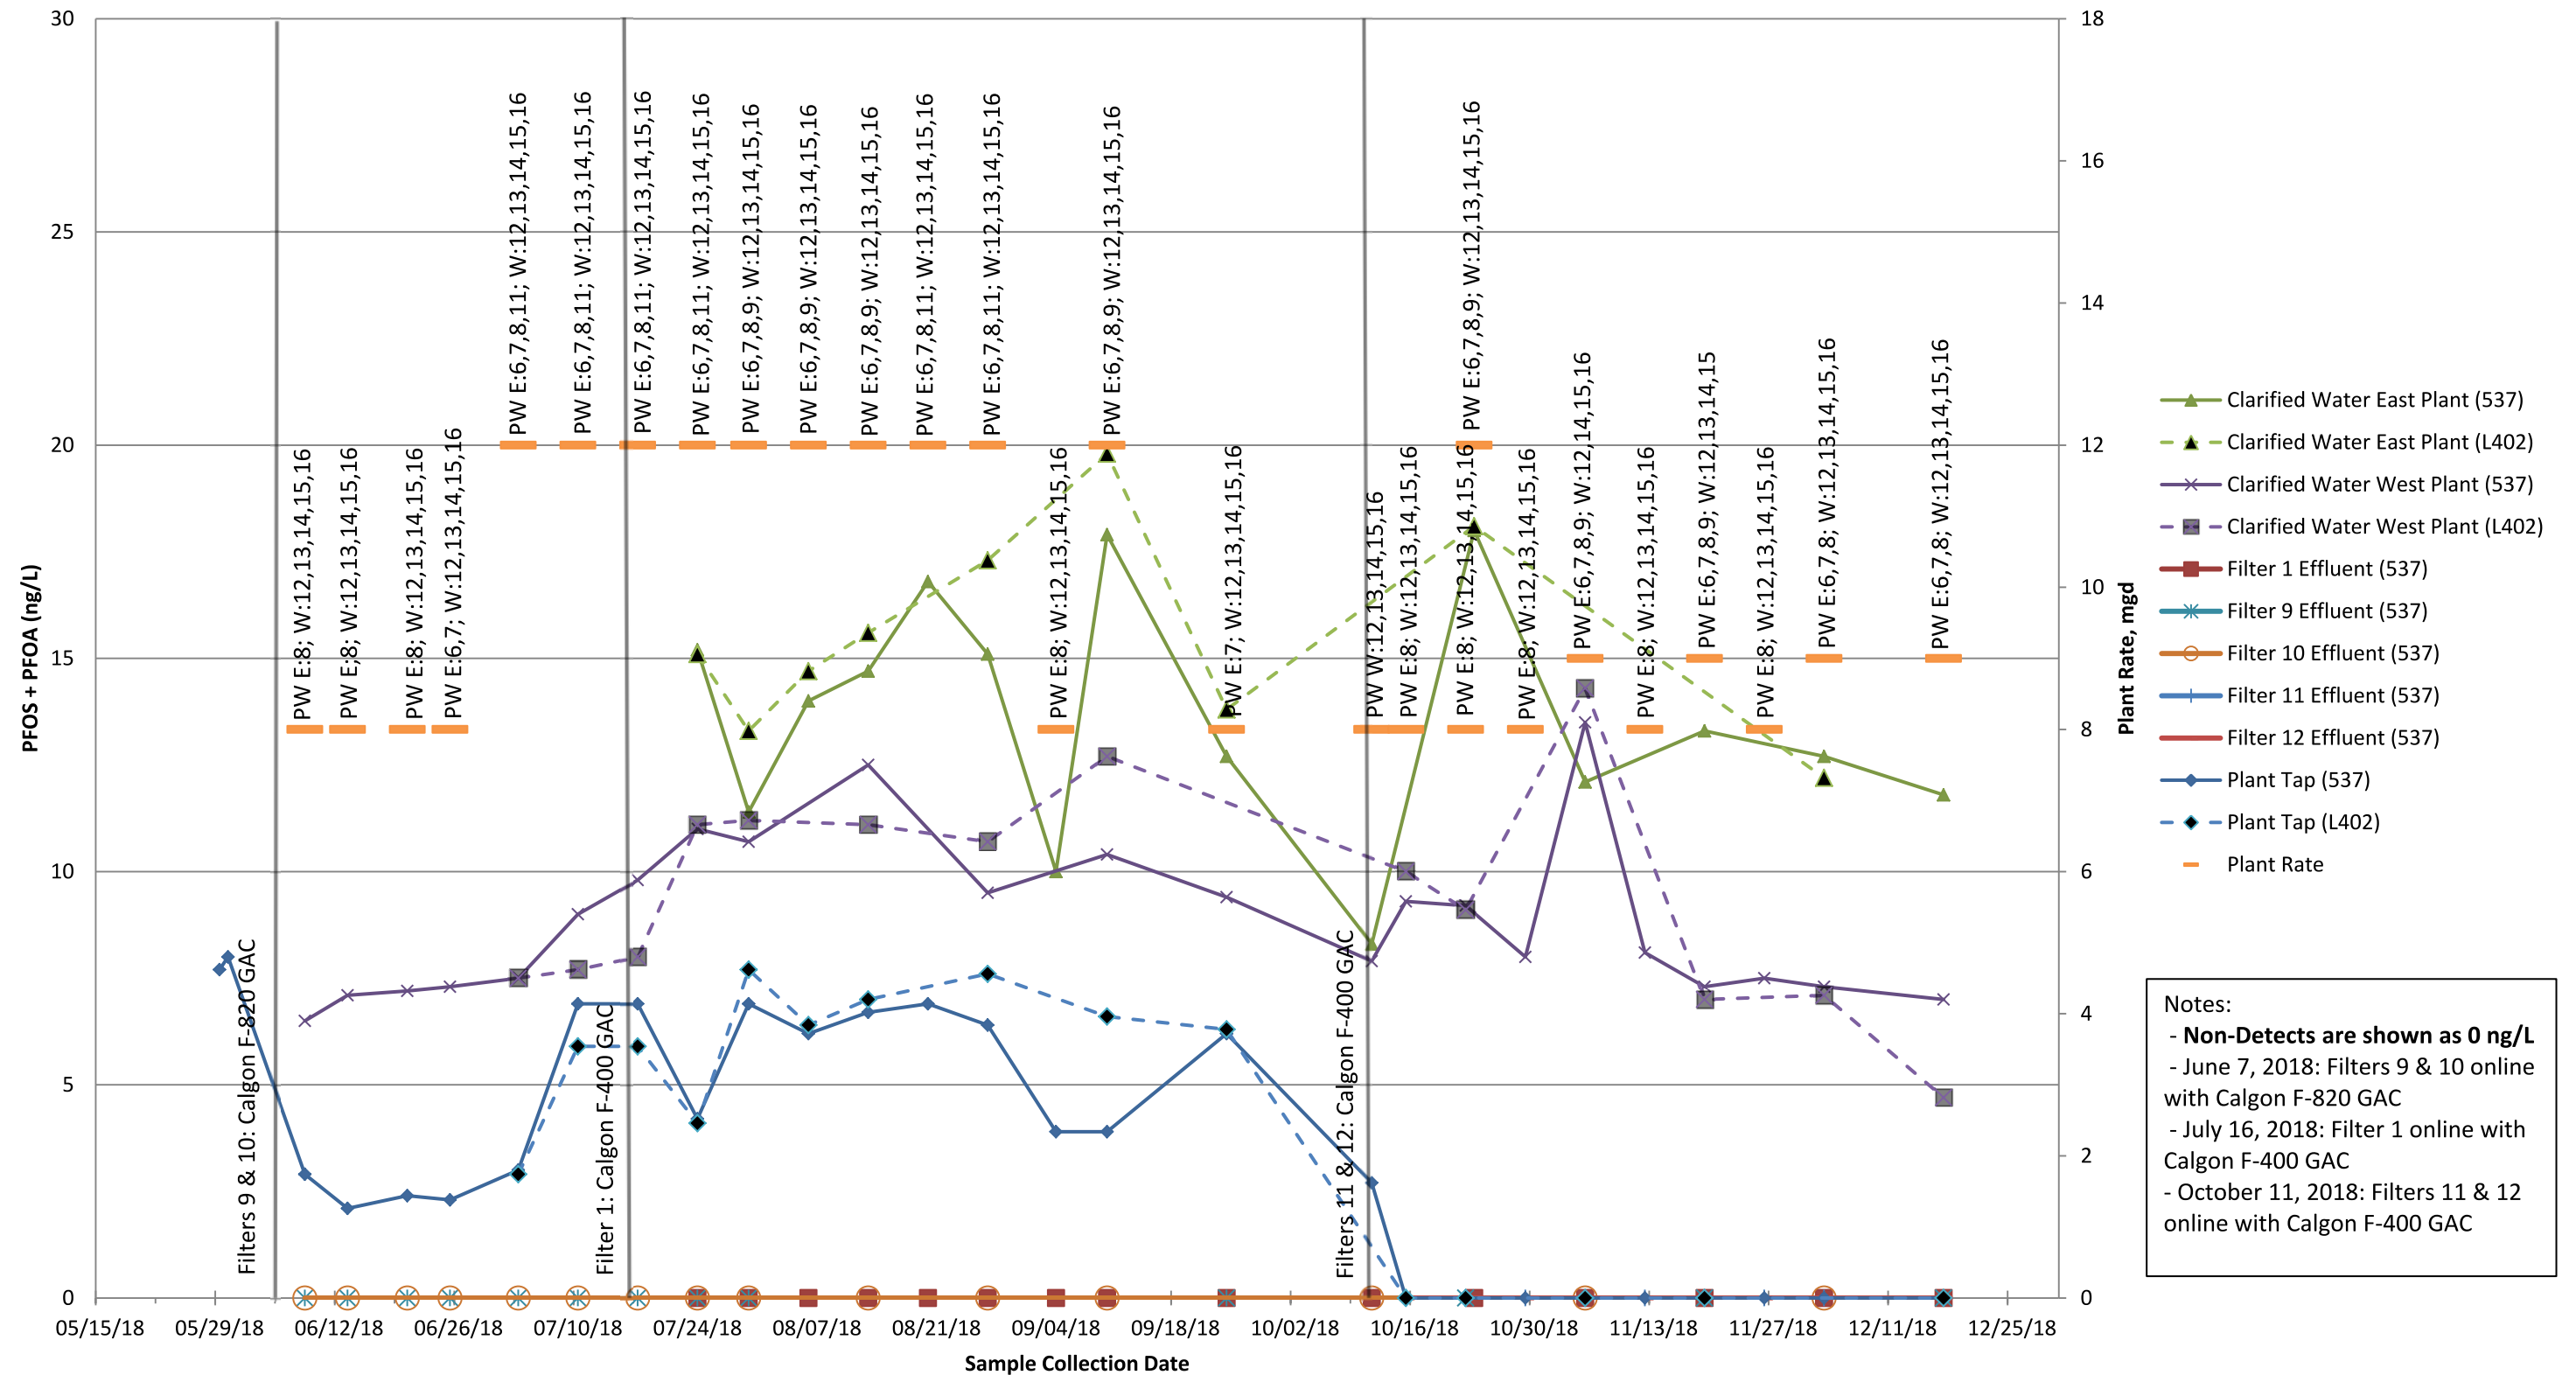

Notes:
 - Non-Detects are shown as 0 ng/L
 - June 7, 2018: Filters 9 & 10 online with Calgon F-820 GAC
 - July 16, 2018: Filter 1 online with Calgon F-400 GAC
 - October 11, 2018: Filters 11 & 12 online with Calgon F-400 GAC