


CONFIRMING LEAD ELIMINATION AFTER REPLACEMENT (CLEAR)

Monitoring results for Flint homes with replaced pipes



*100% OF THE SAMPLES MET THE 15 PPB FEDERAL ACTION LEVEL FOR LEAD

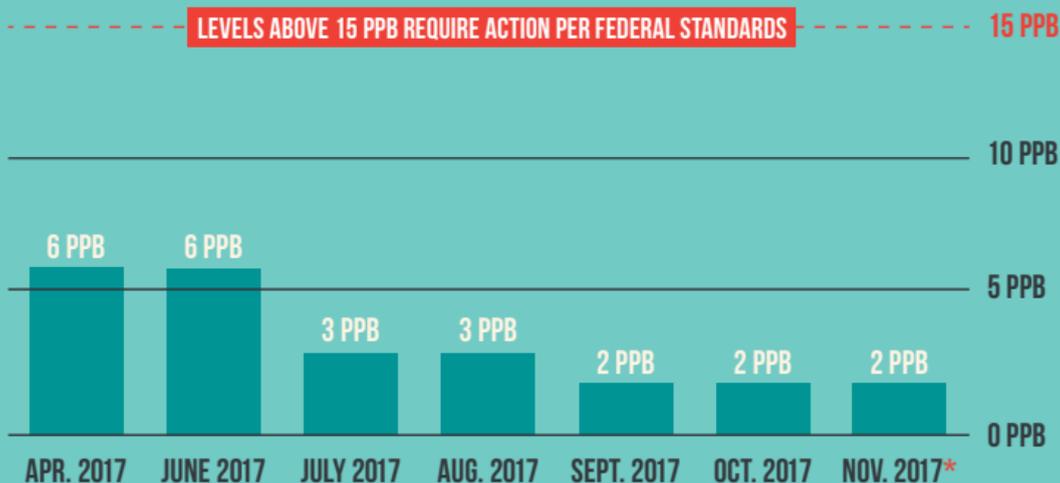