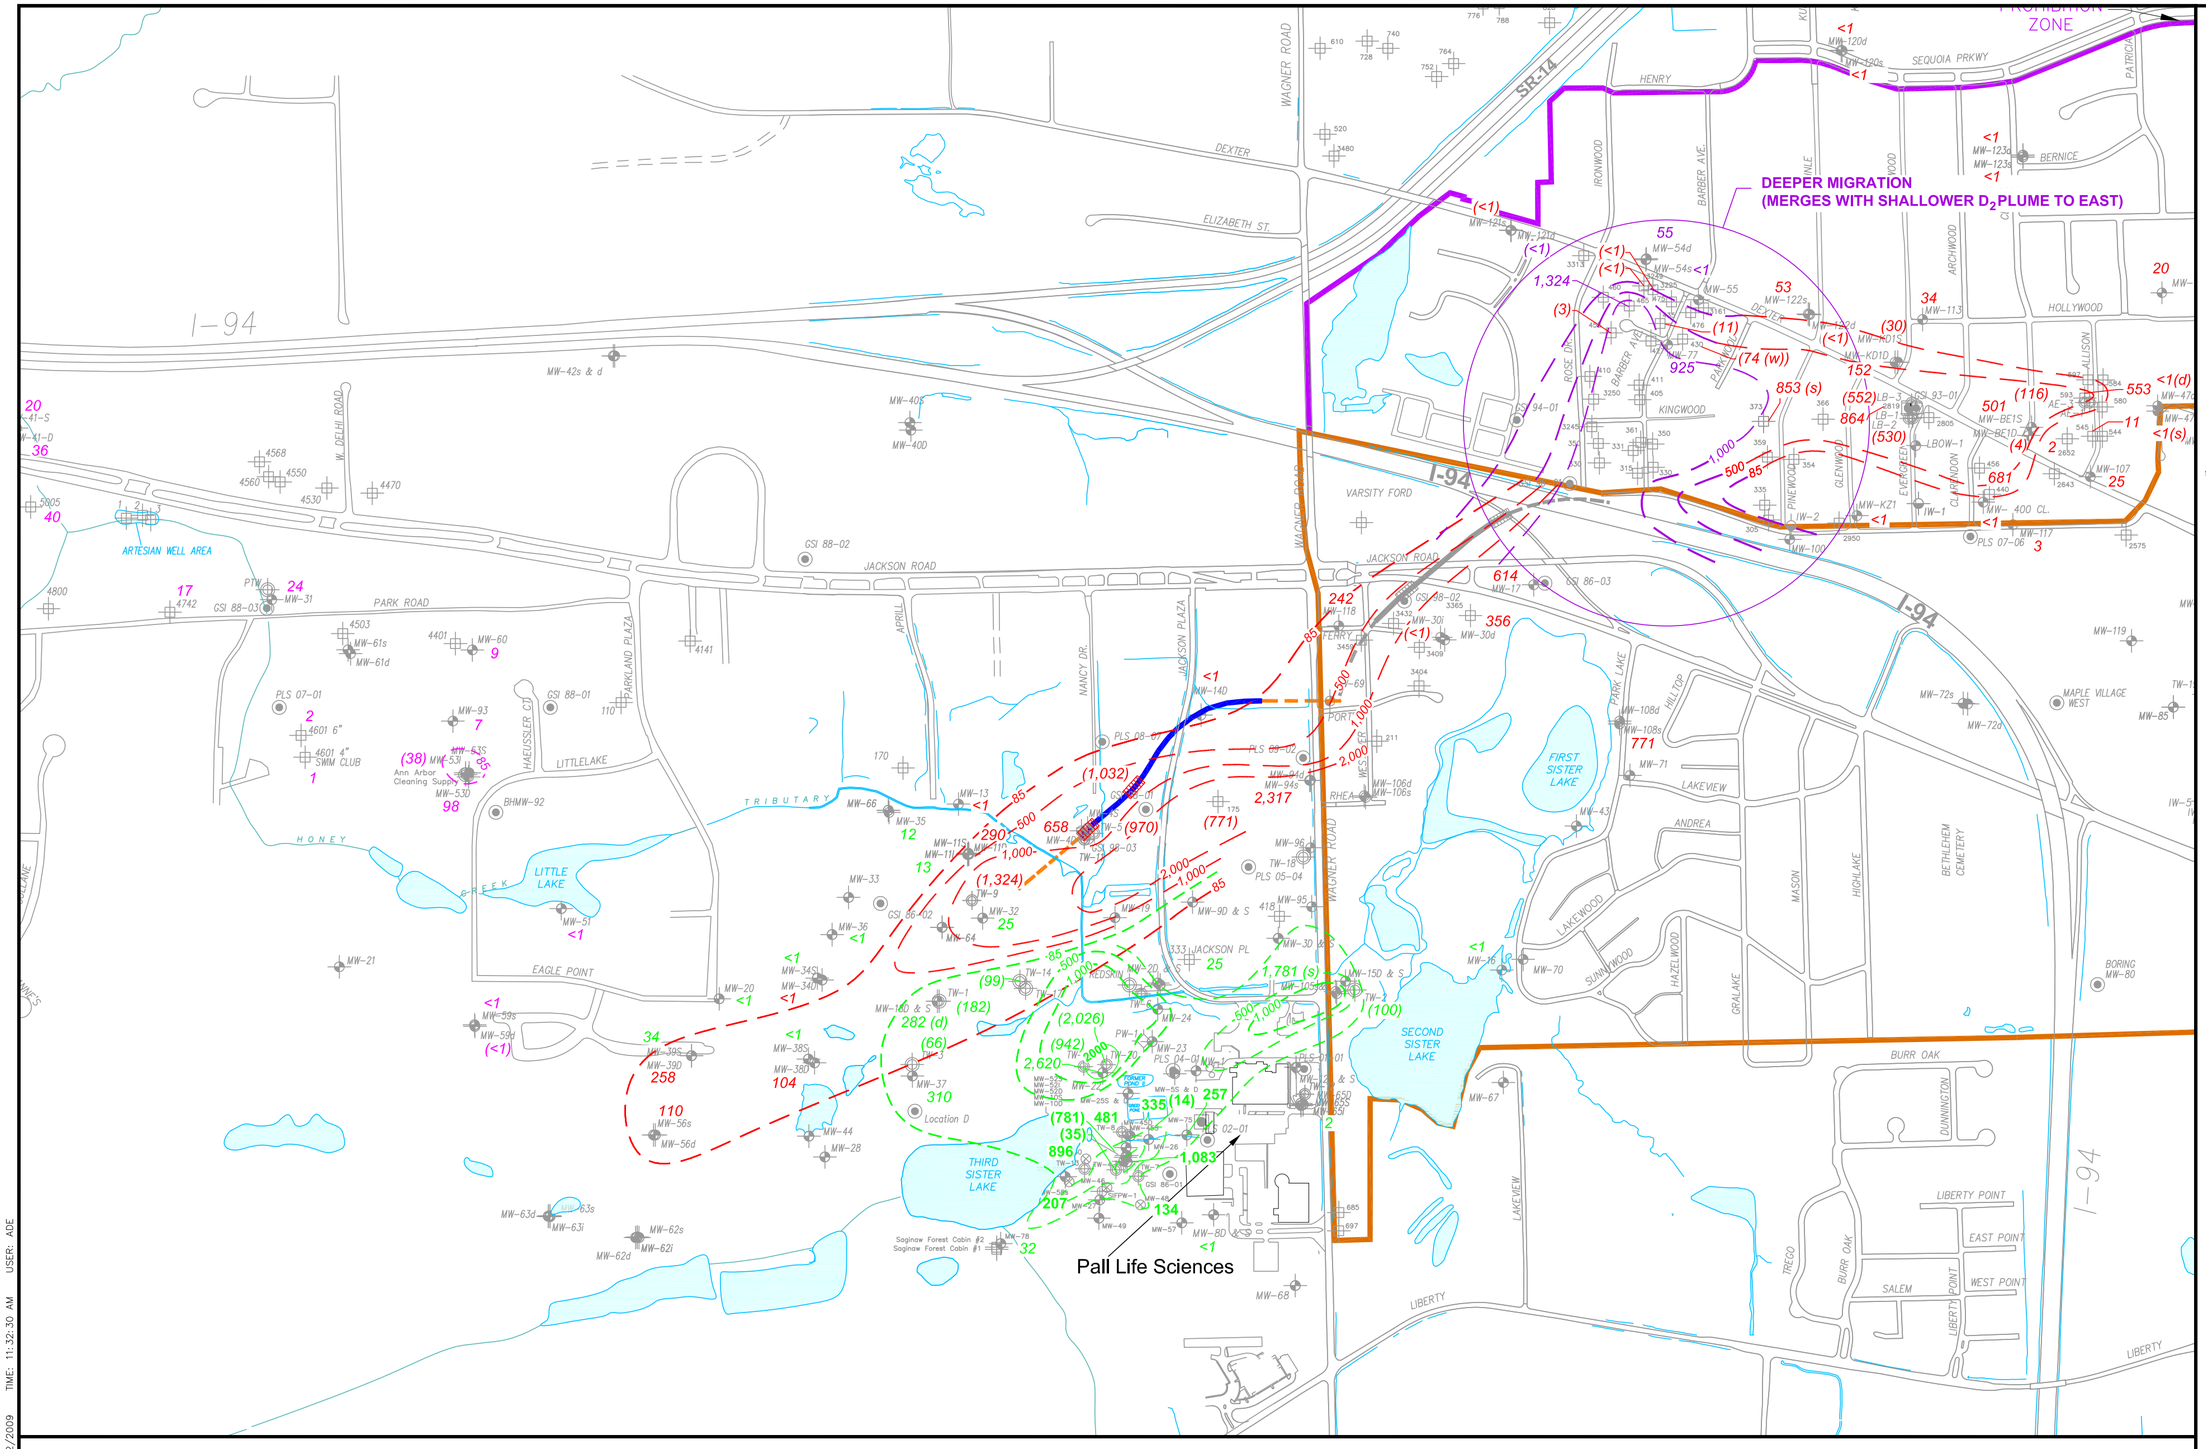

LEGEND

- MONITOR WELL
- RESIDENTIAL WELL
- PURGE WELL
- HYDROGEOLOGIC TEST BORING
- UV/OX. TREATMENT SYSTEM
- TEMPORARY PURGE WELL
- SURFACE WATER ELEVATION POINT
- 1,4-DIOXANE ISOCONCENTRATION CONTOUR (ug/L) – UNIT D_2
- 1,4-DIOXANE ISOCONCENTRATION CONTOUR (ug/L) – UNIT D_2 AREA OF DEEPER MIGRATION
- 1,4-DIOXANE ISOCONCENTRATION CONTOUR (ug/L) – UNIT D_0
- 1,4-DIOXANE ISOCONCENTRATION CONTOUR (ug/L) – UNITS C AND SOUTHWEST PROPERTY
- 1,437 – 1,4-DIOXANE ISOCONCENTRATION (ug/L)
- (184) – DATA NOT USED
- PROHIBITION ZONE BOUNDARY

NOTE: MAP COMBINES WELLS COMPLETED AT MULTIPLE DEPTHS. INTERPRETATION OF THIS MAP REQUIRES FAMILIARITY WITH THE GEOLOGY AND OF THE GROUNDWATER FLOW REGIME.

NORTH

0 600 1200

Scale: 1" = 600'

UNITS C_3, D_2, D_0 AND SOUTHWEST PROPERTY 1,4-DIOXANE ISOCONCENTRATION CONTOUR MAP - APRIL - AUGUST 2009

fr&h

engineers
scientists
architects
constructors

fishbeck, thompson, carr & huber, inc.

Pall Life Sciences

Scio Twp., Washtenaw County, Michigan

Quarterly Report

Drawn By
Designer
Reviewer
Manager

Hard copy is intended to be 18"x24" when plotted. Scale(s) indicated and graphic quality may not be accurate for any other size.

PROJECT NO.
F96502

©Copyright 2009
All Rights Reserved

PLOT INFO: U:\CADD\96502\DWG\CONTOUR MAPS 2009.DWG DATE: 10/12/2009 TIME: 11:32:30 AM USER: ADE

K:\PDFS\ADE\ADE\D2 PSC.TIF
K:\ADE\ADE\TEMP0000J.TIF
M:\CUSTOM\ACAD2008\SYMBOLS\B-11X17.DWG

M:\CUSTOM\ACAD2008\SYMBOLS\B-18X24.DWG
M:\CUSTOM\ACAD2008\SYMBOLS\B-24X36.DWG
R:\96502\TW-18 PUMP TEST\PRE-PUMPING SURF.DWG

R:\96502\TW-18 PUMP TEST\PUMPING SURF.DWG
R:\96502\TW-18 PUMP TEST\PUMPING W_ TW-18SURF.DWG
U:\CADD\96502\RASTER\D2250BPSC-E1 DUPONT.TIF
U:\CADD\96502\RASTER\D2250BPSC-E2 DUPONT.TIF

U:\CADD\96502\RASTER\GLACIAL LANDSYTEMS.JPG
WASHTENAW CNTY PARCELS
AERIAL2003 HIRES