


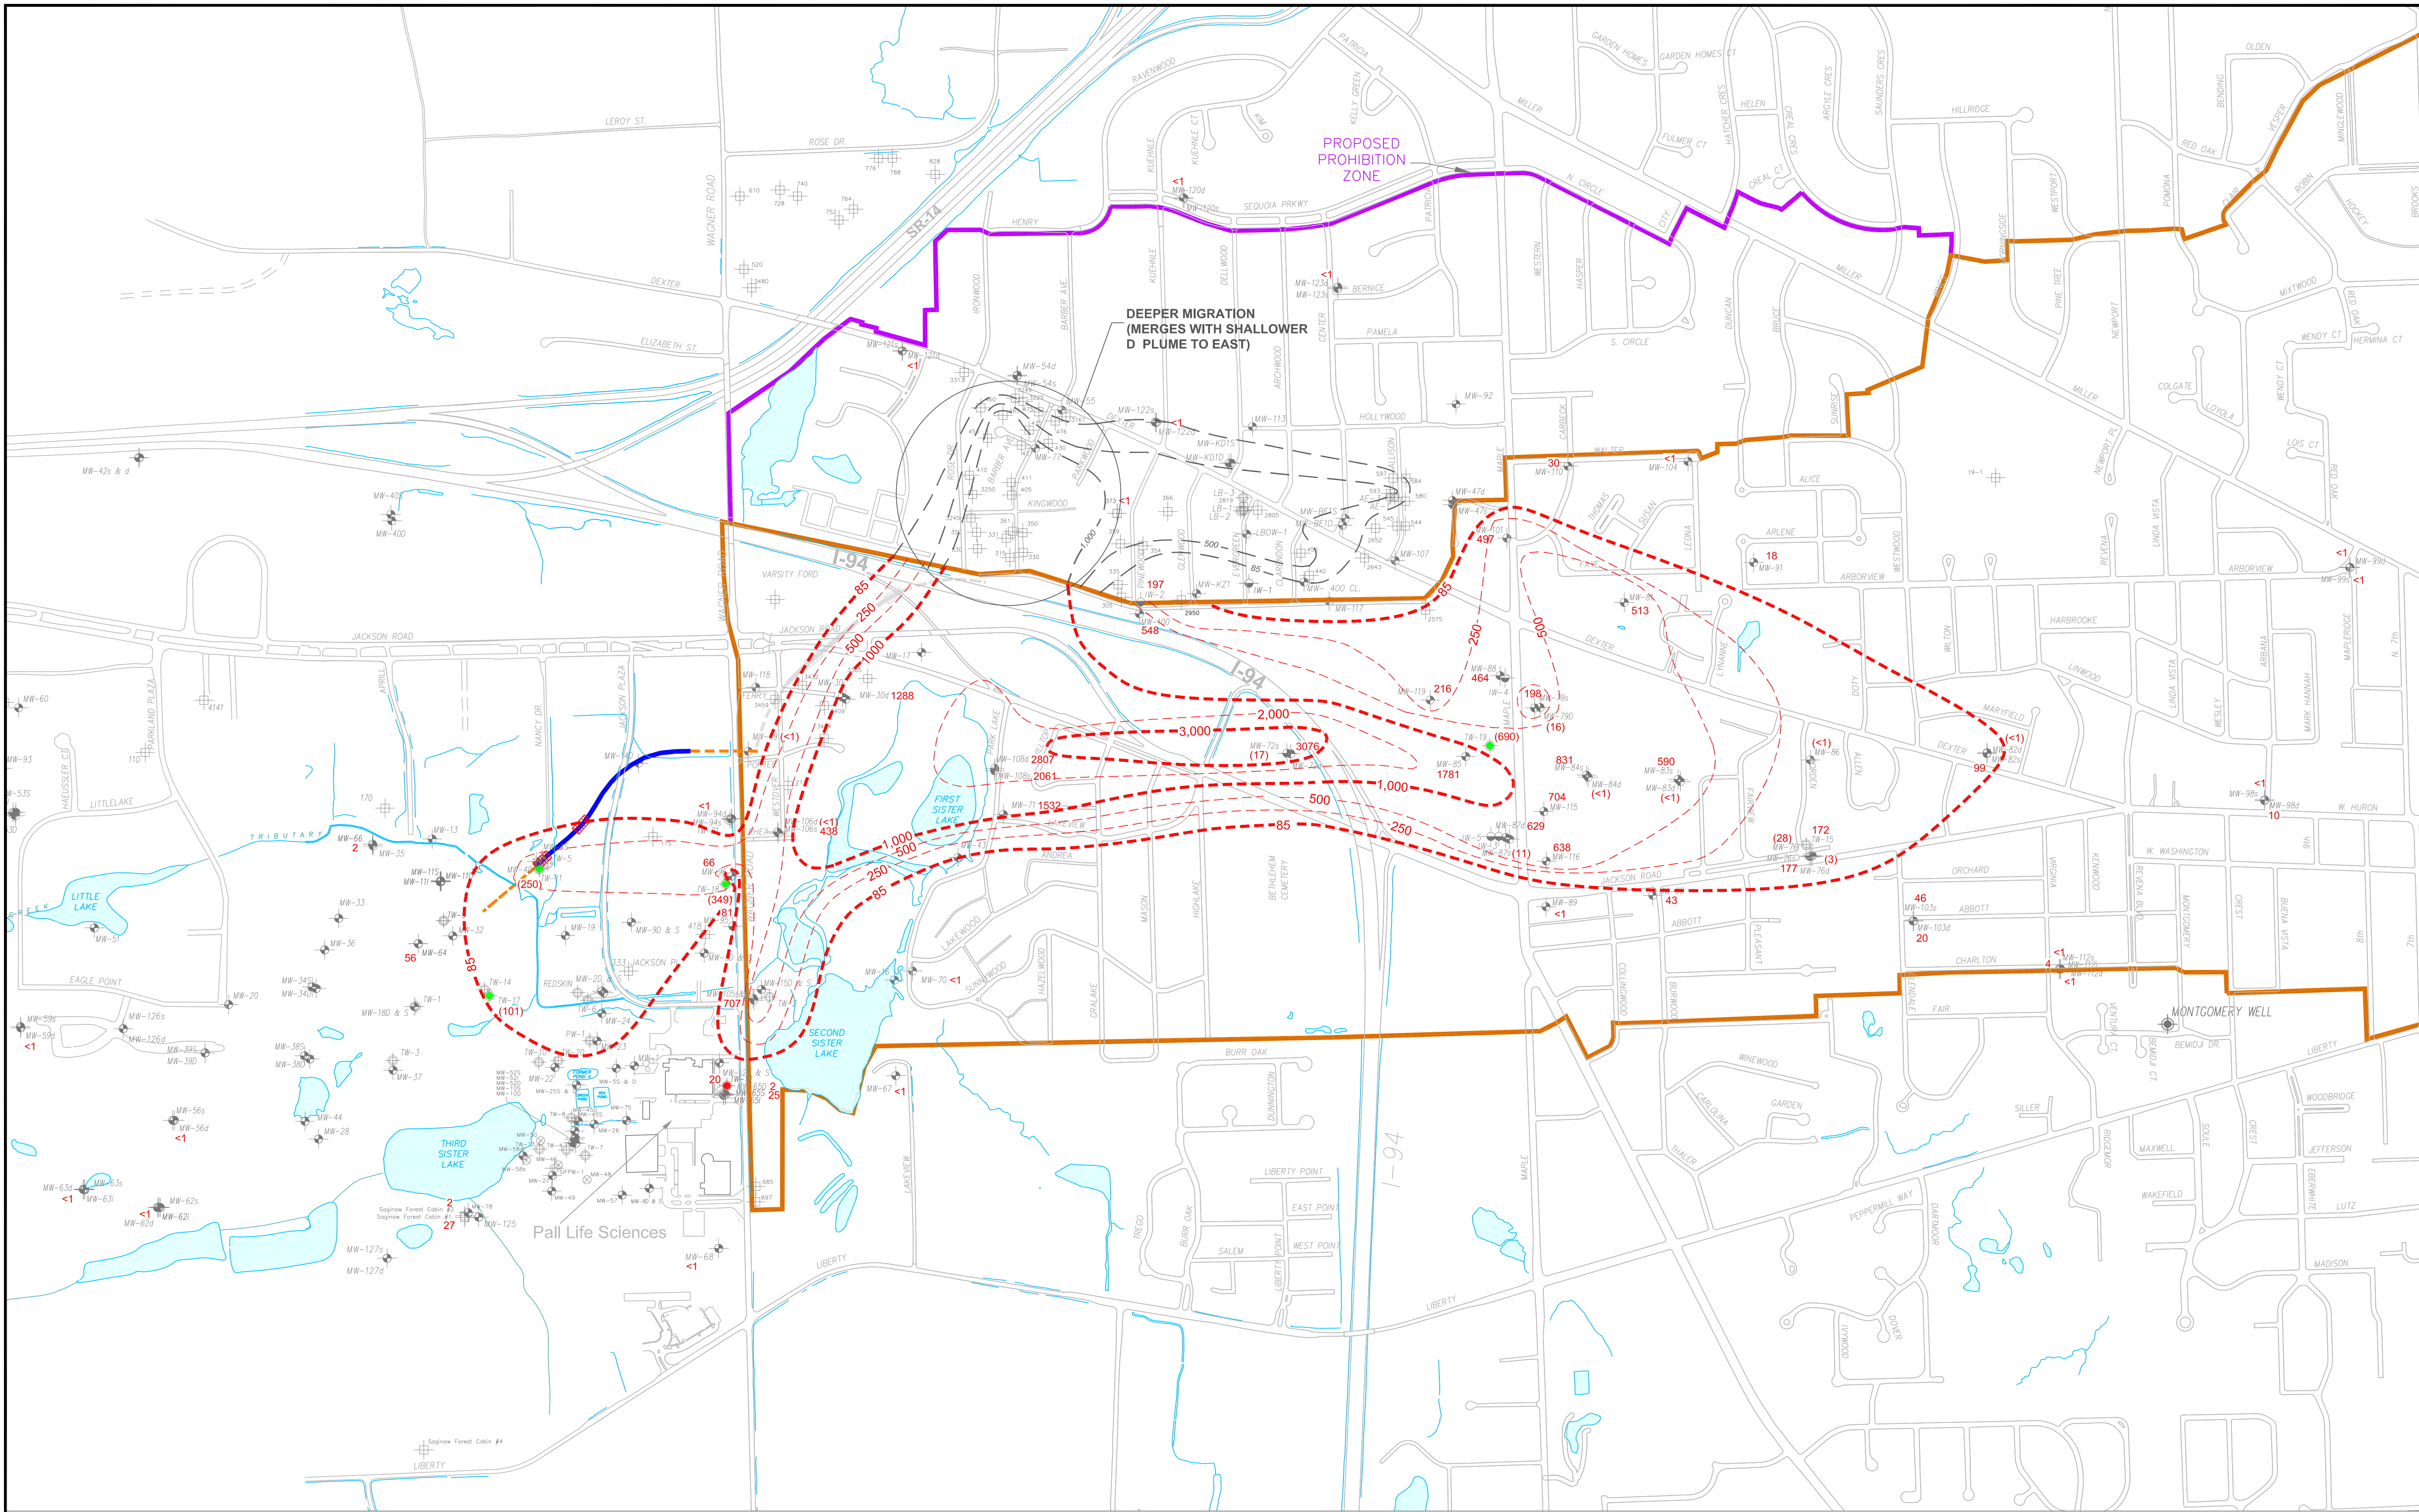


NOTES:

THE MOST RECENT DATA IS SHOWN FROM SAMPLE PERIOD FOR EACH WELL.

MAP COMBINES DATA FROM WELLS COMPLETED AT MULTIPLE DEPTHS. INTERPRETATION OF THIS MAP REQUIRES FAMILIARITY WITH THE GEOLOGY AND OF THE GROUNDWATER FLOW REGIME.

- MONITOR WELL
- RESIDENTIAL WELL
- PURGE WELL OPERATING DURING SAMPLING EVENT
- PURGE WELL NOT OPERATING DURING SAMPLING EVENT
- PURGE WELL NOT IN E UNIT AQUIFER

- ~ UNIT E 1,4-DIOXANE ISOCONCENTRATION CONTOUR (µg/L)
- ~ UNIT D₂ 1,4-DIOXANE ISOCONCENTRATION CONTOUR (µg/L)
- 3076 - 1,4-DIOXANE CONCENTRATION (µg/L)
- (3076) - DATA NOT USED
- PROHIBITION ZONE BOUNDARY

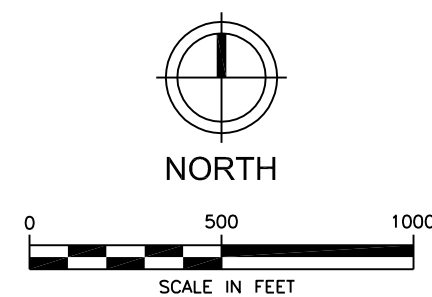

PALL LIFE SCIENCES
Scio Twp., Washtenaw County, Michigan

1,4 DIOXANE ISOCONCENTRATION MAP FOR UNIT E (MAY-AUG. 2010)

PROJECT MGR.	DATE
JWB	9/1/10
DRAWN BY	DATE
RAW	9/1/10
GEOLOGIST	DATE
JWB	9/1/10
CAD FILE	
S1-0810_E_ISO	
EDIT	
Kirkw 100610	
SCALE	1"=500'
DRAWING	

PROJECT 806500
ISO
SHEET NO.

FLEIS & VANDENBRINK
ENGINEERING, INC.
2850 WOODBINE COURT, ANN ARBOR, MI 48106
Phone: (616) 977-1000 Fax: (616) 977-1005

PALL Life Sciences