



PLOT INFO: N:\96502\DWG\FEASIBILITY STUDY REVISED.DWG DATE: 6/1/2004 TIME: 2:01:28 PM USER: ACS

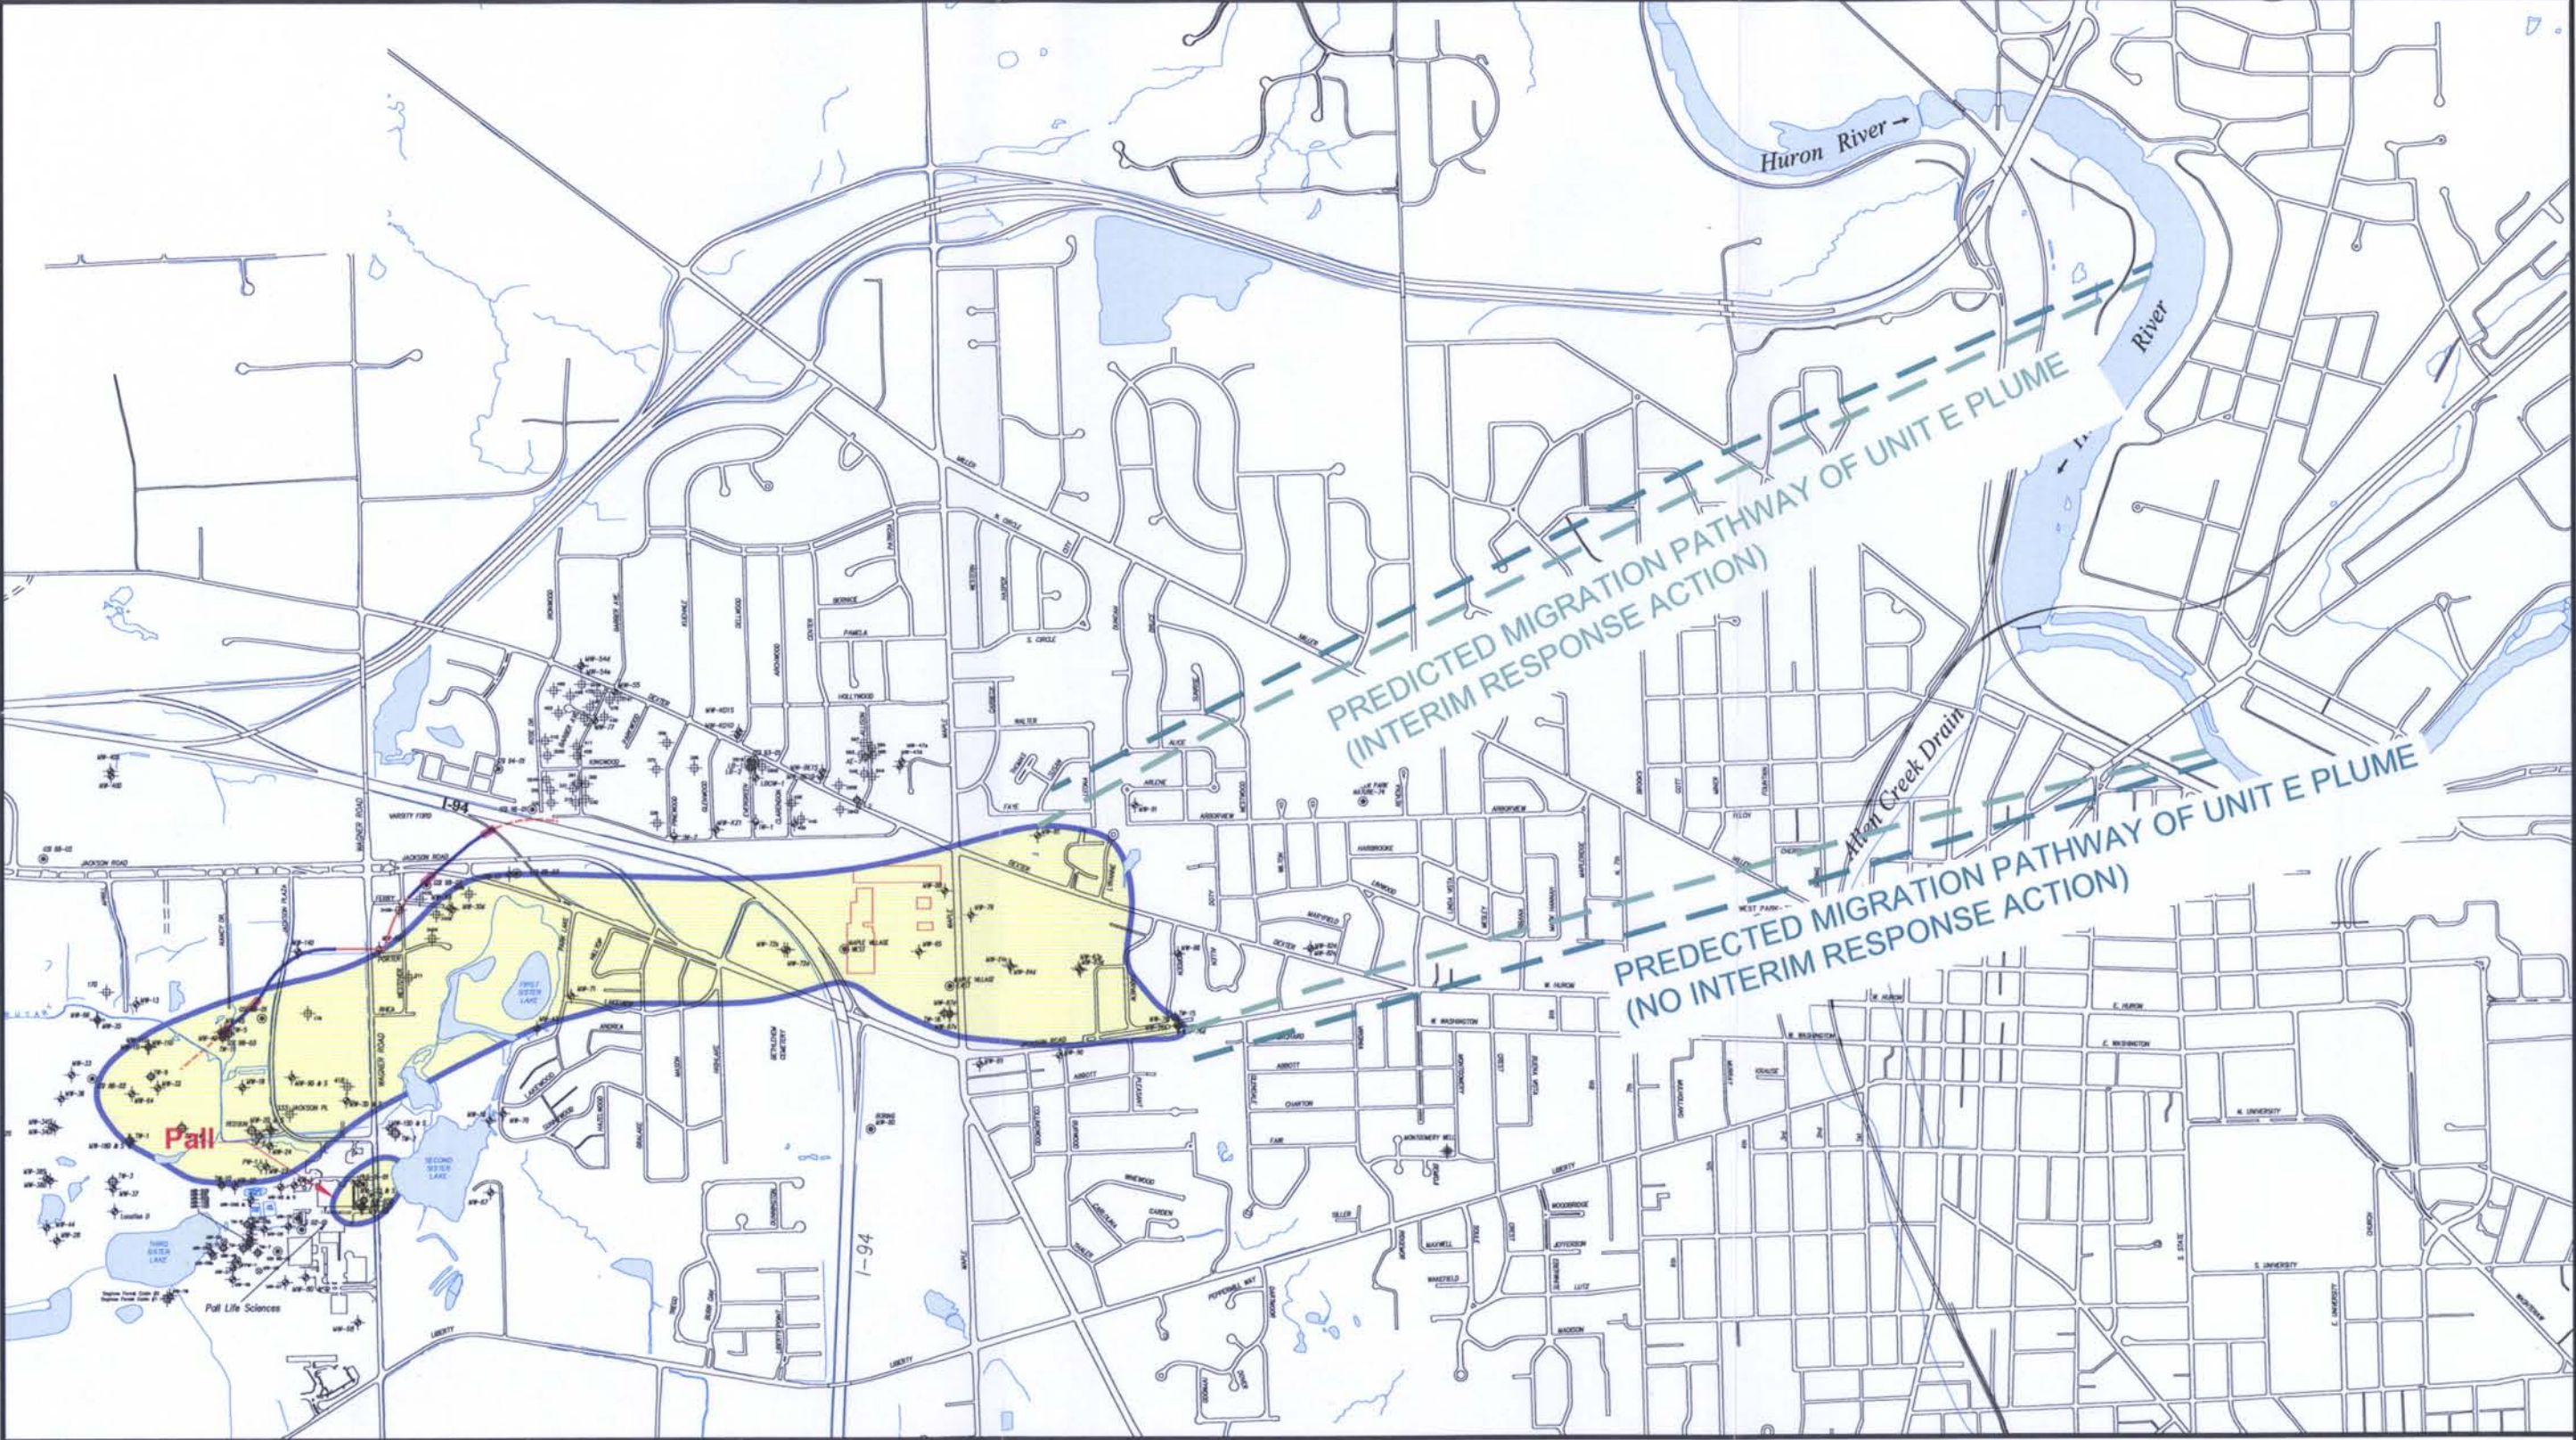

- LEGEND**
- ⊕ - MONITOR WELL
 - ⊕ - RESIDENTIAL WELL
 - ⊕ - PURGE WELL
 - ⊕ - HYDROGEOLOGIC TEST BORING
 - ⊕ - UV/OX. TREATMENT SYSTEM
 - ⊕ - TEMPORARY PURGE WELL
 - - UNIT E AREA WITH 1,4-DIOXANE CONCENTRATIONS EXCEEDING 85 ug/L (ppb) JANUARY-MARCH 2004

NOTE: Predicted migration pathway base on groundwater modeling and groundwater flow interpretation made by Fleis and Vandenberg, City of Ann Arbor Montgomery Wellfield Wellhead Protection Area Delineation.

AREA SUBJECT TO WAIVER



Fishbeck, Thompson, Carr & Huber
 Engineers • Scientists • Architects
 Kalamazoo, Michigan (269) 375-3824
 © Copyright 2004 All Rights Reserved



Pall Life Sciences
 Scio Twp., Washtenaw County, Michigan
 Final Feasibility Study

PROJECT NO.
F96502

FIGURE NO.

11