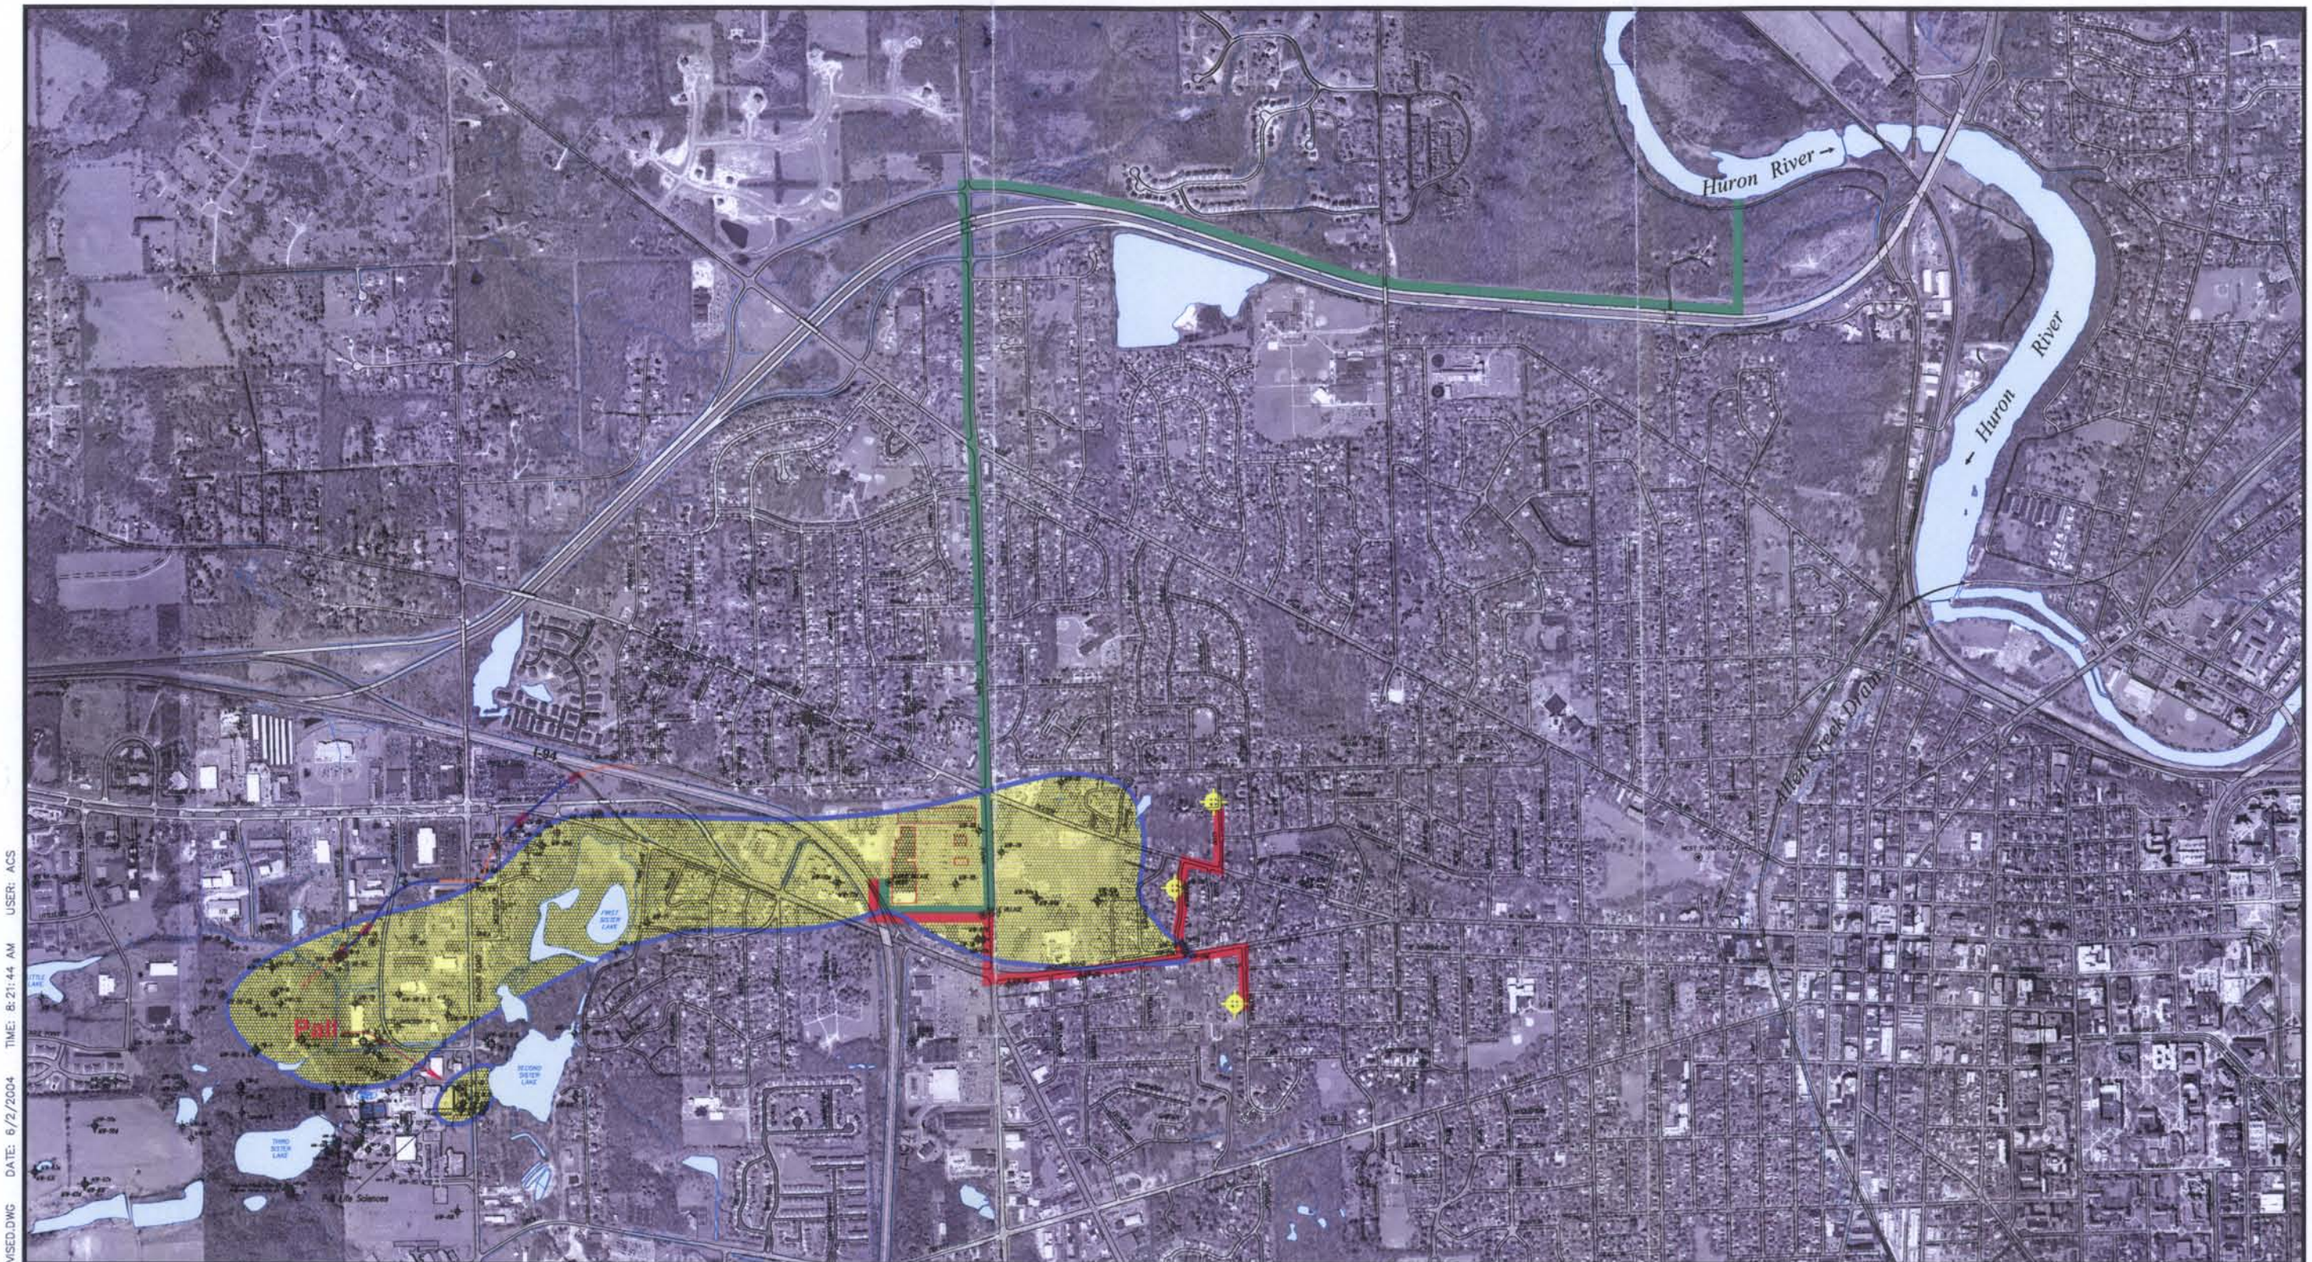

LEGEND

- MONITOR WELL
- RESIDENTIAL WELL
- PURGE WELL
- HYDROGEOLOGIC TEST BORING
- UV/OX. TREATMENT SYSTEM
- TEMPORARY PURGE WELL
- UNIT E AREA WITH 1,4-DIOXANE CONCENTRATIONS EXCEEDING 85 ug/L (ppb) JANUARY-MARCH 2004
- DOUBLE CONTAINED WATER LINE (GENERALIZED)
- DISCHARGE LINE (GENERALIZED)
- PROPOSED EXTRACTION WELL

NORTH

0 1500 3000

FEET

ALTERNATIVE 4a

Groundwater Pumping, Treatment at Site Near Maple Road with Ozone/Hydrogen Peroxide Followed by Transmission through a New Pipeline to the Huron River for Disposal Under an NPDES Permit

Fishbeck, Thompson, Carr & Huber
Engineers • Scientists • Architects
Kalamazoo, Michigan (269) 375-3824

© Copyright 2004 All Rights Reserved

fTC&H

Pall Life Sciences
Scio Twp., Washtenaw County, Michigan
Final Feasibility Study

PROJECT NO. F96502

FIGURE NO. 9

PLOT INFO: N:\96502\DWG\FEASIBILITY STUDY REVISED.DWG DATE: 6/2/2004 TIME: 8:21:44 AM USER: ACS
N:\96502\RASTER\02810282.JPG
N:\96502\RASTER\02950274.JPG
N:\96502\RASTER\02710290.JPG
N:\96502\RASTER\01050582.TIF