


# Flint Water Incident - Extended Sentinel Sampling Round 6 - Lead

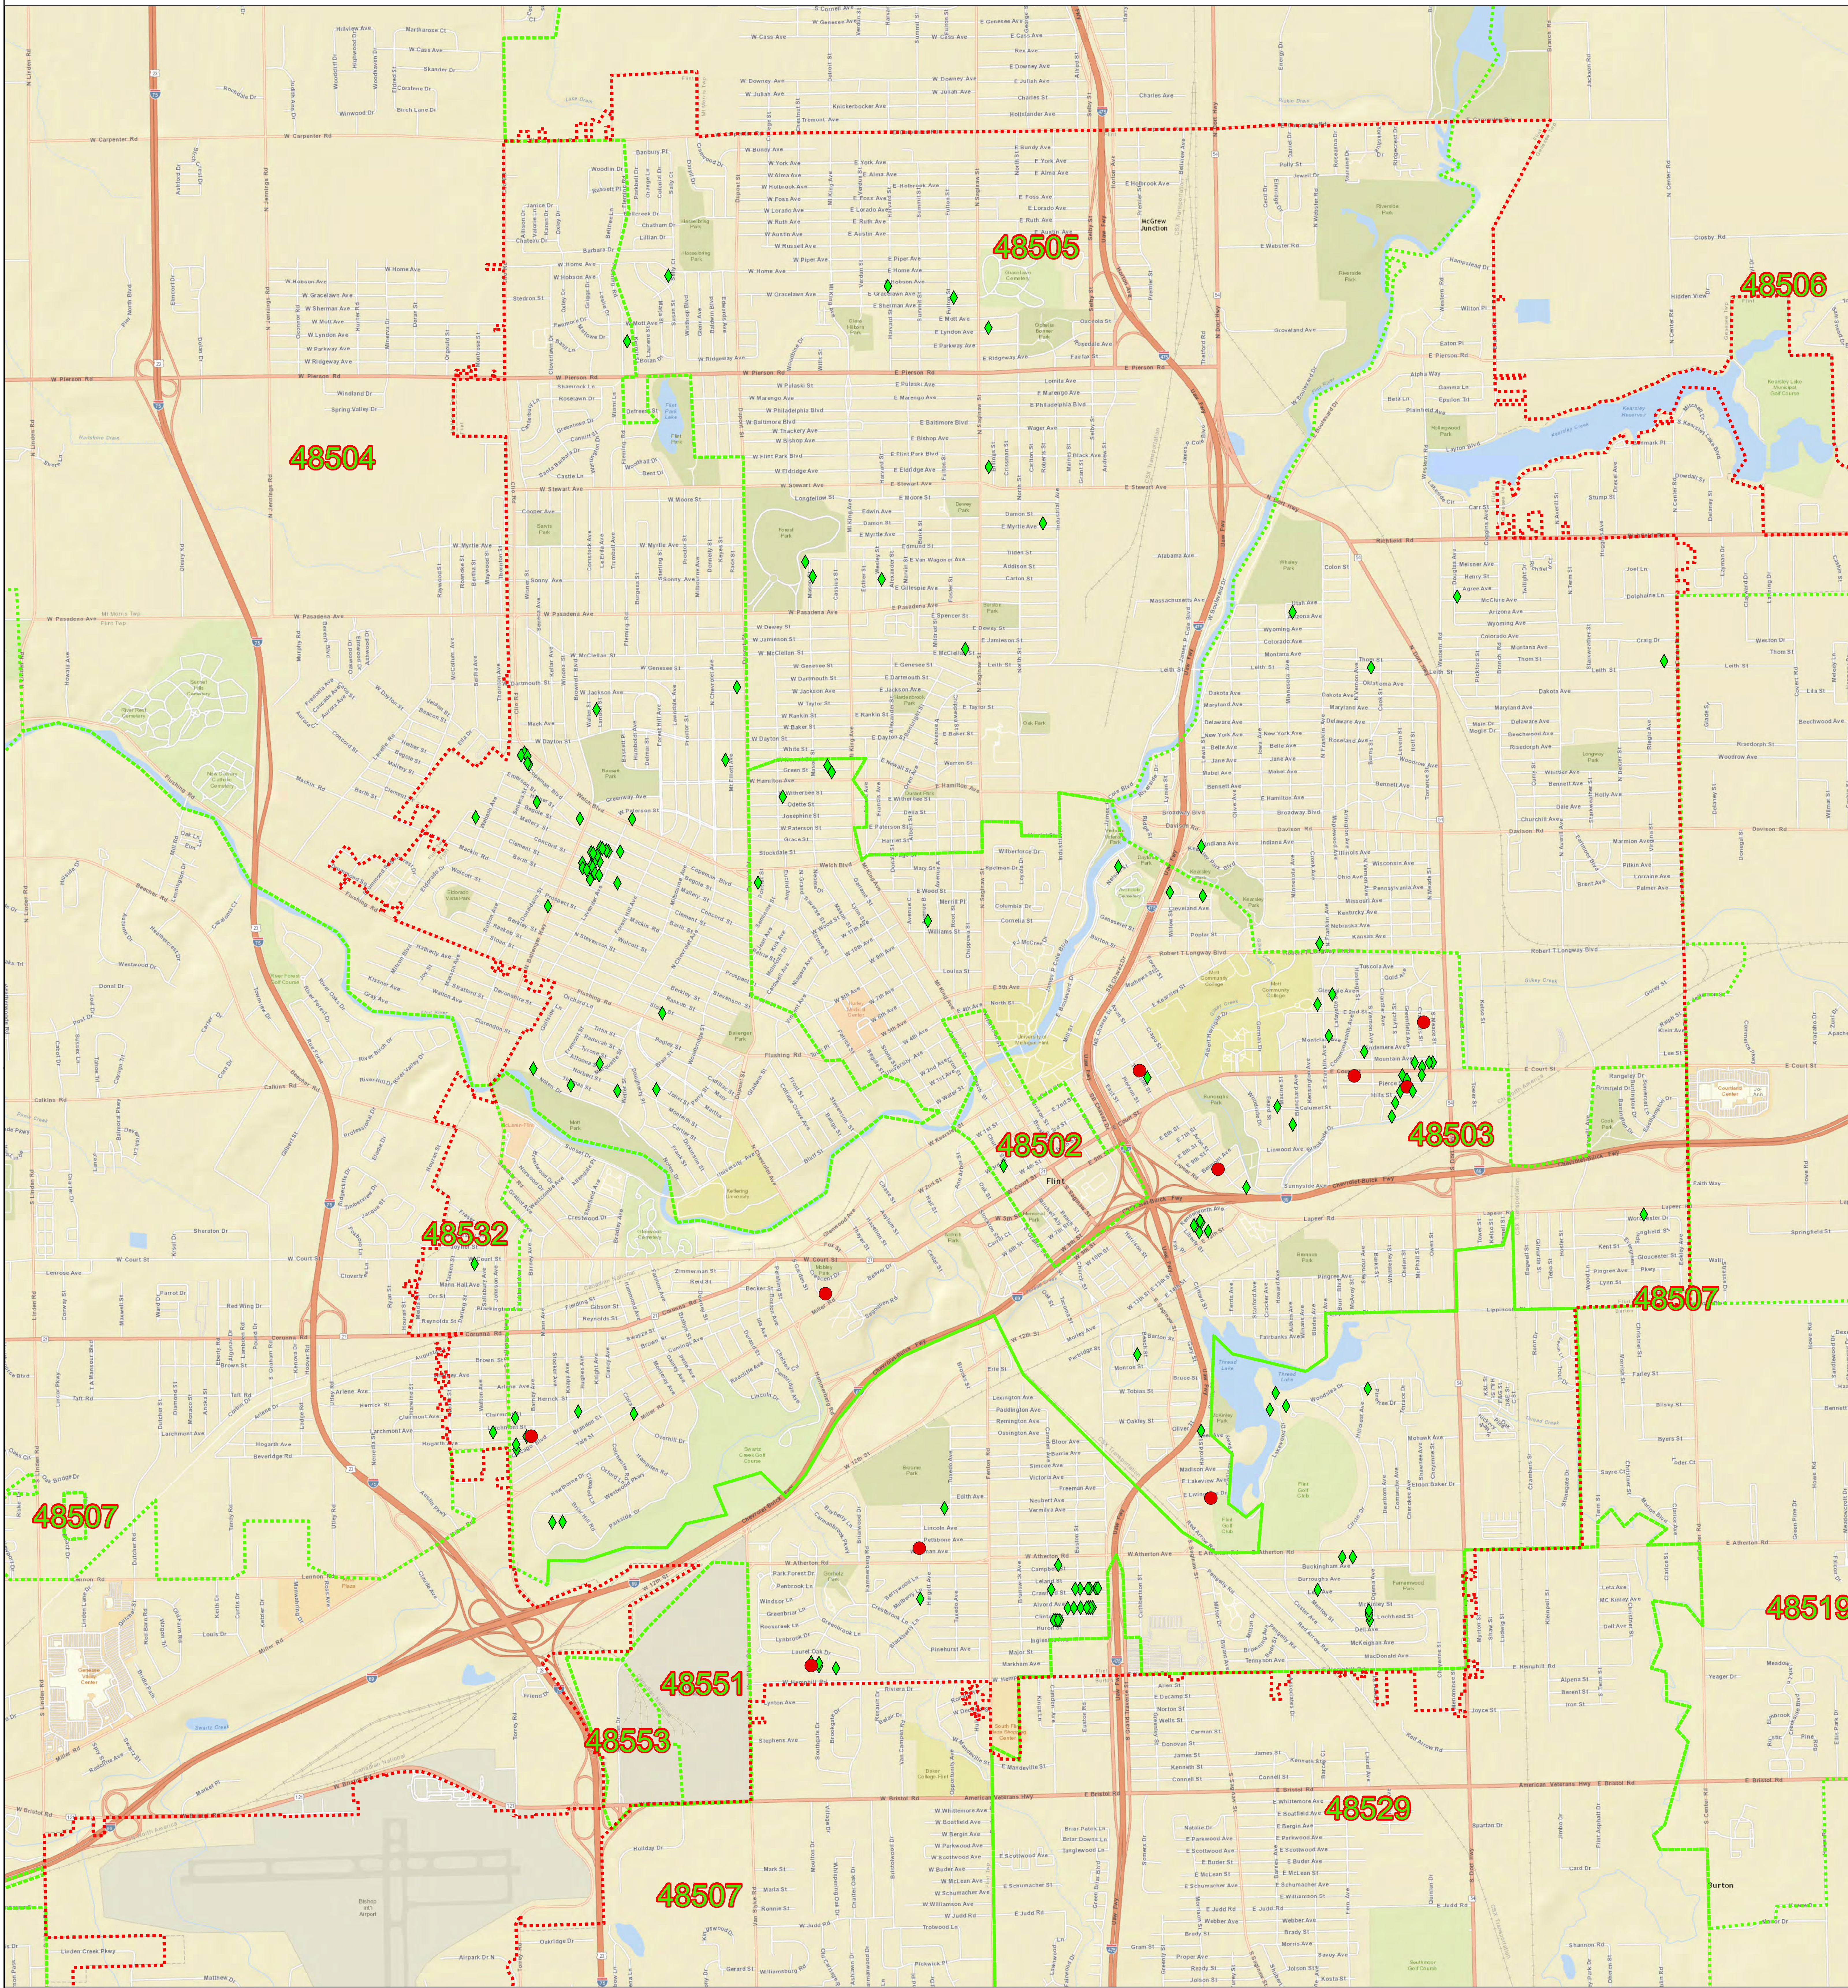


### Legend

#### Lead\_ppb

- ◆ 139 Results less than or equal to 15 parts per billion of Lead
- 10 Results greater than 16 parts per billion of Lead
- Flint w/Franchise Boundary
- Flint Area Zip Codes



State of Michigan

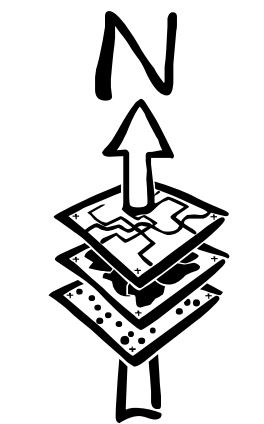

Date: 12/2/2016

