


Flint Water Incident - Extended Sentinel Sampling Round 1 - Lead

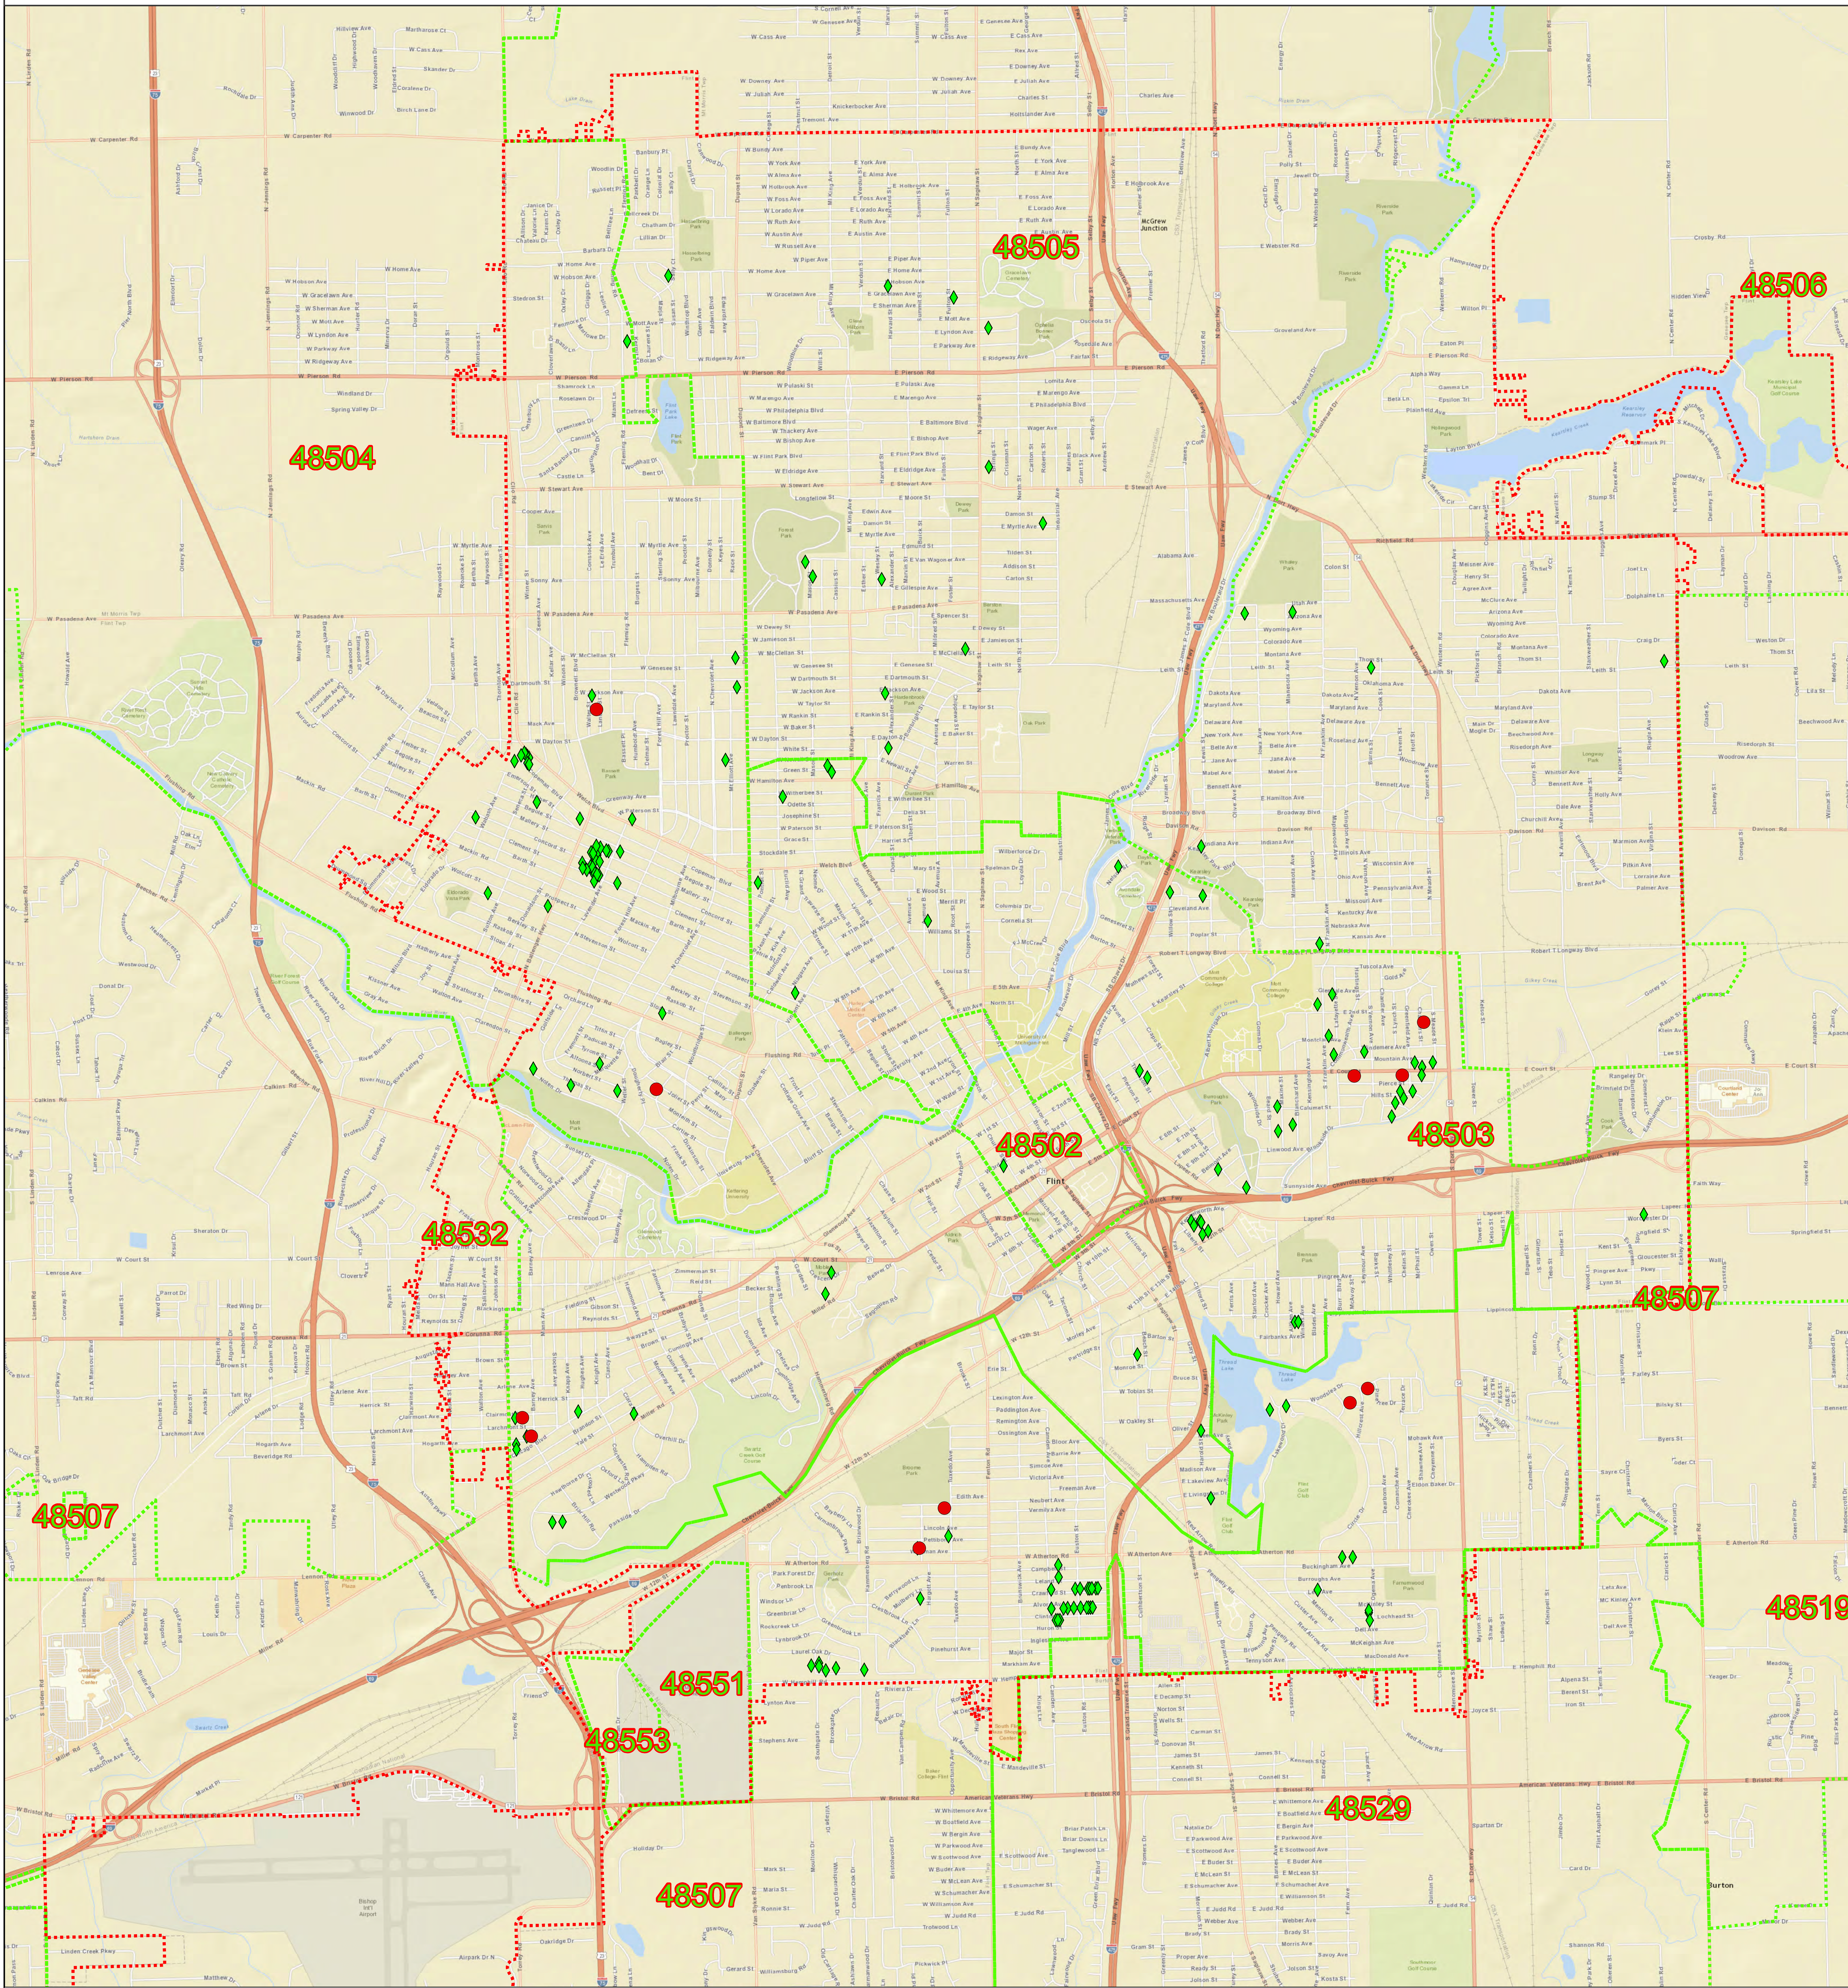

Legend

Lead_ppb

- ◆ 159 Results less than or equal to 15 parts per billion of Lead
- 12 Results greater than 16 parts per billion of Lead
- Flint w/Franchise Boundary
- Flint Area Zip Codes



State of Michigan

Date: 6/16/2016

