


Flint Water Incident - Extended Sentinel Sampling Round 3 - Lead

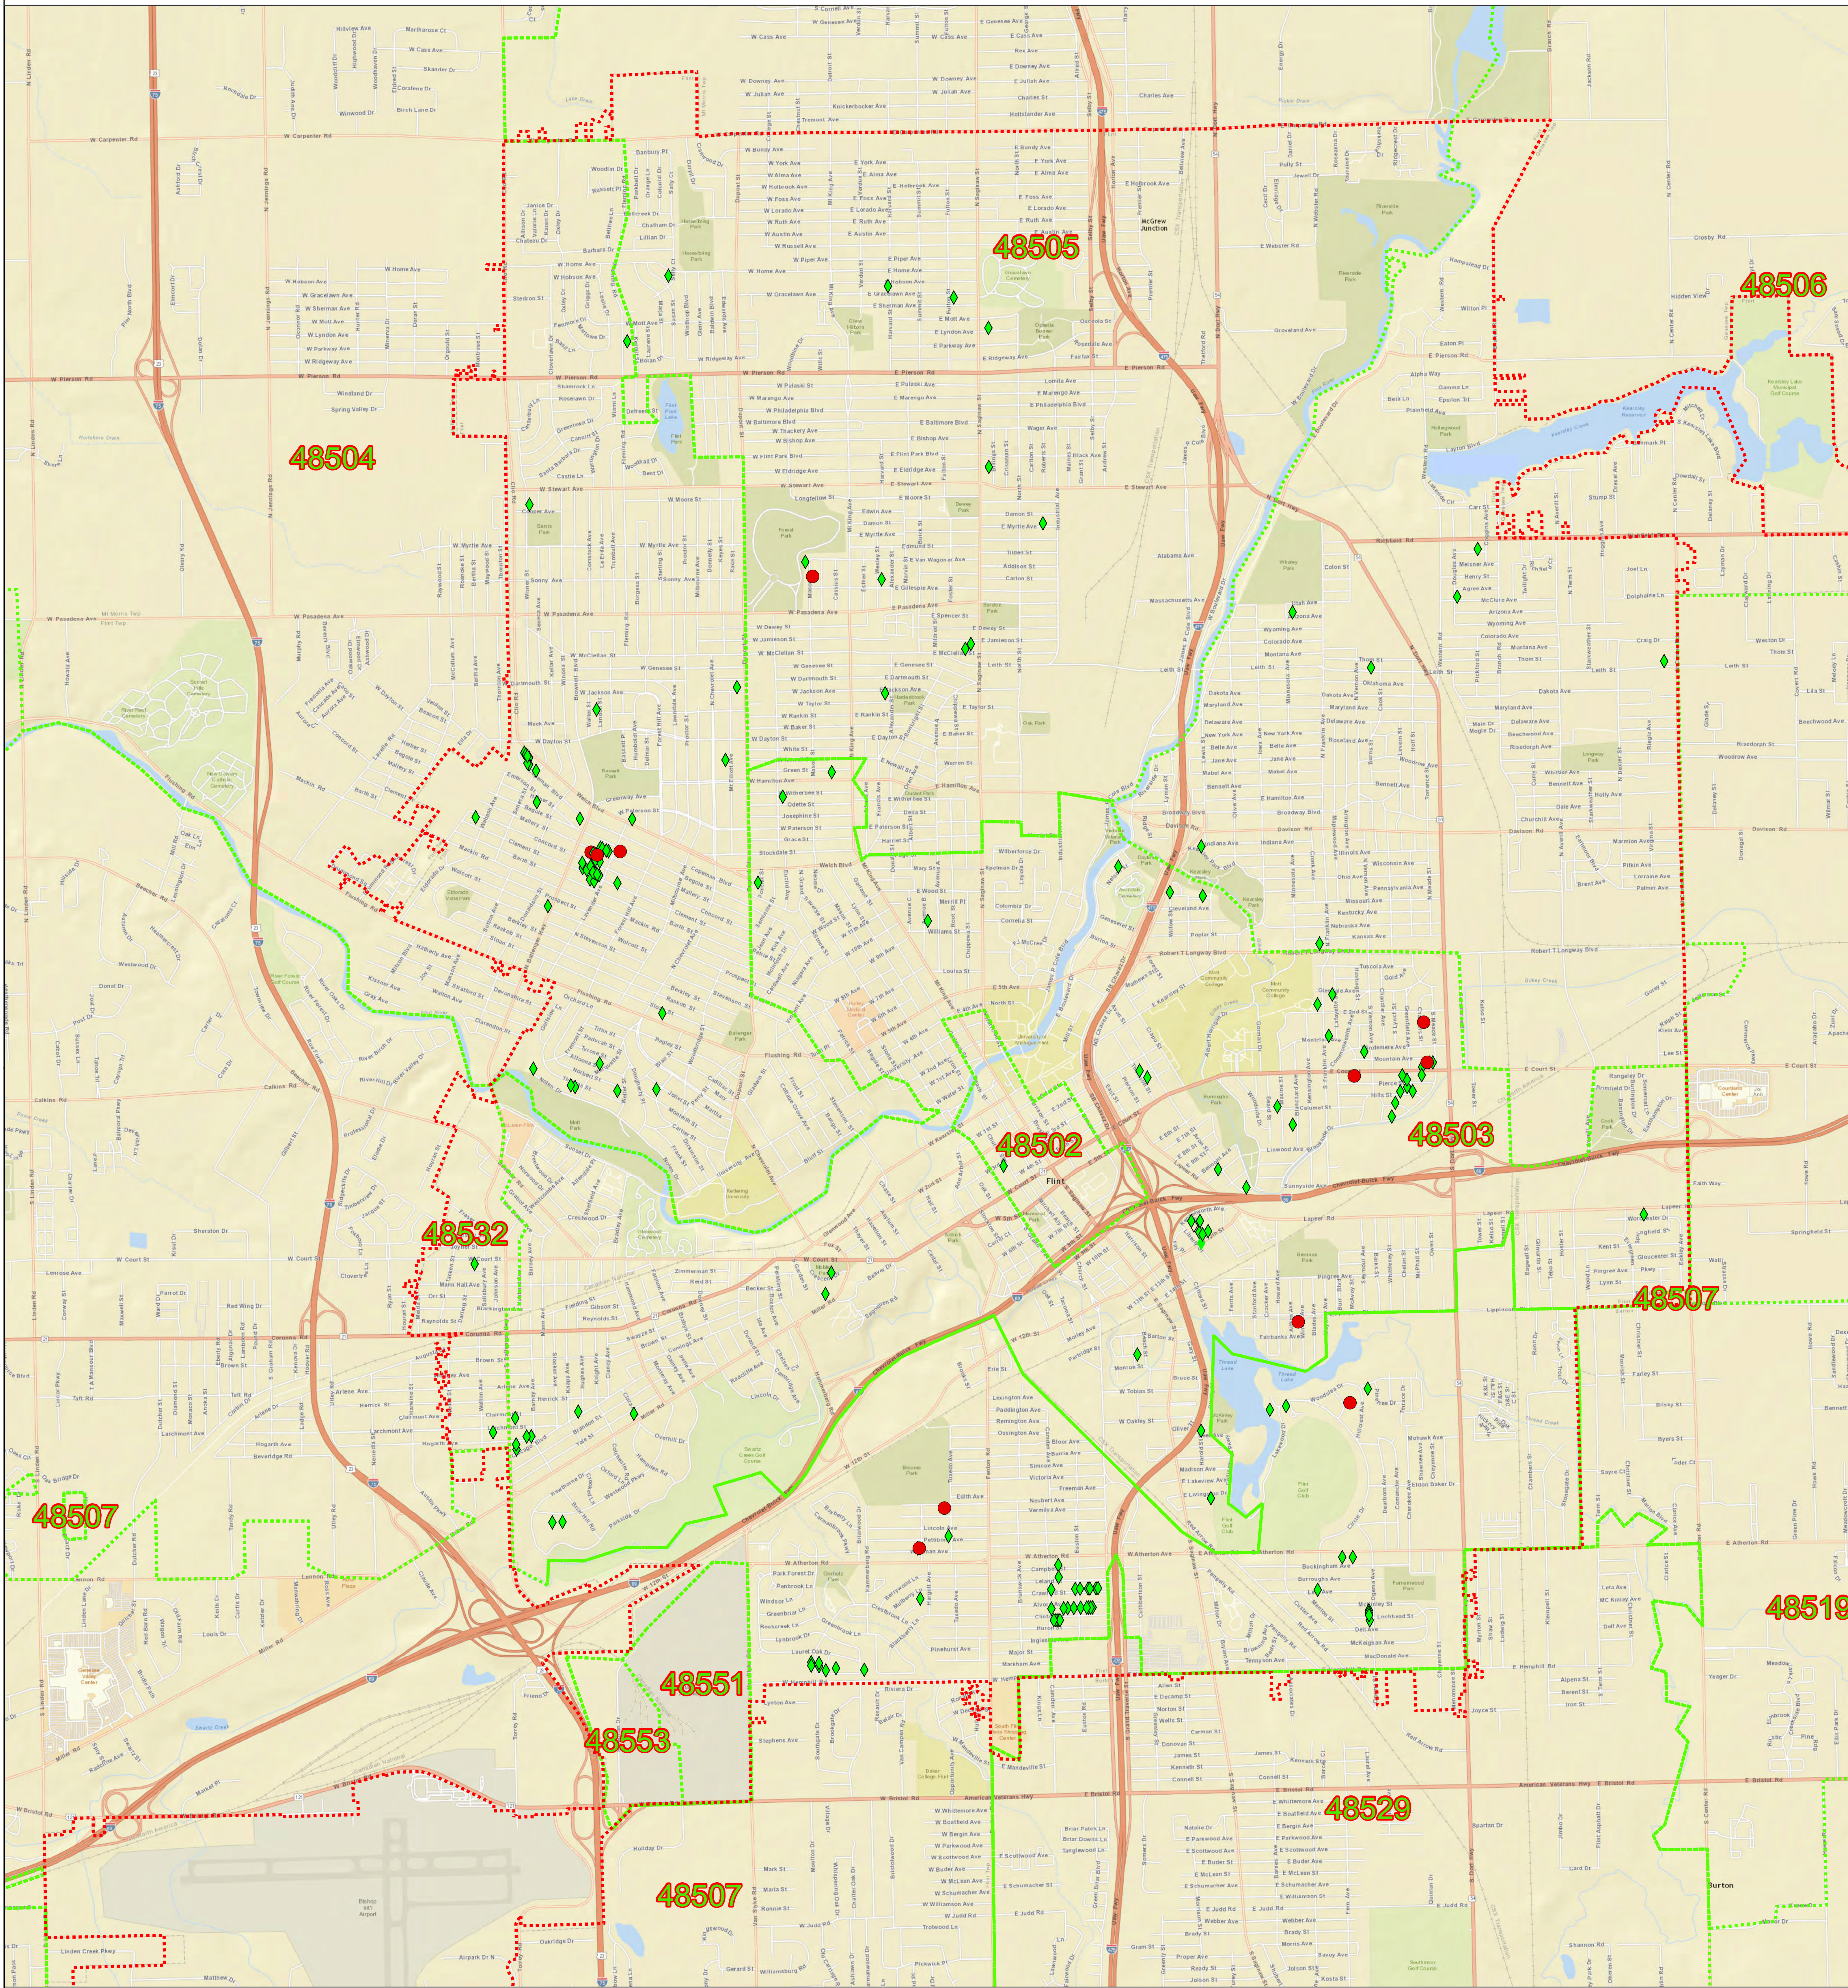


Legend

Lead_ppb

- ◆ 156 Results less than or equal to 15 parts per billion of Lead
- 11 Results greater than 16 parts per billion of Lead
- Flint w/Franchise Boundary
- Flint Area Zip Codes



State of Michigan

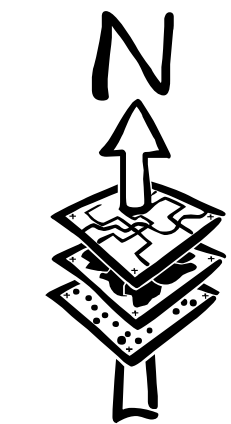

Date: 8/2/2016

