


# Flint Water Incident - Round 2 Sentinel Sampling Results - Lead

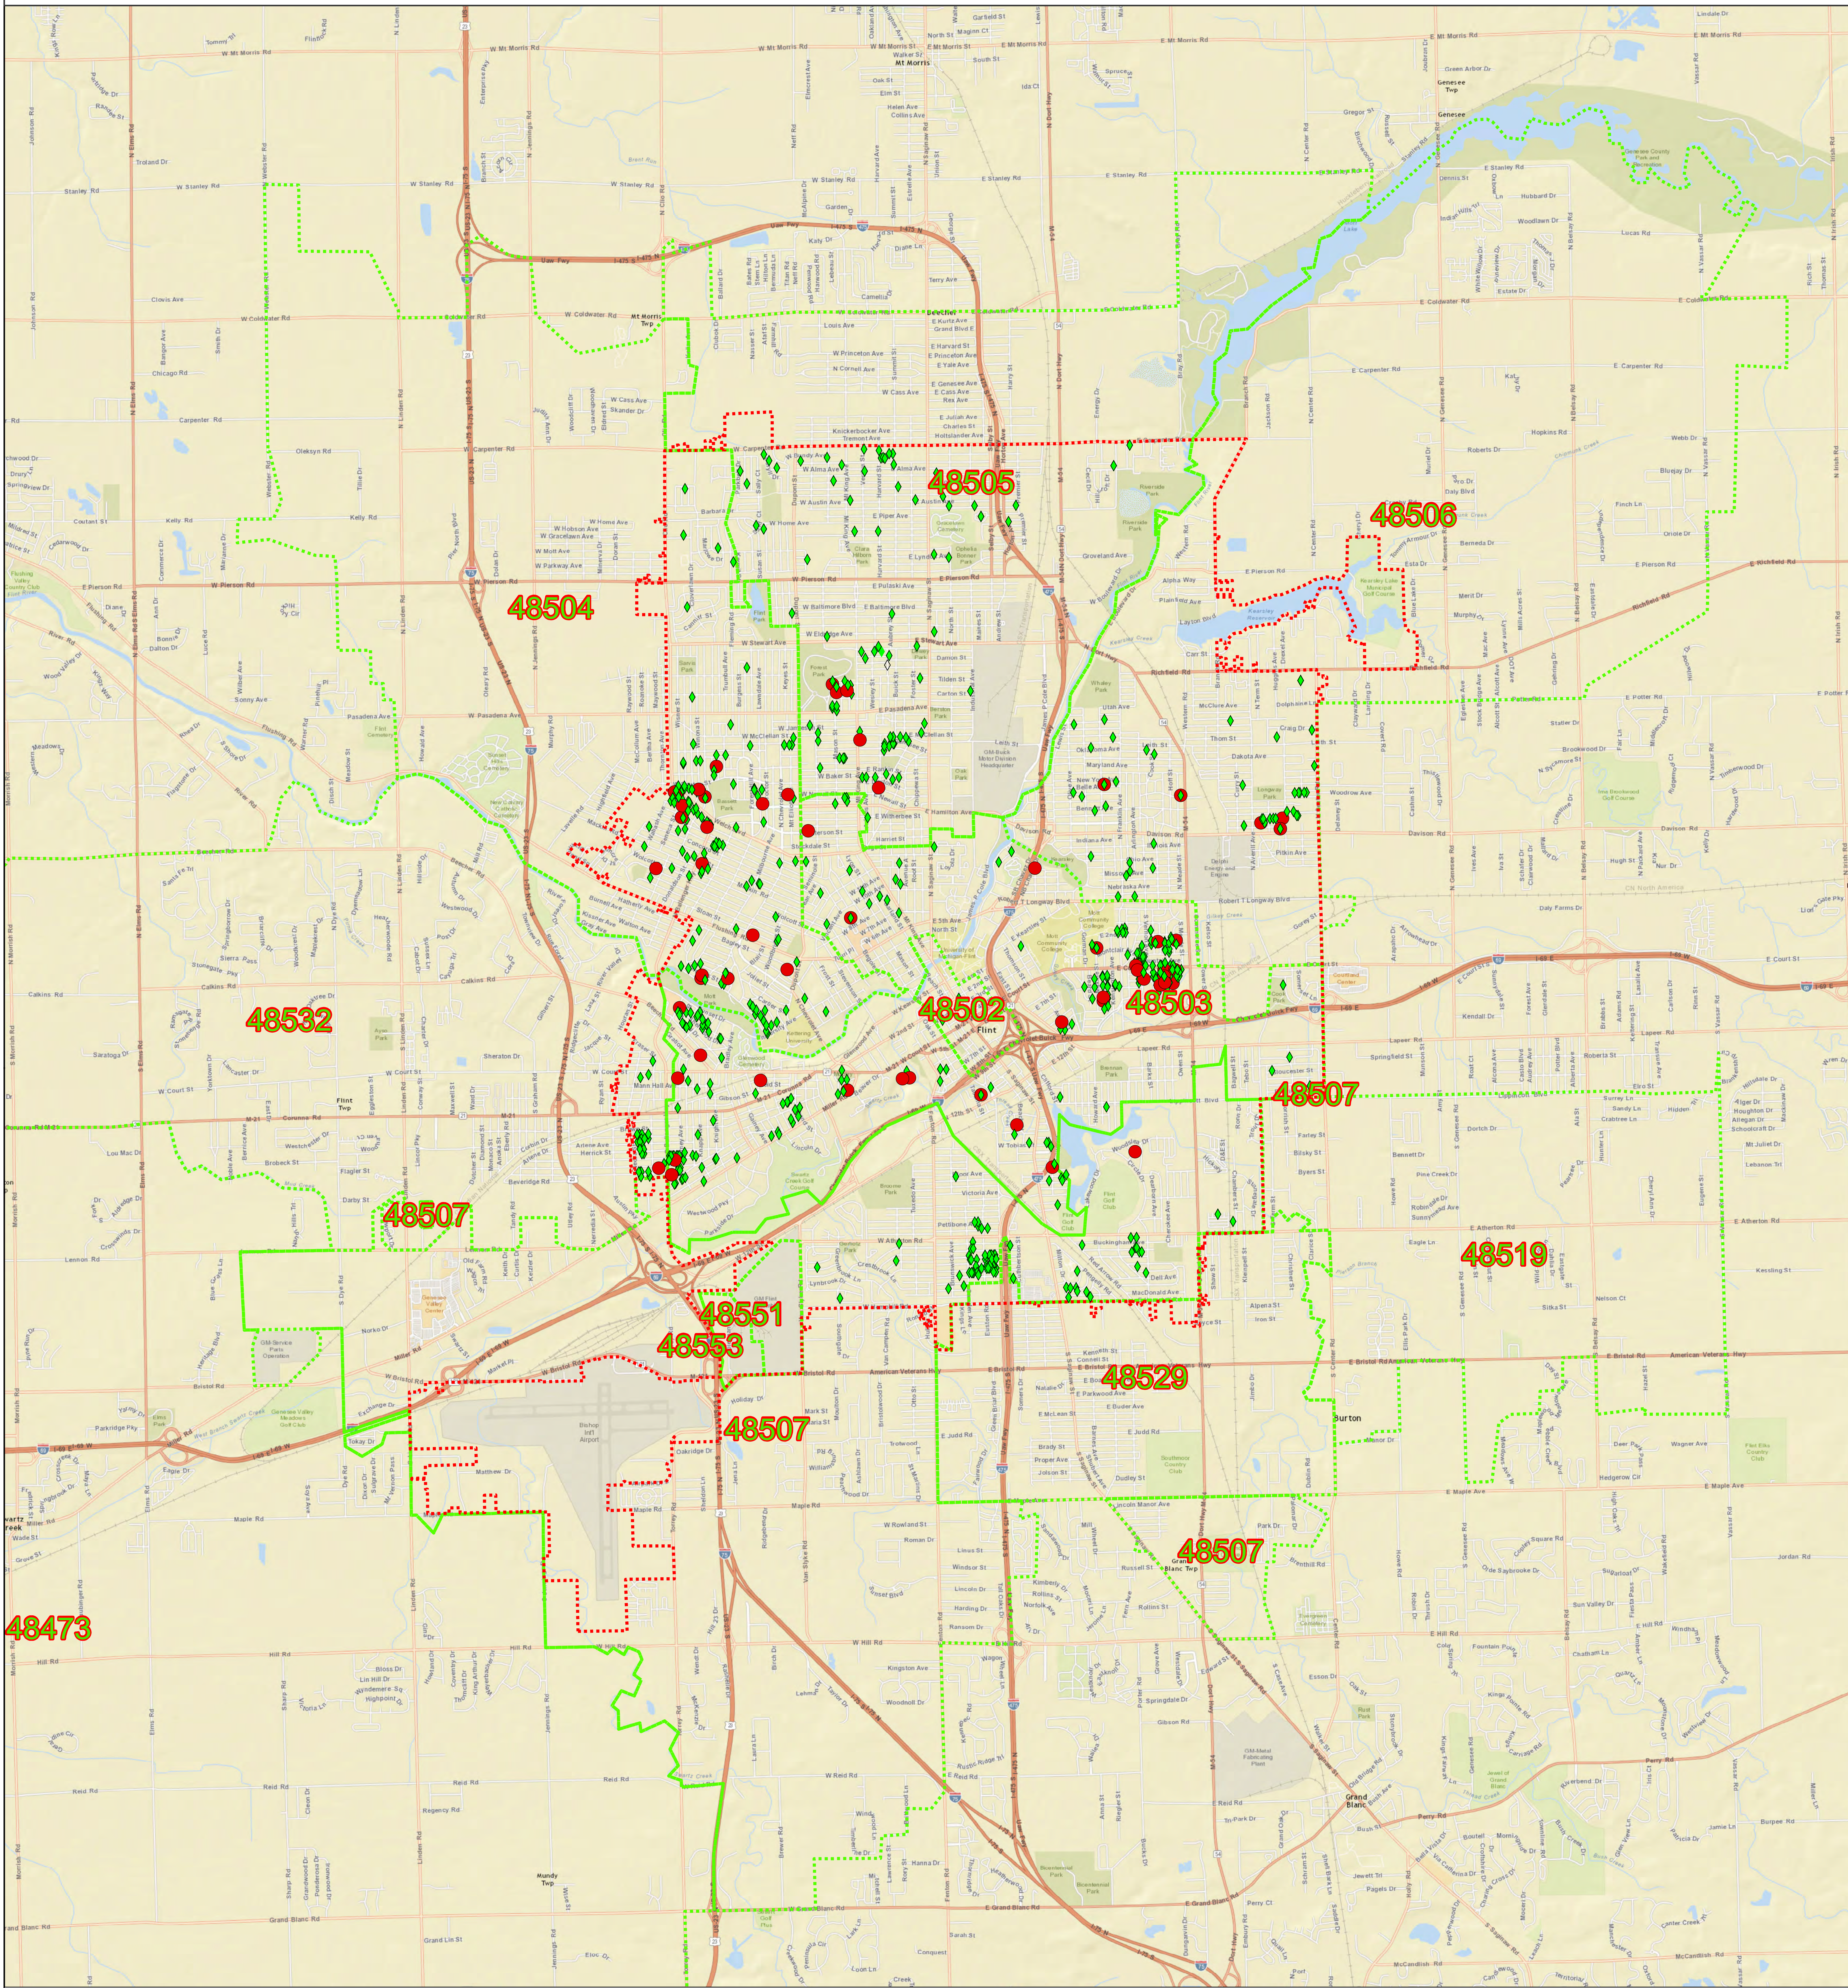


## Legend

### Lead\_ppb

- ◆ 619 Results less than or equal to 15 parts per billion of Lead
- 63 Results greater than 16 parts per billion of Lead
- Flint w/Franchise Boundary
- Flint Area Zip Codes



State of Michigan

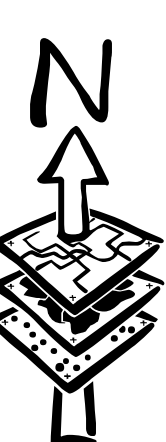

Date: 3/21/2016

