


Flint Water Incident - Round 4 Sentinel Sampling Results - Lead

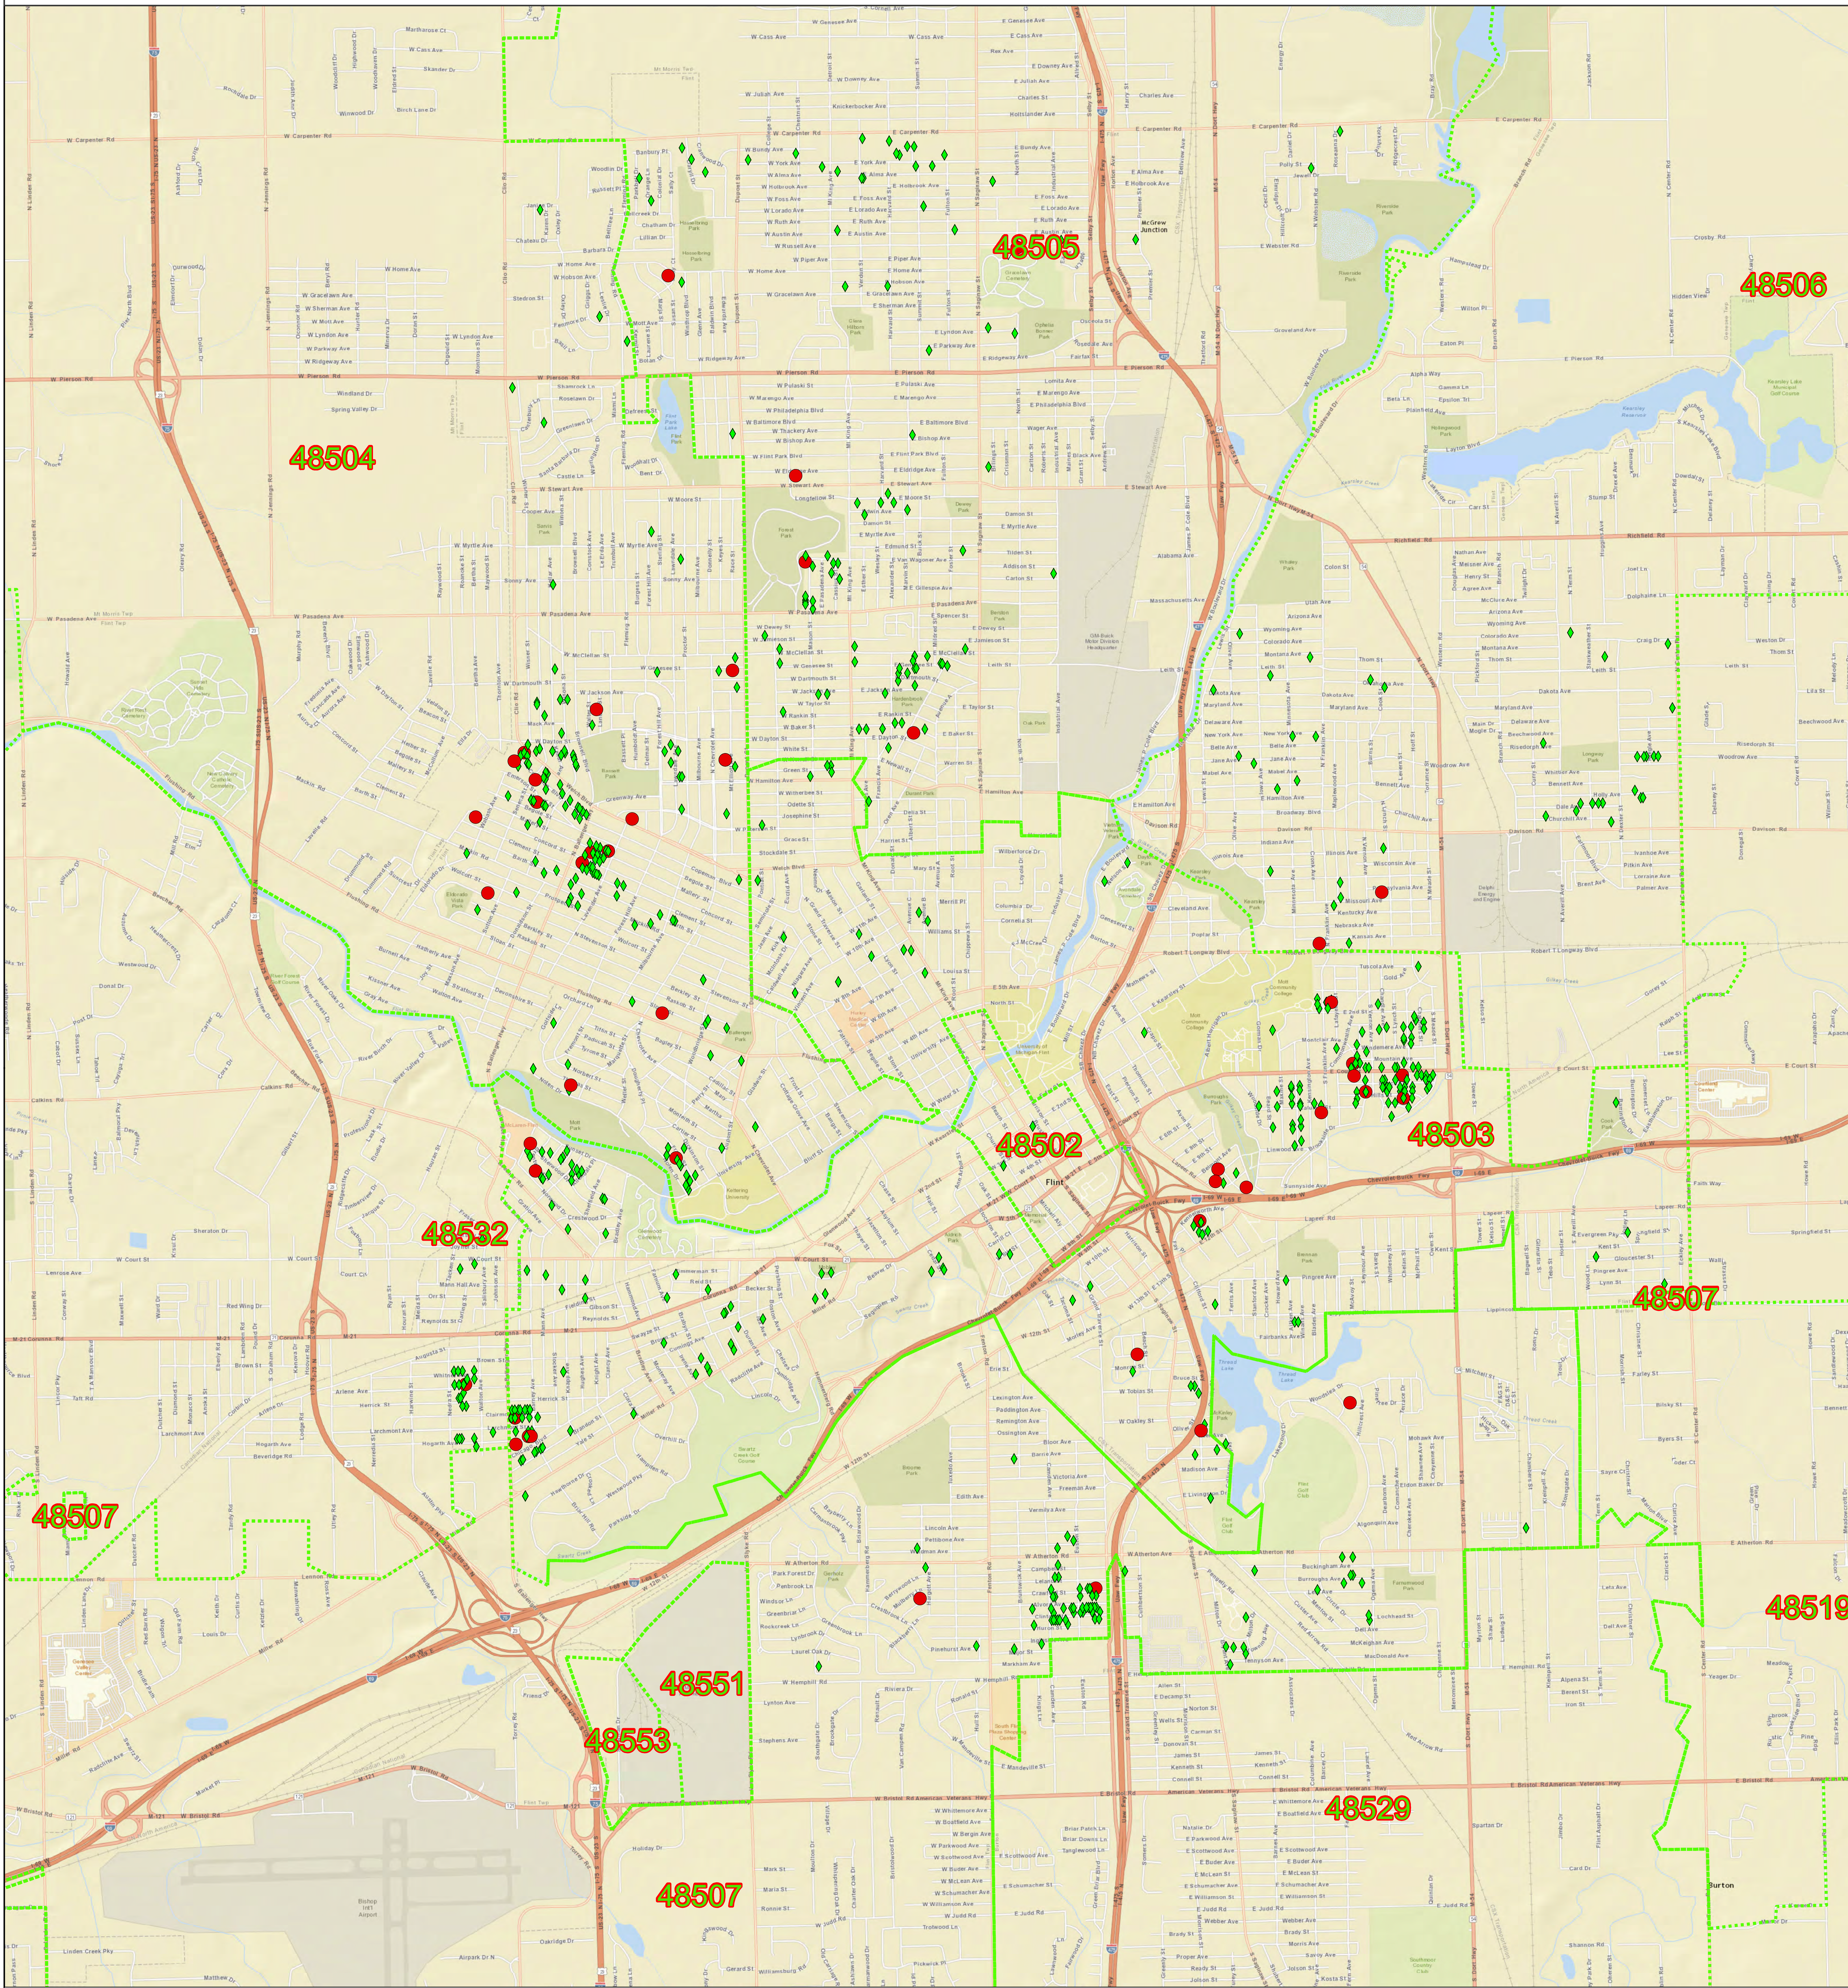

Legend

Round 4 Sentinel Results

- ◆ 594 Results less than or equal to 15 parts per billion of Lead
- 48 Results greater than 16 parts per billion of Lead
- Flint Area Zip Codes



State of Michigan

Date: 4/15/2016

