


# Flint Water Incident - Round 5 Sentinel Sampling Results - Lead

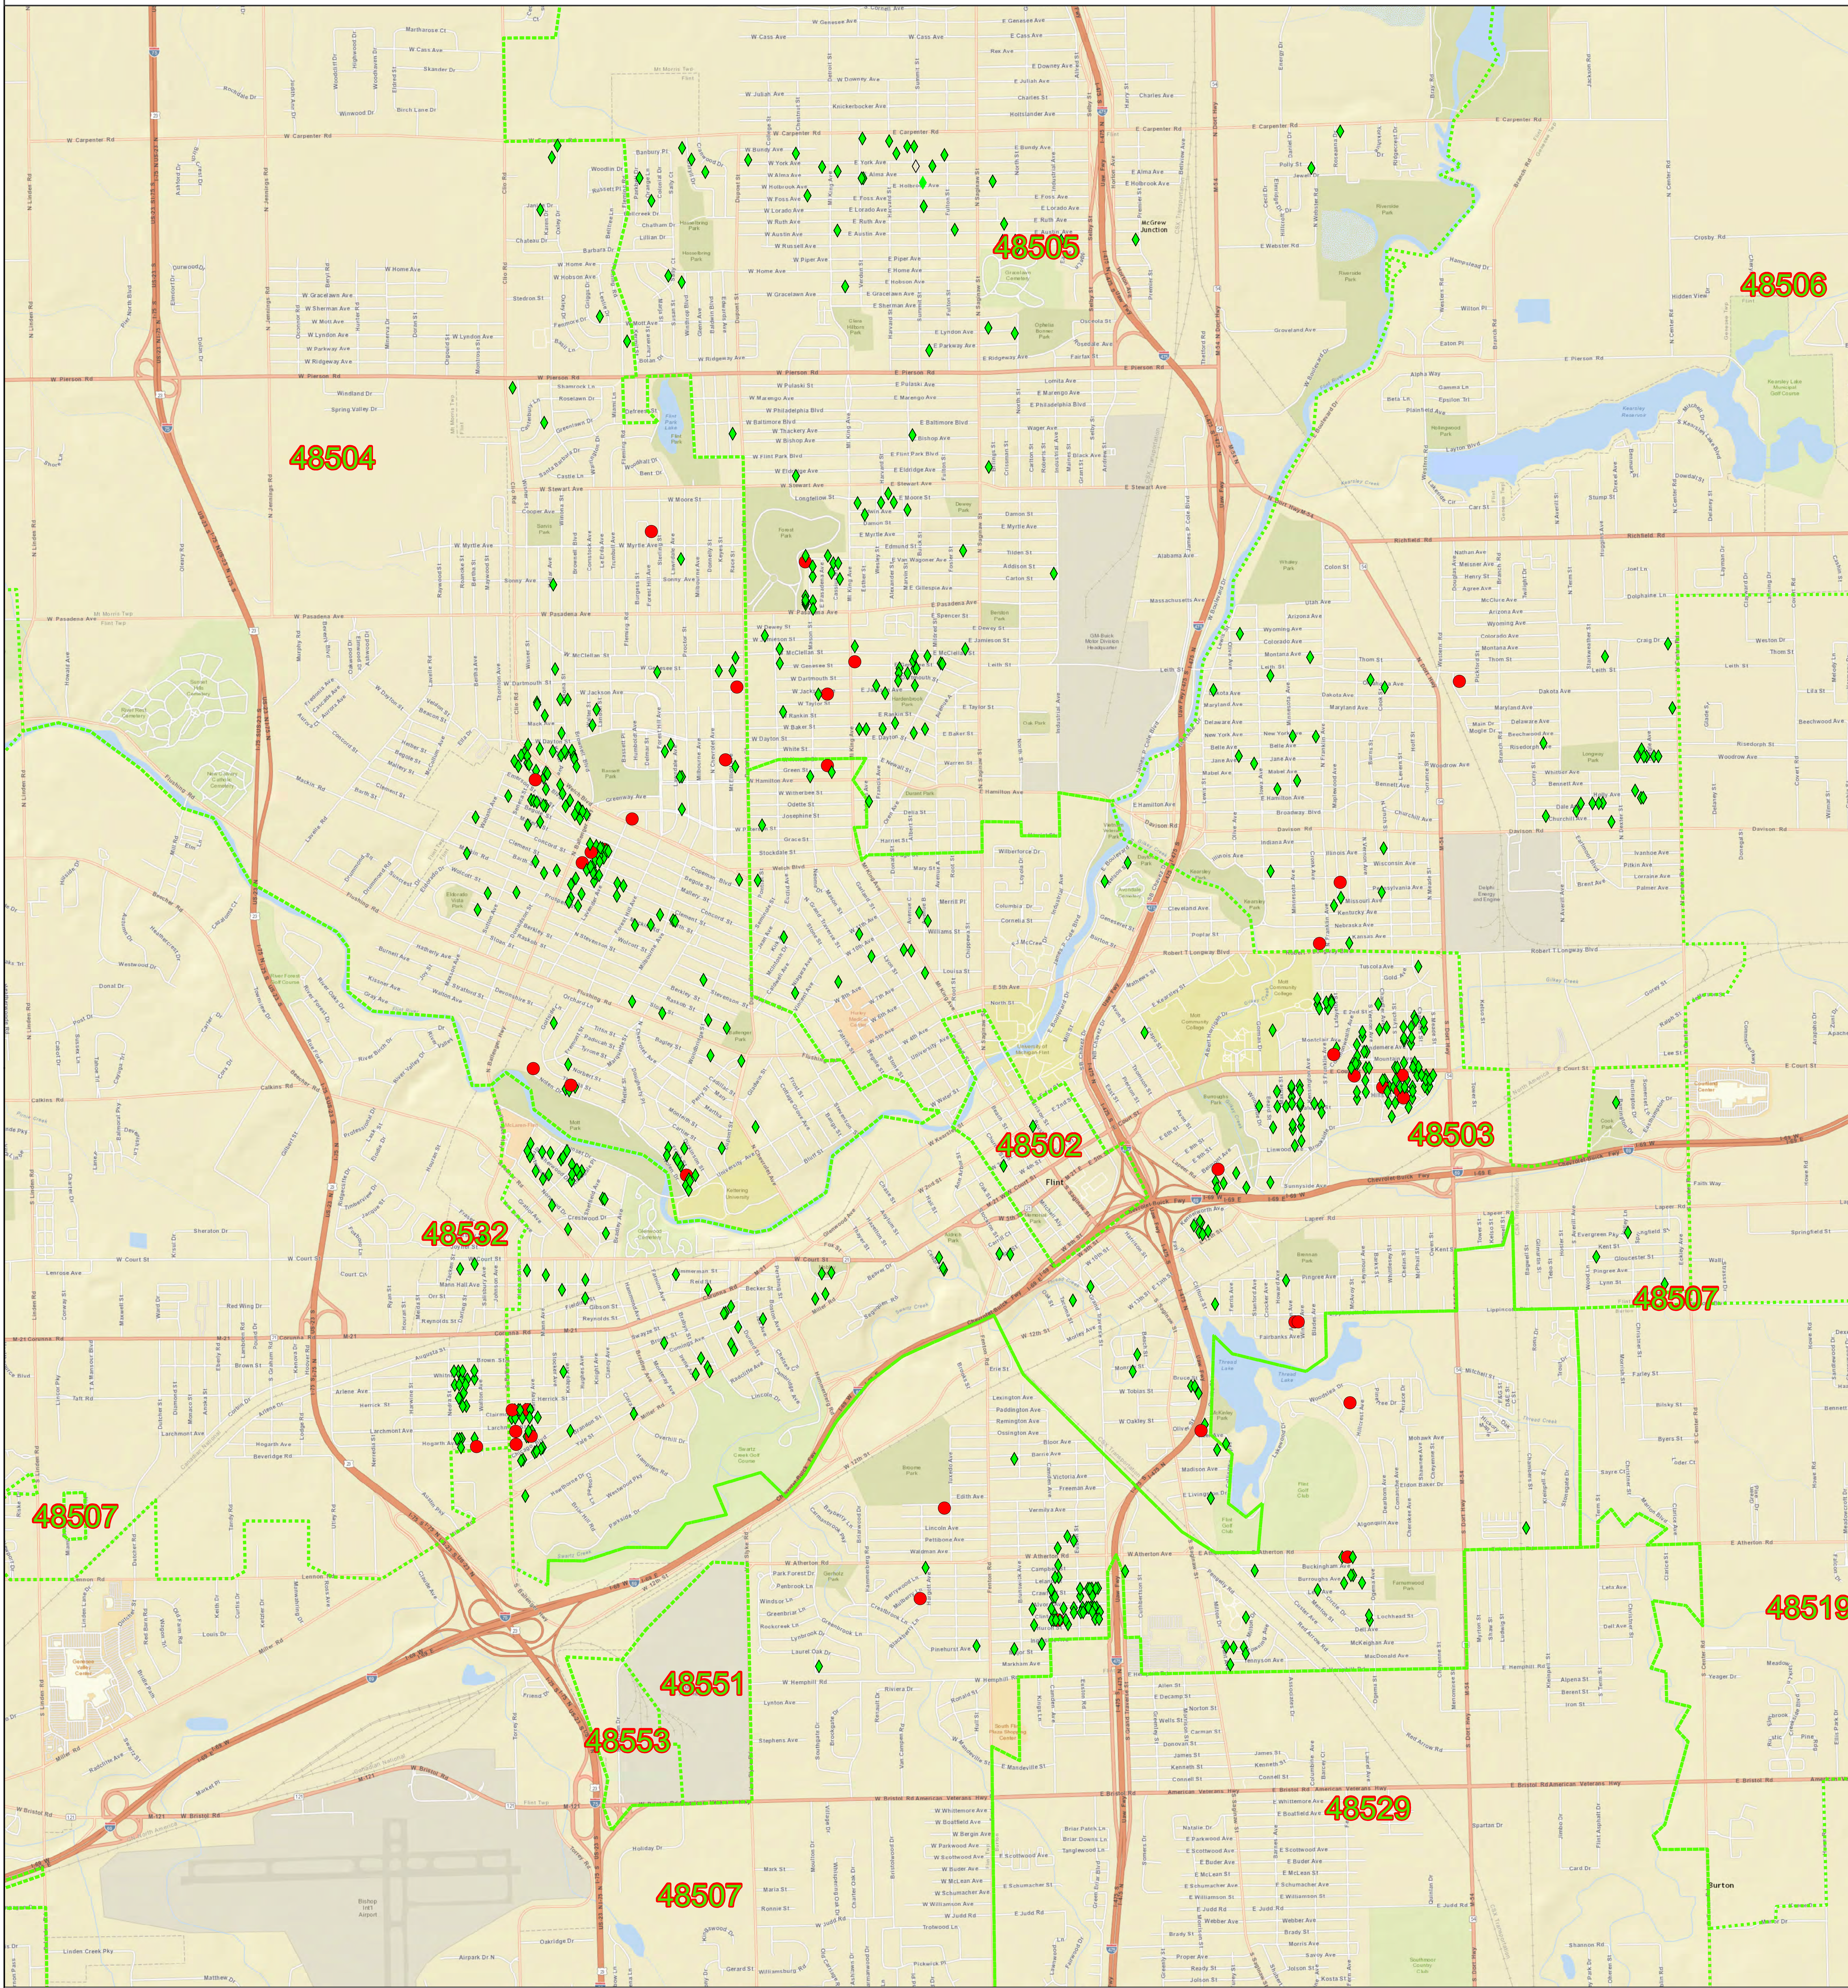

### Legend


#### Lead\_PPB

- ◆ 586 Results less than or equal to 15 parts per billion of Lead
- 40 Results greater than or equal to 16 parts per billion of Lead
- Flint Area Zip Codes



State of Michigan

Date: 5/10/2016

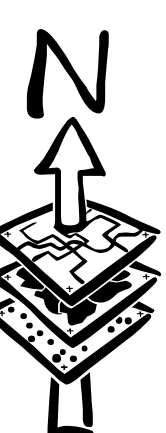

1 0.5 0 1 Miles