


Flint Water Incident - Extended Sentinel Sampling Round 10 - Lead



Legend

- Lead_ppb**
- ◆ 128 Results less than or equal to 15 parts per billion of Lead
 - 8 Results greater than 16 parts per billion of Lead
 - Flint w/Franchise Boundary
 - Flint Area Zip Codes

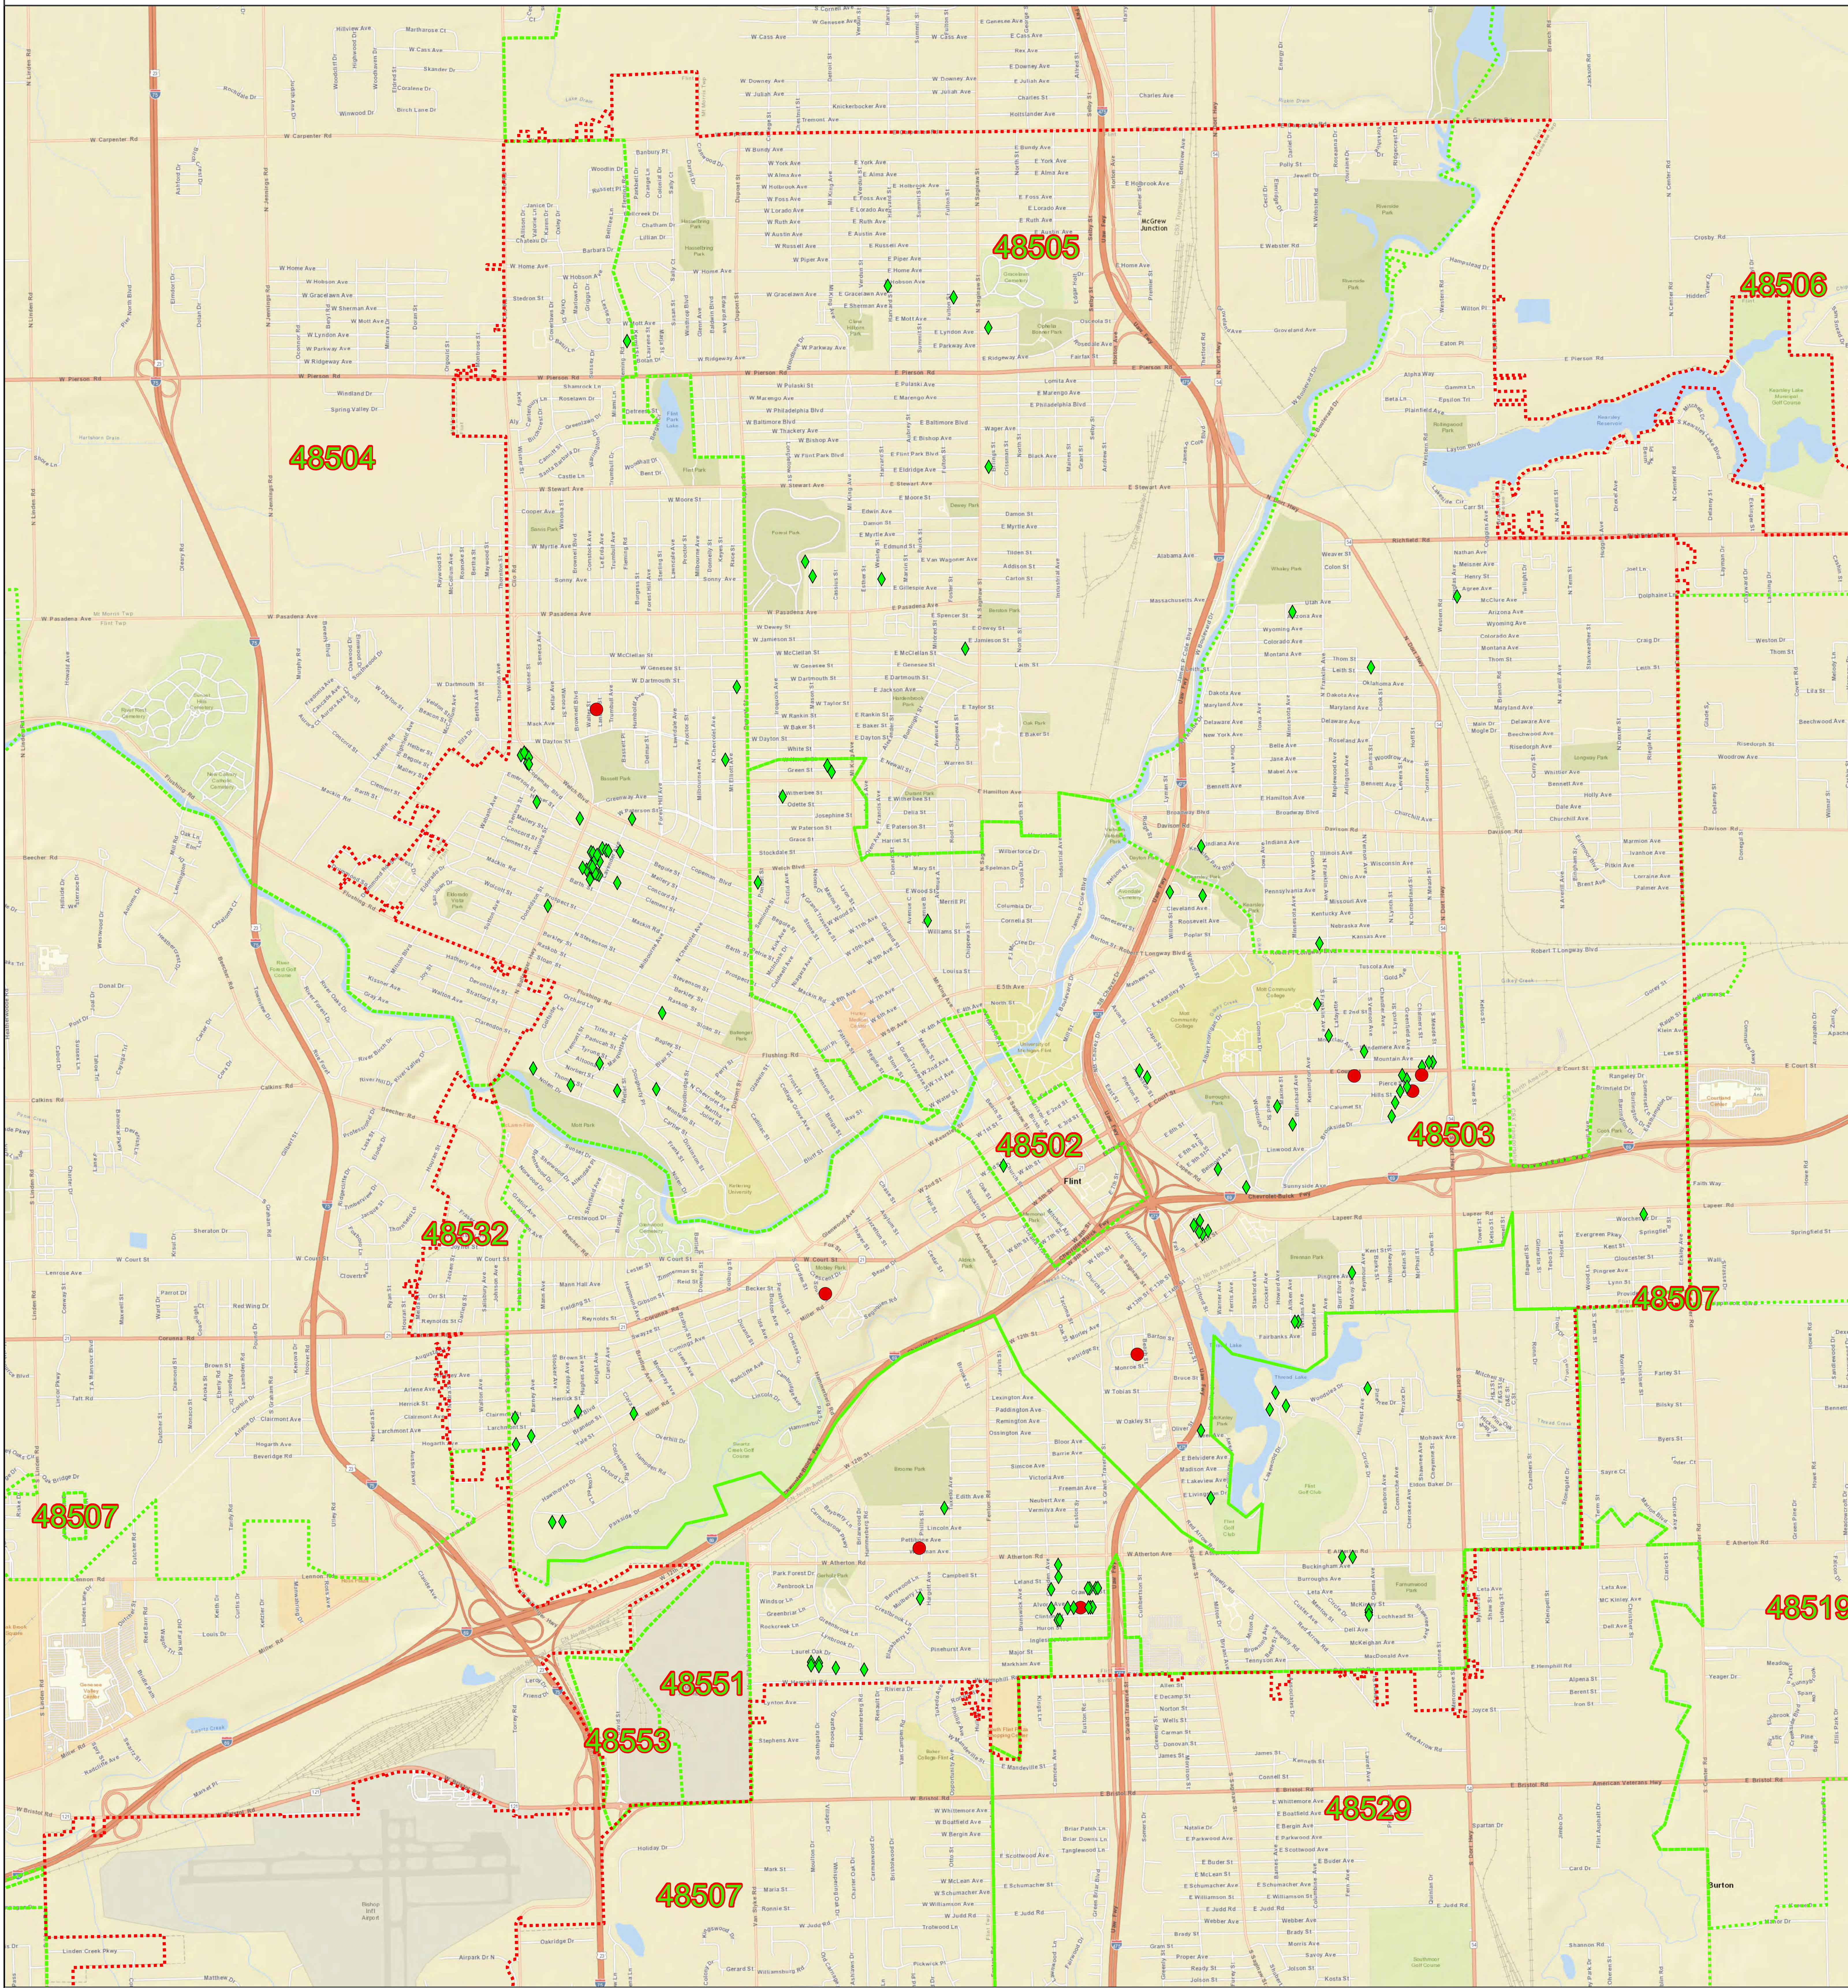

State of Michigan

Date: 7/25/2017

