


# Flint Water Incident - Extended Sentinel Sampling Round 8 - Lead

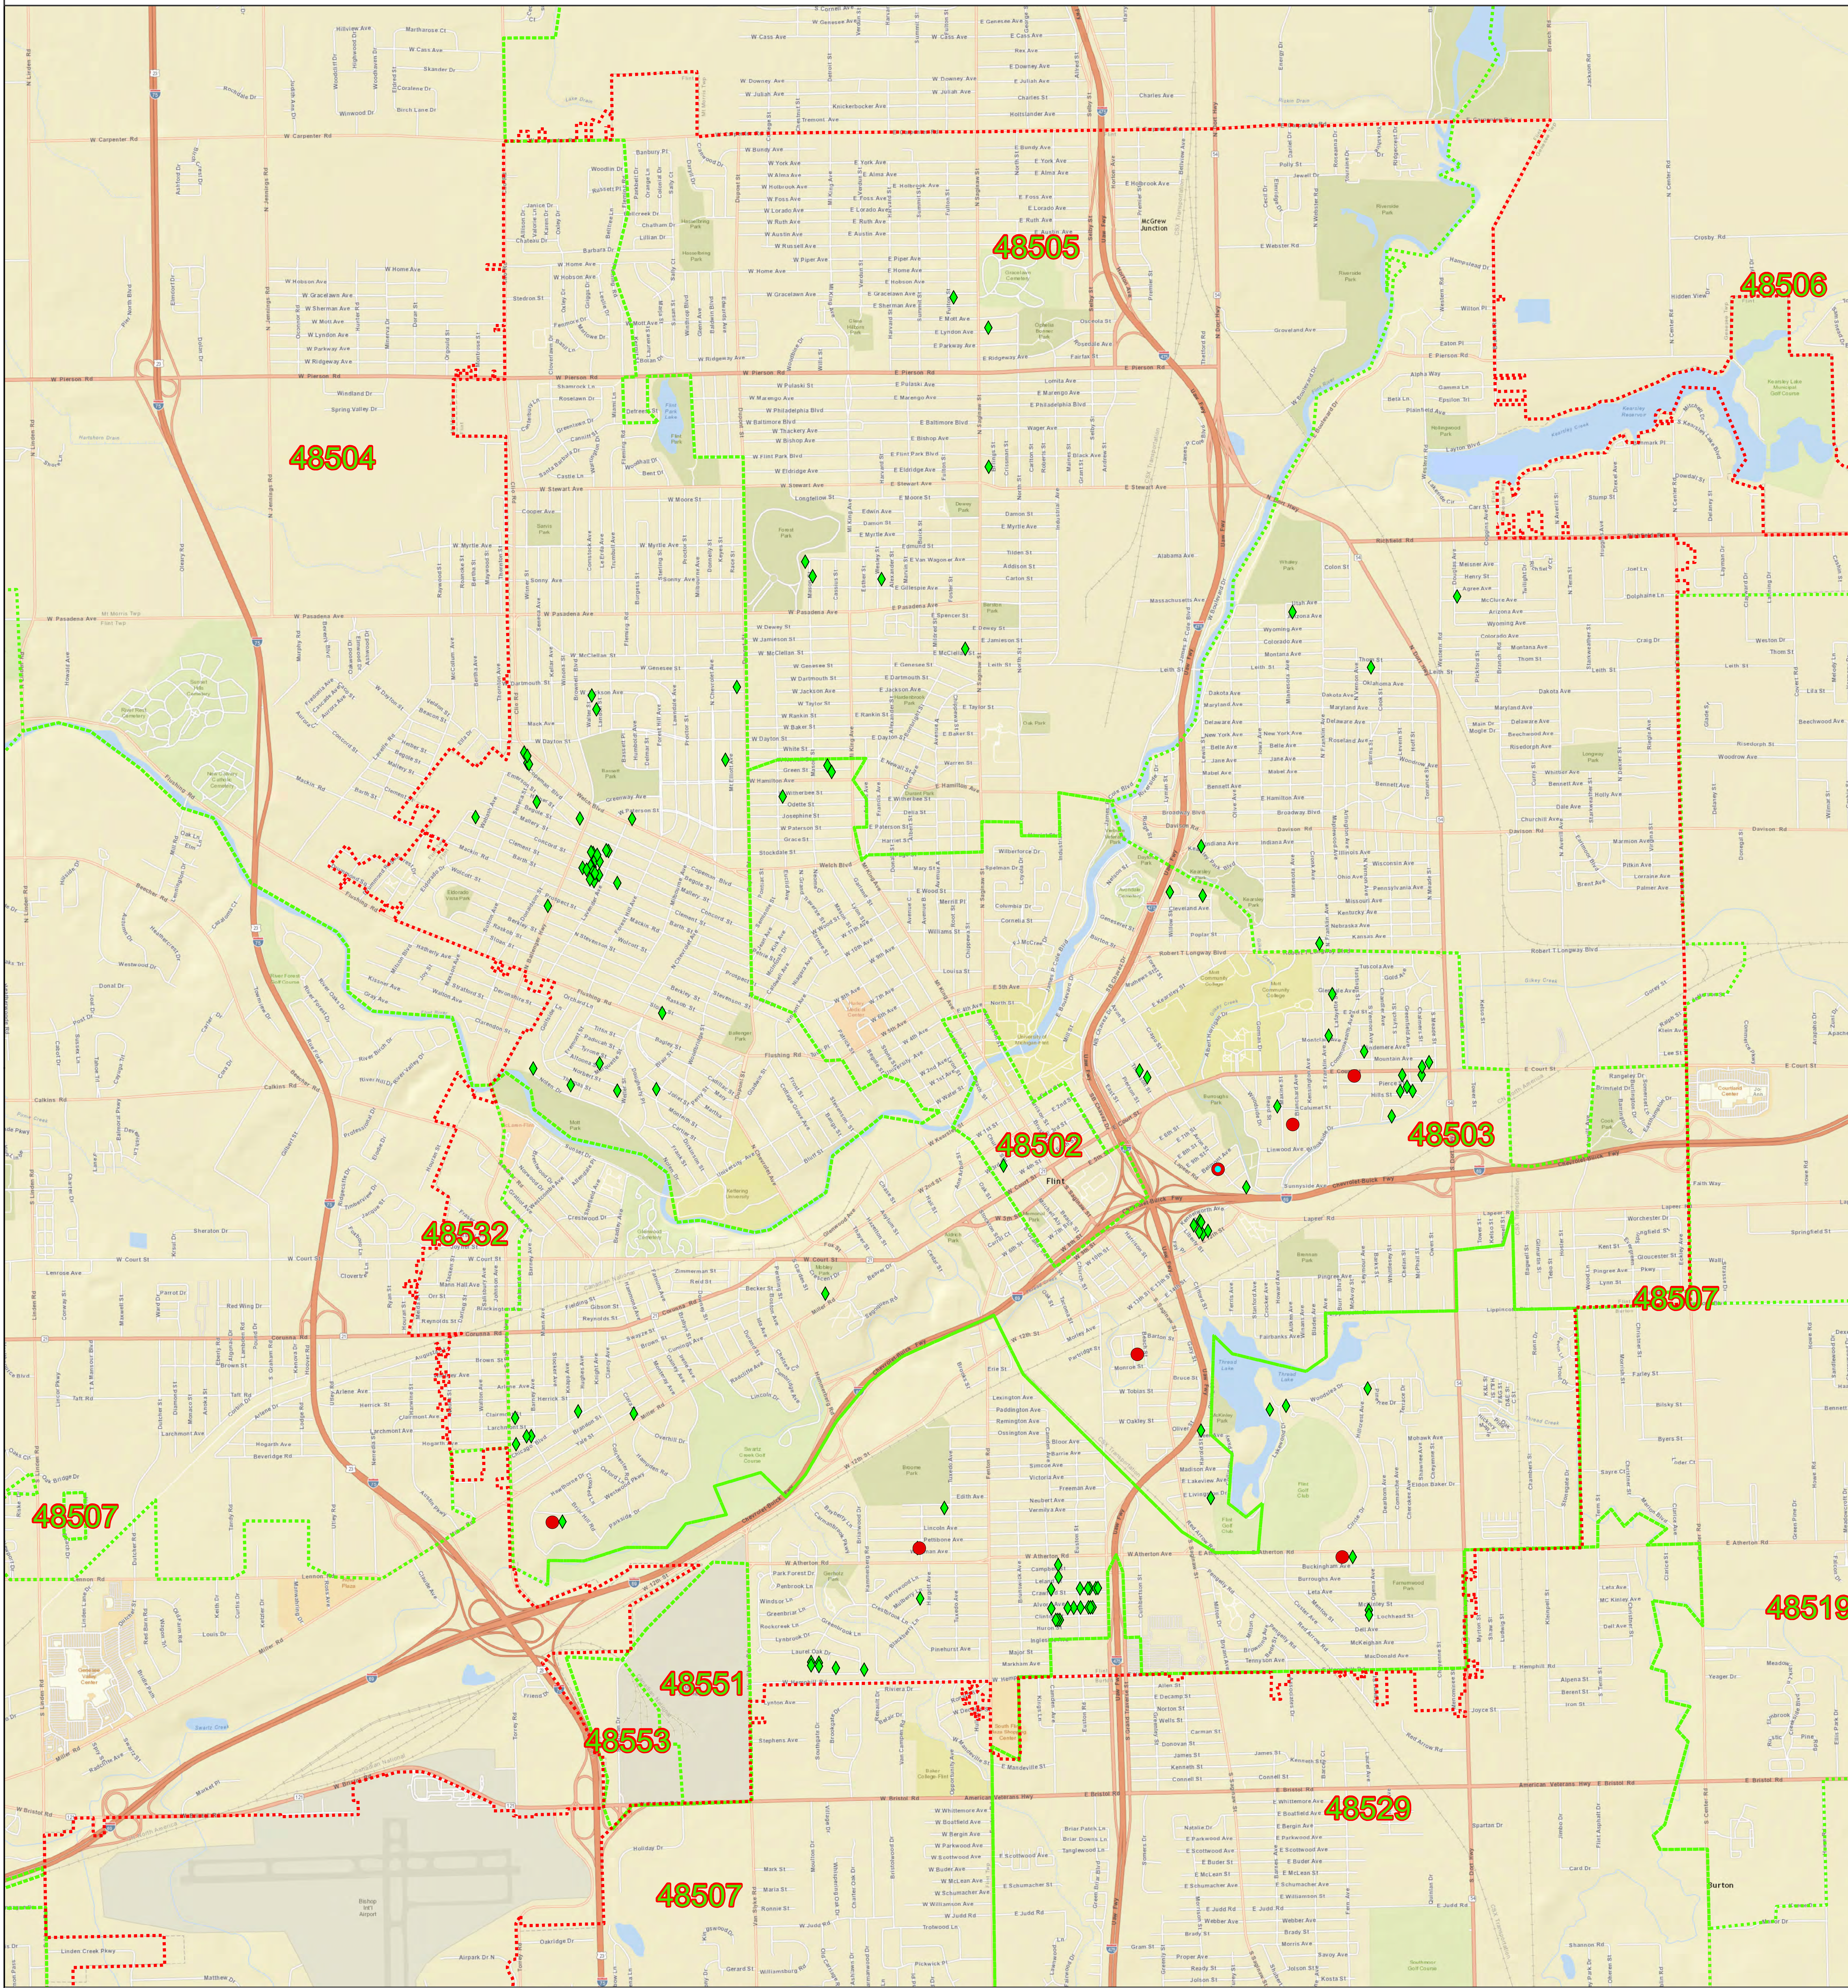


## Legend

### Lead\_ppb

- ◆ 118 Results less than or equal to 15 parts per billion of Lead
- 8 Results greater than 16 parts per billion of Lead
- Flint w/Franchise Boundary
- Flint Area Zip Codes



State of Michigan

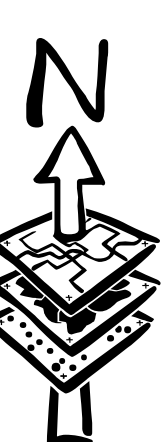

Date: 5/4/2017

1 0.5 0 1 Miles