


City of Flint Distribution System: Free Chlorine Residual
(Last Updated 5/5/22)

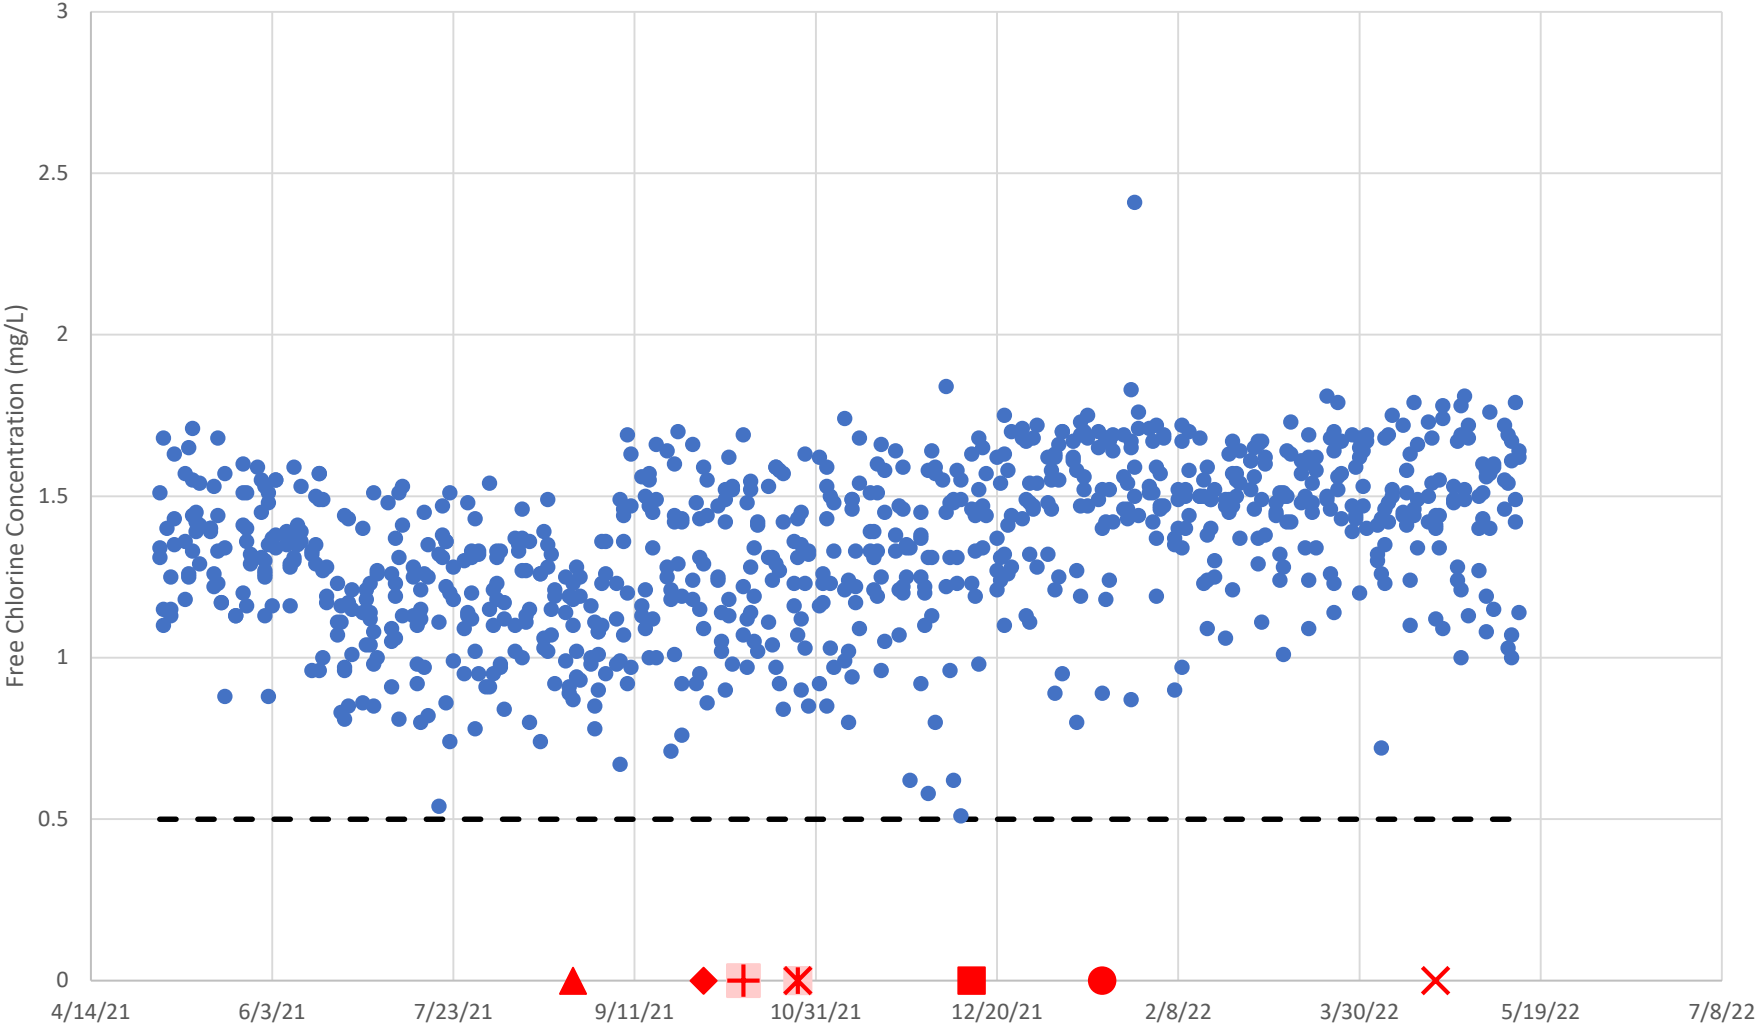

- Dist Free Cl₂ Residual
- Lower Limit (0.5)
- ▲ Transition Start Date (5% GCDC)
- ◆ Transition Start Date (25% GCDC)
- ⊕ Transition Start Date (50% GCDC)
- ✕ Transition Start Date (75% GCDC)
- Transition Start Date (50% GCDC)
- Transition Start Date (100% GCDC)
- ✕ Transition Start Date (5% GCDC)