


Michigan EGLE Part 201 Screening Levels	
Compound	Drinking Water (ng/l)
PFOA	8.0

ng/l = nanograms per liter

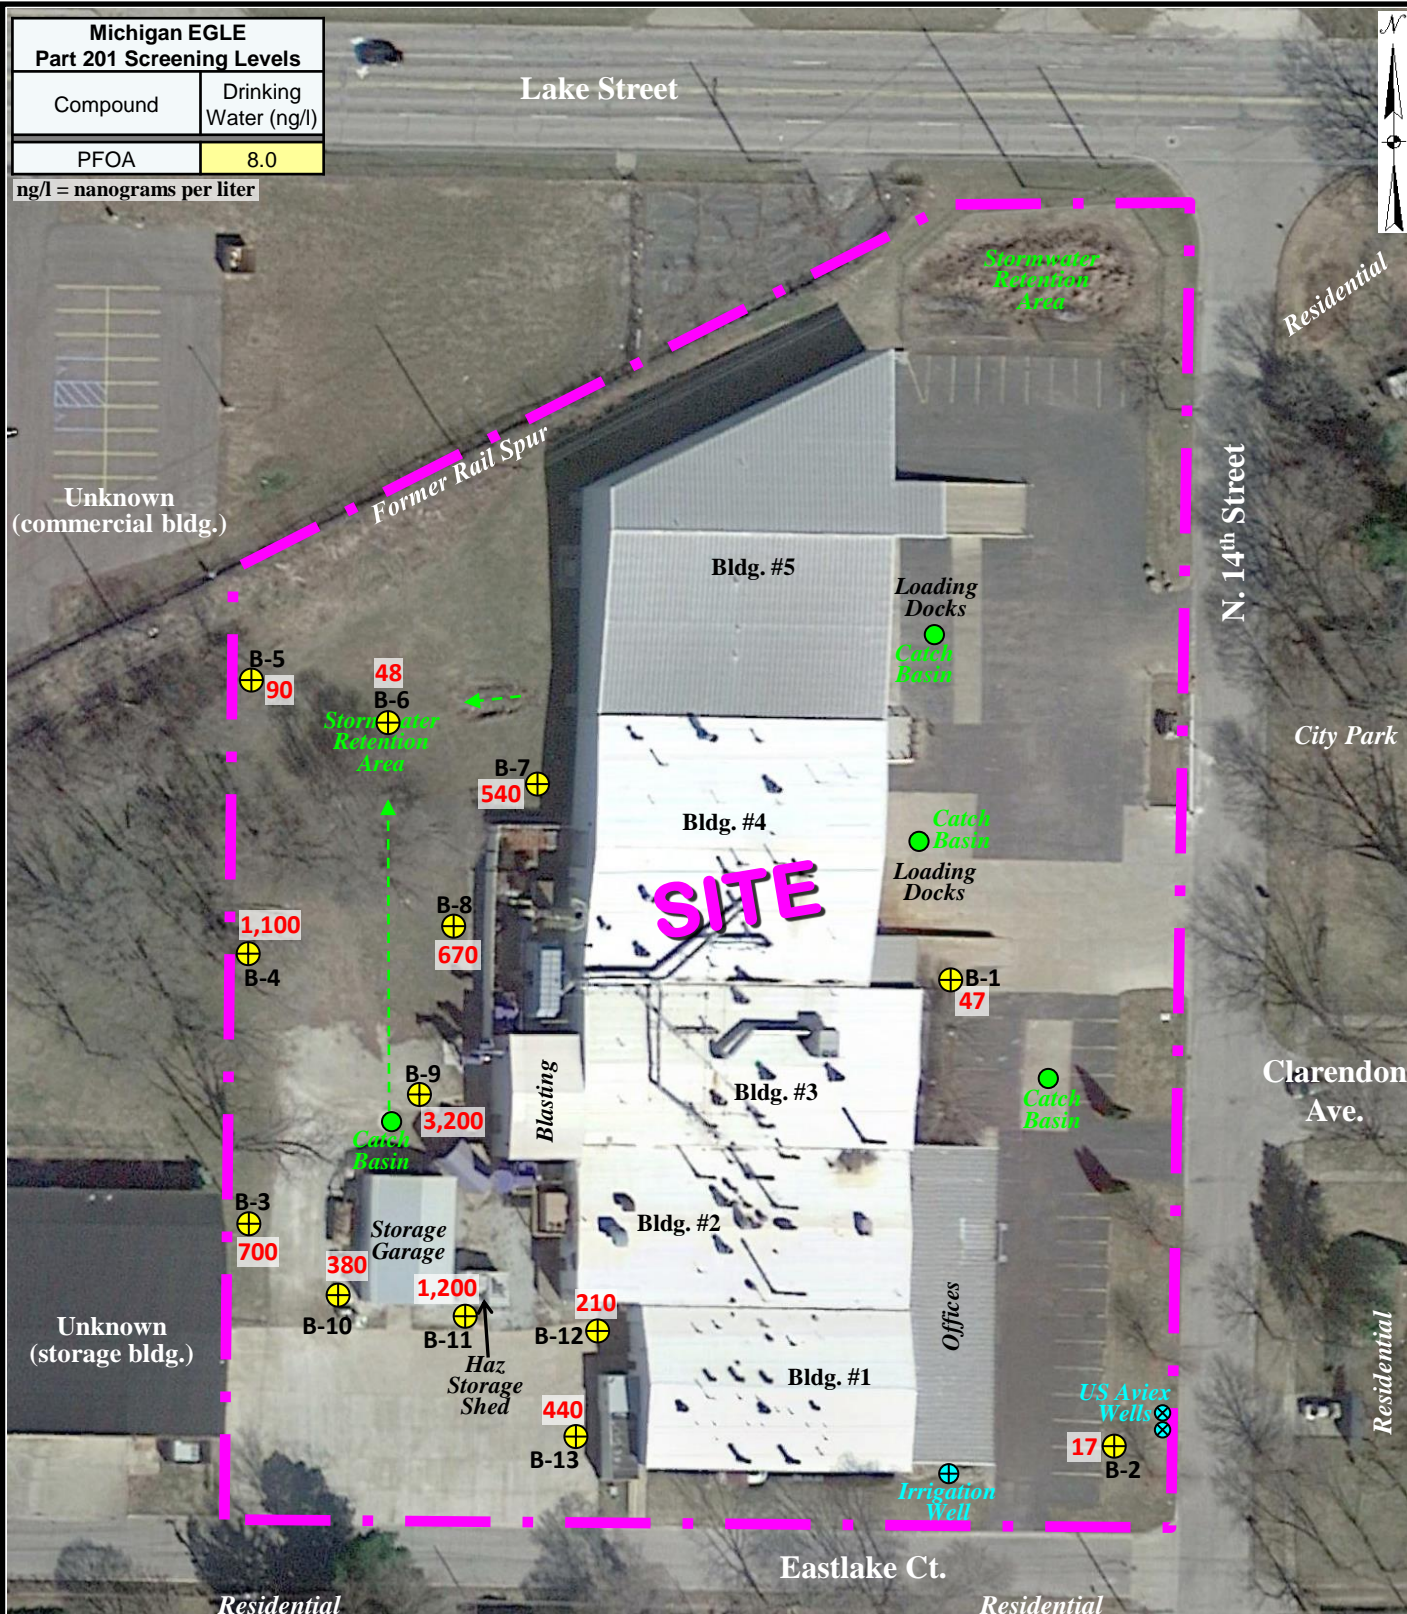

<p>⊕ Soil & Ground Water Samples 440 Perfluorooctanoic acid (PFOA) concentration (ng/l – red exceeds screening level)</p>	<p>Prepared By: DDJ</p>	<p>Date Prepared: January 2022</p>
----------------------------------------------------------------------------------------------------------------------------------	-------------------------	------------------------------------

<p>Google Earth Aerial Date: 2021</p>	<p>Approximate Scale: 1.0-inch ~ 70-feet</p>
-------------------------------------------	--------------------------------------------------

ROBERTS ENVIRONMENTAL SERVICES, LLC
 2112 Carmen Court • Goshen, Indiana
 101 W. Ohio Street, Ste. 2000 • Indianapolis, Indiana
www.robertsenvironmental.net

**PFOA IN GROUND WATER
 TOEFCO COATINGS
 1220 NORTH 14th STREET
 NILES, MICHIGAN**