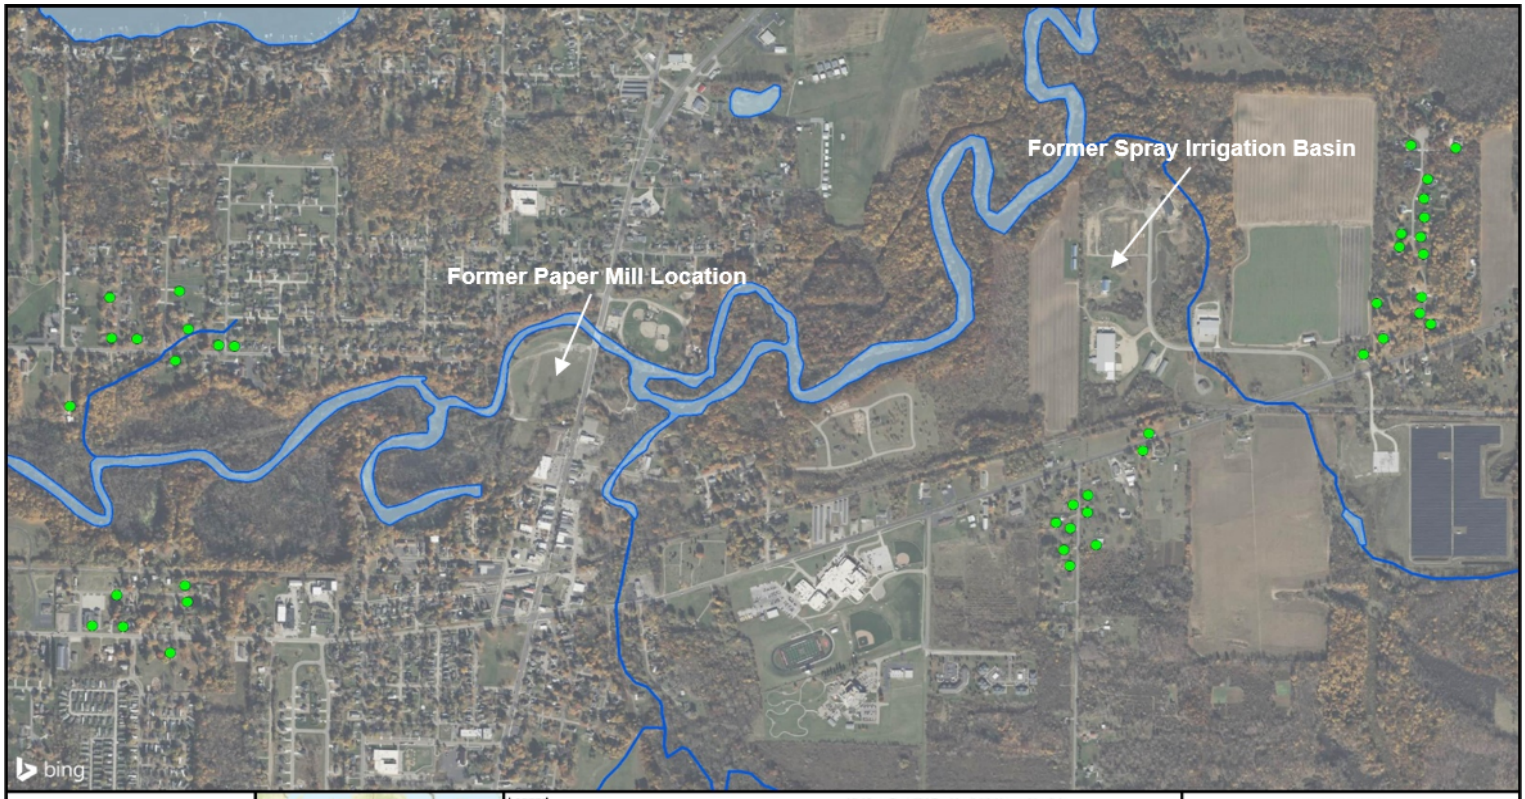

AECOM

Drawn: AA	Date: 11/5/2024
Approved: DB	Date: 11/5/2024
Project #: 60733947	

Legend

Residential Well Sample

- No Detections of Analyzed PFAS
- One or more PFAS Detected
- One or more of the 7 PFAS with Michigan Part 201
- Surface Water Body

Labels list PFAS with DWC that were detected.

Michigan Part 201 Residential & Nonresidential Drinking Water Criteria (DWC), ng/L
PFHxA = 400,000
PFOA = 8
PFNA = 6
PFBS = 420
PFHxS = 51
PFOS = 16
HFPO-DA = 370

N

0 400 800 1,600 2,400 Feet

FIGURE 2

WATERVLIET
PFAS HEATMAP

BERRIEN COUNTY, MI