


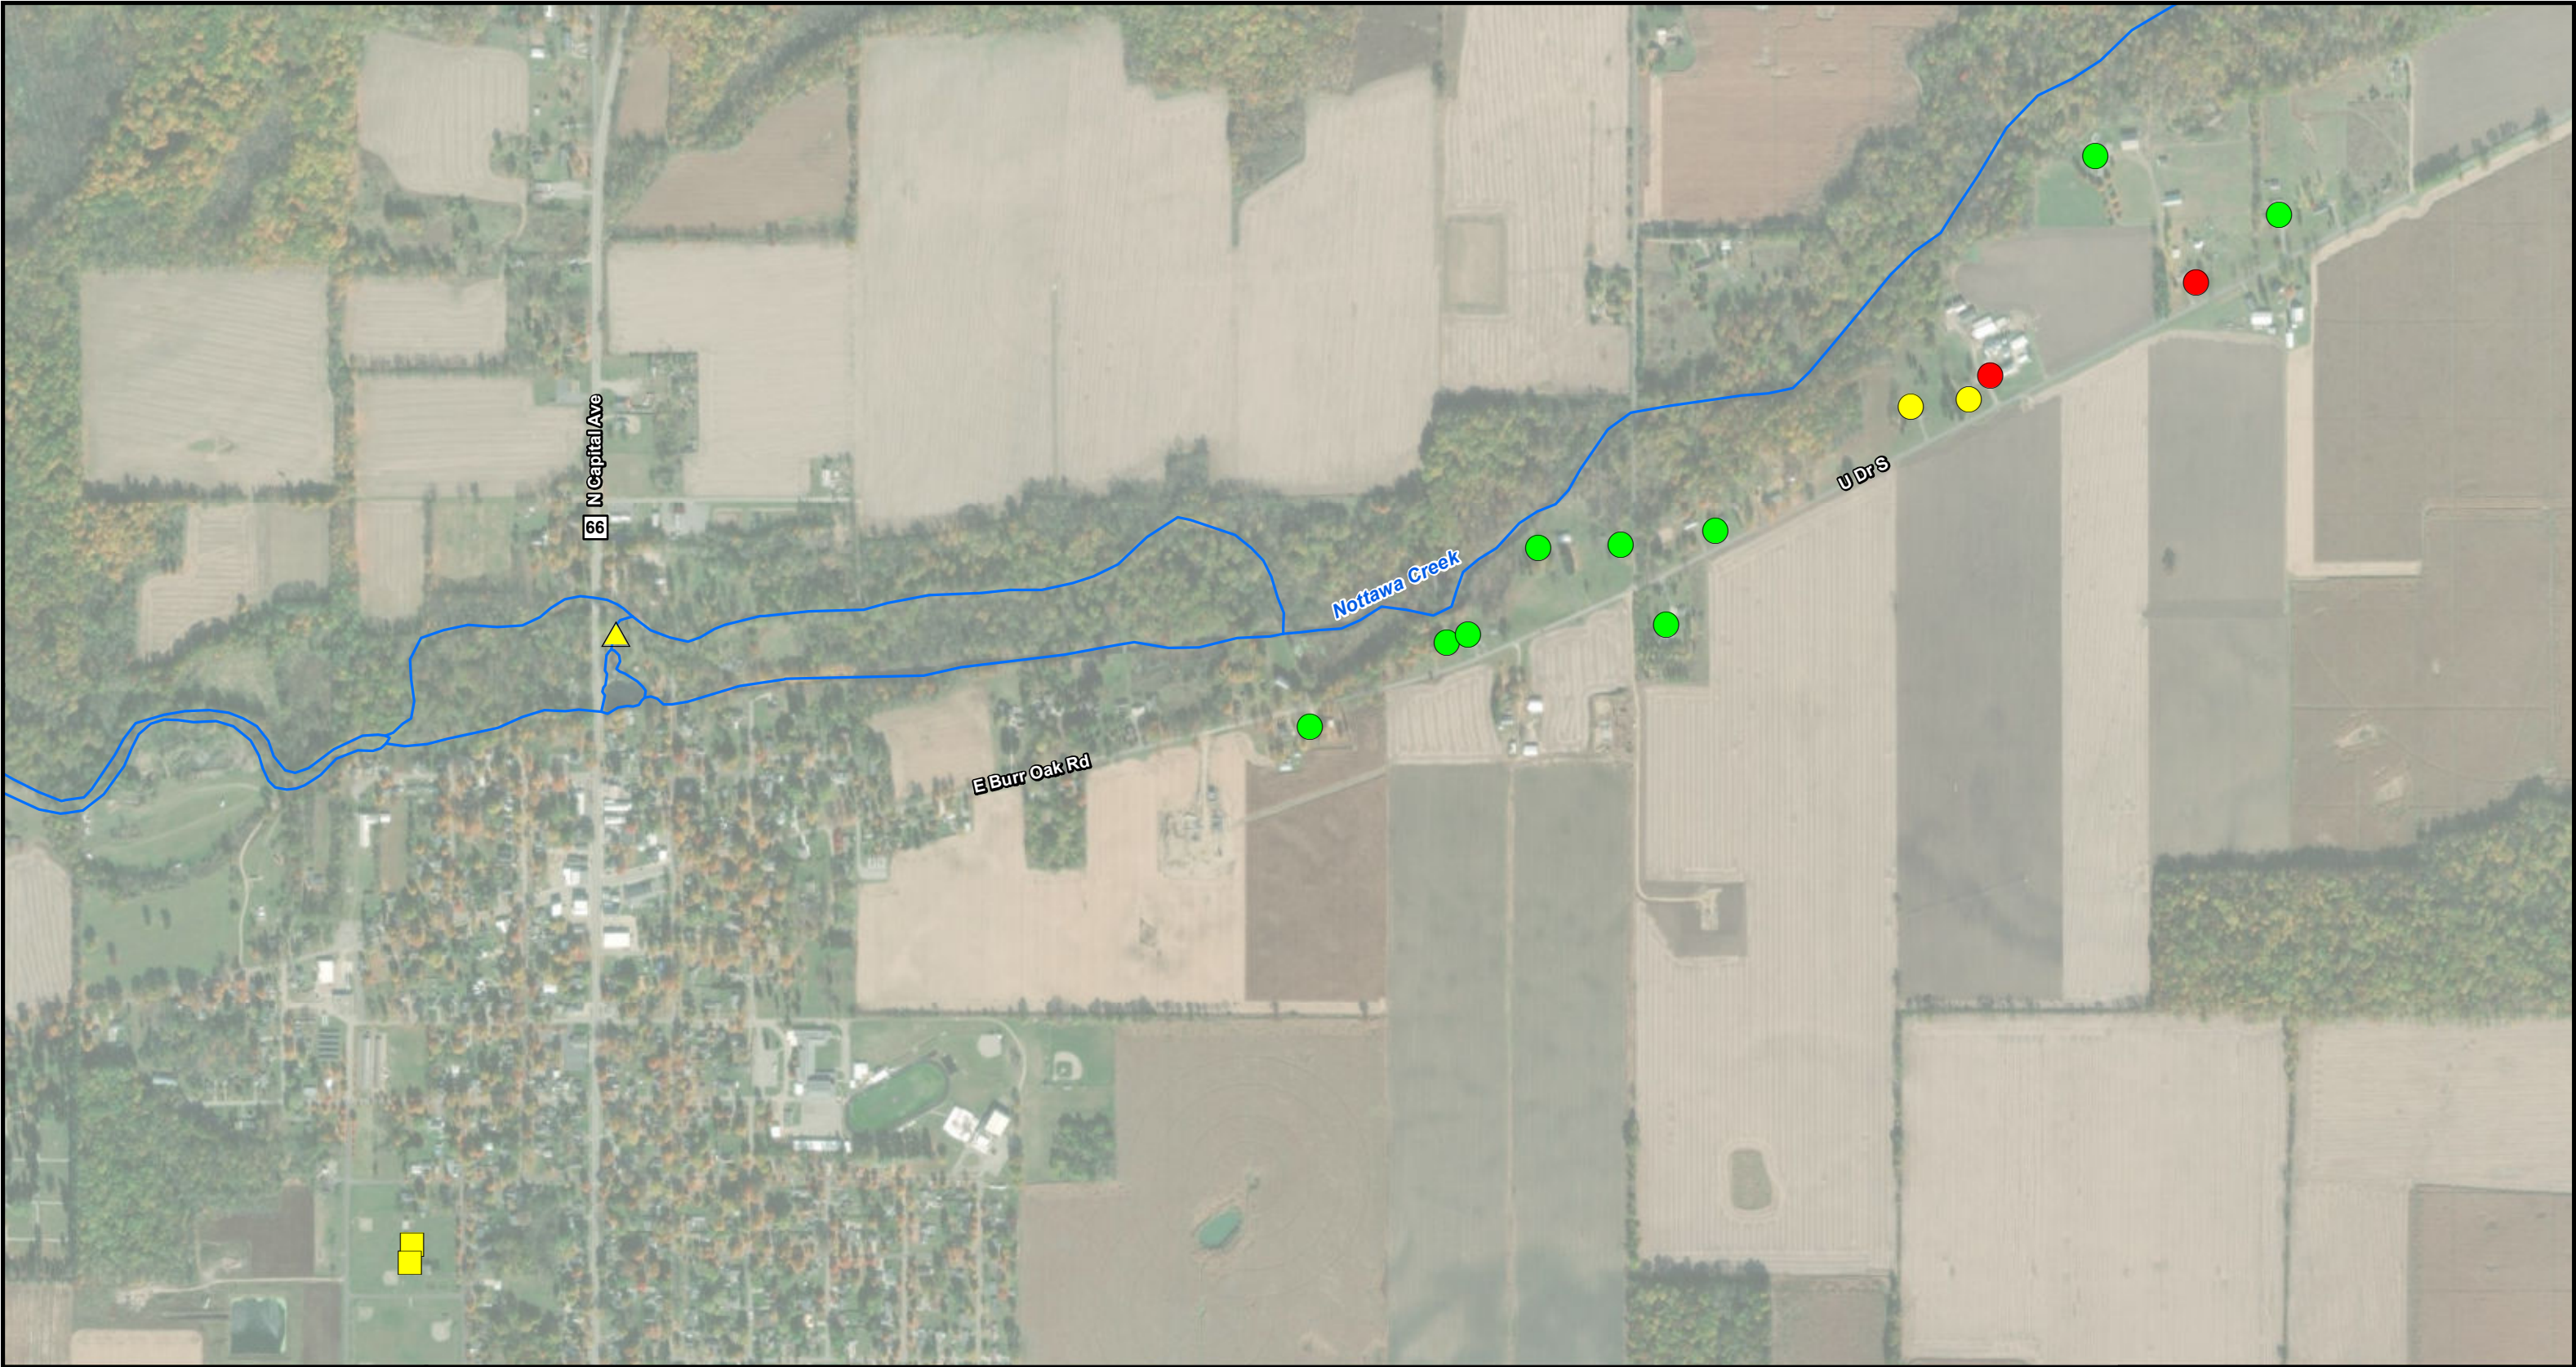

Drawn: DP Date: 3/17/2025

Approved: DB Date: 3/17/2025

Project #: 60560354

Legend
Sample Type

- Residential Well Sample
- Municipal Well Sample

PFAS Criteria Heat Map

- No Detections of Analyzed PFAS
- One or more PFAS Detected
- One or more of the 7 PFAS with Michigan Part 201 GSI Criteria Detected Above Criteria
- Michigan Part 201 DWC Detected Above Criteria

Surface Water Sample

- ▲ No Detections of Analyzed PFAS
- ▲ One or more PFAS Detected
- ▲ One or more of the 5 PFAS with Michigan Part 201 GSI Criteria Detected Above Criteria
- Surface Water Body

Michigan Part 201 Residential & Nonresidential Drinking Water Criteria (DWC), ng/L

PFHxA = 400,000	PFHxS = 51
PFOA = 8	PFOS = 16
PFNA = 6	HFPO-DA = 370
PFBS = 420	

Michigan Part 201 Groundwater/Surface Water Interface Criteria (GSI), ng/L

PFOA = 170	PFHxS = 210
PFNA = 30	PFOS = 12
PFBS = 670,000	

FIGURE 1
PFAS CRITERIA HEAT MAP

ATHENS AREA OF INTEREST
CALHOUN COUNTY, MI