


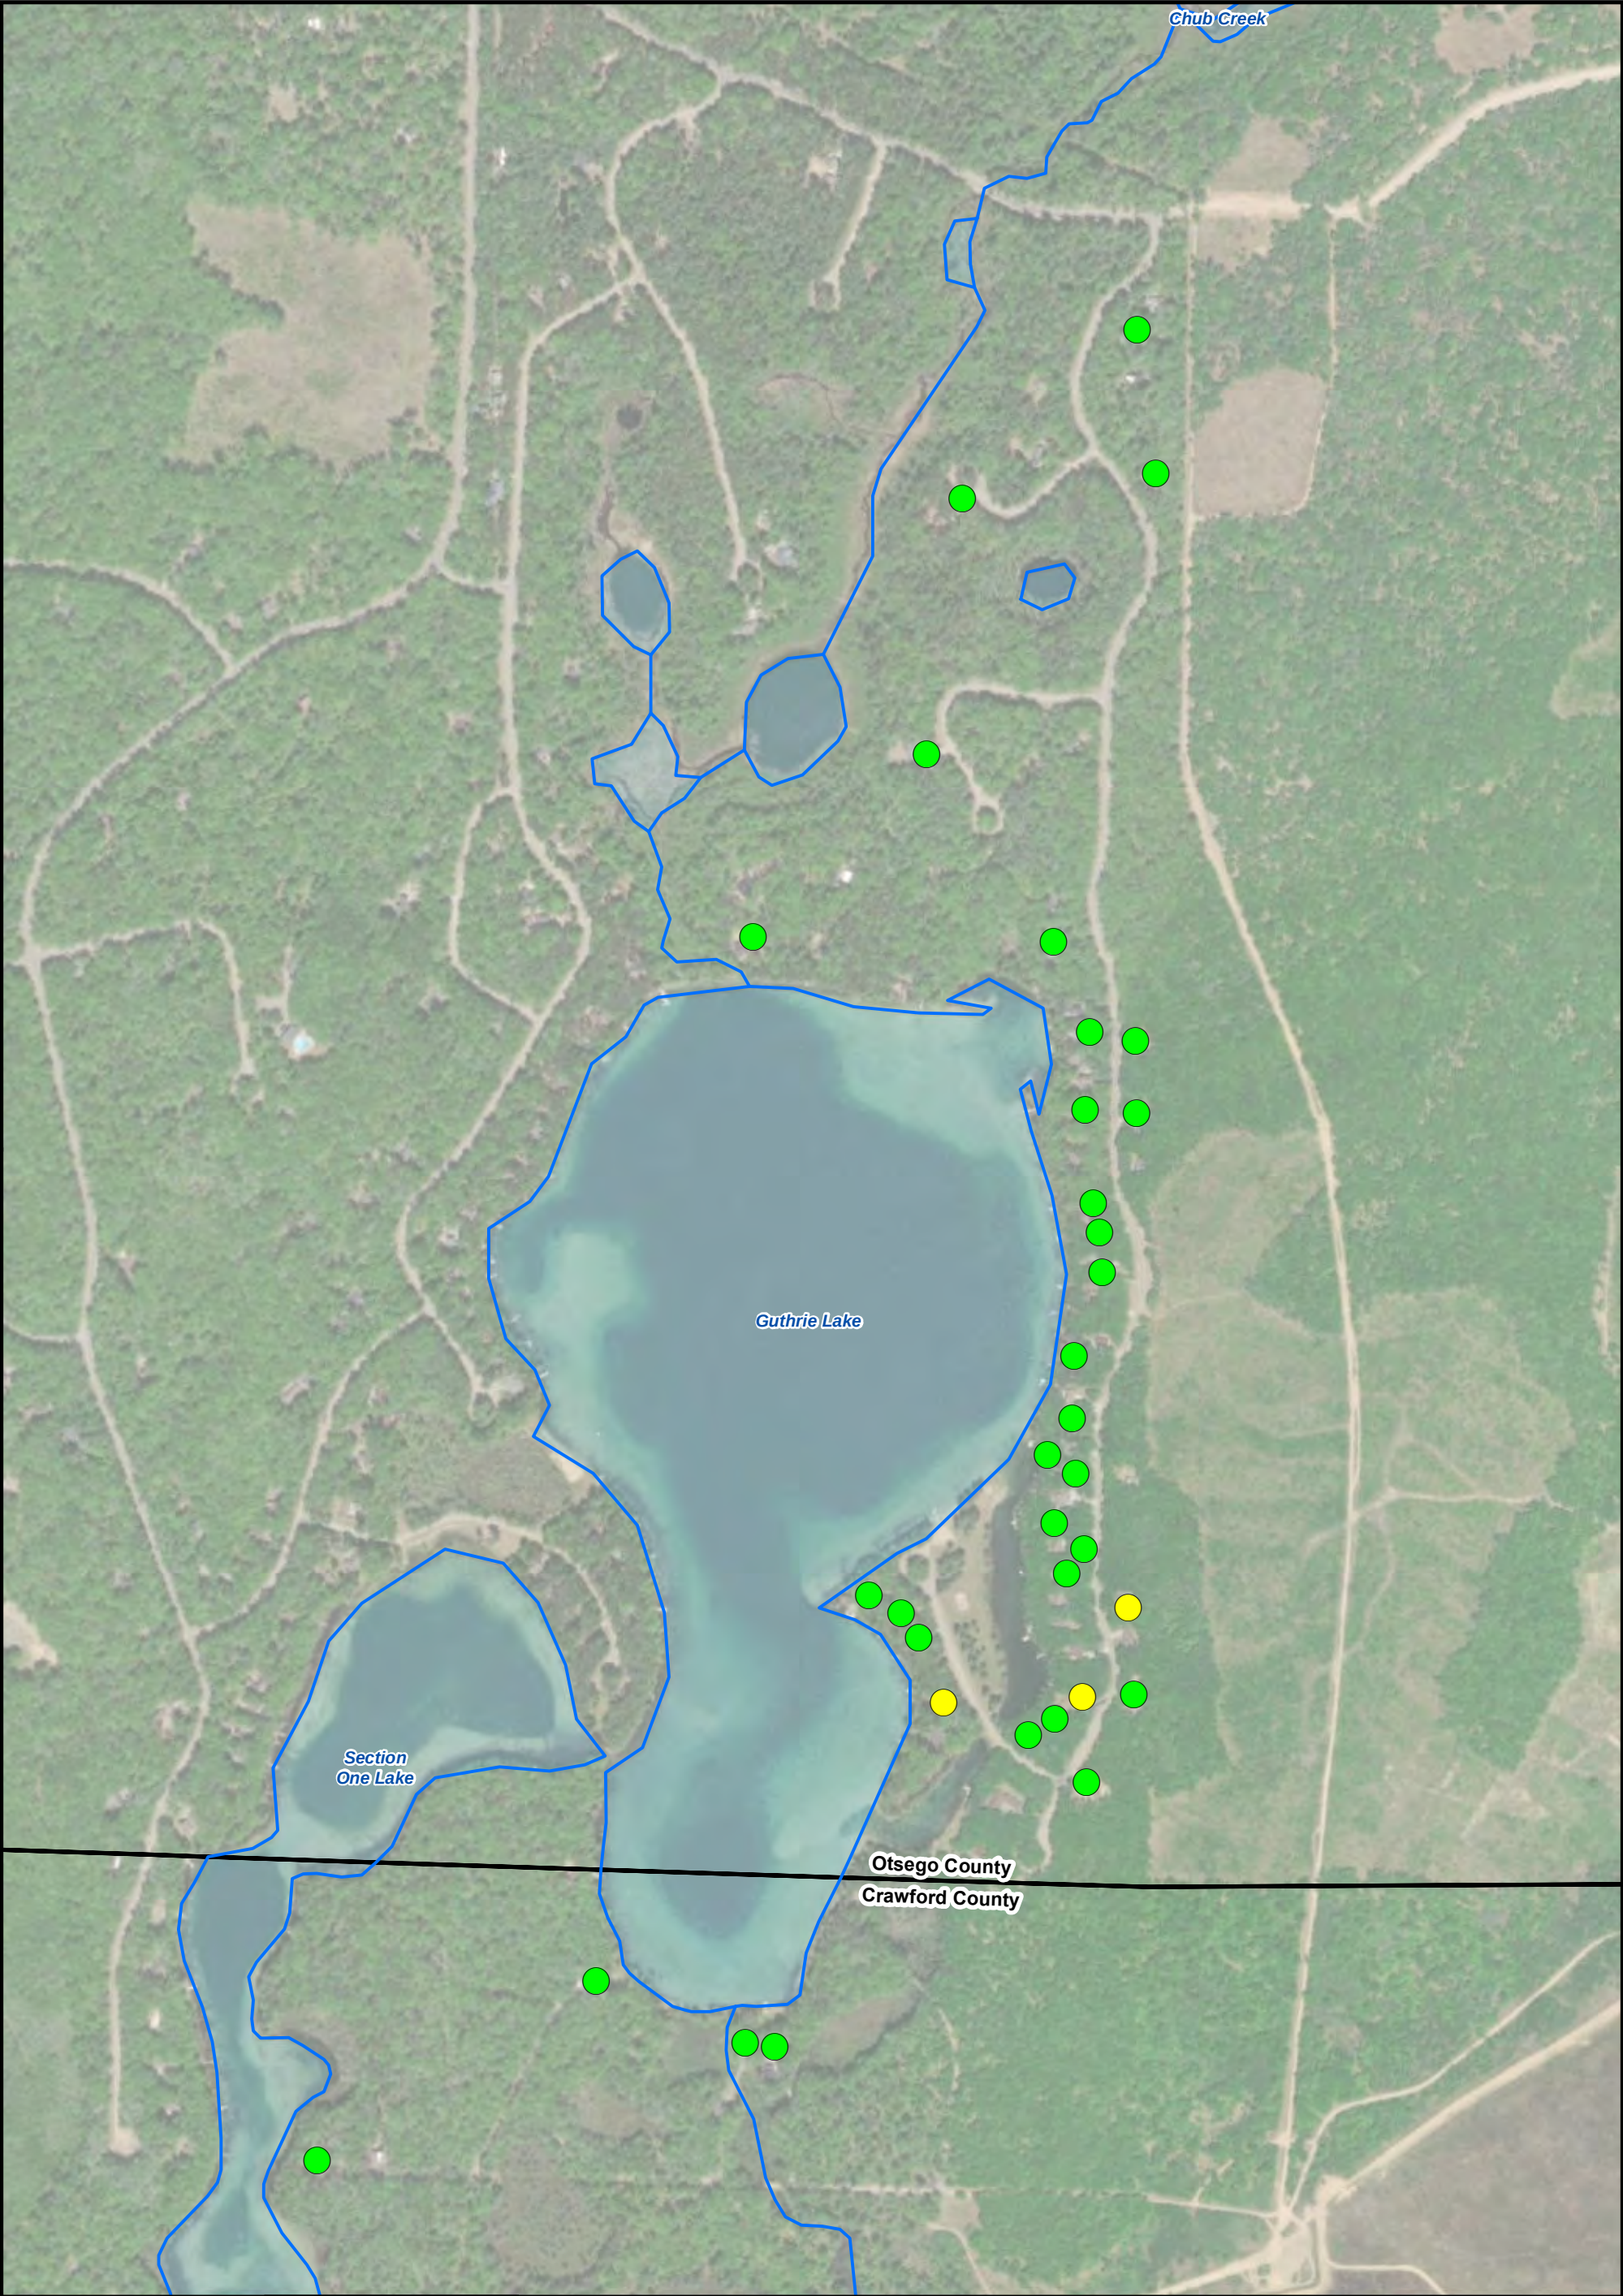

Drawn: DP Date: 8/29/2023 Approved: JM Date: 8/29/2023 Project #: 60560354		Legend Residential Well Samples ● Non-Detect ● Detection Below Part 201 DWC ● Detection Above Part 201 DWC — Waterbodies Michigan Part 201 Residential & Nonresidential Drinking Water Criteria (DWC), ng/L PFHxA = 400,000 PFHxS = 51 PFOA = 8 PFOS = 16 PFNA = 6 HFPO-DA = 370 PFBS = 420 N 0 600 1,200 Feet	MPART-GRAYLING RANGE 40 EGLE PART 201 CRITERIA HEAT MAP CRAWFORD AND OTSEGO COUNTIES, MI
--	--	---	--