




# DRAFT

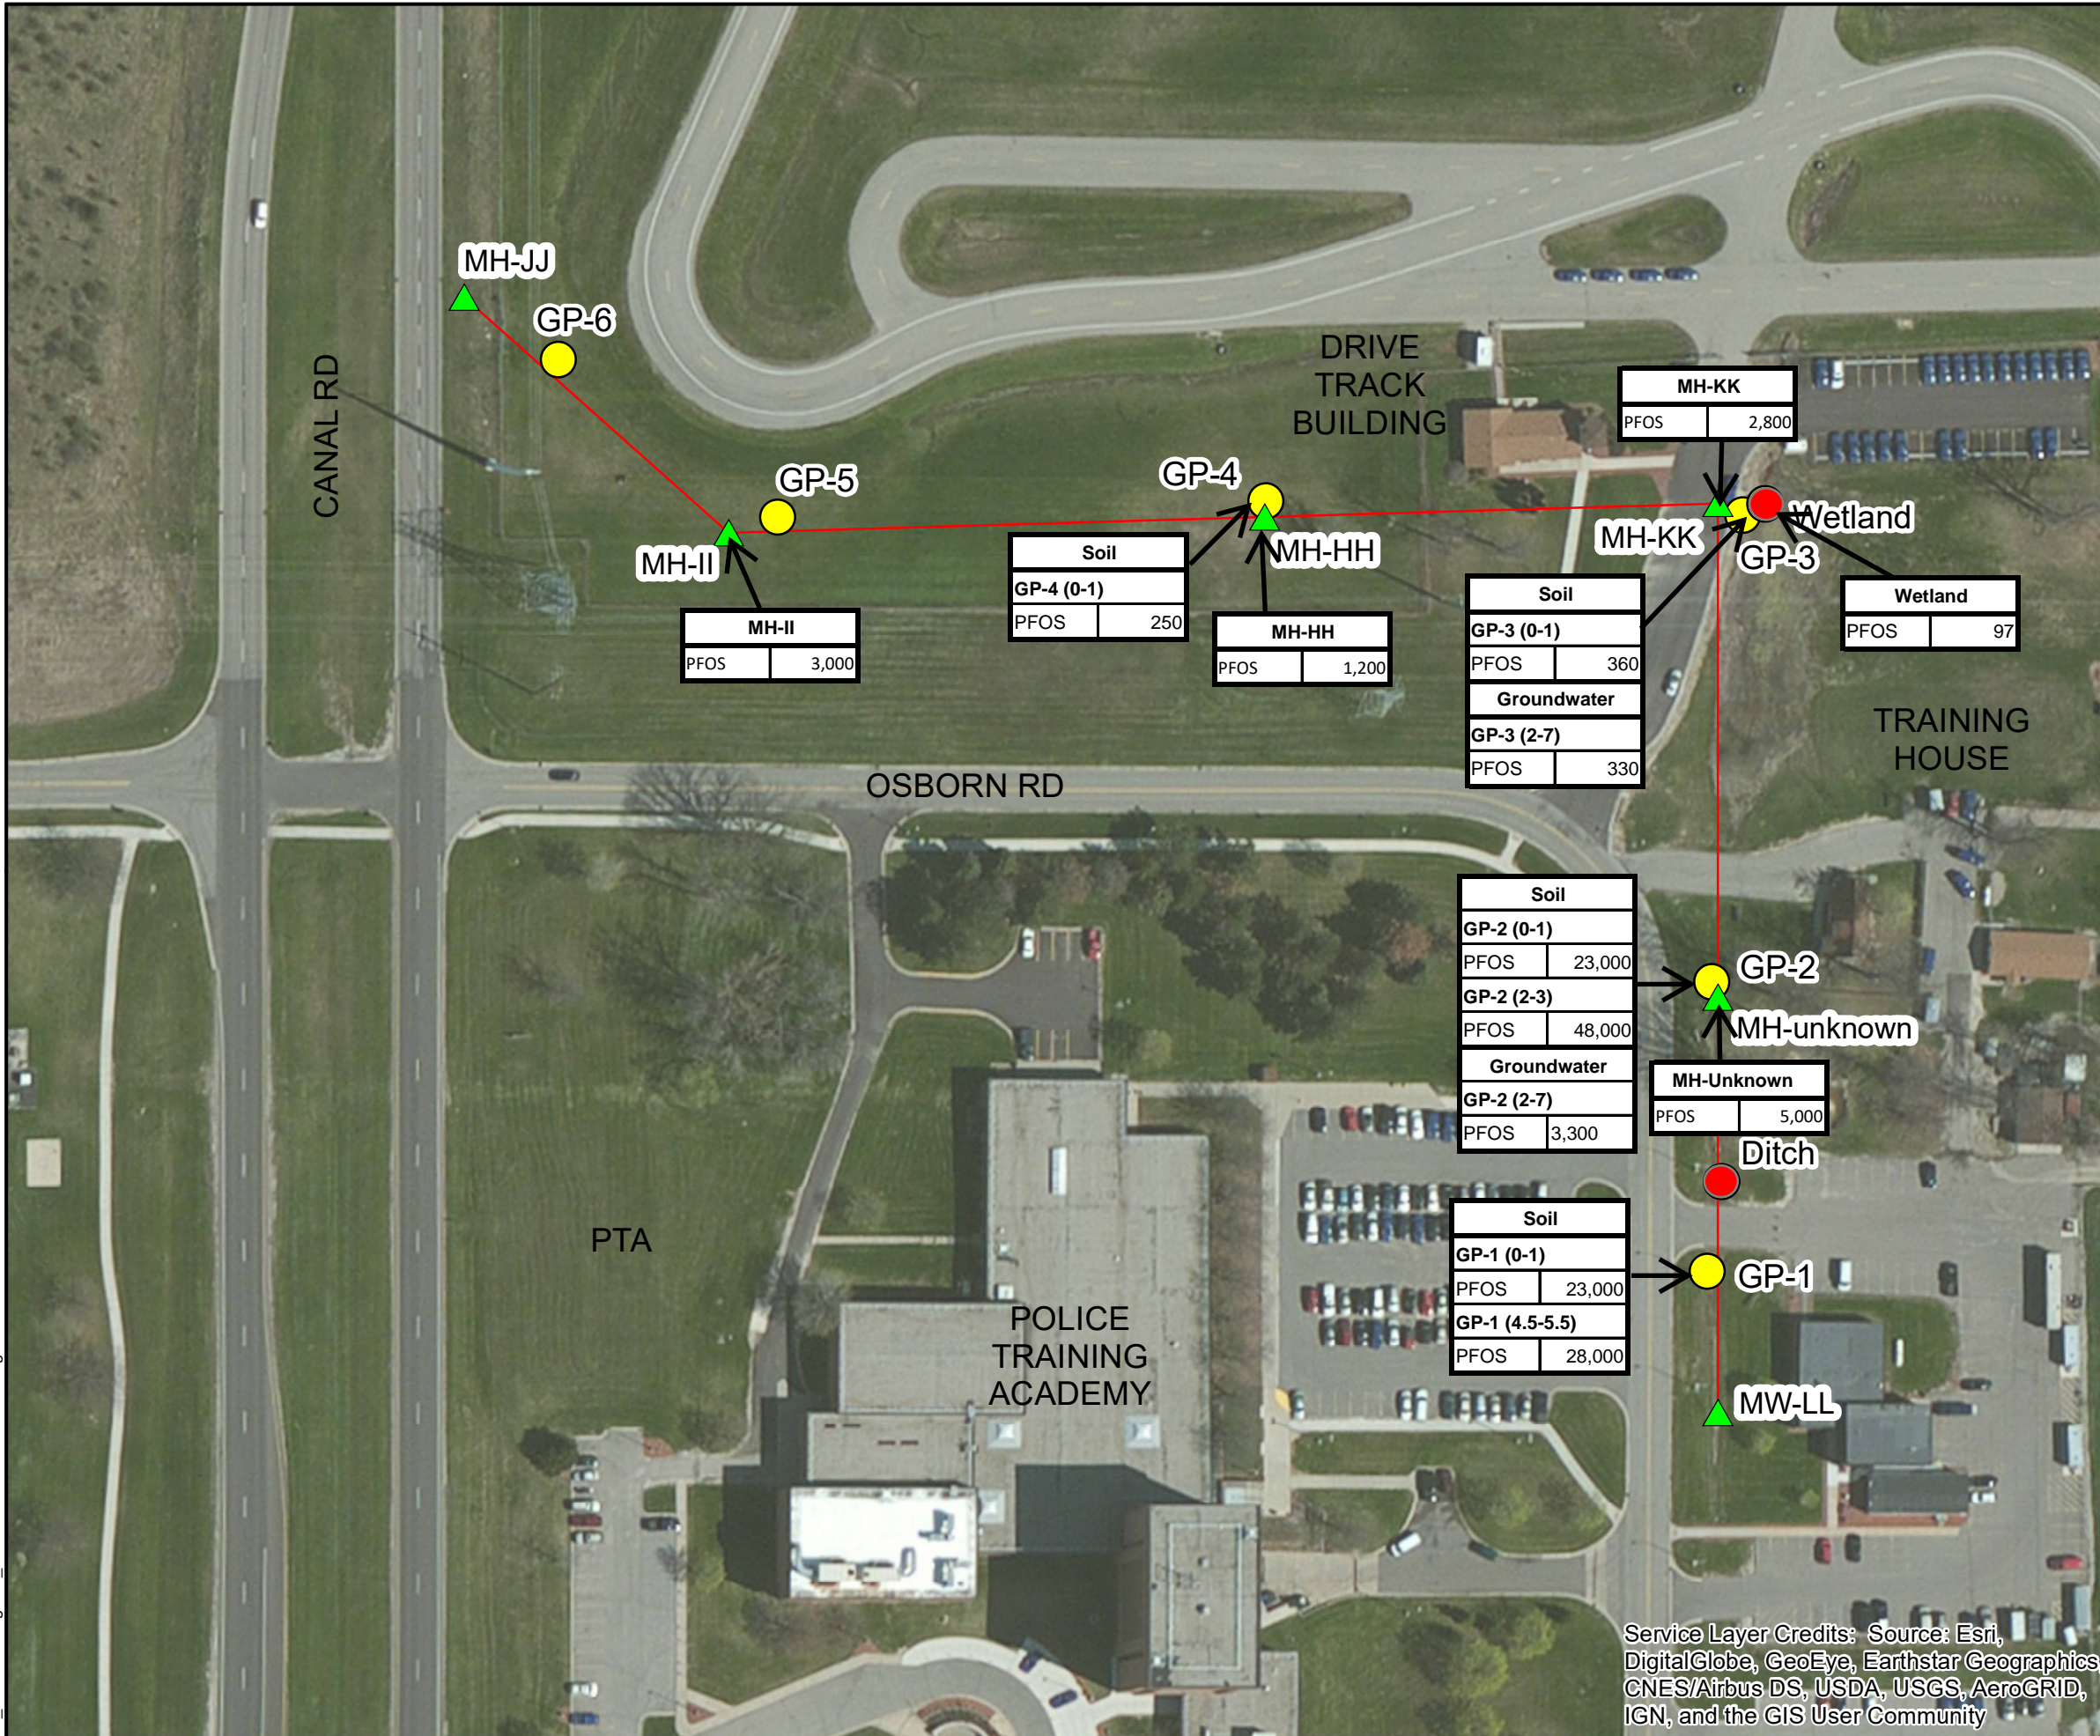


### Legend

- MANHOLE
- BORING/ GW SAMPLE
- SANITARY SEWER
- SURFACE WATER SAMPLE

PFOS Concentrations are compared to the following criteria:

- Soil - GSIP 240 ng/kg
- Groundwater - GSI 12 ng/L
- Wastewater and Surface Water - Rule 57 HNV, non-drinking water 12 ng/L

All soil data unit are ng/kg  
All water data units are ng/l



MICHIGAN DTMB PFAS  
SOIL AND GROUNDWATER SAMPLING  
LANSING, SECONDARY COMPLEX

### SITE MAP AND PFOS CRITERIA EXCEEDANCES



FIGURE  
1

Service Layer Credits: Source: Esri, DigitalGlobe, GeoEye, Earthstar Geographics, CNES/Airbus DS, USDA, USGS, AeroGRID, IGN, and the GIS User Community