


**Surface Water Sample
PFOS Concentration (ppt)**

- Non-Detect
- >0 - 12
(Below GSI Criterion)
- >12
(Above GSI Criterion)

*Samples collected between
2012-2018,
Highest concentration shown

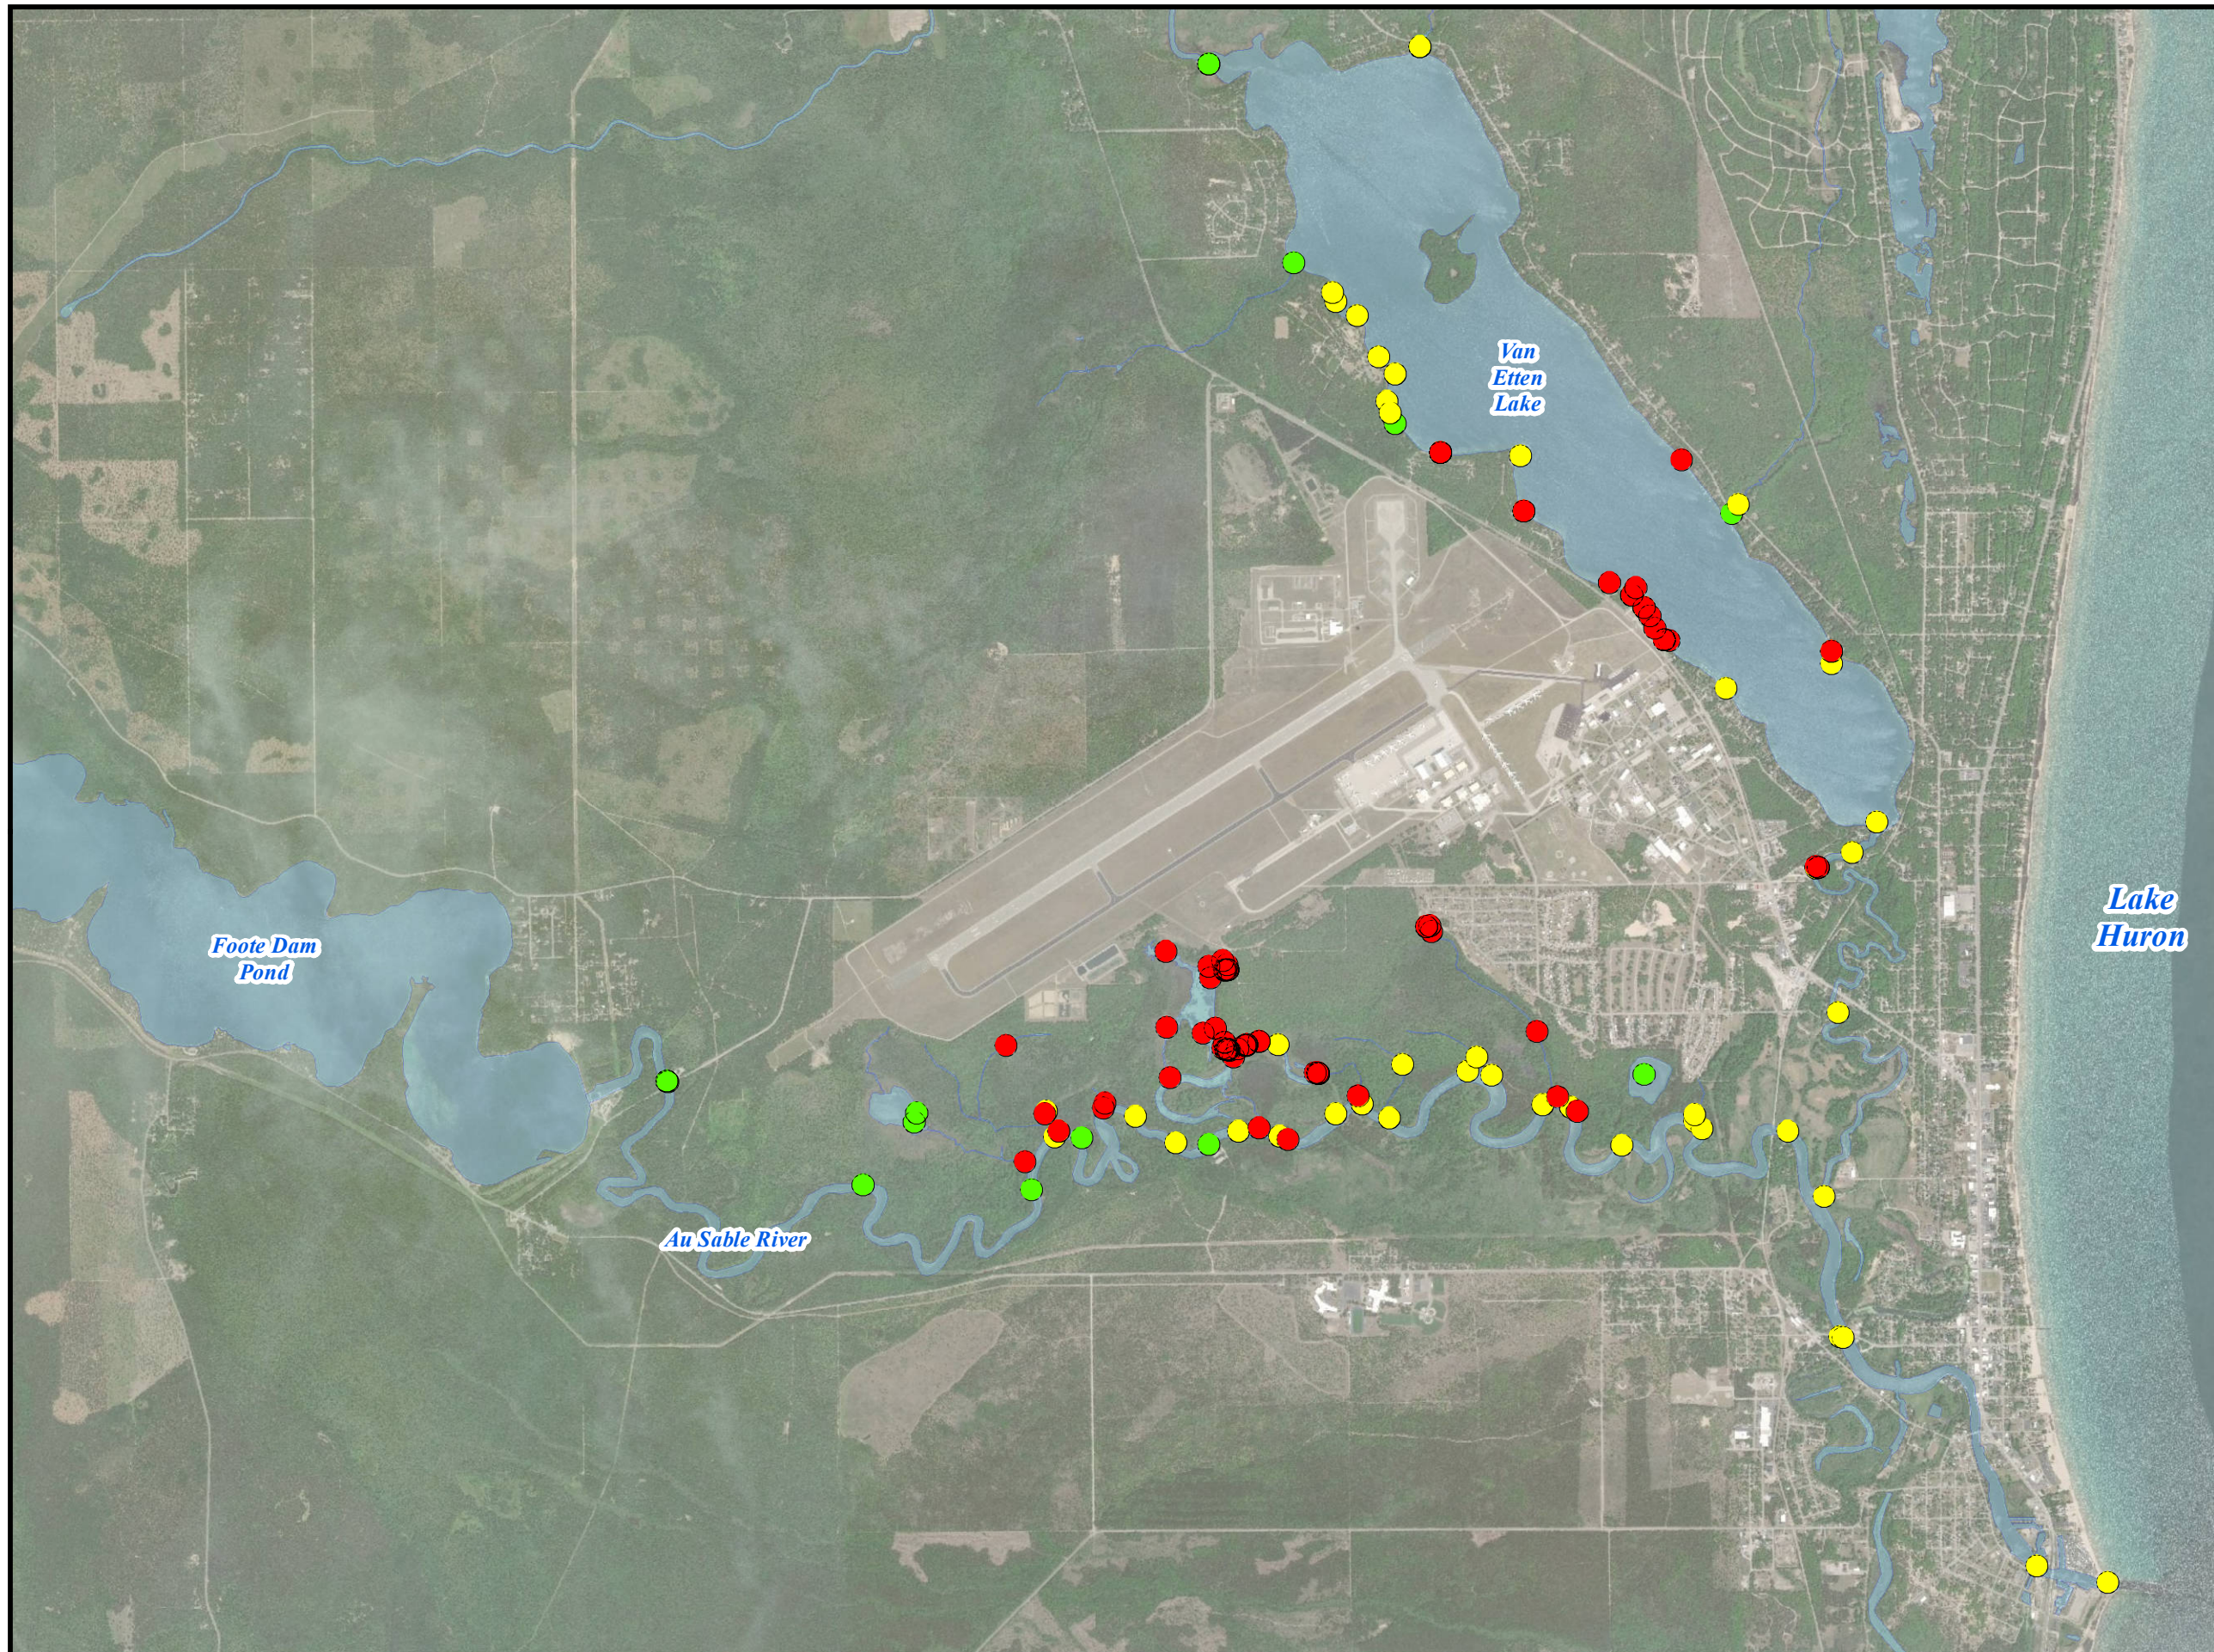

**PFOS ANALYTICAL RESULTS
IN SURFACE WATER SAMPLES**

**FORMER WURTSMITH
AIR FORCE BASE
AND OSCODA AREA
IOSCO COUNTY,
MICHIGAN**

