


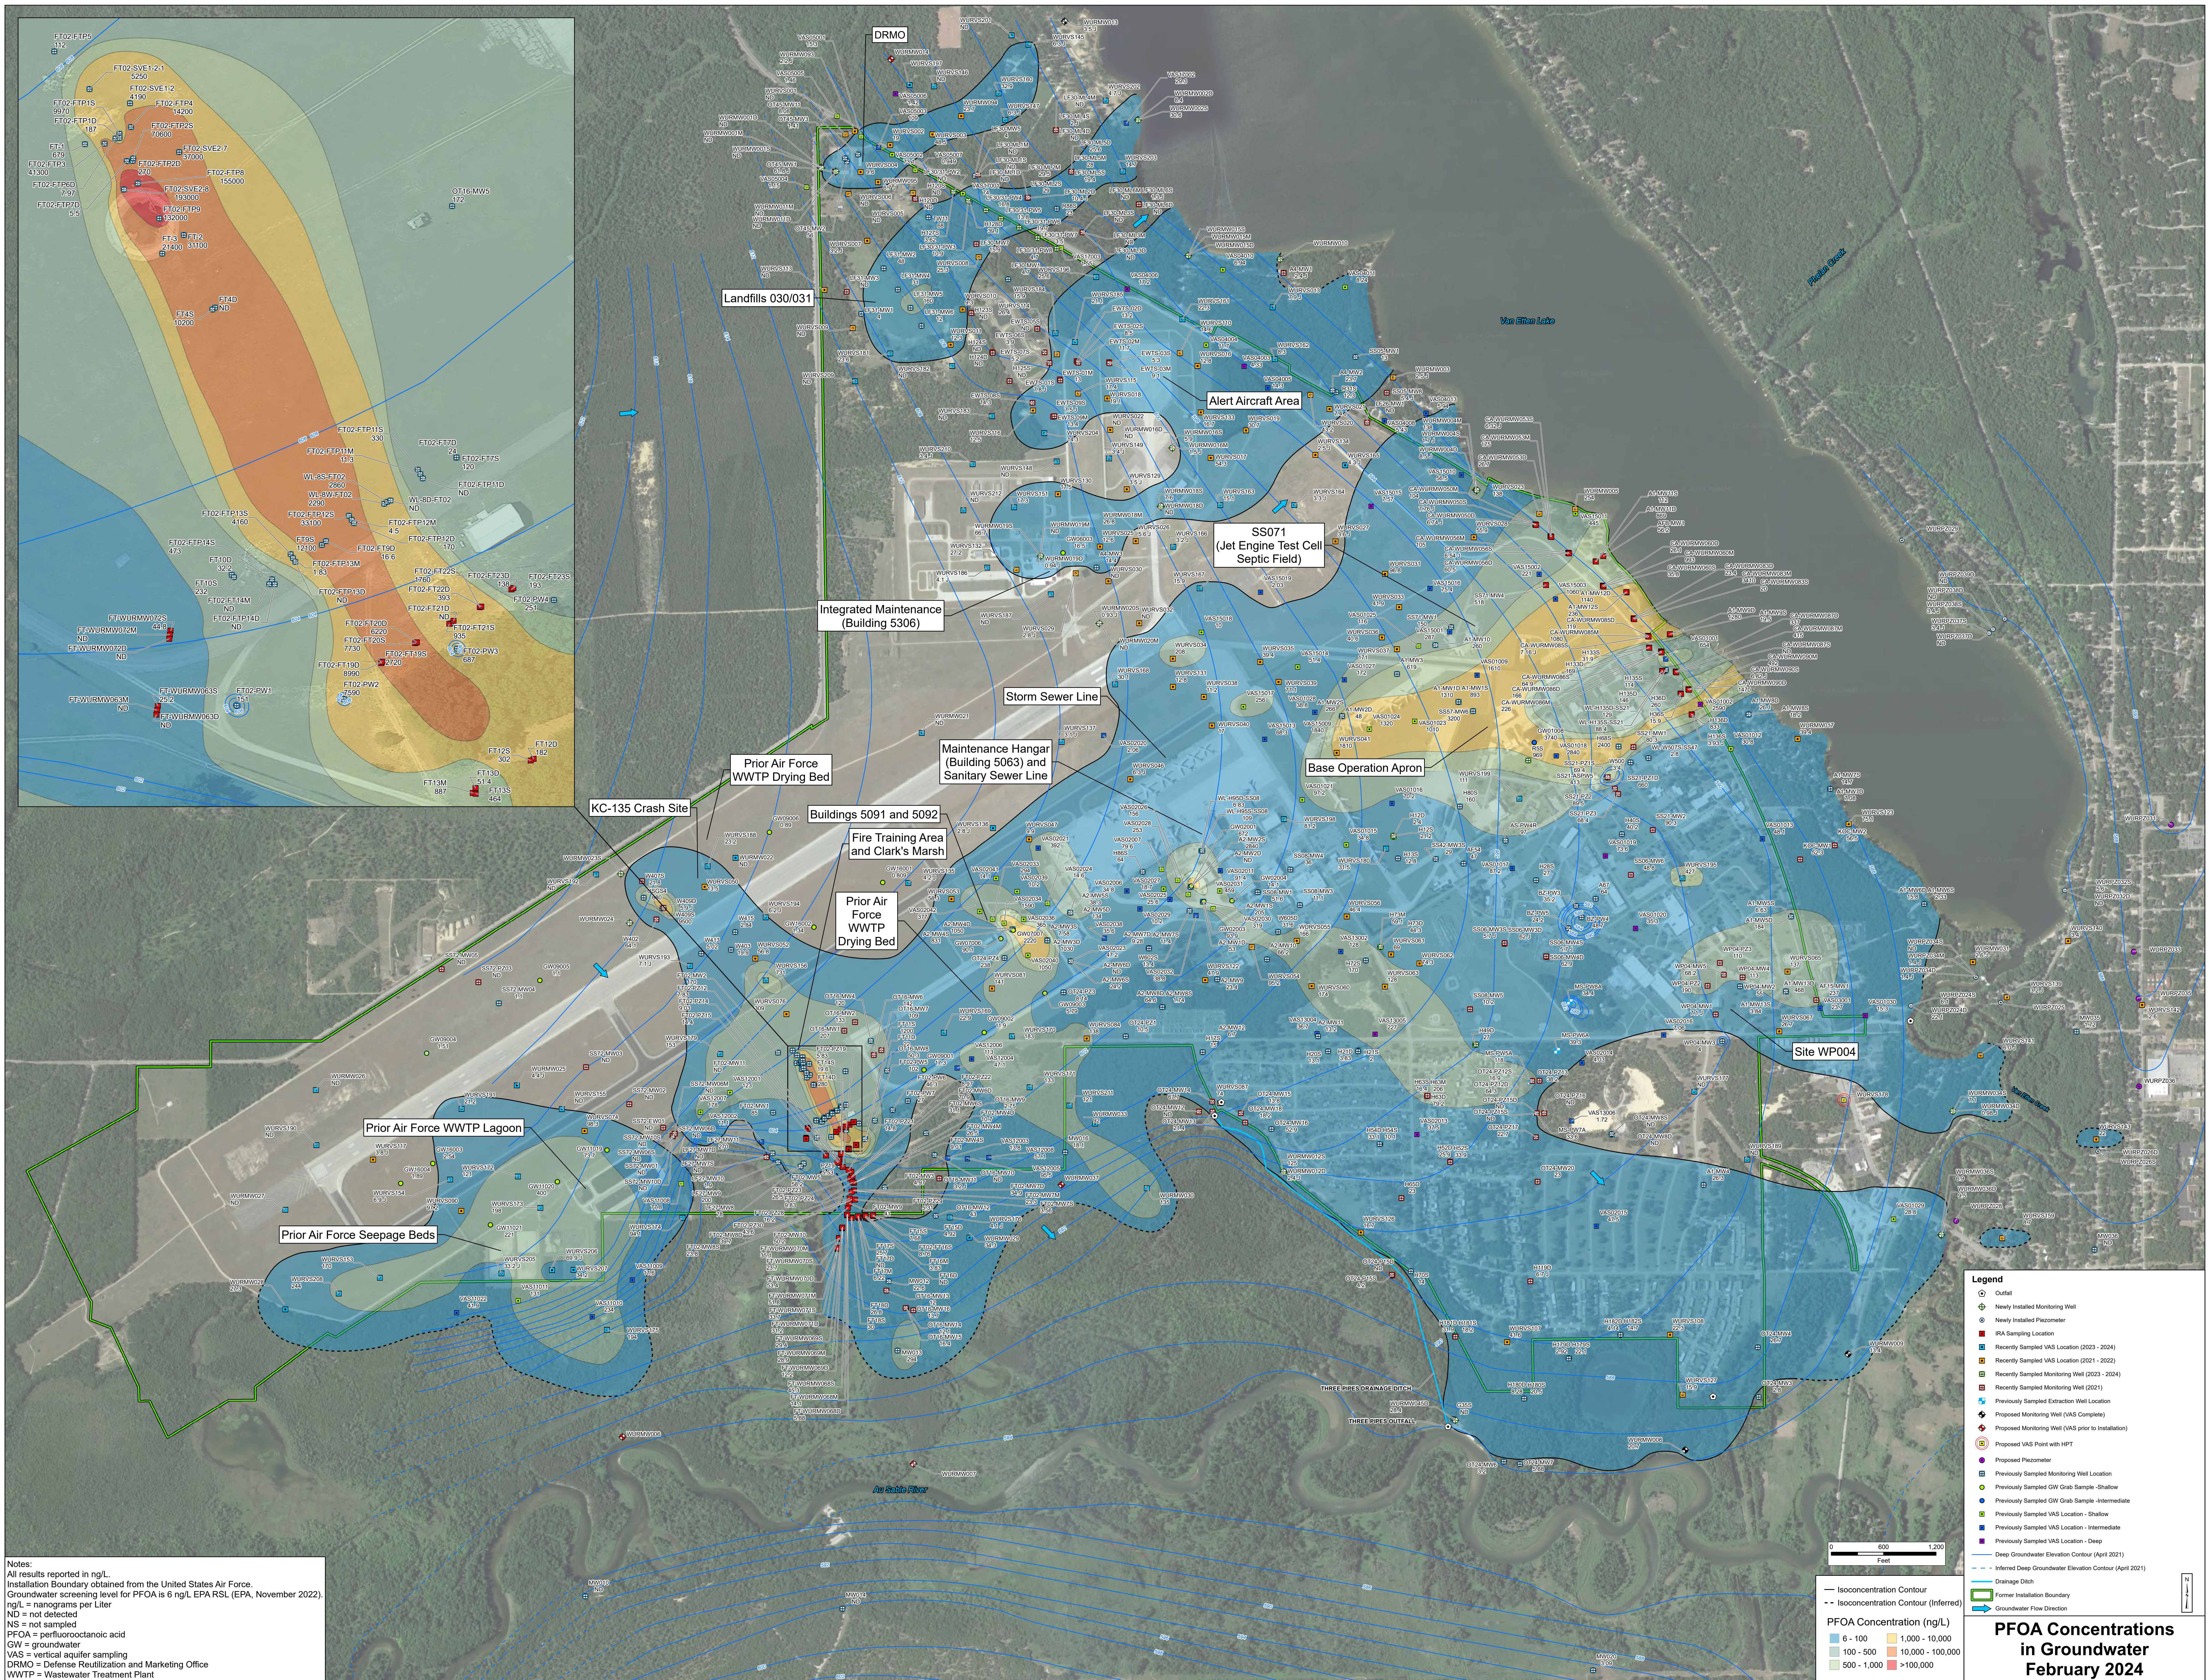

Notes:
All results reported in ng/L.
Installation Boundary obtained from the United States Air Force.
Groundwater screening level for PFOA is 6 ng/L EPA RSL (EPA, November 2022).
ng/L = nanograms per Liter
ND = not detected
NS = not sampled
PFOA = perfluorooctanoic acid
GW = groundwater
VAS = vertical aquifer sampling
DRMO = Defense Reutilization and Marketing Office
WWTP = Wastewater Treatment Plant

Legend

- Outfall
- Newly Installed Monitoring Well
- Newly Installed Piezometer
- IRA Sampling Location
- Recently Sampled VAS Location (2023 - 2024)
- Recently Sampled VAS Location (2021 - 2022)
- Recently Sampled Monitoring Well (2023 - 2024)
- Recently Sampled Monitoring Well (2021)
- Previously Sampled Extraction Well Location
- Proposed Monitoring Well (VAS Complete)
- Proposed Monitoring Well (VAS prior to Installation)
- Proposed VAS Point with HPT
- Proposed Piezometer
- Previously Sampled Monitoring Well Location
- Previously Sampled GW Grab Sample - Shallow
- Previously Sampled GW Grab Sample - Intermediate
- Previously Sampled VAS Location - Shallow
- Previously Sampled VAS Location - Intermediate
- Previously Sampled VAS Location - Deep
- Deep Groundwater Elevation Contour (April 2021)
- Inferred Deep Groundwater Elevation Contour (April 2021)
- Drainage Ditch
- Former Installation Boundary
- Groundwater Flow Direction

PFOA Concentrations (ng/L)

6 - 100	1,000 - 10,000
100 - 500	10,000 - 100,000
500 - 1,000	>100,000

PFOA Concentrations in Groundwater February 2024