


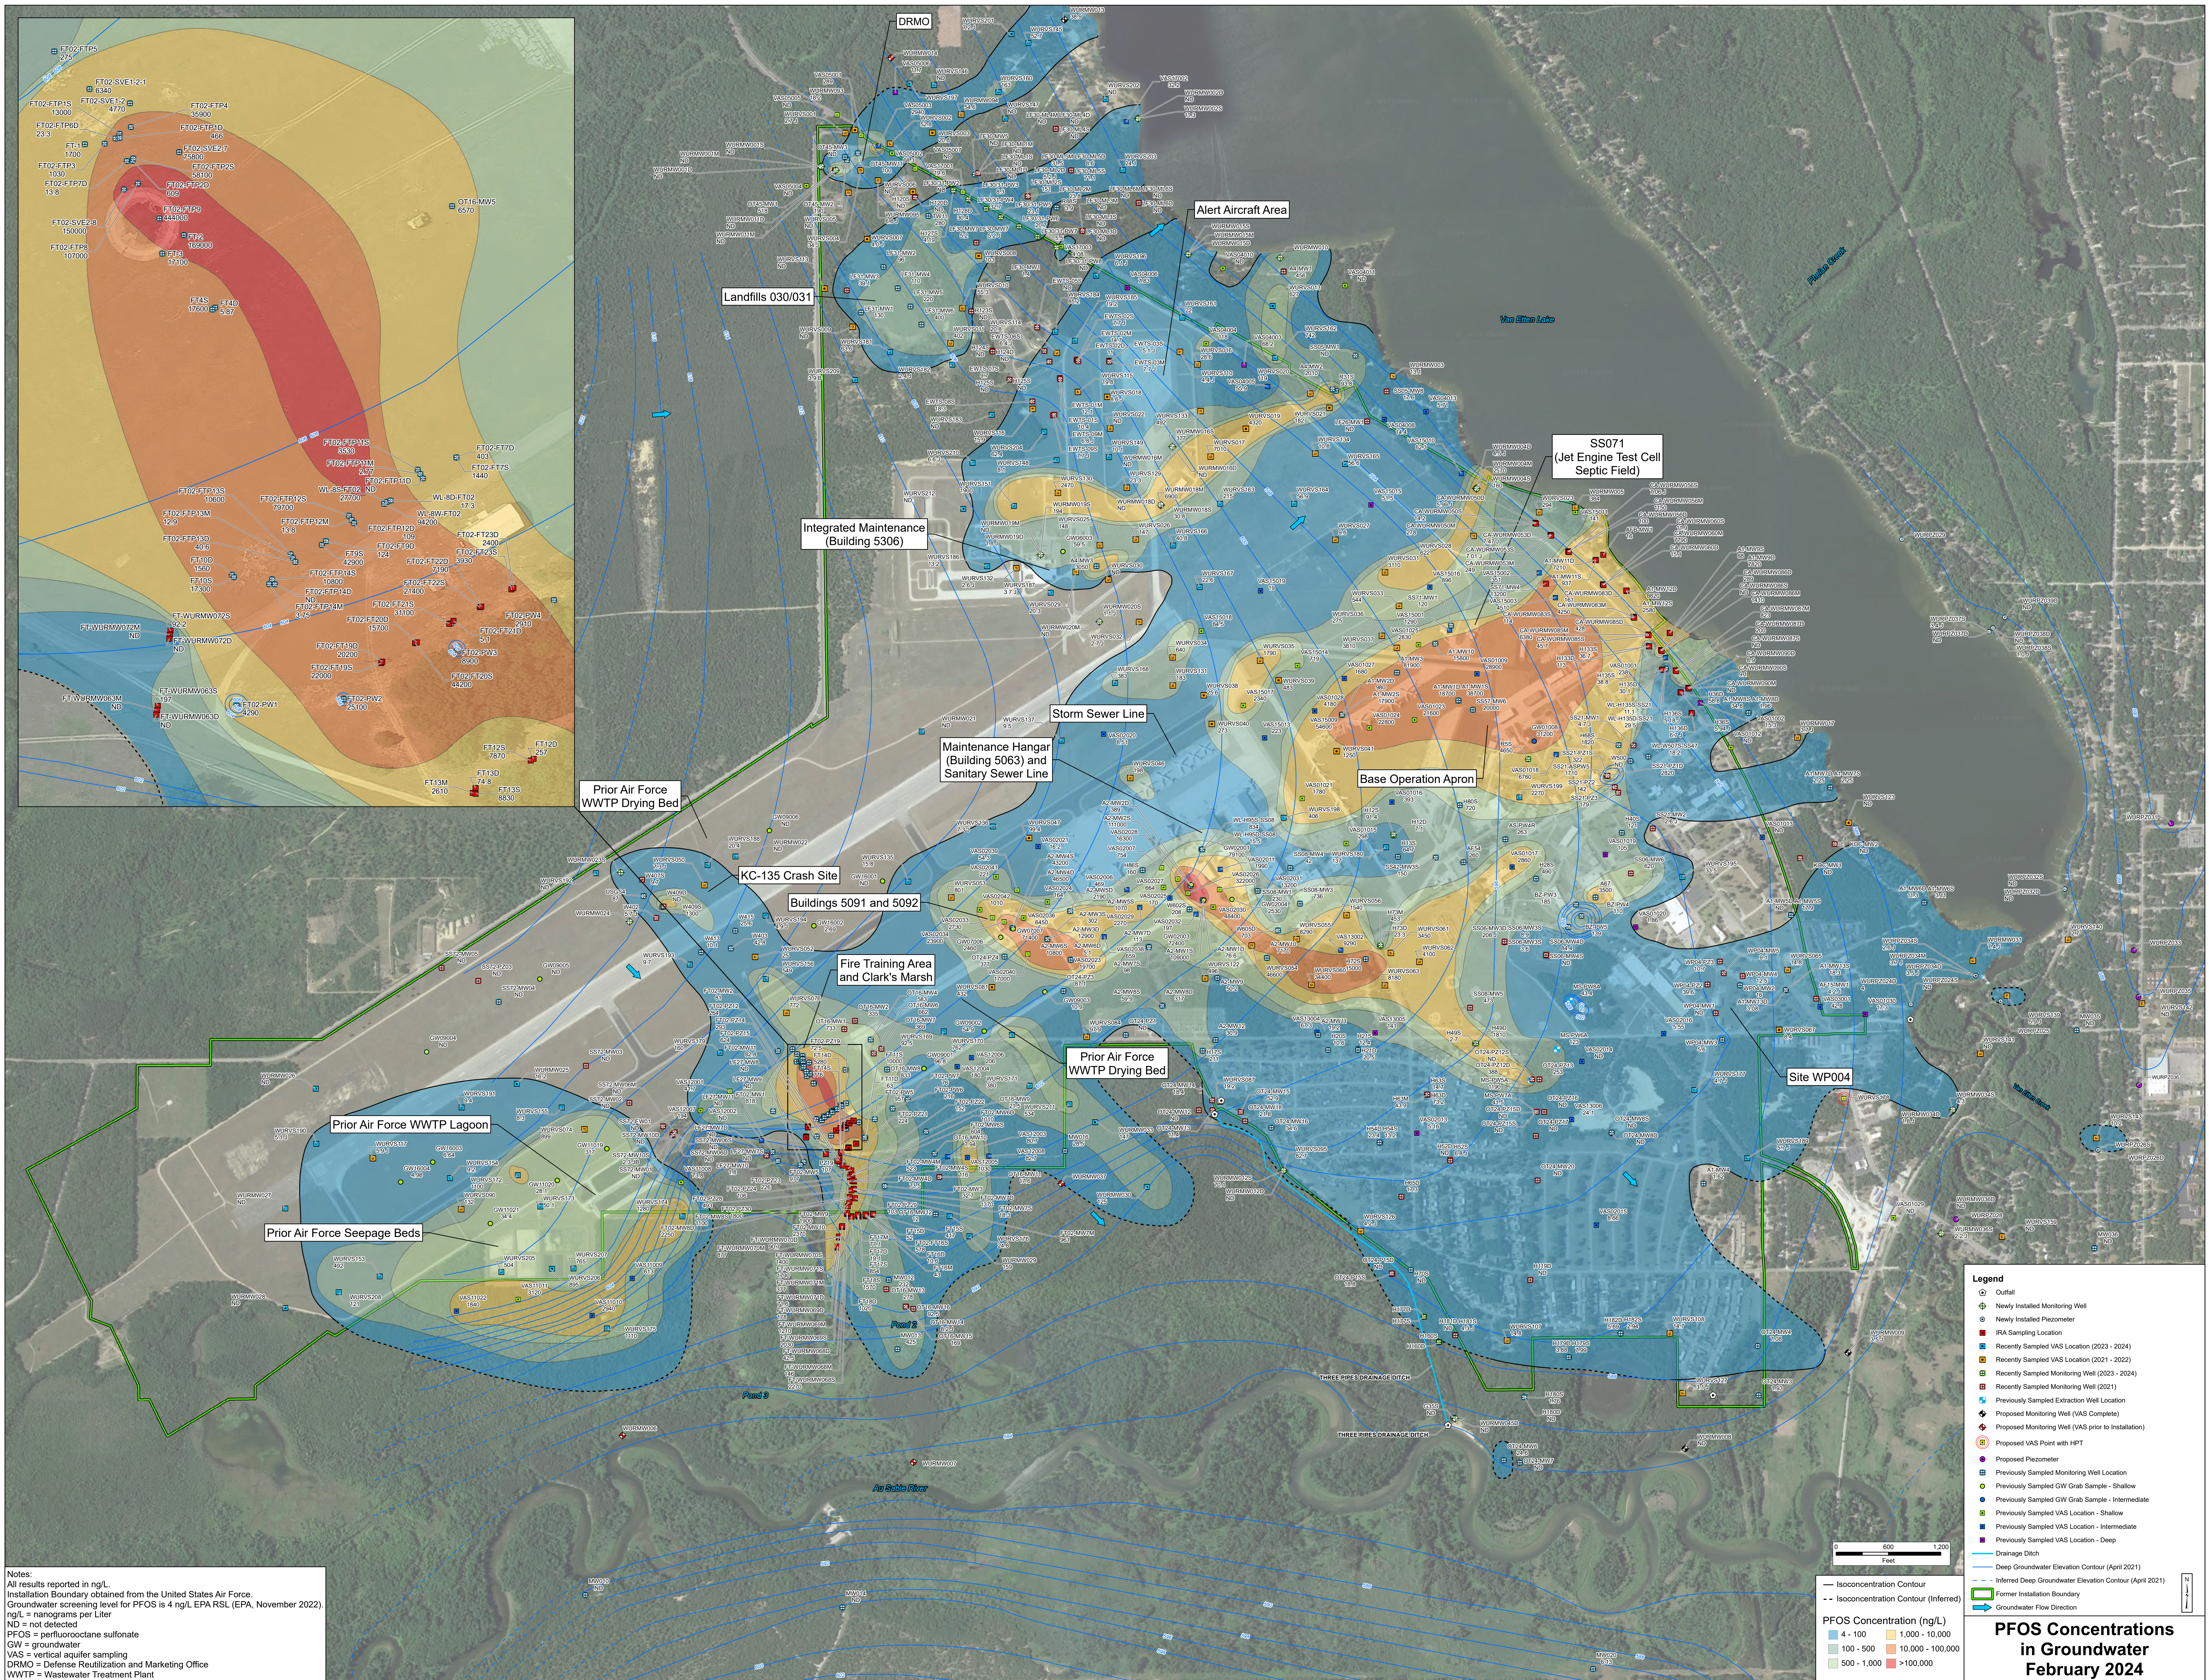

Notes:
All results reported in ng/L.
Installation Boundary obtained from the United States Air Force.
Groundwater screening level for PFOS is 4 ng/L EPA RSL (EPA, November 2022).
ng/L = nanograms per Liter
ND = not detected
PFOS = perfluorooctane sulfonate
GW = groundwater
VAS = vertical aquifer sampling
DRMO = Defense Reutilization and Marketing Office
WWTP = Wastewater Treatment Plant

PFOS Concentrations in Groundwater February 2024