


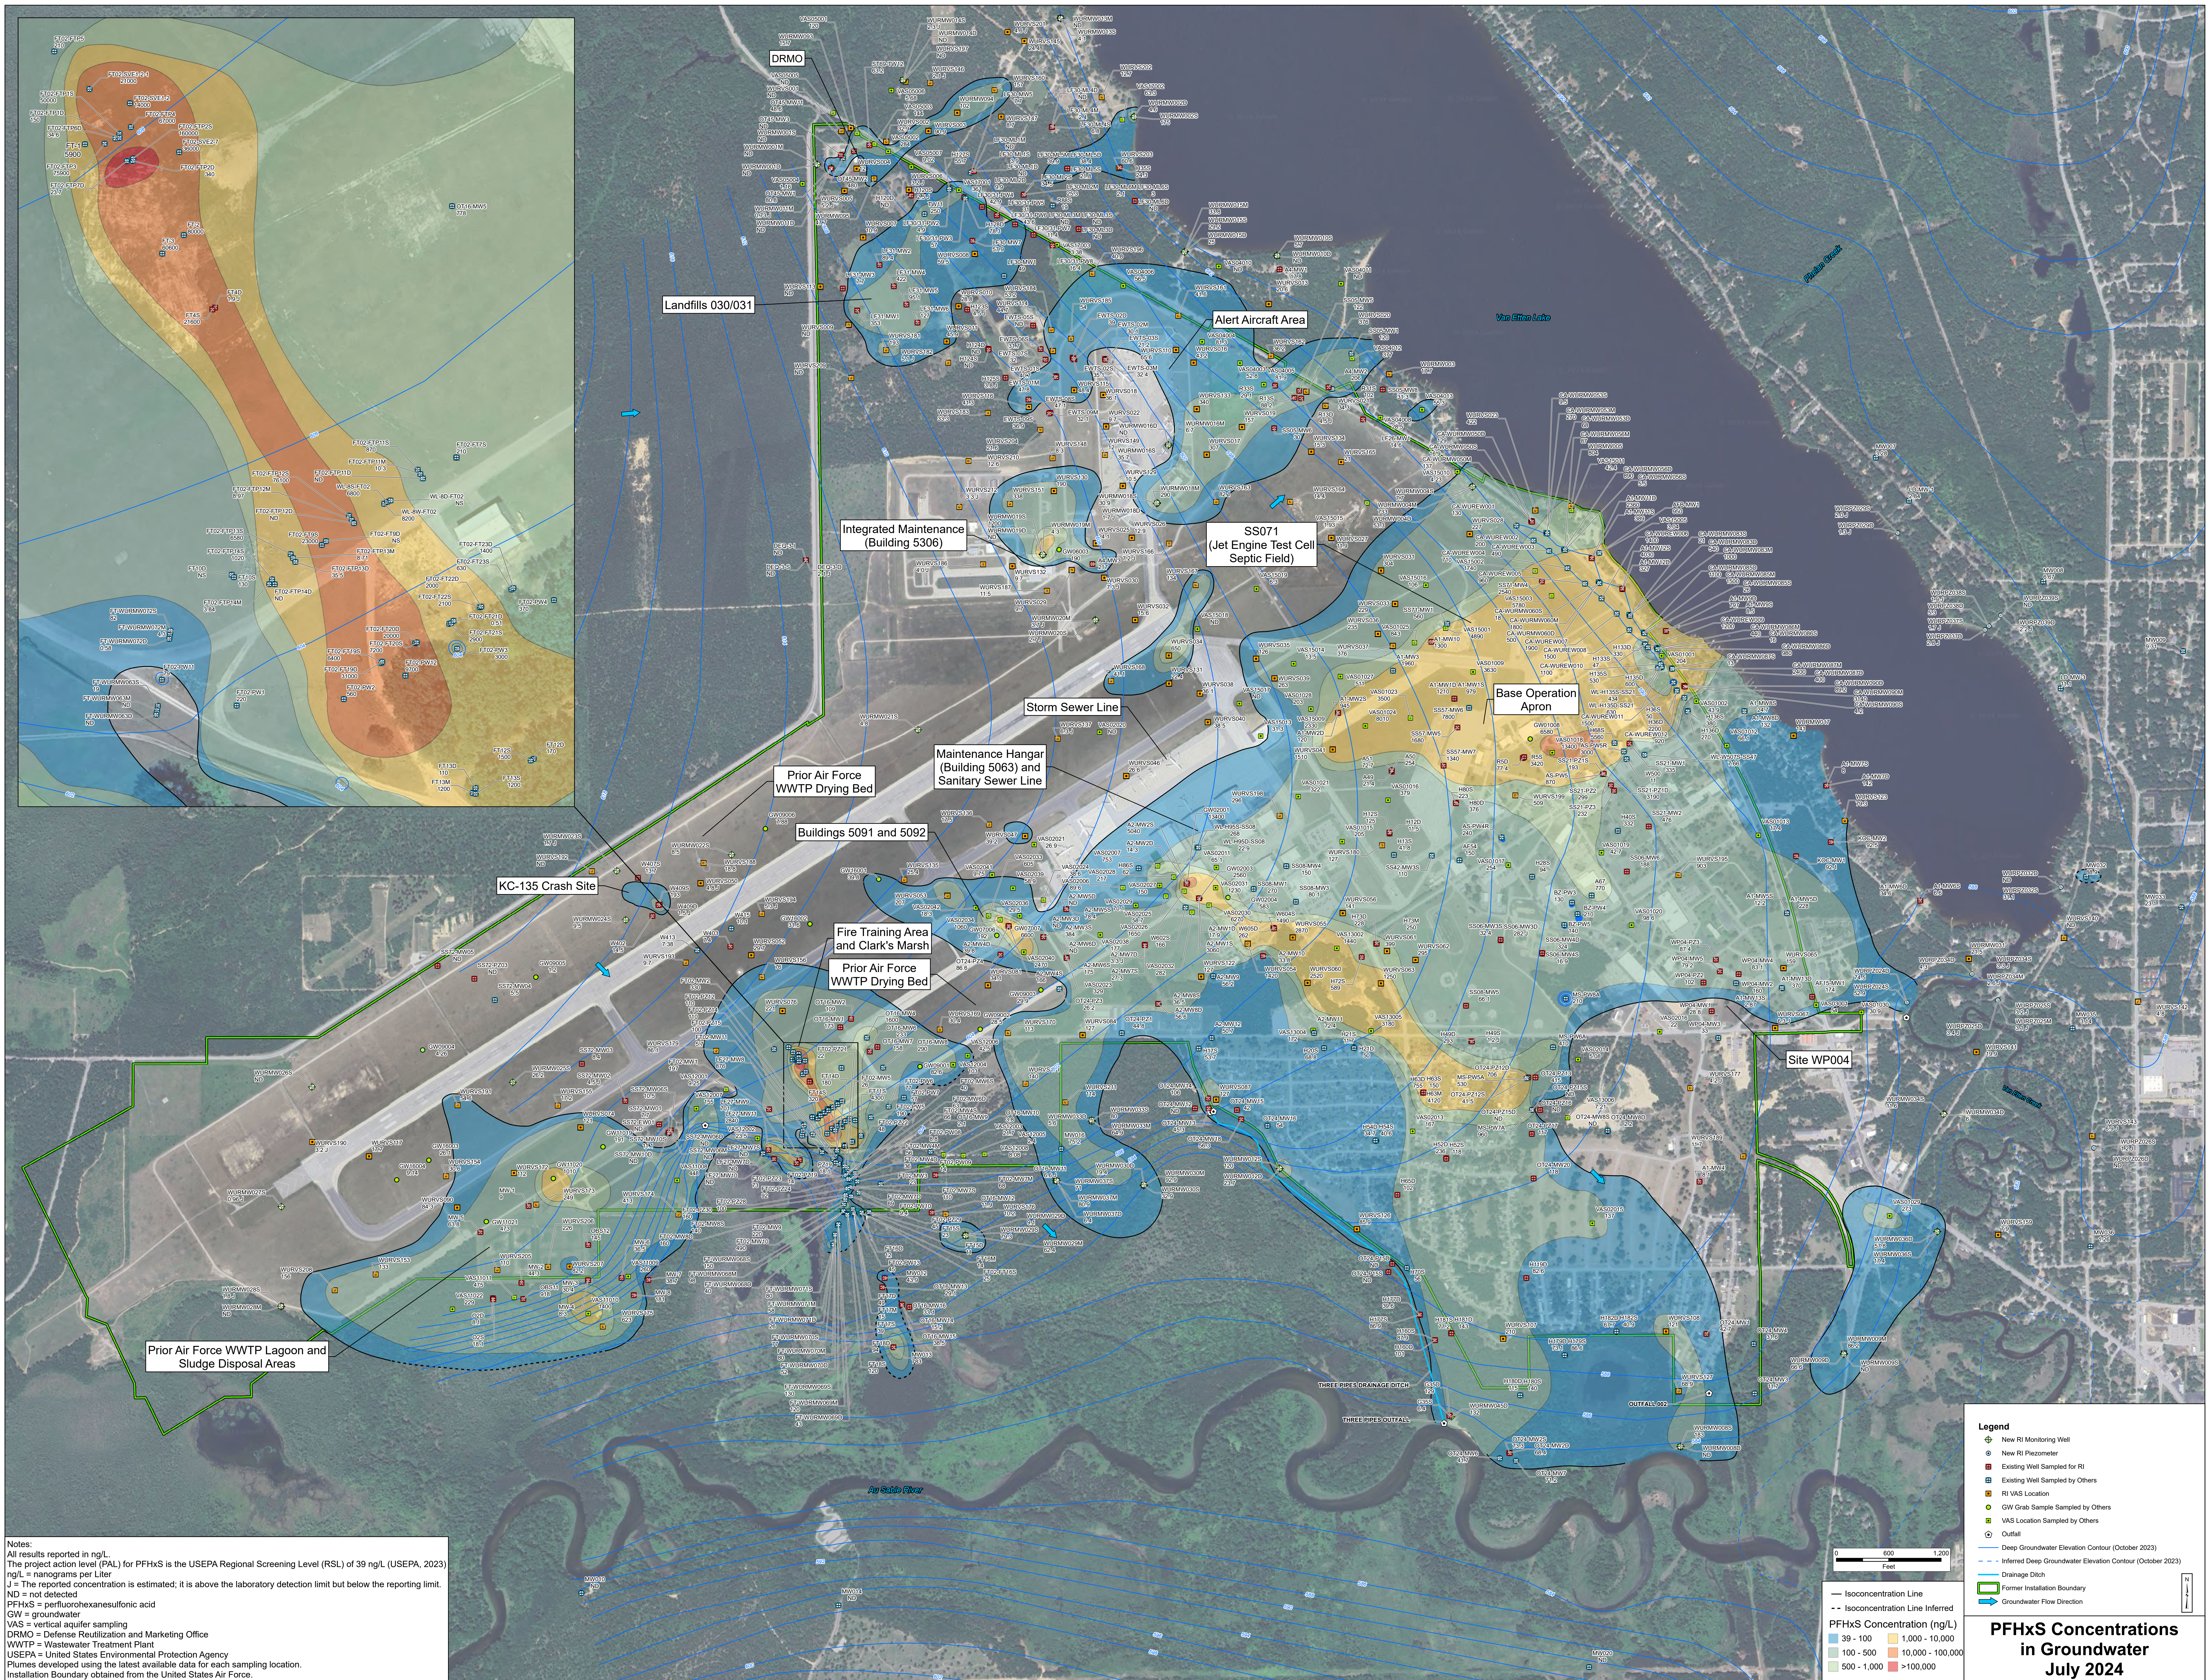

Notes:
All results reported in ng/L.
The project action level (PAL) for PFHxS is the USEPA Regional Screening Level (RSL) of 39 ng/L (USEPA, 2023)
ng/L = nanograms per Liter
J = The reported concentration is estimated; it is above the laboratory detection limit but below the reporting limit.
ND = not detected
PFHxS = perfluorohexanesulfonic acid
GW = groundwater
VAS = vertical aquifer sampling
DRMO = Defense Reutilization and Marketing Office
WWTP = Wastewater Treatment Plant
USEPA = United States Environmental Protection Agency
Plumes developed using the latest available data for each sampling location.
Installation Boundary obtained from the United States Air Force.

Legend

- New RI Monitoring Well
- New RI Piezometer
- Existing Well Sampled for RI
- Existing Well Sampled by Others
- RI VAS Location
- GW Grab Sample Sampled by Others
- VAS Location Sampled by Others
- Outfall
- Deep Groundwater Elevation Contour (October 2023)
- Inferred Deep Groundwater Elevation Contour (October 2023)
- Drainage Ditch
- Former Installation Boundary
- Groundwater Flow Direction

PFHxS Concentrations (ng/L)

39 - 100	1,000 - 10,000
100 - 500	10,000 - 100,000
500 - 1,000	>100,000

PFHxS Concentrations in Groundwater July 2024