



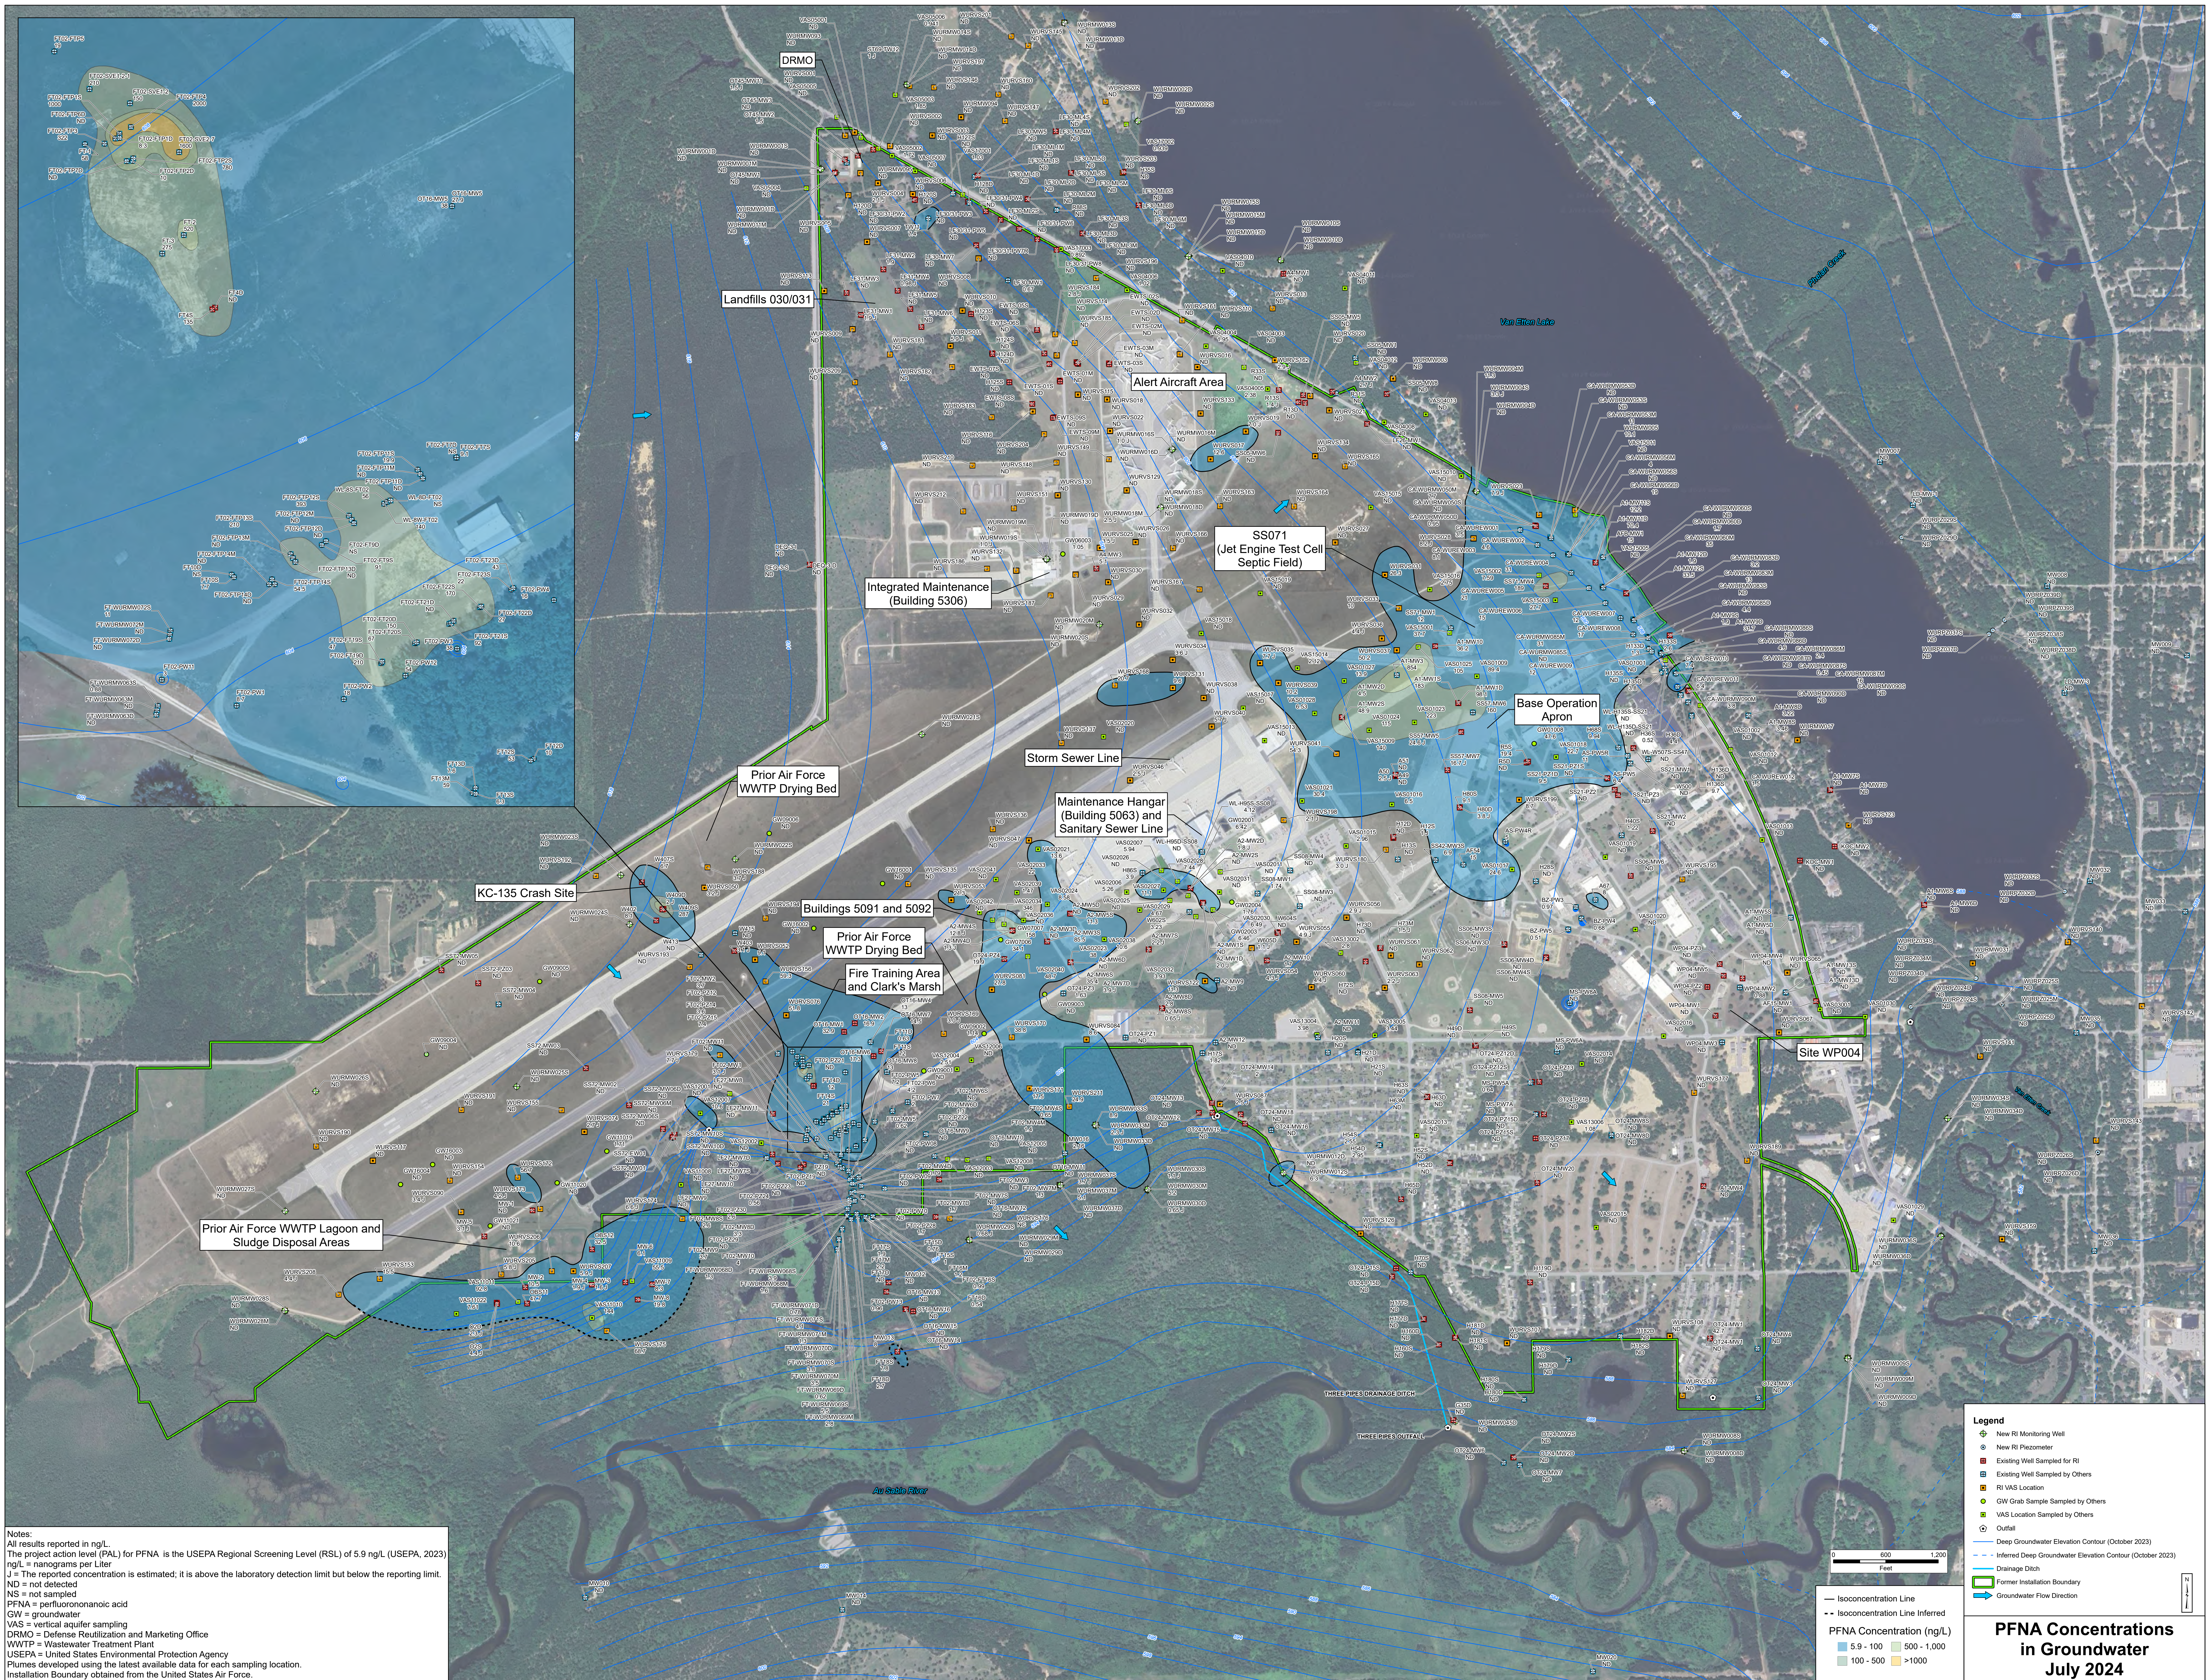

Notes:
All results reported in ng/L.
The project action level (PAL) for PFNA is the USEPA Regional Screening Level (RSL) of 5.9 ng/L (USEPA, 2023)
ng/L = nanograms per Liter
J = The reported concentration is estimated; it is above the laboratory detection limit but below the reporting limit.
ND = not detected
NS = not sampled
PFNA = perfluorononanoic acid
GW = groundwater
VAS = vertical aquifer sampling
DRMO = Defense Reutilization and Marketing Office
WWTP = Wastewater Treatment Plant
USEPA = United States Environmental Protection Agency
Plumes developed using the latest available data for each sampling location.
Installation Boundary obtained from the United States Air Force.

- Legend**
- New RI Monitoring Well
 - New RI Piezometer
 - Existing Well Sampled for RI
 - Existing Well Sampled by Others
 - RI VAS Location
 - GW Grab Sample Sampled by Others
 - VAS Location Sampled by Others
 - Outfall
 - Deep Groundwater Elevation Contour (October 2023)
 - Inferred Deep Groundwater Elevation Contour (October 2023)
 - Drainage Ditch
 - Former Installation Boundary
 - Groundwater Flow Direction

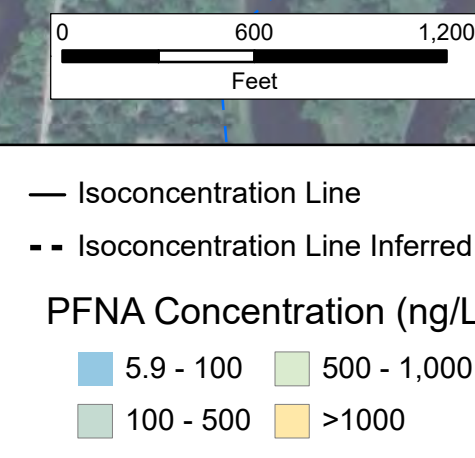

**PFNA Concentrations
in Groundwater
July 2024**