


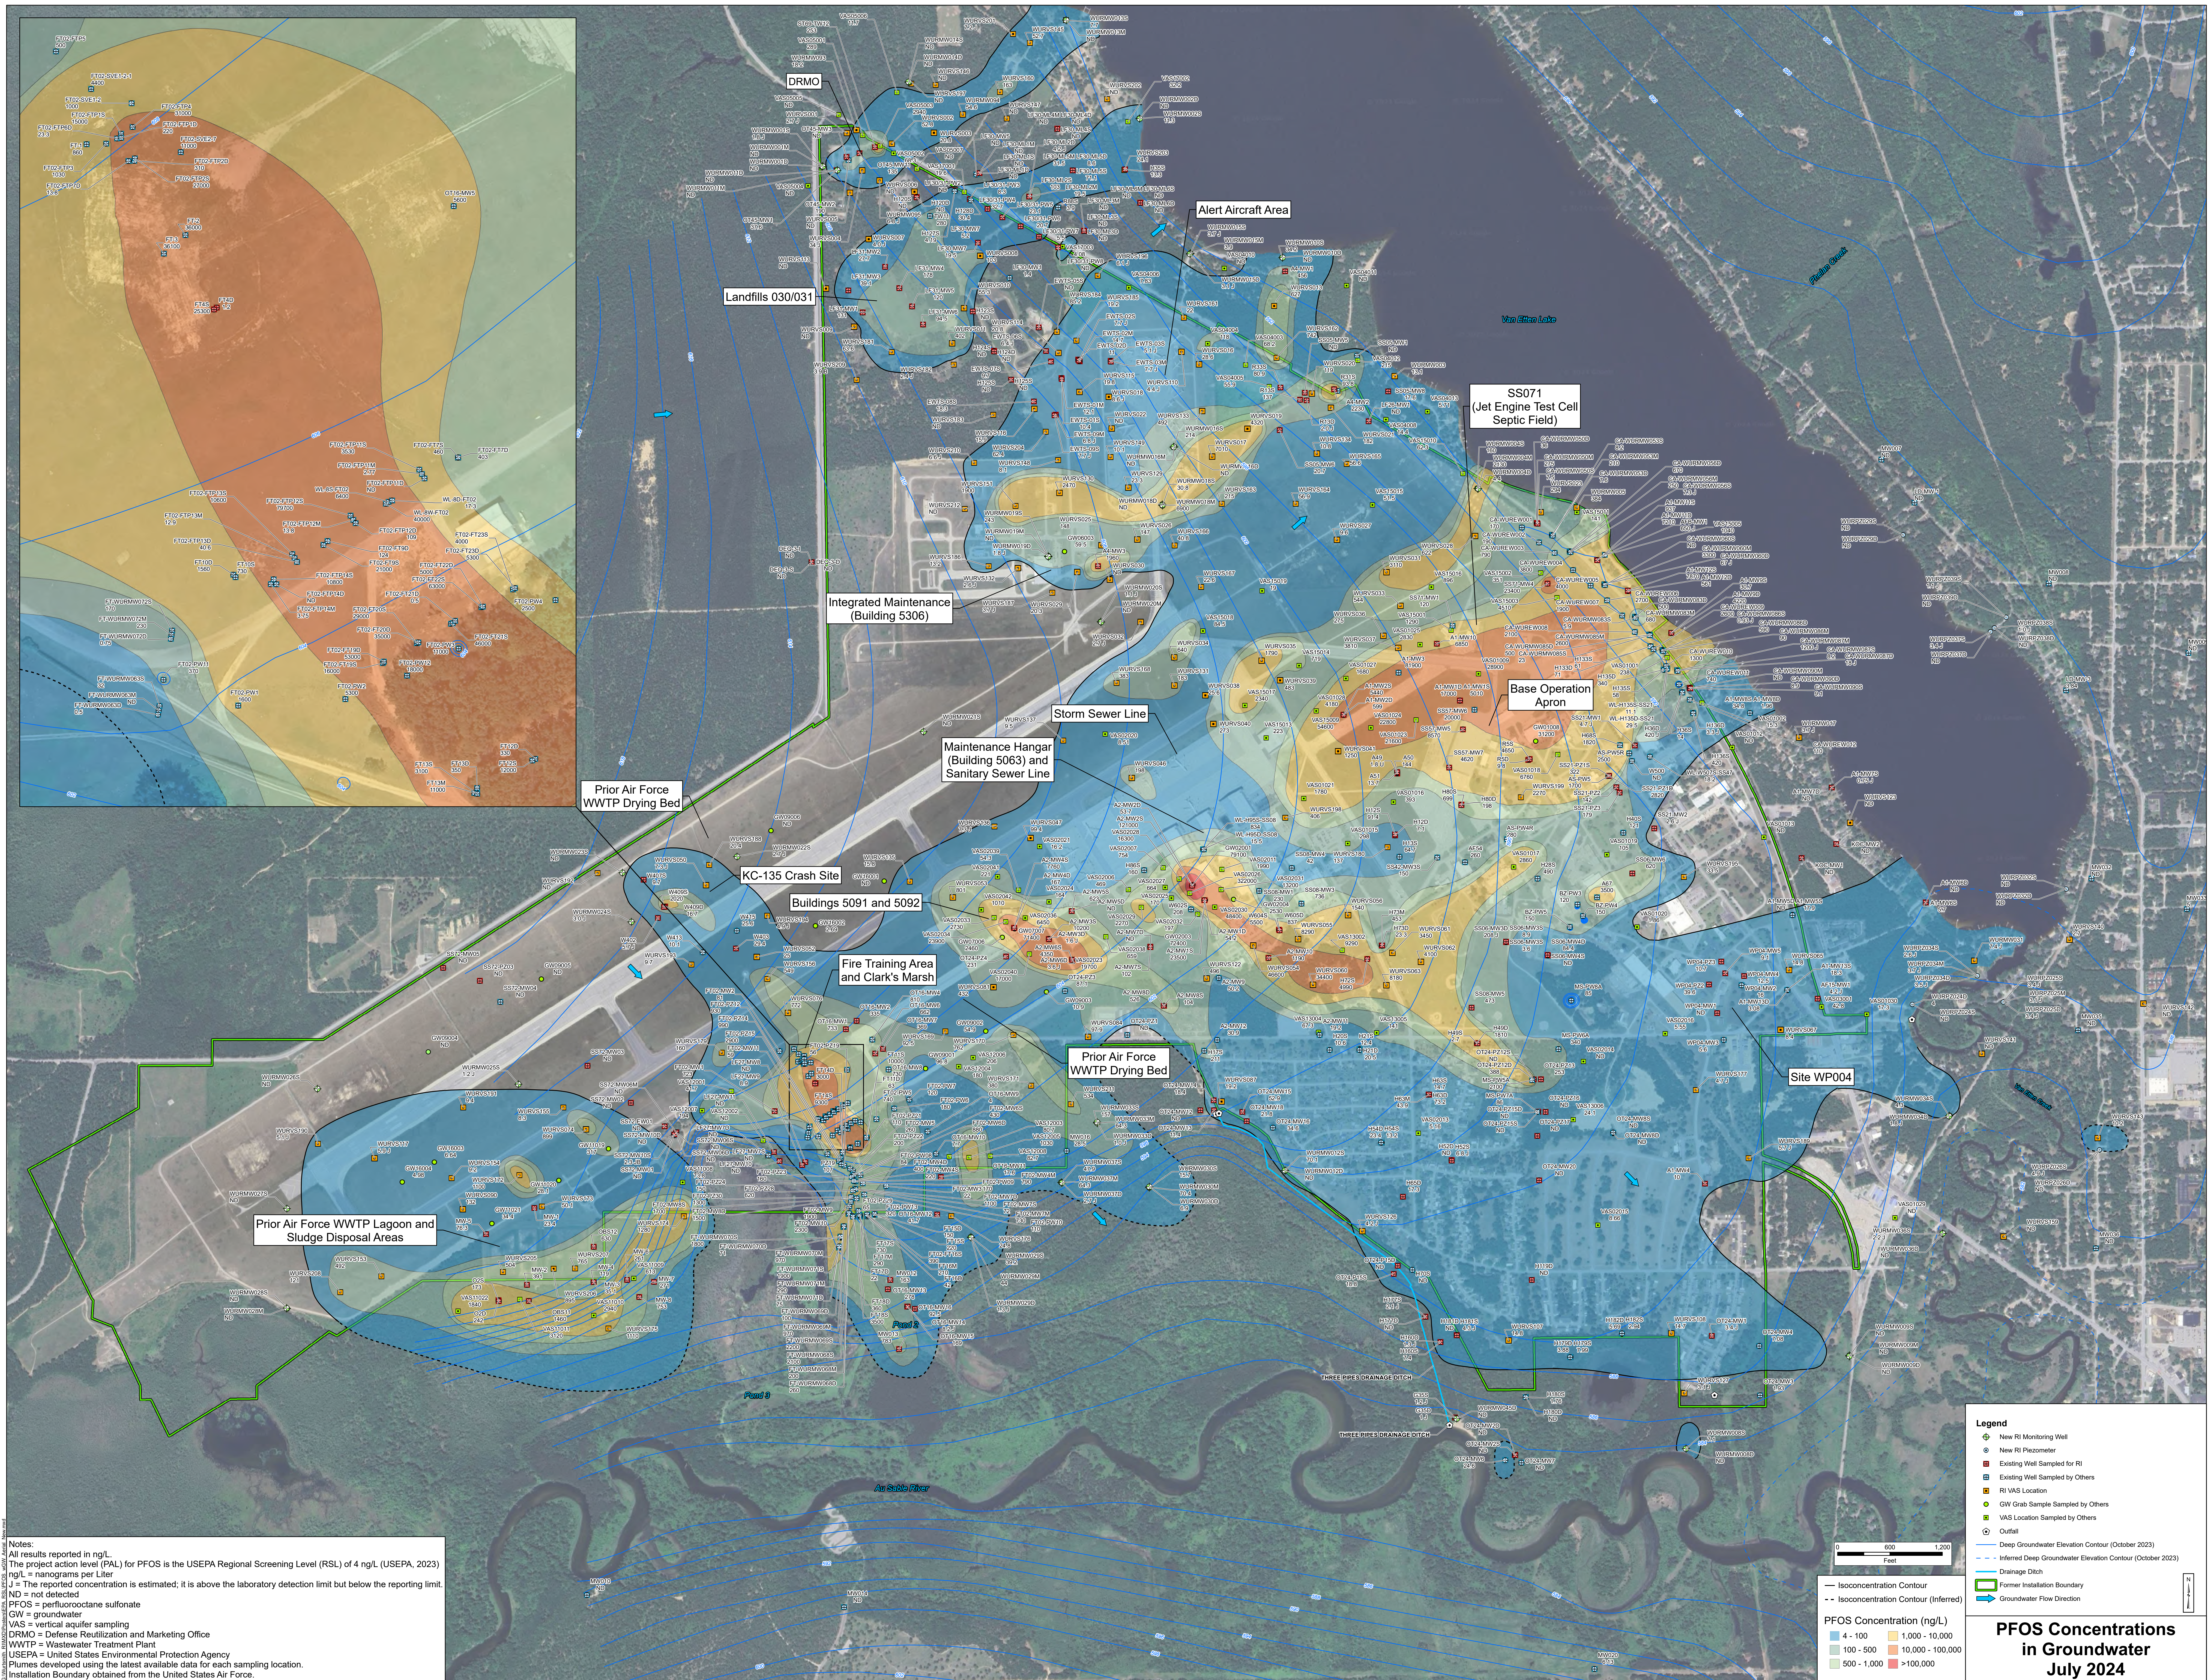

Notes:
All results reported in ng/L.
The project action level (PAL) for PFOS is the USEPA Regional Screening Level (RSL) of 4 ng/L (USEPA, 2023)
ng/L = nanograms per Liter
J = The reported concentration is estimated; it is above the laboratory detection limit but below the reporting limit.
ND = not detected
PFOS = perfluorooctane sulfonate
GW = groundwater
VAS = vertical aquifer sampling
DRMO = Defense Reutilization and Marketing Office
WWTP = Wastewater Treatment Plant
USEPA = United States Environmental Protection Agency
Plumes developed using the latest available data for each sampling location.
Installation Boundary obtained from the United States Air Force.

- Legend**
- New RI Monitoring Well
 - New RI Piezometer
 - Existing Well Sampled for RI
 - Existing Well Sampled by Others
 - RI VAS Location
 - GW Grab Sample Sampled by Others
 - VAS Location Sampled by Others
 - Outfall
 - Deep Groundwater Elevation Contour (October 2023)
 - Inferred Deep Groundwater Elevation Contour (October 2023)
 - Drainage Ditch
 - Former Installation Boundary
 - Isoconcentration Contour (Inferred)

PFOS Concentrations in Groundwater July 2024

PFOS Concentration (ng/L)

- 4 - 100
- 100 - 500
- 500 - 1,000
- 1,000 - 10,000
- 10,000 - 100,000
- >100,000