


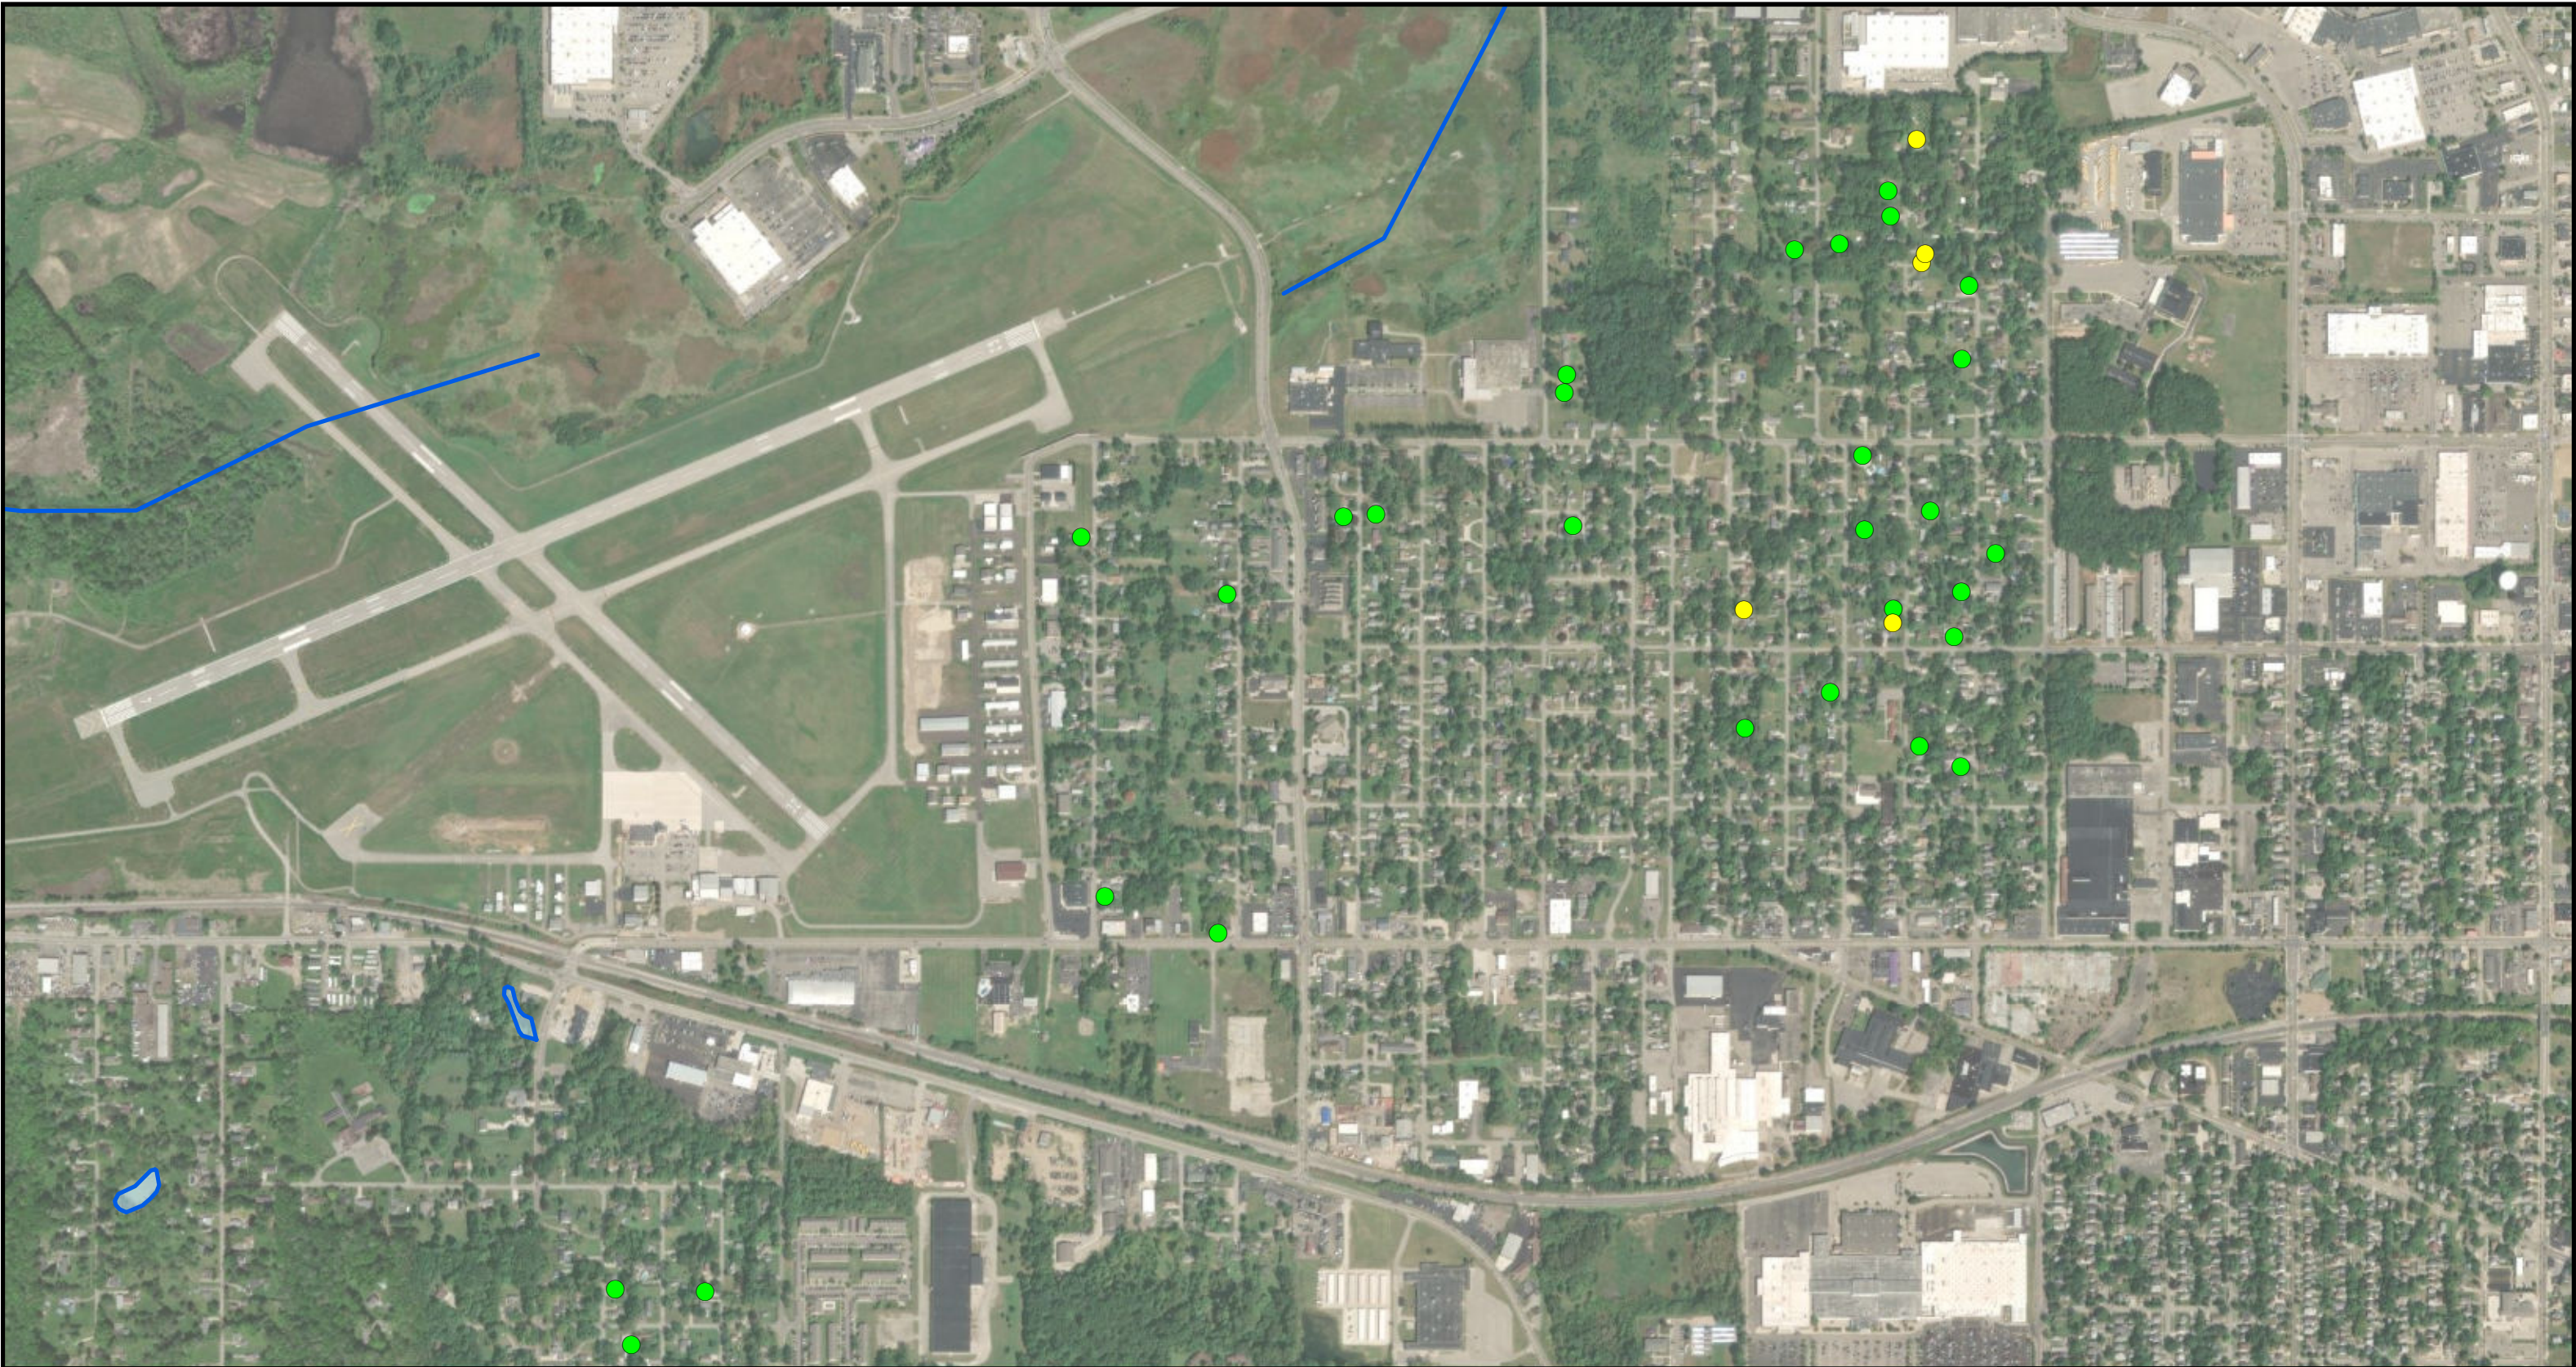

AECOM

Drawn: DP Date: 5/19/2025

Approved: DB Date: 5/19/2025

Project #: 60733947



Legend

Drinking Water Well Sample

- No Detections of the Analyzed PFAS Substances
- One or more of the Analyzed PFAS Substances Detected
- One or more of the 7 PFAS Substances with Michigan DWC
- Detected at or Above Criteria
- Surface Water Body

Michigan Drinking Water Criteria (DWC), ppt
PFHxA = 400,000 PFHxS = 51
PFOA = 8 PFOS = 16
PFNA = 6 HFPO-DA = 370
PFBS = 420



0 800 1,600 2,400 Feet

FIGURE 3A
PFAS CRITERIA HEATMAP
AREAS 1 & 2

CITY OF JACKSON
JACKSON COUNTY, MI