

2018-2019 PFOS Sample Results (Groundwater)


- ND at the RL
- > RL and < 12 ng/L (GSI)
- > 12 ng/L

2019 PFOS Sample Results (Surface Water)


- ▲ ND at the RL
- ▲ > RL - < 12 ng/L (GSI)
- Sheet Pile Location
- Portage Creek

SAMPLE LABEL

- PS-4 — Sample Location
- Total PFAS = 271 ng/L — Total of PFAS analytical results
- PFOS = 74 ng/L — PFOS analytical result

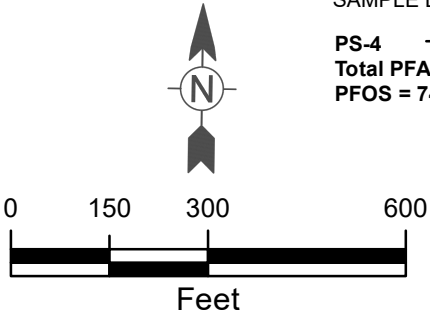

ND = Not Detected
 RL = Reporting Limit
 PFAS = Per- and polyfluoroalkyl substances
 PFOS = Perfluorooctane sulfonic acid
 ng/L = nanograms per liter
 GSI = Groundwater Surface Water Interface Criterion

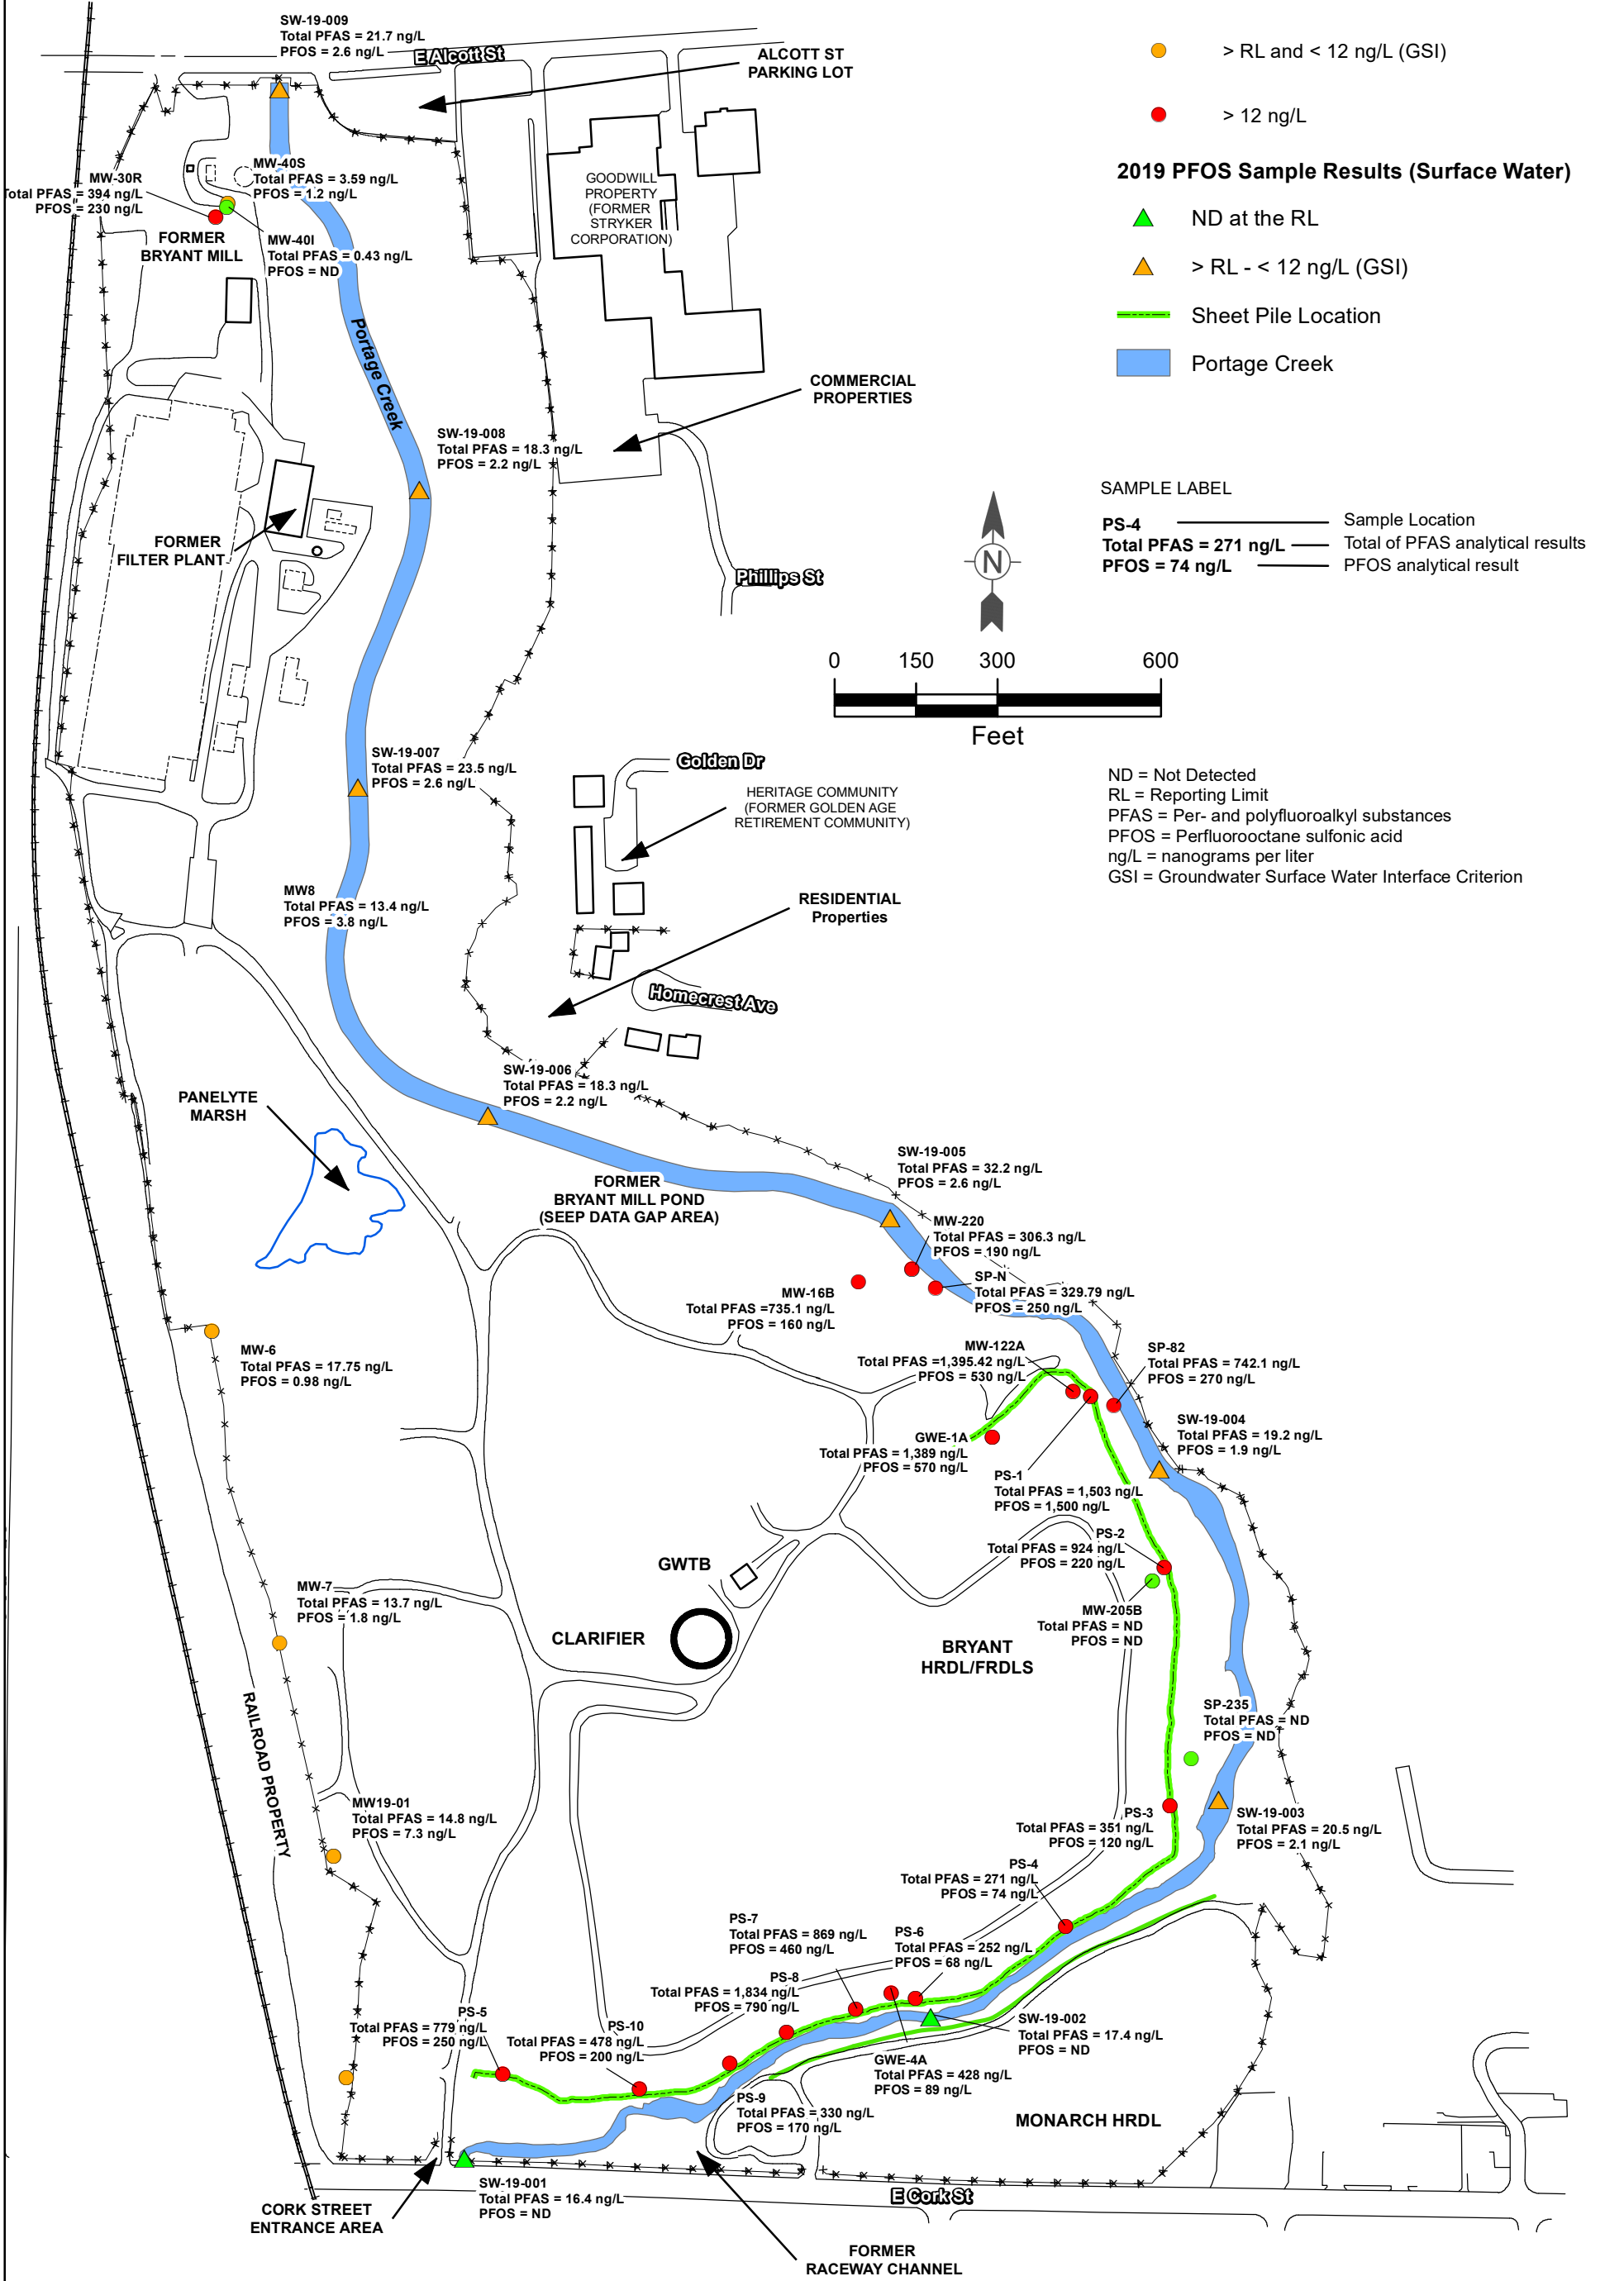

2/14/2020 - 8:37:07 AM - P:\Projects\Le Petomane\Lyondell Environmental Custodial Trust\Lyondell ECT - Allied Paper Mill\GIS\Figures\PDI_ER15-1 - PFAS Site Results_GW_SW_ARR.mxd - ally.racisz



710 AVIS DRIVE, SUITE 100
 ANN ARBOR, MI 48108
 PHONE: 734.665.6000

PRE-DESIGN INVESTIGATION EVALUATION REPORT
 ALLIED PAPER SUPERFUND SITE
 OPERABLE UNIT 1, ALLIED LANDFILL
 LYONDELL ENVIRONMENTAL CUSTODIAL TRUST
 KALAMAZOO, MICHIGAN
**TOTAL PFAS AND PFOS ANALYTICAL RESULTS
 GROUNDWATER AND SURFACE WATER 2018 AND 2019**

Project No: 117-7503005-2020
 Date: 2/14/2020
 Designed by: MC
 FIGURE
5-1

Bar Measures 1 inch

Copyright: Tetra Tech