


Results – PFAS In Groundwater

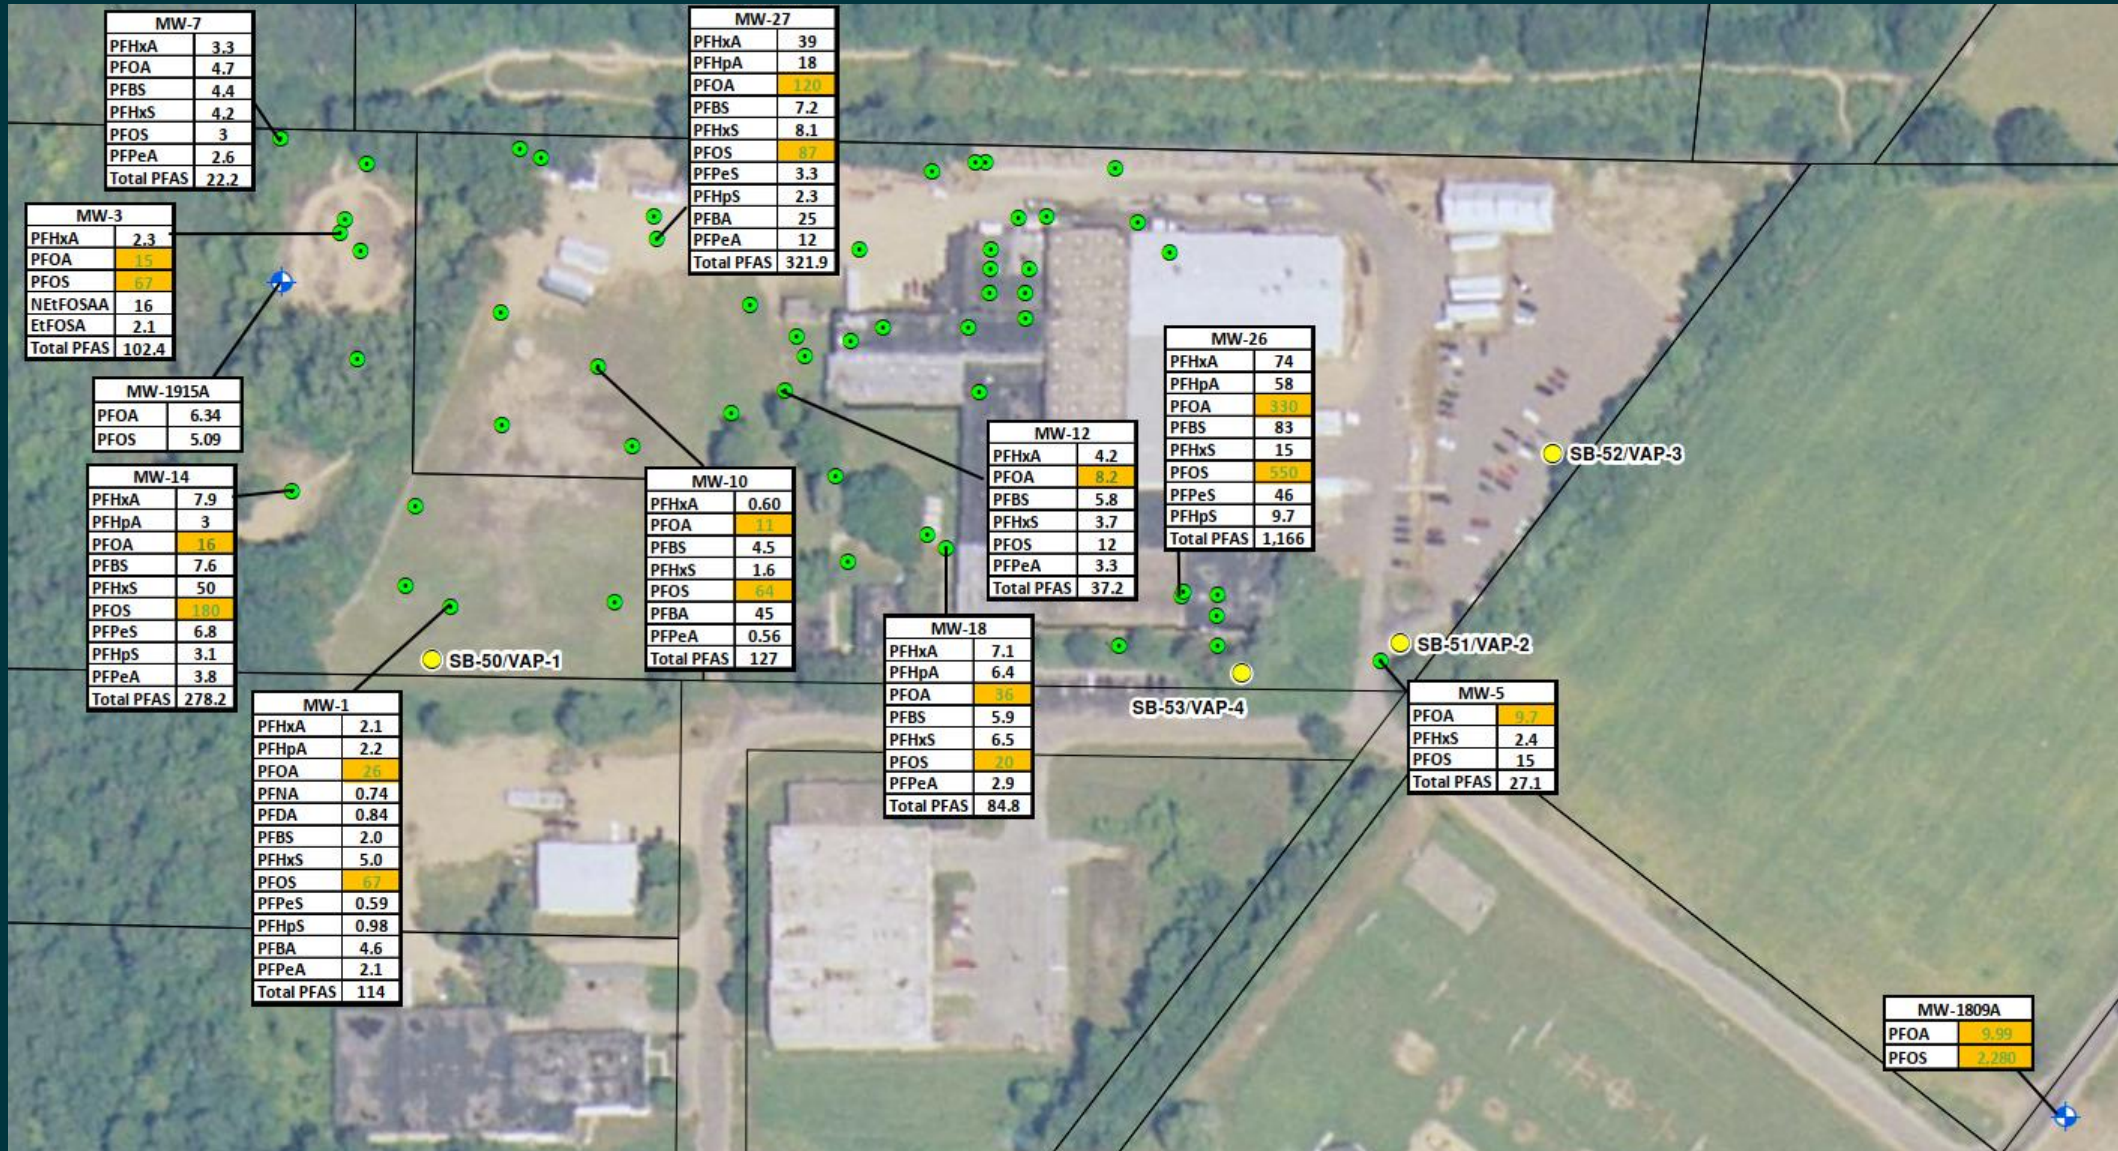

Concentrations shown in ng/L

Exceeds Nonresidential Drinking Water Criteria