


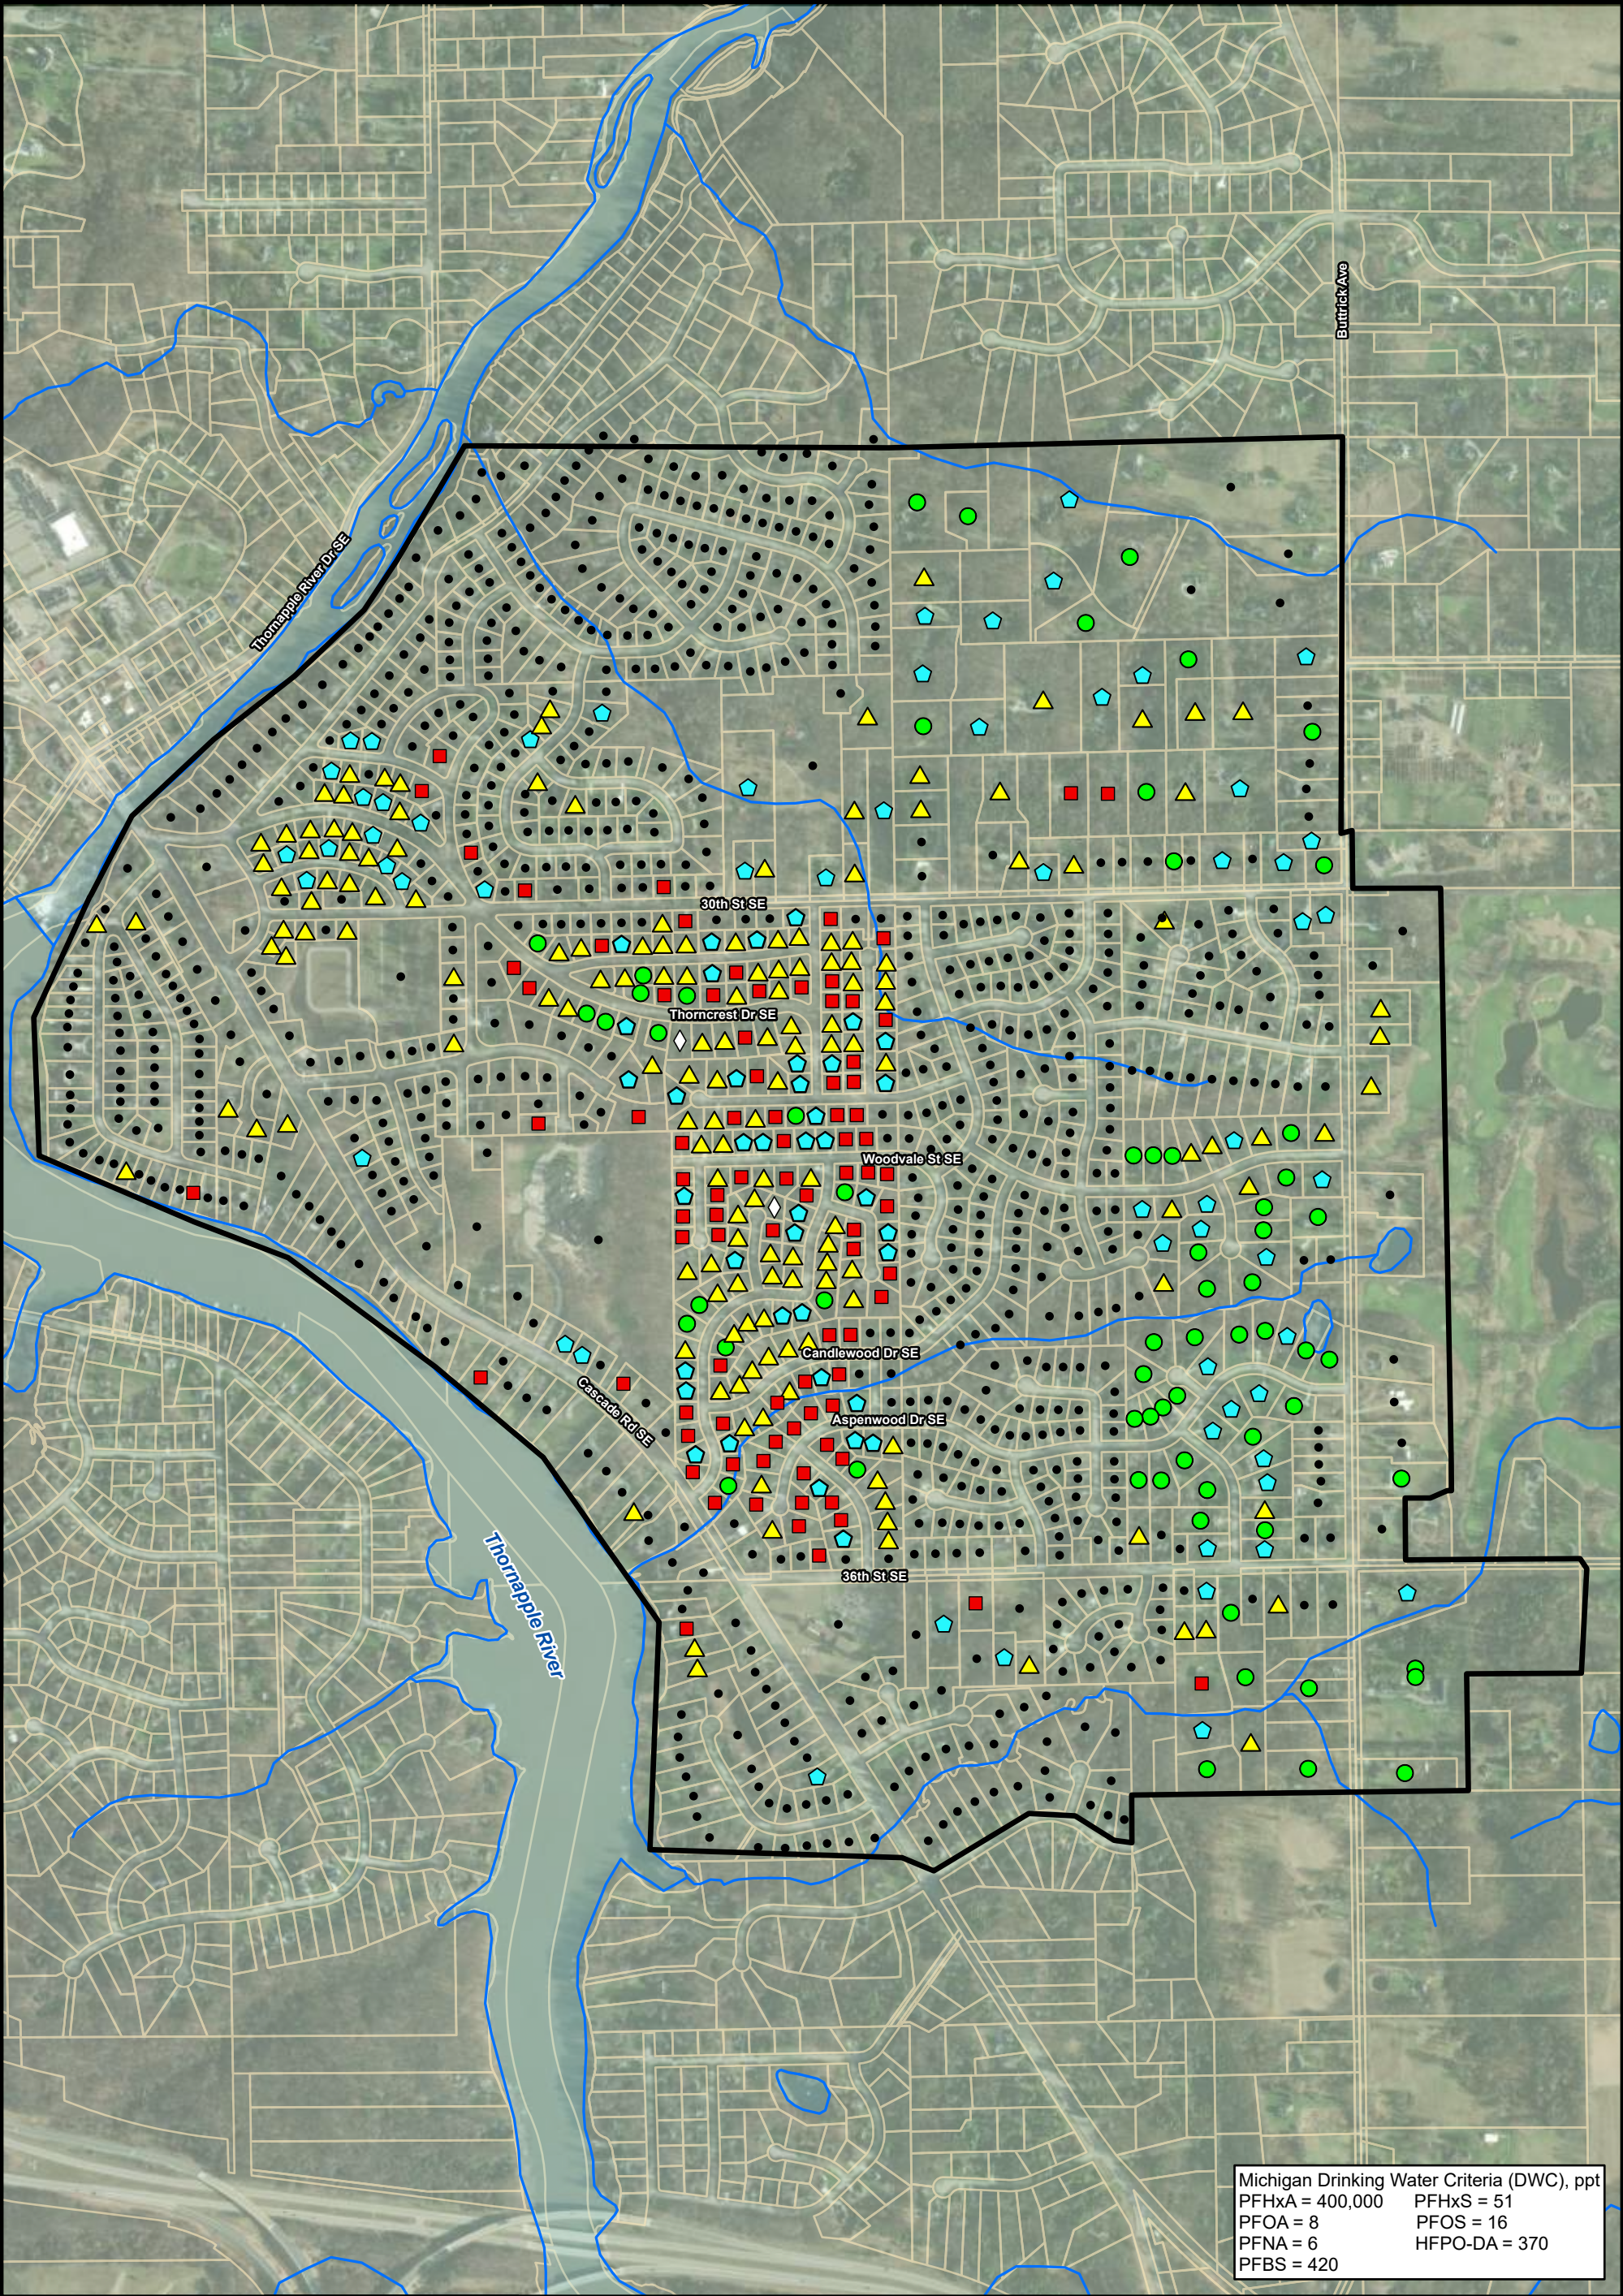

Michigan Drinking Water Criteria (DWC), ppt
PFHxA = 400,000 PFHxS = 51
PFOA = 8 PFOS = 16
PFNA = 6 HFPO-DA = 370
PFBS = 420

Drawn: DP Date: 6/29/2026

Approved: DB Date: 6/29/2026

Project #: 60785632



Legend
Drinking Water Well Sample
 No Detections of the Analyzed PFAS Substances
 One or more of the Analyzed PFAS Substances Detected
 Substances with Michigan DWC Detected at or Above Criteria

Sample Status
 Identified to Sample
 Canvassed
 Connected to Municipal Water

Sampling Area
 Parcel Boundary
 Surface Water Body

0 910 1,820 Feet

FIGURE 1
PFAS CRITERIA HEAT MAP

DRAFT

MPART - ASPENWOOD DRIVE
KENT COUNTY, MI