


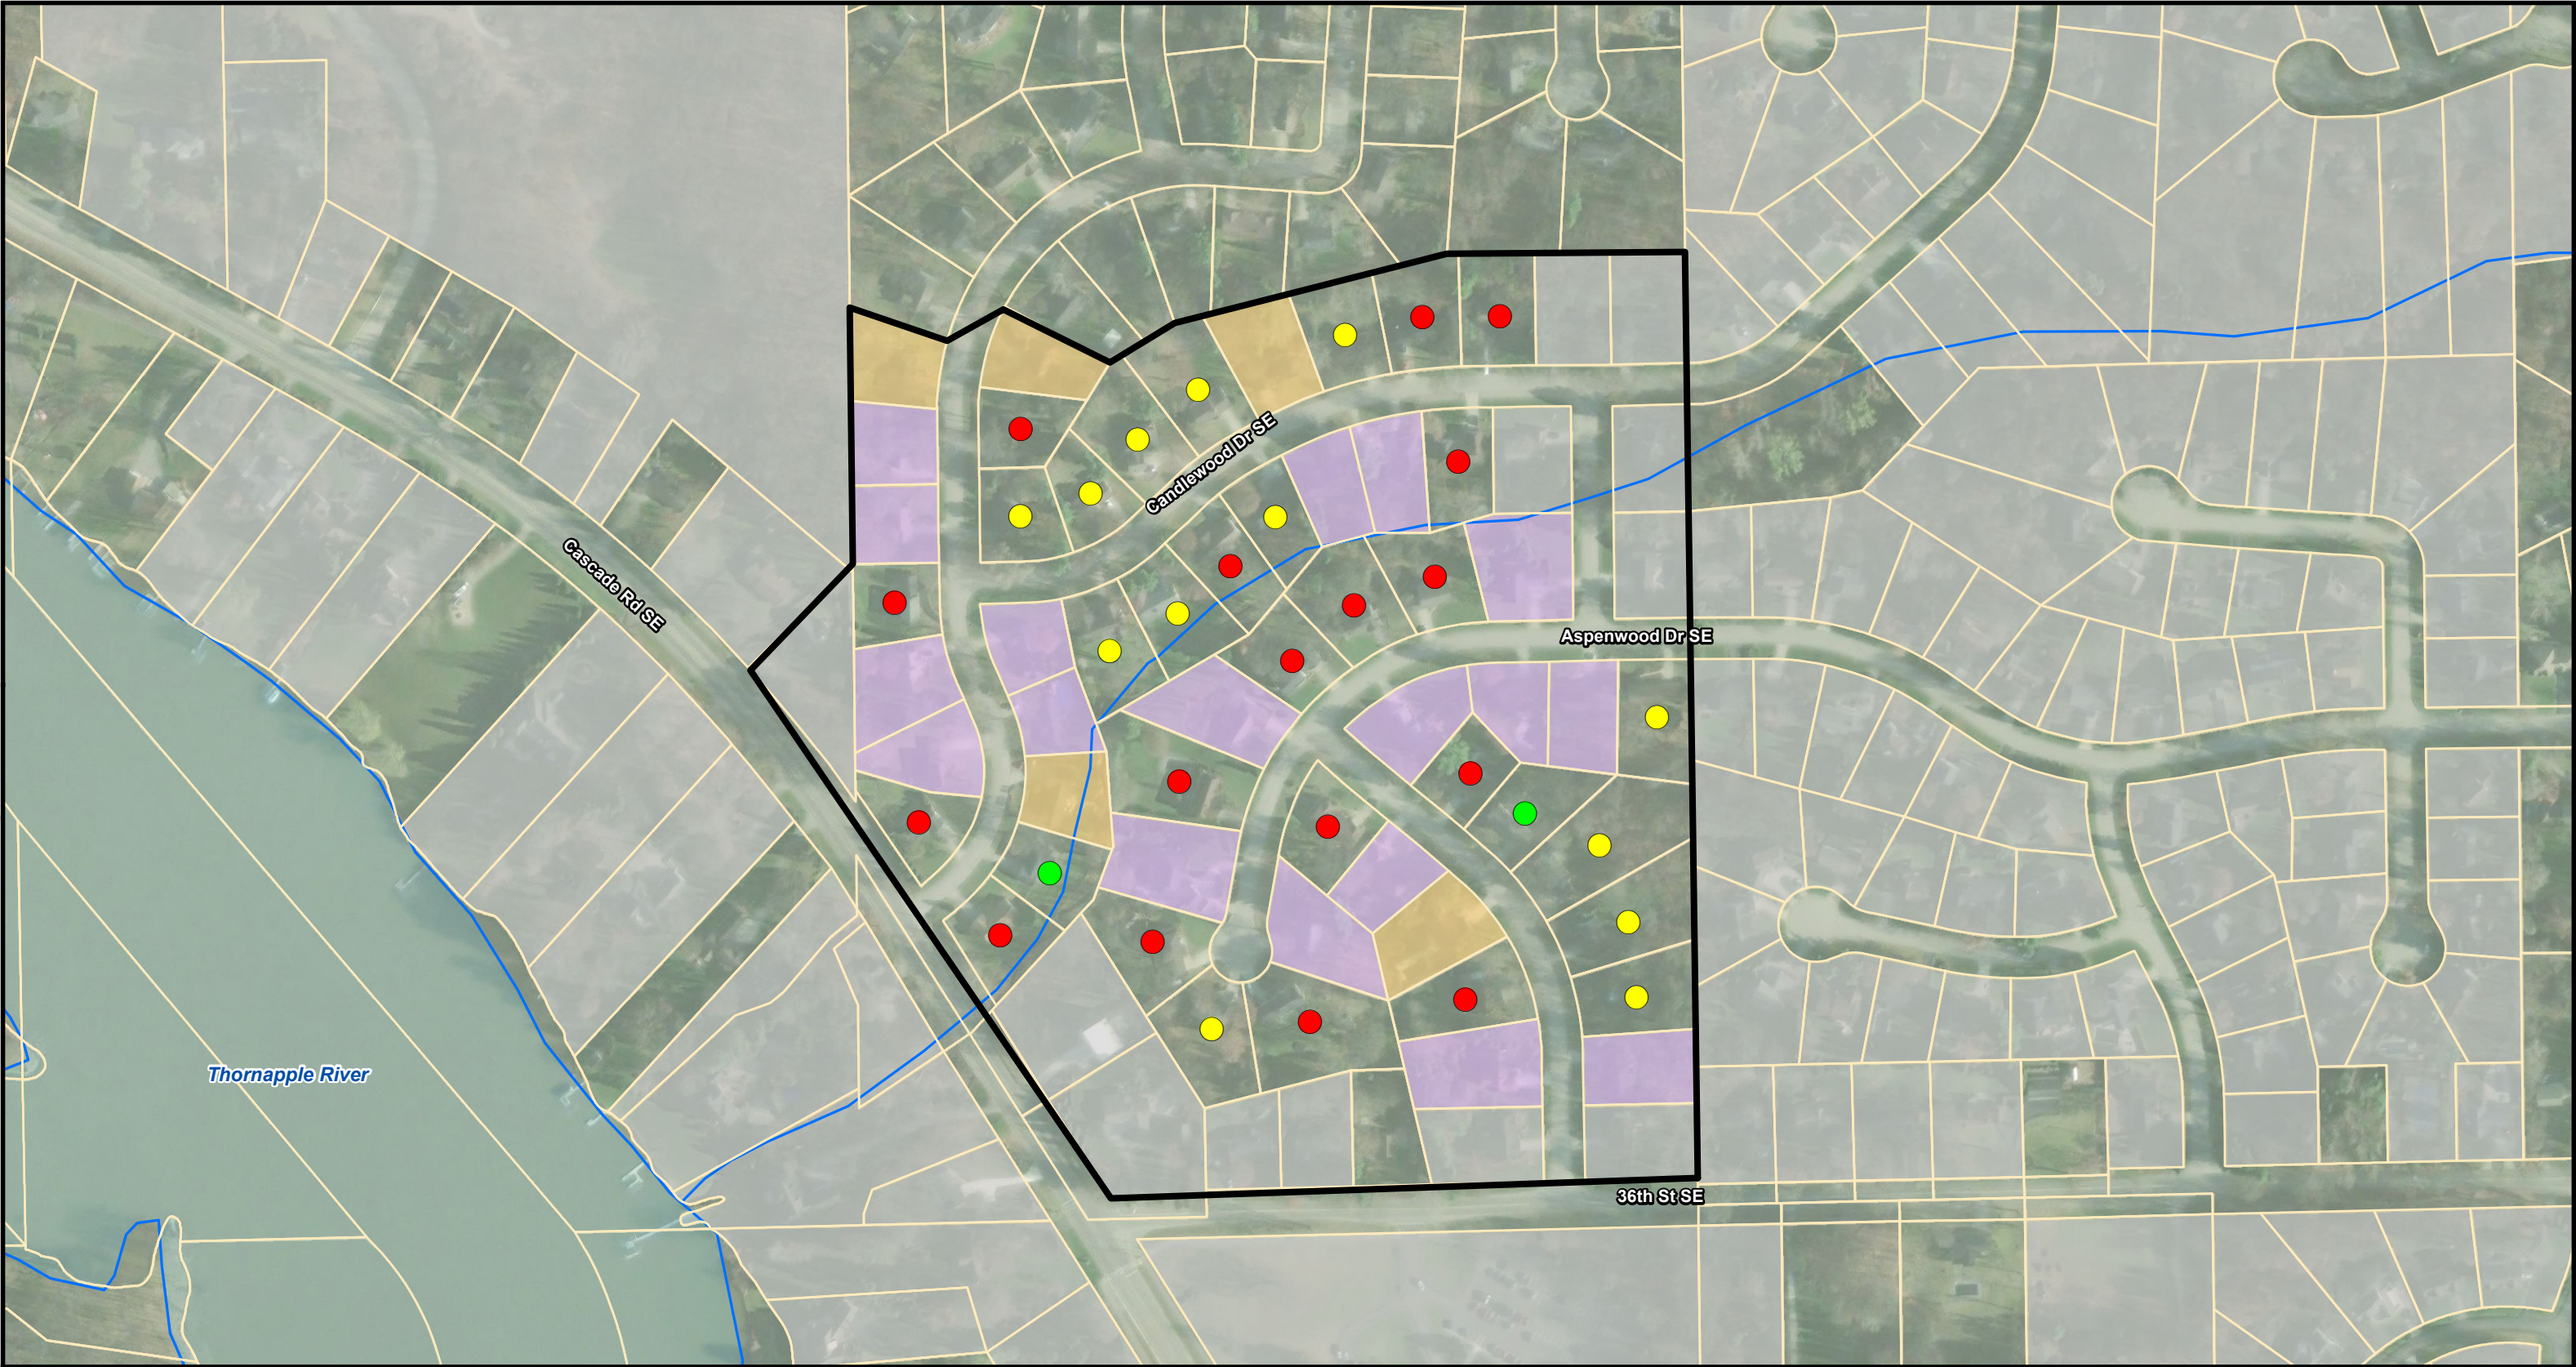

Drawn: DP

Date: 11/24/2025

Approved: DB

Date: 11/24/2025

Project #: 60560354



Legend

Drinking Water Well Sample

No Detections of the Analyzed PFAS Substances

One or more of the Analyzed PFAS Substances Detected

One or more of the 7 PFAS Substances with Michigan DWC Detected at or Above Criteria

Surface Water Body

SampleStatus

Access Agreement Obtained

No Response to Sampling Request

Connected to Municipal Water

Parcel Boundary

State-Funded Sampling Area

Michigan Drinking Water Criteria (DWC), ppt

PFHxA = 400,000

PFOA = 8

PFNA = 6

PFBS = 420

PFHxS = 51

PFOS = 16

HFPO-DA = 370

0

250

500

Feet

FIGURE 1

PFAS CRITERIA HEAT MAP

DRAFT

MPART - ASPENWOOD DRIVE

KENT COUNTY, MI

Document Path: C:\Users\lendriss-periardi\OneDrive - AECOM\60560354_MI_State-Wide_PFAS_Tech_Sup_(MPART)\900_CAD_GIS\920_929_GIS\Aspenwood\251105\Work\Aspenwood_PFAS_Criteria_Heatmap.mxd

Aerial: ESRI World Imagery