




Drawn:	DP	Date:	9/17/2026
Approved:	DB	Date:	9/17/2026
Project #: 60778704			

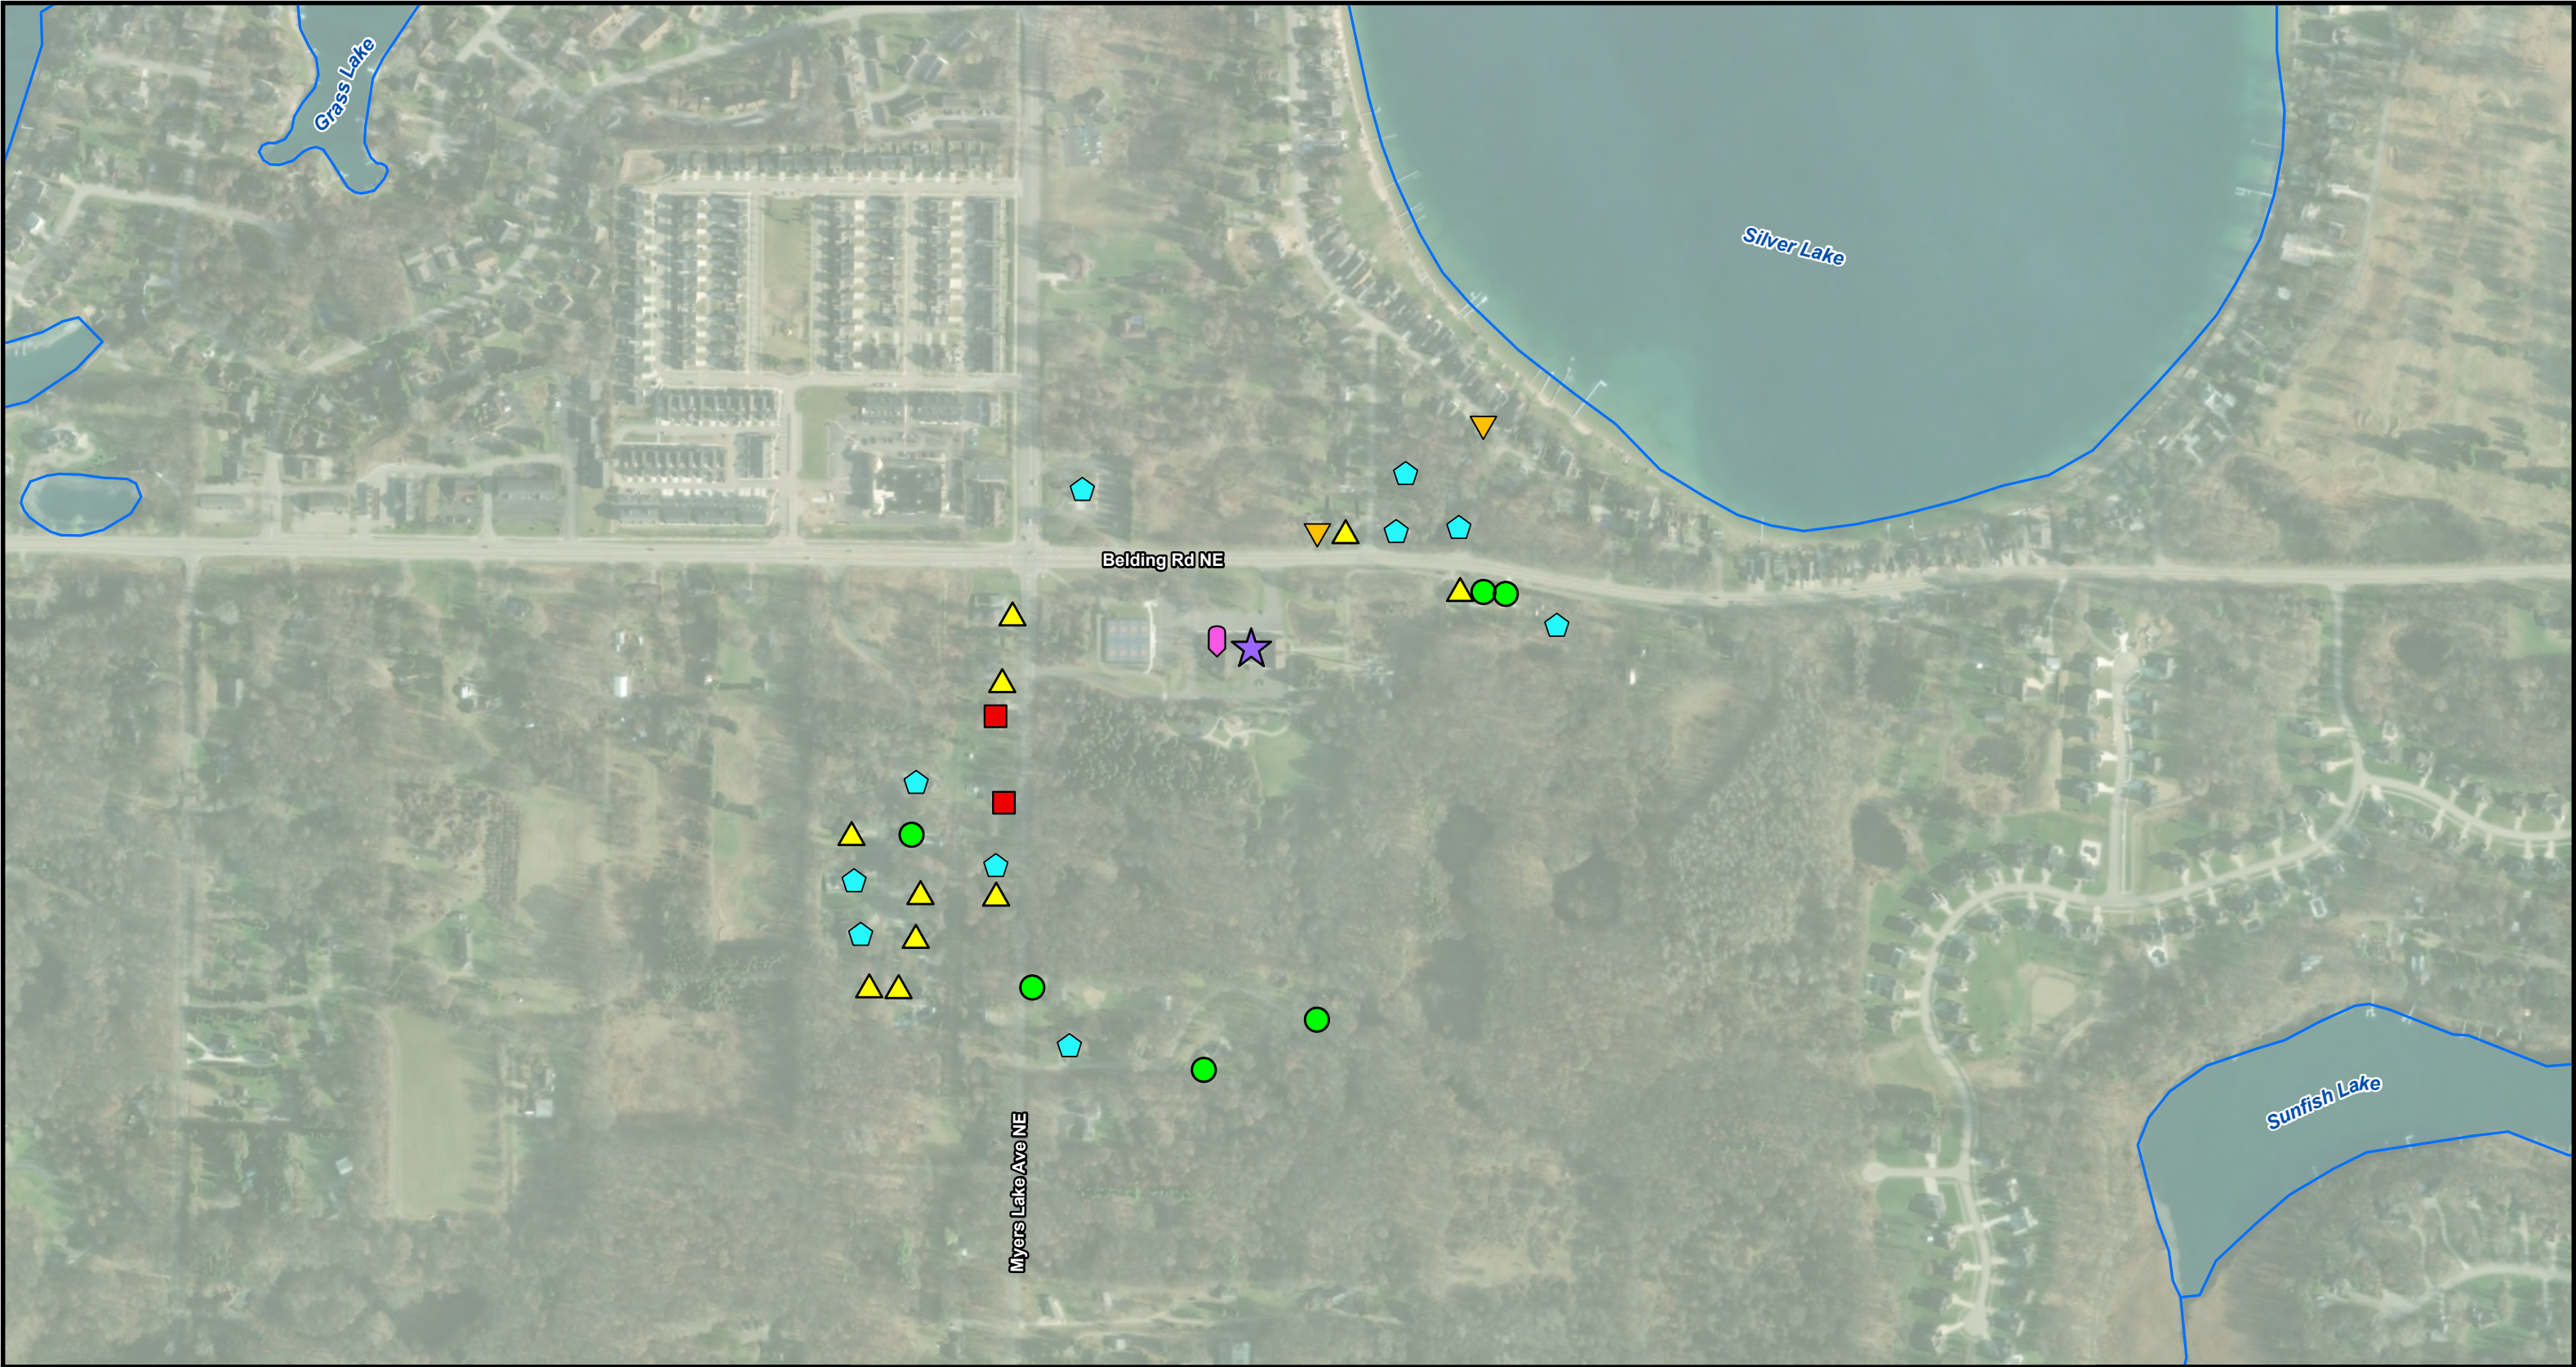

Legend

- Cannon Township Fire Department
- Drinking Water Well Sample**
- No Detections of the Analyzed PFAS Substances
- One or more of the Analyzed PFAS Substances Detected
- One or more of the 7 PFAS Substances with Michigan DWC Detected at or Above Criteria
- Canvassed
- Declined Sampling
- No Response to Letter

Michigan Drinking Water Criteria (DWC), ppt

PFHxA = 400,000	PFHxS = 51
PFOA = 8	PFOS = 16
PFNA = 6	HFPO-DA = 370
PFBS = 420	

Surface Water Body

Surface Water Body

Scale

0 500 1,000 Feet

FIGURE 1
PFAS CRITERIA HEAT MAP

MPART - CANNON TOWNSHIP
KENT COUNTY, MI