


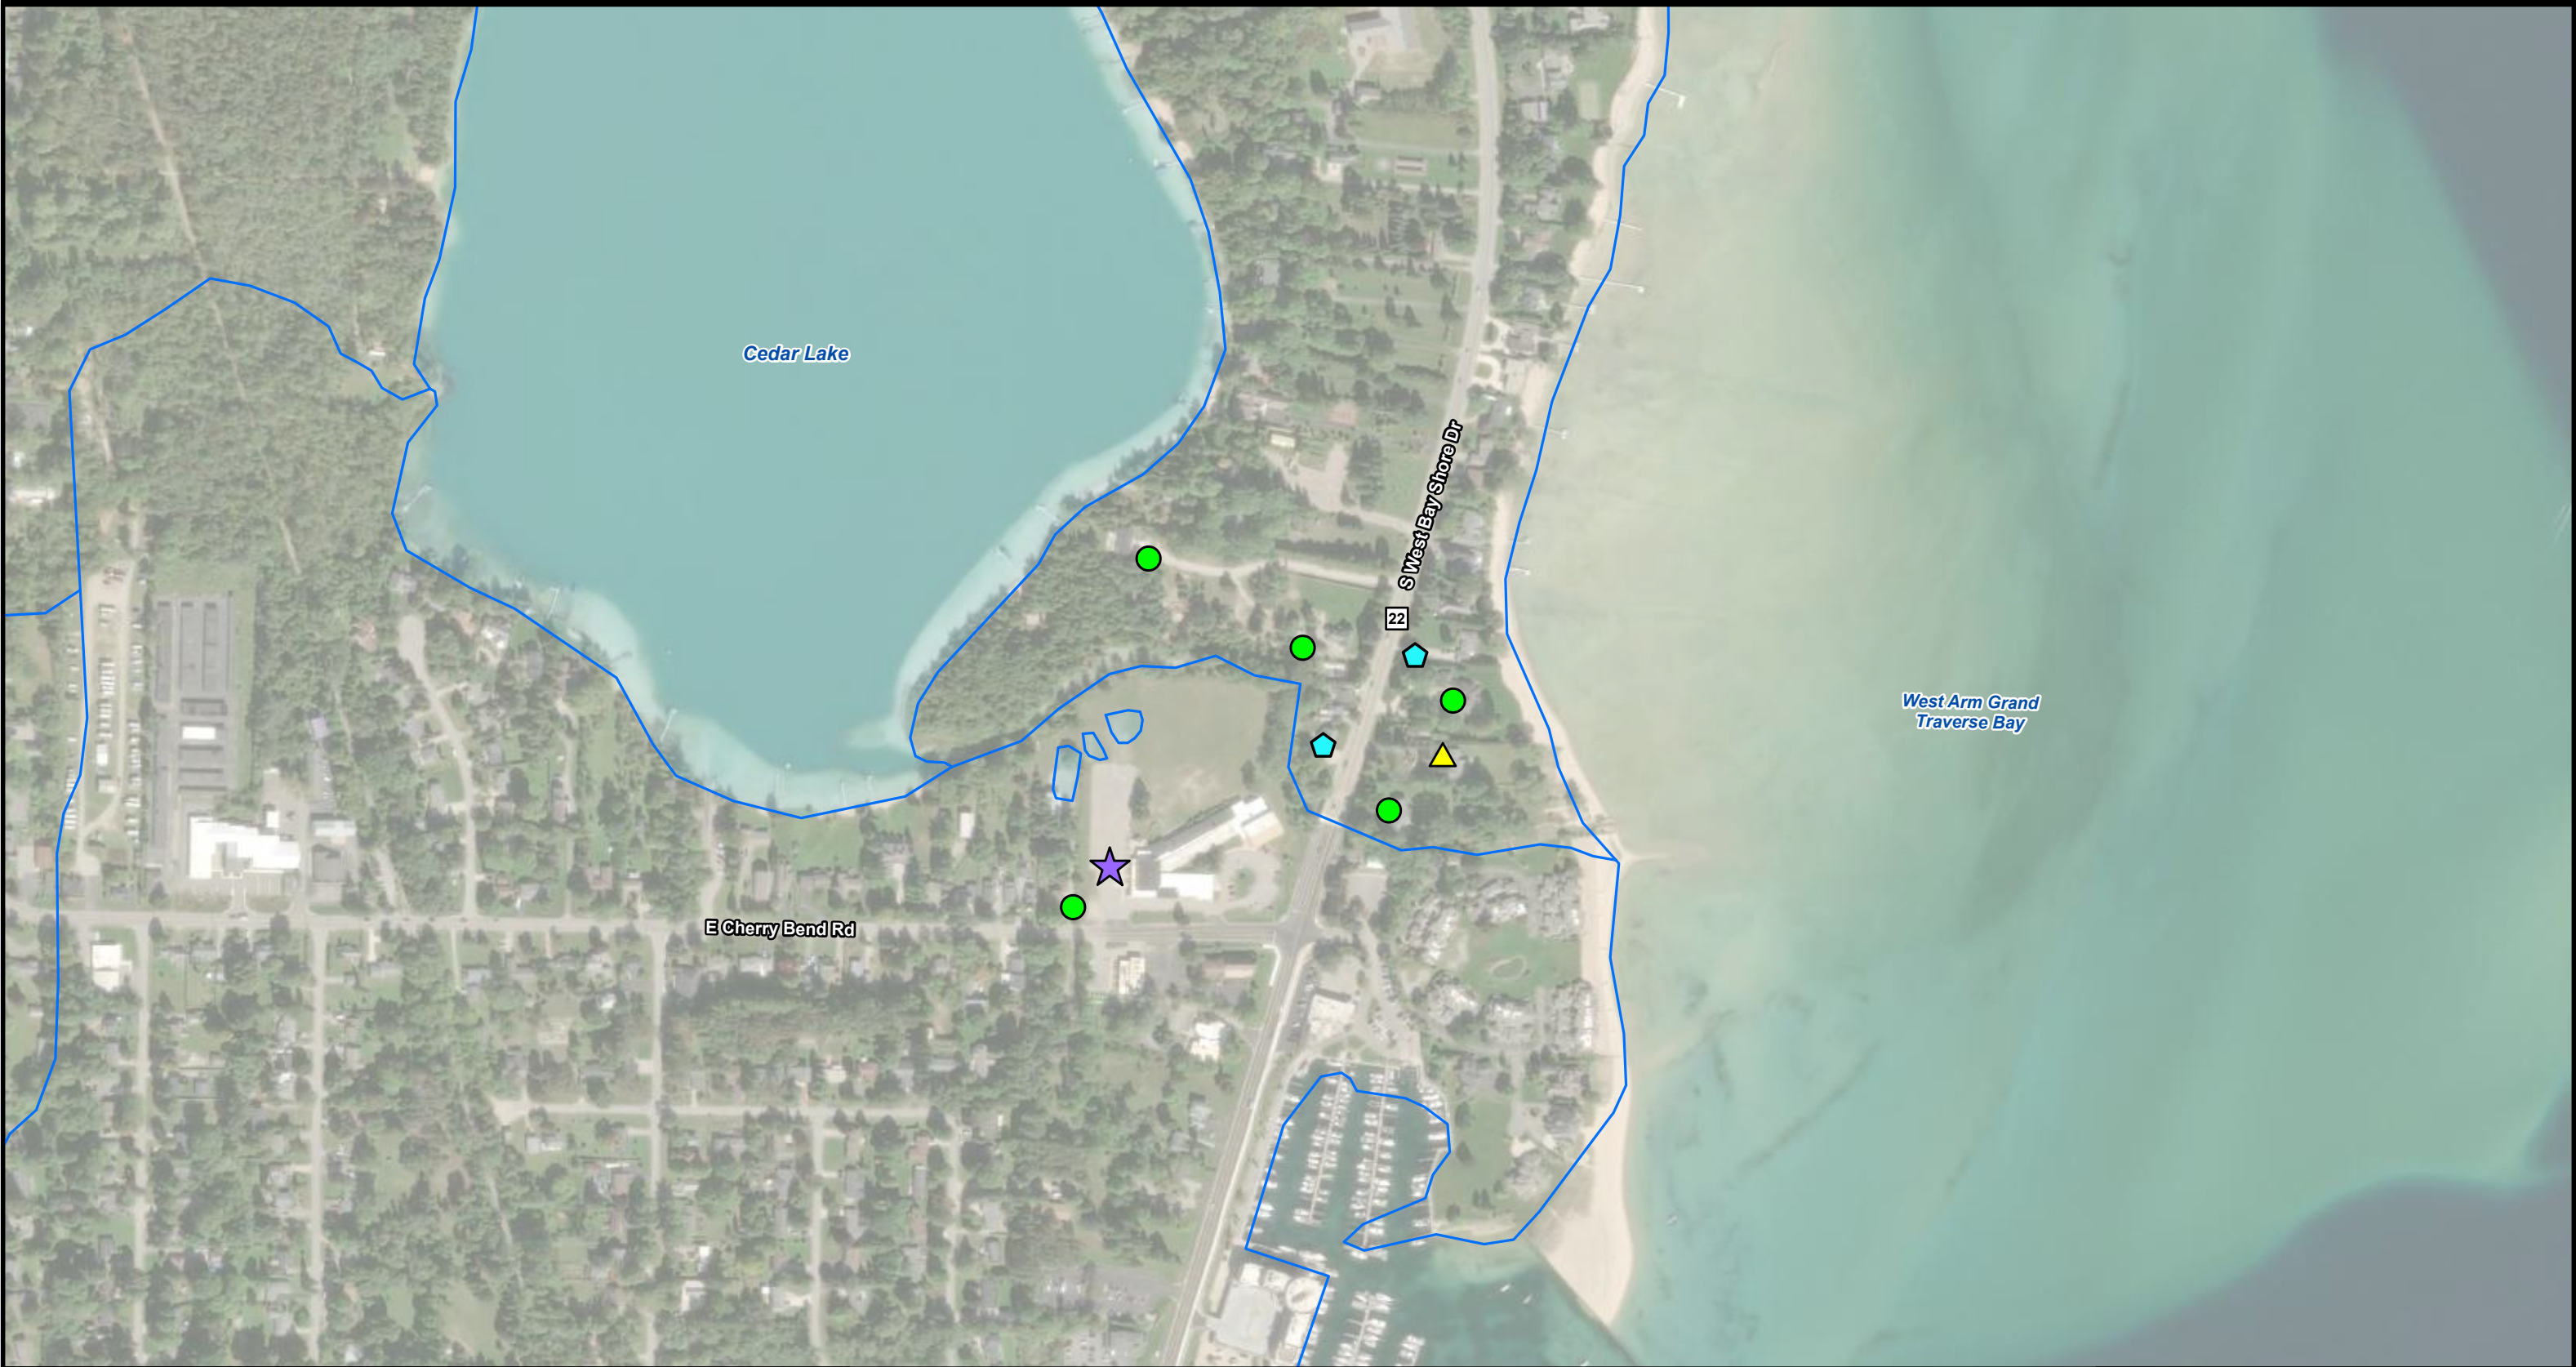

Drawn: DP Date: 6/23/2026

Approved: DB Date: 6/23/2026

Project #: 60778704

Legend

- Former Grand Traverse Overall Supply
- Drinking Water Well Sample**
 - No Detections of the Analyzed PFAS Substances
 - One or more of the Analyzed PFAS Substances Detected
 - One or more of the 7 PFAS Substances with Michigan DWC Detected at or Above Criteria

Sampling Status

- Surface Water Body
- Canvassed

Michigan Drinking Water Criteria (DWC), ppt

- PFHxA = 400,000
- PFOA = 8
- PFNA = 6
- PFBS = 420

PFHxS = 51

- PFOS = 16
- HFPO-DA = 370

FIGURE 1
PFAS CRITERIA HEAT MAP

MPART - GRAND TRAVERSE
OVERALL SUPPLY
LEELANAU COUNTY, MI