
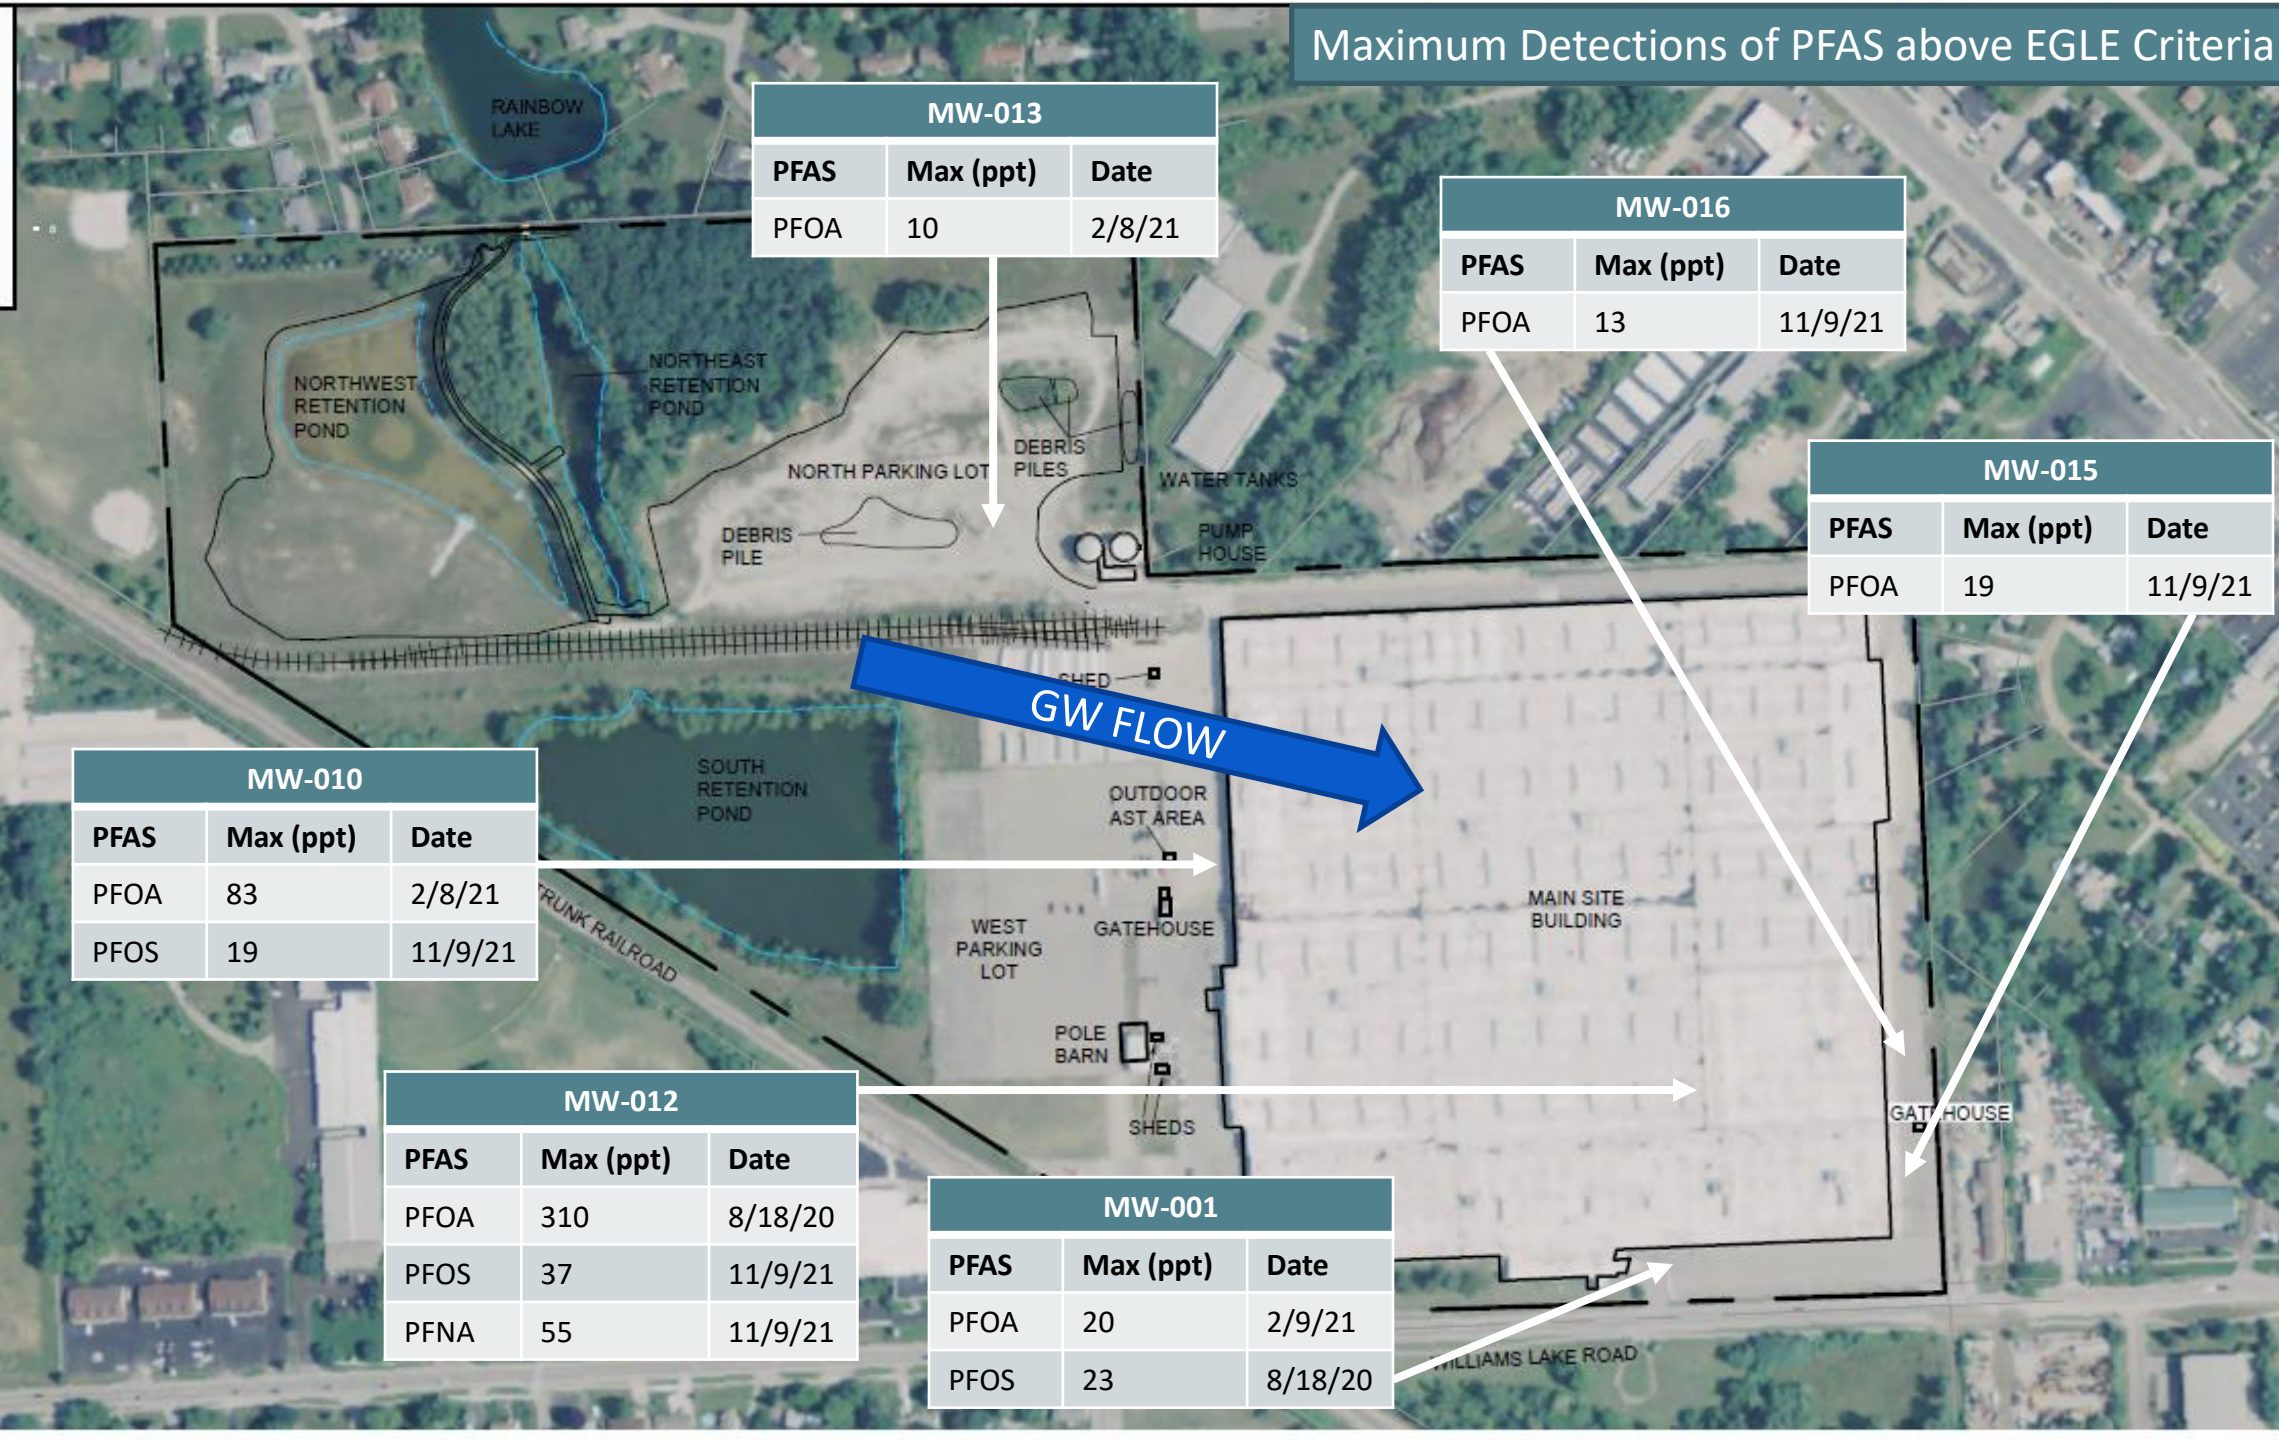


Maximum Detections of PFAS above EGLE Criteria



MW-013		
PFAS	Max (ppt)	Date
PFOA	10	2/8/21

MW-016		
PFAS	Max (ppt)	Date
PFOA	13	11/9/21

MW-015		
PFAS	Max (ppt)	Date
PFOA	19	11/9/21

MW-010		
PFAS	Max (ppt)	Date
PFOA	83	2/8/21
PFOS	19	11/9/21

MW-012		
PFAS	Max (ppt)	Date
PFOA	310	8/18/20
PFOS	37	11/9/21
PFNA	55	11/9/21

MW-001		
PFAS	Max (ppt)	Date
PFOA	20	2/9/21
PFOS	23	8/18/20

**GW FLOW** →