


Document Path: G:\MDEQ-LOE\_32931065190\_100.xxxx\la\_MXD\June 2021 Sampling Event\Figure3\_2021GWExceedances.mxd

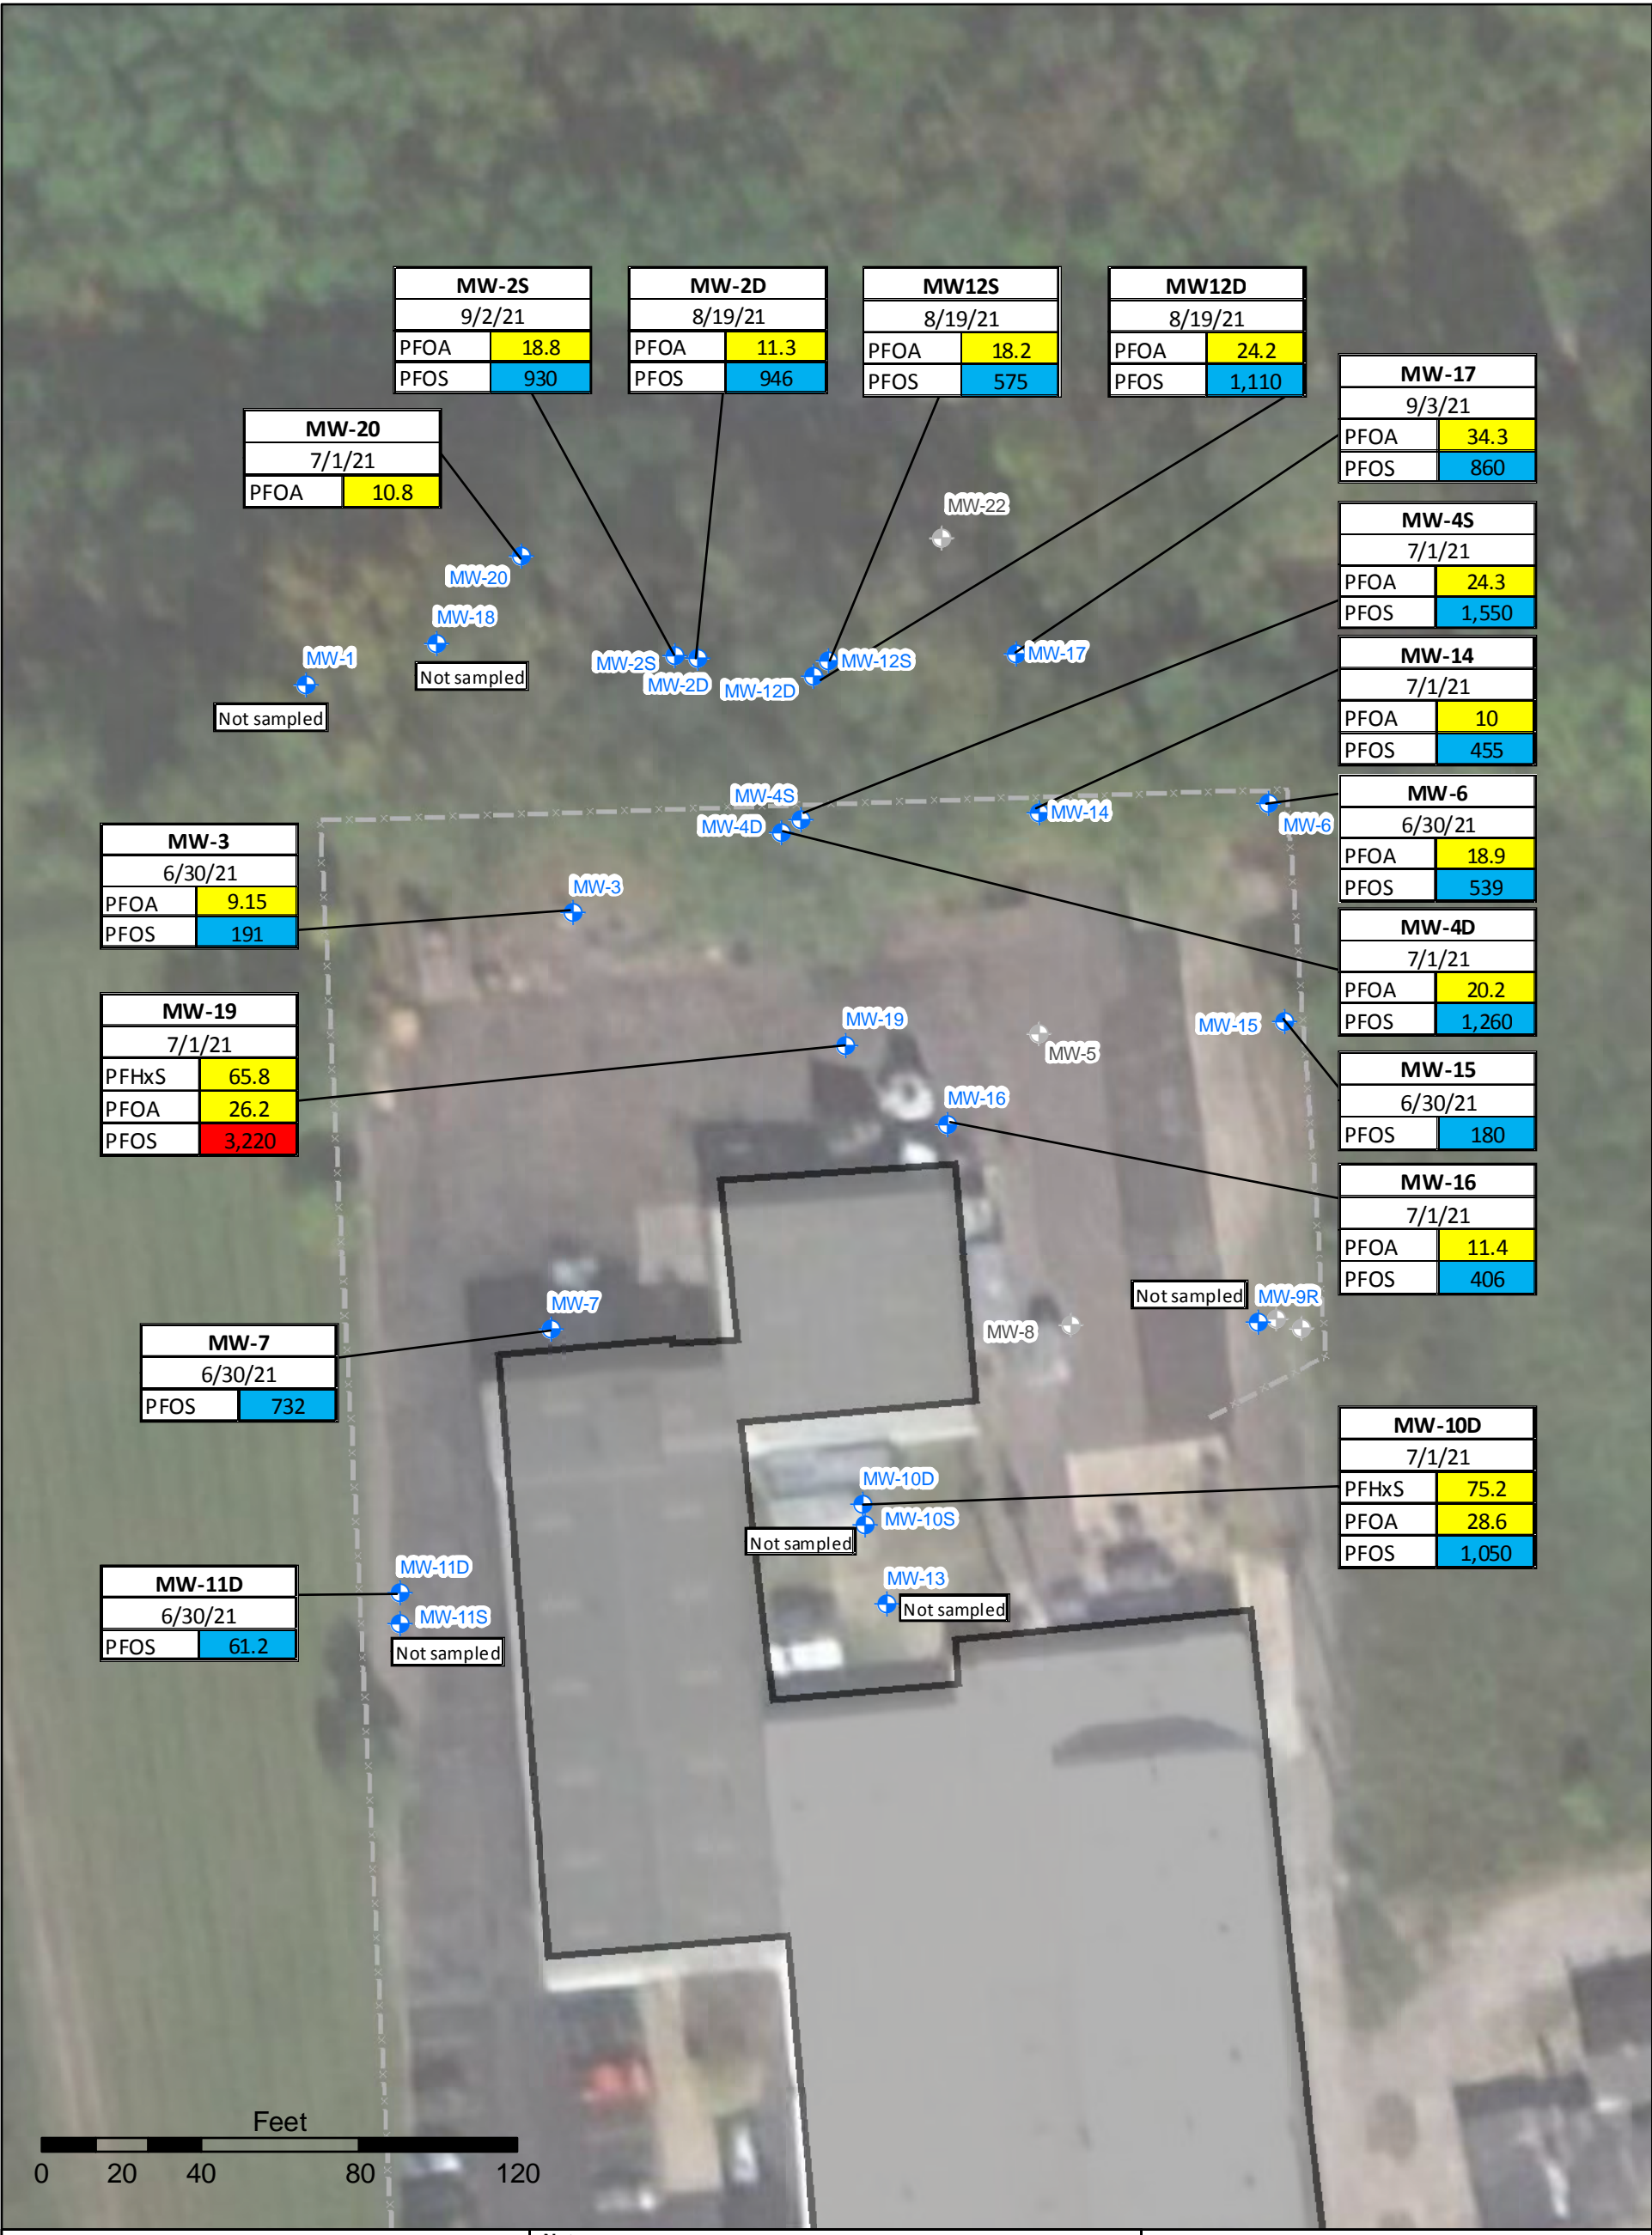

**Legend**

- Existing Monitoring Well
- Wells Not Located
- Warehouse Boundary
- Fenced Boundary

Yellow	Result exceeds DW criteria
Blue	Result exceeds GSI and DW criteria
Red	Result exceeds Water Solubility, GSI, and DW criteria

**Notes:**  
 Results are reported in nanograms per liter (ng/L)  
 Samples were not collected from MW-1, MW-9R, MW-10S, MW-11S, MW-18, and MW-22.  
 DW = drinking water  
 EGLE = Michigan Department of Environment, Great Lakes, and Energy  
 GSI = groundwater-surface water interface  
 PFAS = Perfluoroalkyl and Polyfluoroalkyl Substances  
 PFHxS = Perfluorohexanesulfonic Acid  
 PFOA = Perfluorooctanoic Acid  
 PFOS = Perfluorooctane Sulfonate

Job No.	3293165190
Created By:	MSC
Checked By:	BMS
Date:	11/11/2021

**FIGURE 2**  
**PFAS in Groundwater Exceeding EGLE Part 201 Criteria**

**Former CYB Tool Site**  
**42056 Michigan Avenue**  
**Canton Township, Michigan 48188**

**wood.**  
 46850 Magellan Drive, Suite 190  
 Novi, Michigan 48377

Service Layer Credits: Source: Esri, Maxar, GeoEye, Earthstar Geographics, CNES/Airbus DS, USDA, USGS, AeroGRID, IGN, and the GIS User Community